


Campbelltown Hospital Redevelopment



AIR MONITORING REPORT FEBRUARY 2020

Thursday, 27 February 2020

Prepared For CPB

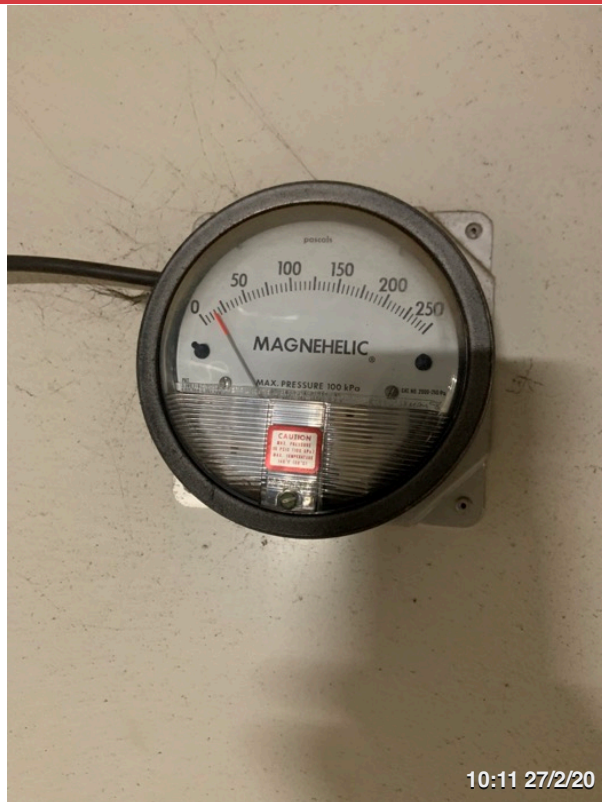

High Level AHU CTC

Baseline pressure drop across filter bank.



Low Level AHU CTC

Baseline pressure drop across filter bank.



AHU 3.15



AHU 3.06



Building D



AHU 3.07



AHU 3.09





AHU 3.11



AHU 3.16





AHU 3.05



**Western Plantroom
Outside Air**



Cooling Tower Area



Cooling Tower Area

Building D



AHU 3.03



AHU 3.12





AHU 3.10



AHU 3.14






AHU 3.08



AHU 3.13



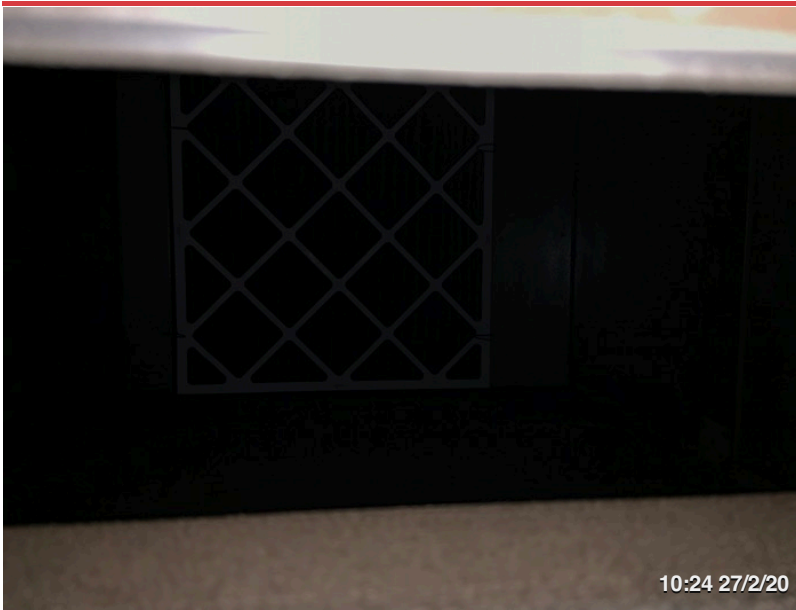

AHU 3.02



AHU 3.01



Building D



AHU 3.04




AHU 3.17



Building D



**Eastern Plantroom
Outside Air**

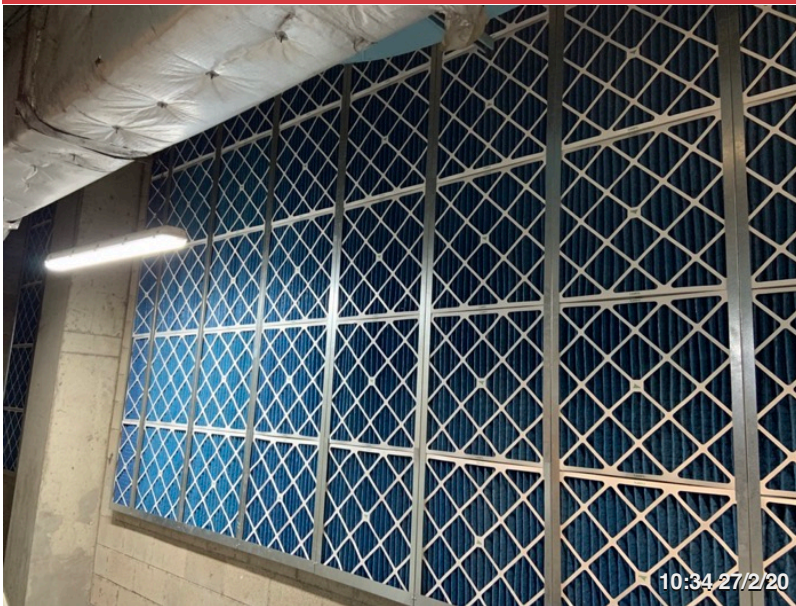


Building A Outside Air




AHU G7

No change in Differential Pressure across AHU Filter Bank.

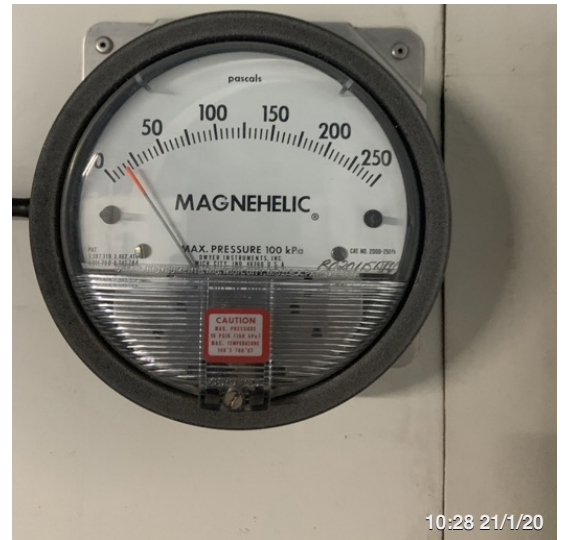

AHU LG1A

No change in Differential Pressure across AHU Filter Bank.

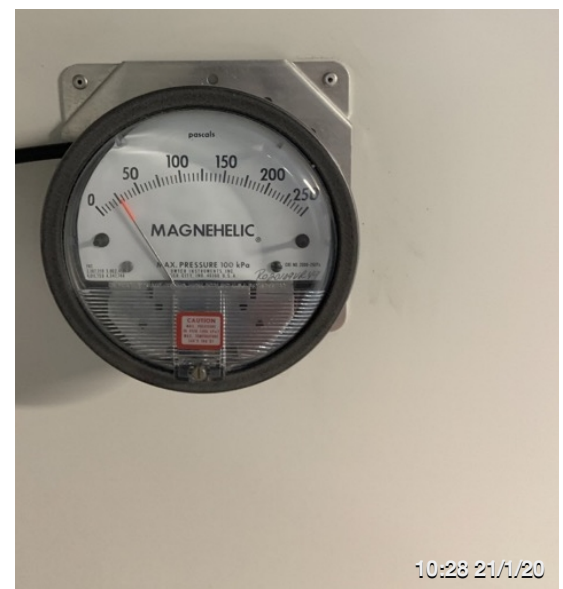



AHU LG1B

No change in Differential Pressure across AHU Filter Bank.



AHU 2.3

No change in Differential Pressure across AHU Filter Bank.






AHU G8

No change in Differential Pressure across AHU Filter Bank.



AHU 1.1


No change in Differential Pressure across AHU Filter Bank.

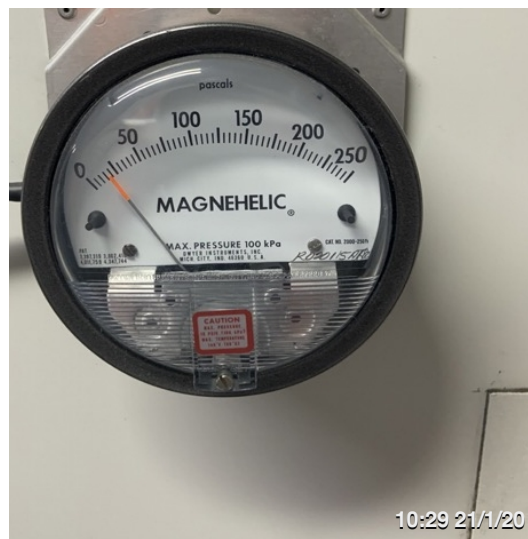



AHU LG2


No change in Differential Pressure across AHU Filter Bank.

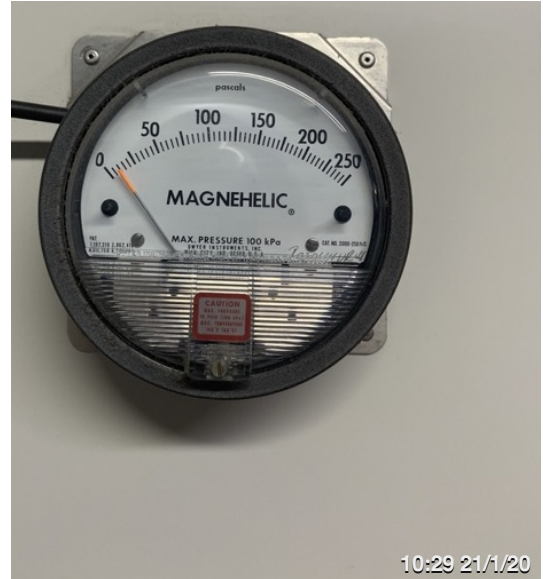

AHU G9

No change in Differential Pressure across AHU Filter Bank.



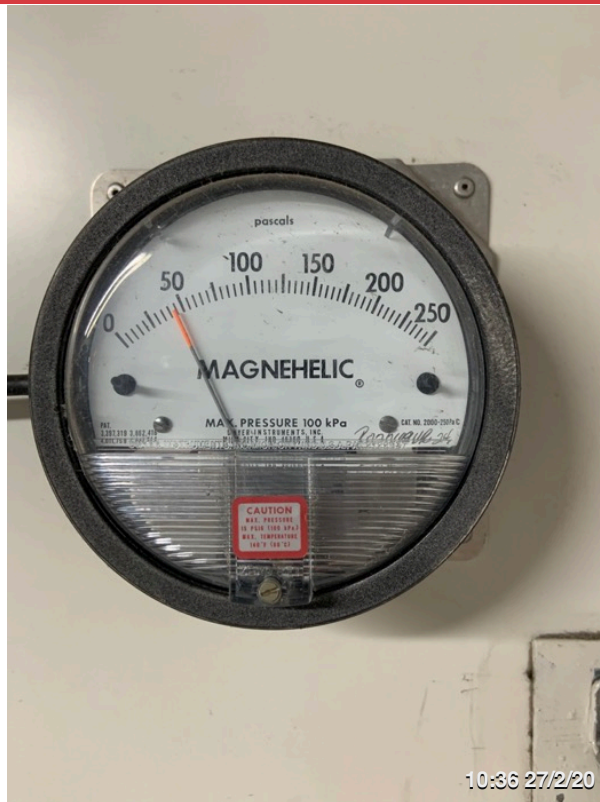

AHU G6


No change in Differential Pressure across AHU Filter Bank.



AHU G5


No change in Differential Pressure across AHU Filter Bank.



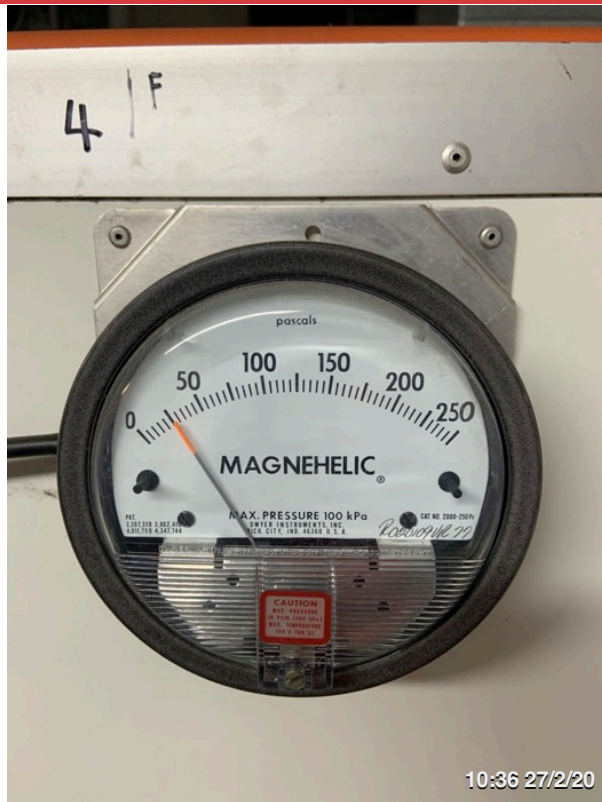

AHU G4

No change in Differential Pressure across AHU Filter Bank.

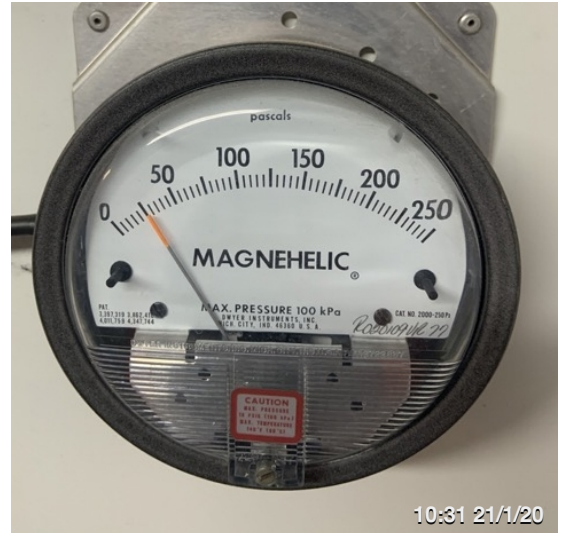

AHU G3


No change in Differential Pressure across AHU Filter Bank.






AHU 2.2

No change in Differential Pressure across AHU Filter Bank.

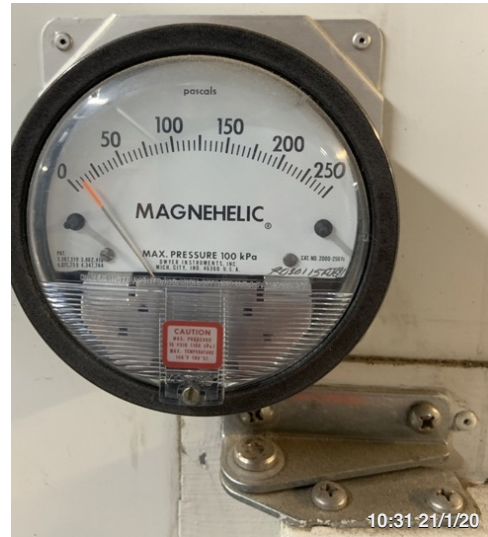

AHU 2.1


No change in Differential Pressure across AHU Filter Bank.

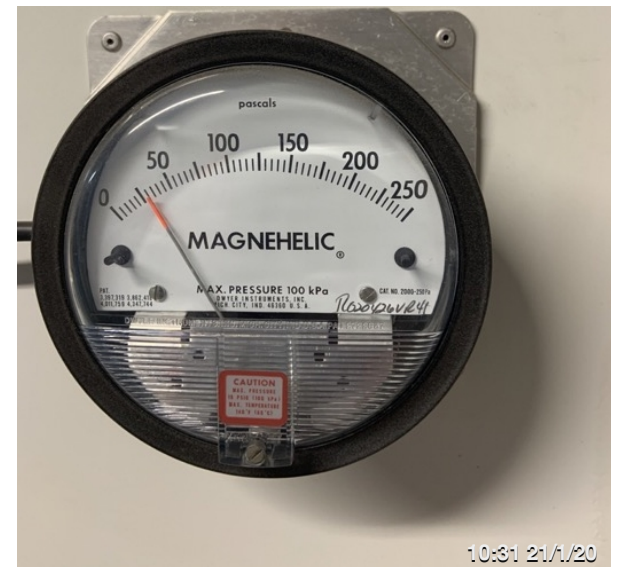




AHU G2

No change in Differential Pressure across AHU Filter Bank.

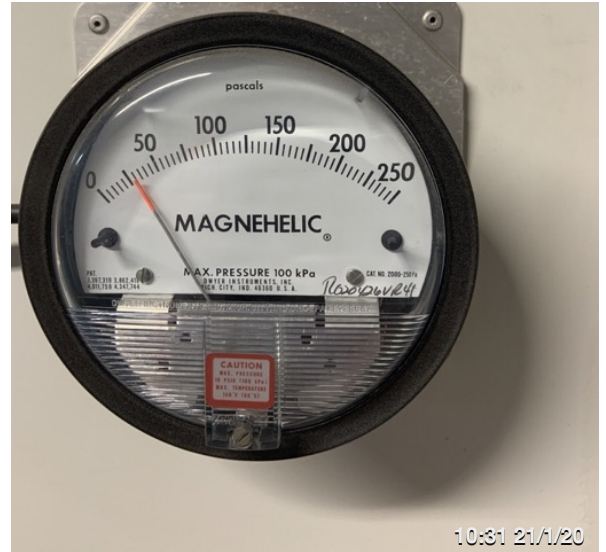

AHU G1

No change in Differential Pressure across AHU Filter Bank.

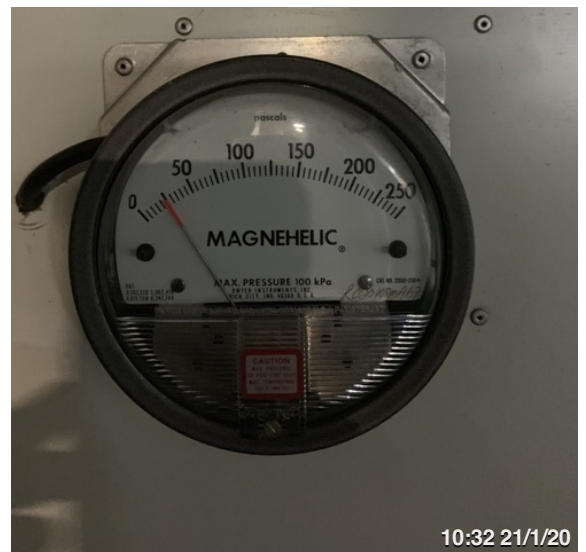

Building B



Building B Outside Air



AHU 4



AHU 1






AHU 2






AHU 3

Building A - February Daily Averages

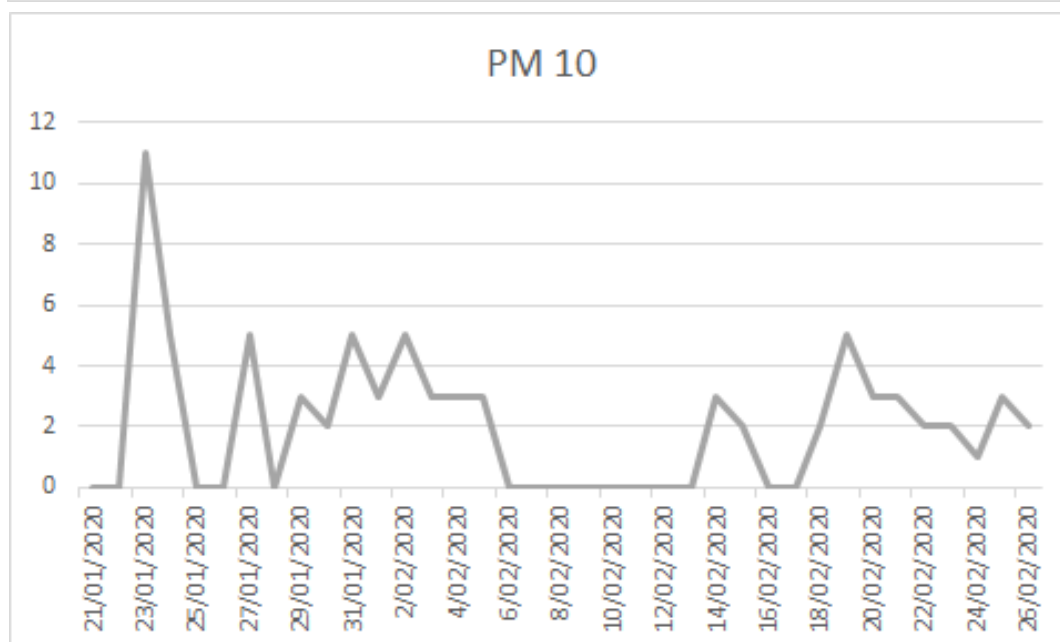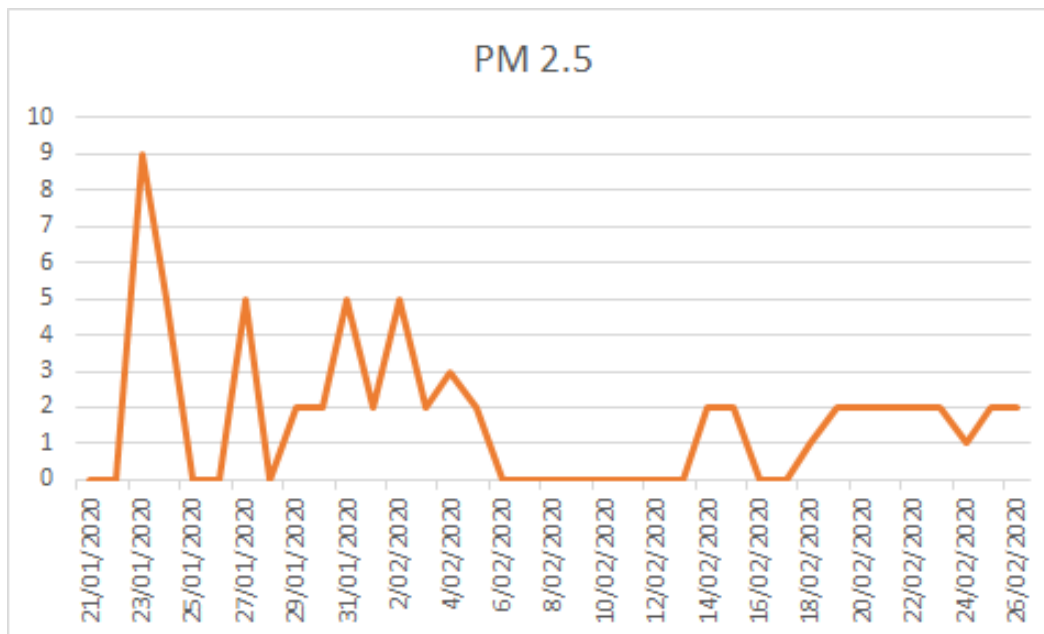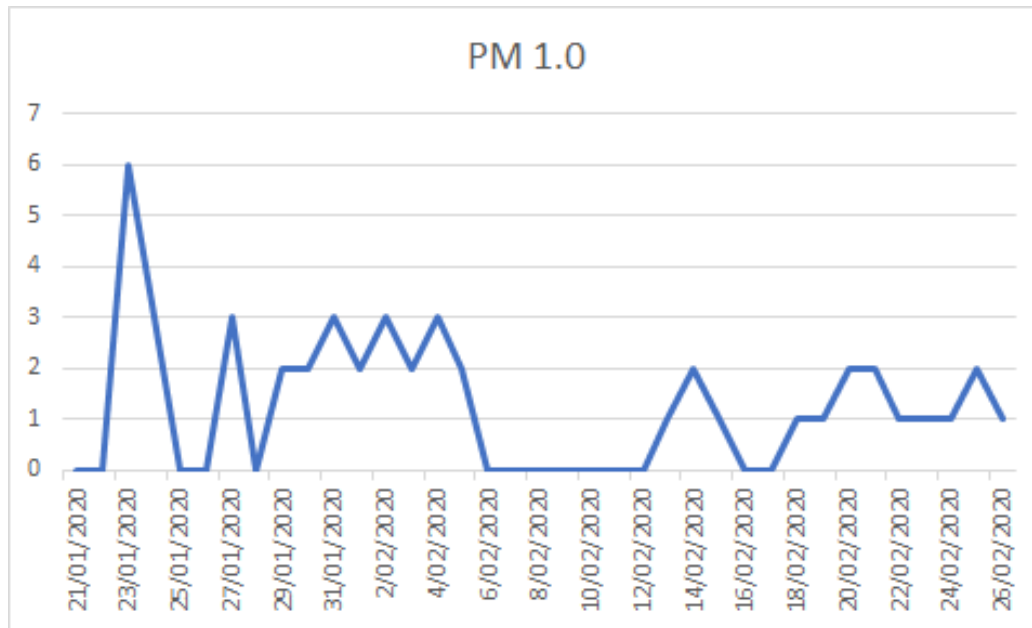

Building B - February Daily Averages

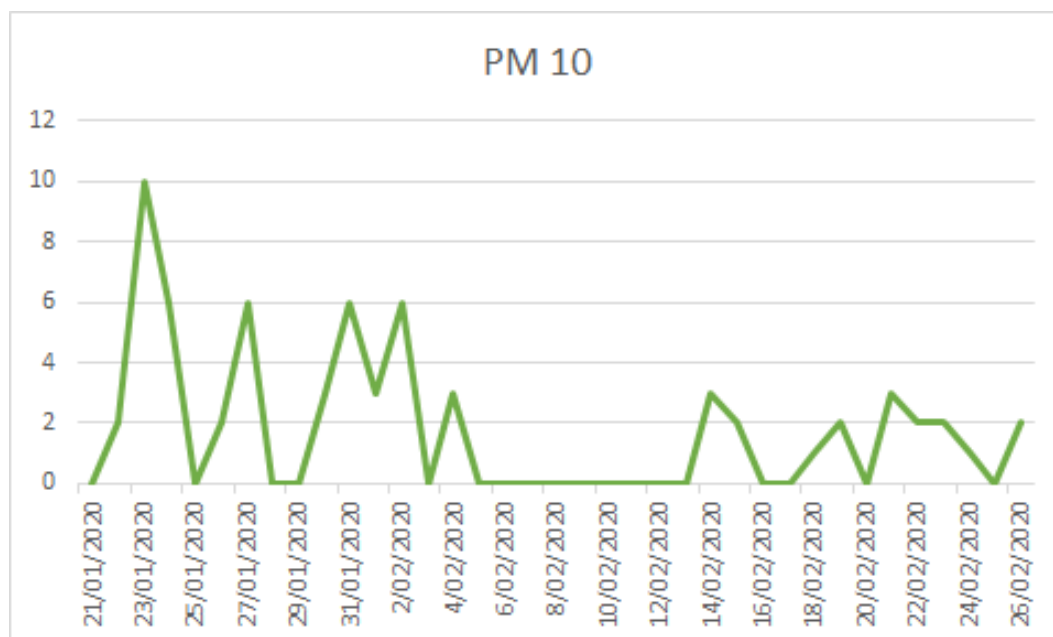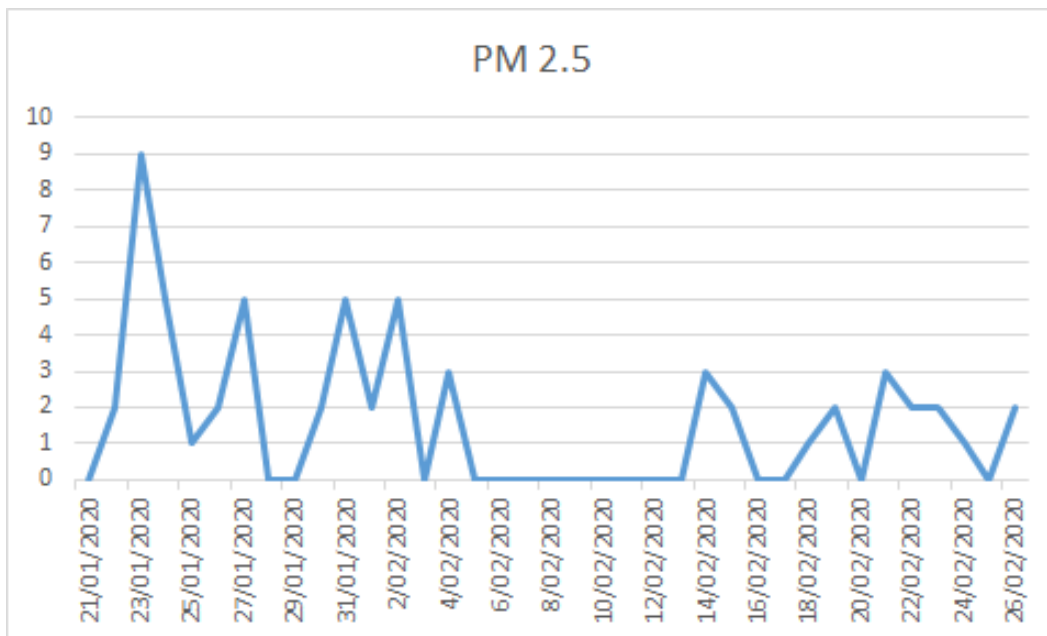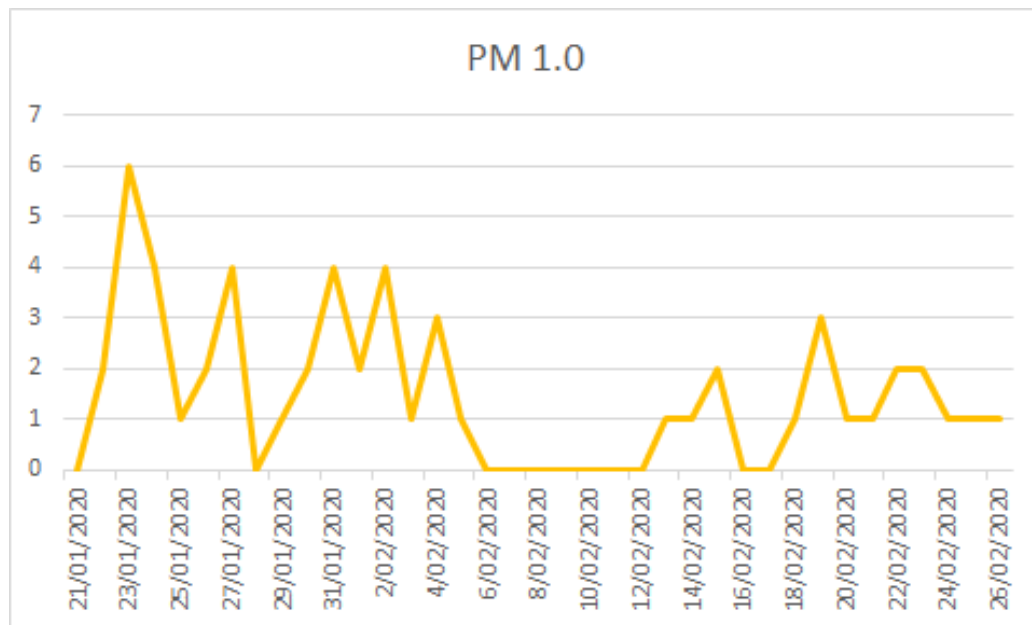

Building D - February Daily Averages

