

## CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

04 April 2022

**Attention:** Danny Khal  
**Company:** Ford Civil Contracting Pty Ltd  
**Email:** miguel.canas@fordcivil.com.au  
**Address:** 9 Hattersley Street, Arncliffe NSW 2205

**SWE Report Reference:** S110355.40-AAM1.v1-01/04/2022  
**Site Address:** MSCP and PSB, Westmead Hospital  
**Sampling Date:** 01/04/2022  
**Sample Analysis Date:** 04/04/2022  
**Period of Sampling:** 01/04/2022 07:07 AM - 01/04/2022 02:55 PM  
**Scope of Work:** Control monitoring for asbestos fibres  
**SWE Laboratory:** Suite 15, 103 Majors Bay Road, Concord NSW 2137

**Accreditation number:** 17092

**Site number:** 18665

**1. Introduction:** Control monitoring for airborne asbestos fibres was undertaken by Safe Work and Environments Pty Ltd (SWE) is used to verify the effectiveness of control measures implemented to prevent fibre release as a result of asbestos removal/related work.

**2. Methods:** Airborne asbestos fibre monitoring was carried out in accordance with the Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres, 2nd Edition [NOHSC:3003 (2005)] and SWE's In-House Method 2 – Volume Measurement, Calibration and Standardisation. Analysis of collected filter membrane samples was performed in accordance with NOHSC:3003 (2005) and SWE's In-House Method 1 – Asbestos Fibre Count and Mount.

### 3. Results:

SWE REF.	LOCATION OF SAMPLE	FIBRES/ FIELDS	CONCENTRATION (FIBRES/mL)
S110355.40/S104/010422	MSCP site, northwest end of site, adj old maintenance car park, fencing	1.0/100	<0.01
S110355.40/S204/010422	MSCP site, Corner of Labyrinth Way and Redbank Road, fencing	0.0/100	<0.01
S110355.40/S325/010422	MSCP site, southeast end of site, adj site sheds, fencing	1.0/100	<0.01
S110355.40/S736/010422	MSCP site, southwest end, adj. small courtyard, fencing	2.0/100	<0.01
S110355.40/S805/010422	PSB site, northern end, fencing along Redbank Rd.	0.0/100	<0.01
S110355.40/S038/010422	PSB site, western end, fencing along CASB loading dock.	0.0/100	<0.01
S110355.40/S635/010422	PSB site, southern end, fencing along laneway	0.0/100	<0.01
S110355.40/S784/010422	PSB site, eastern end, fencing behind site sheds	0.0/100	<0.01
S110355.40/S901/010422	Field Blank	0.0/100	NA

## CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

04 April 2022

**4. Conclusion:** All air monitoring analytical results reported on in this report are below the lowest detectable level of 0.01 fibres/mL of air.

**Analysed and reported by:**



**Karl Grovenor**  
Analyst



**Rune Knoph**  
Approved Issuer of Reports


## CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

04 April 2022

### APPENDIX A – MONITOR LOCATIONS

## CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

04 April 2022

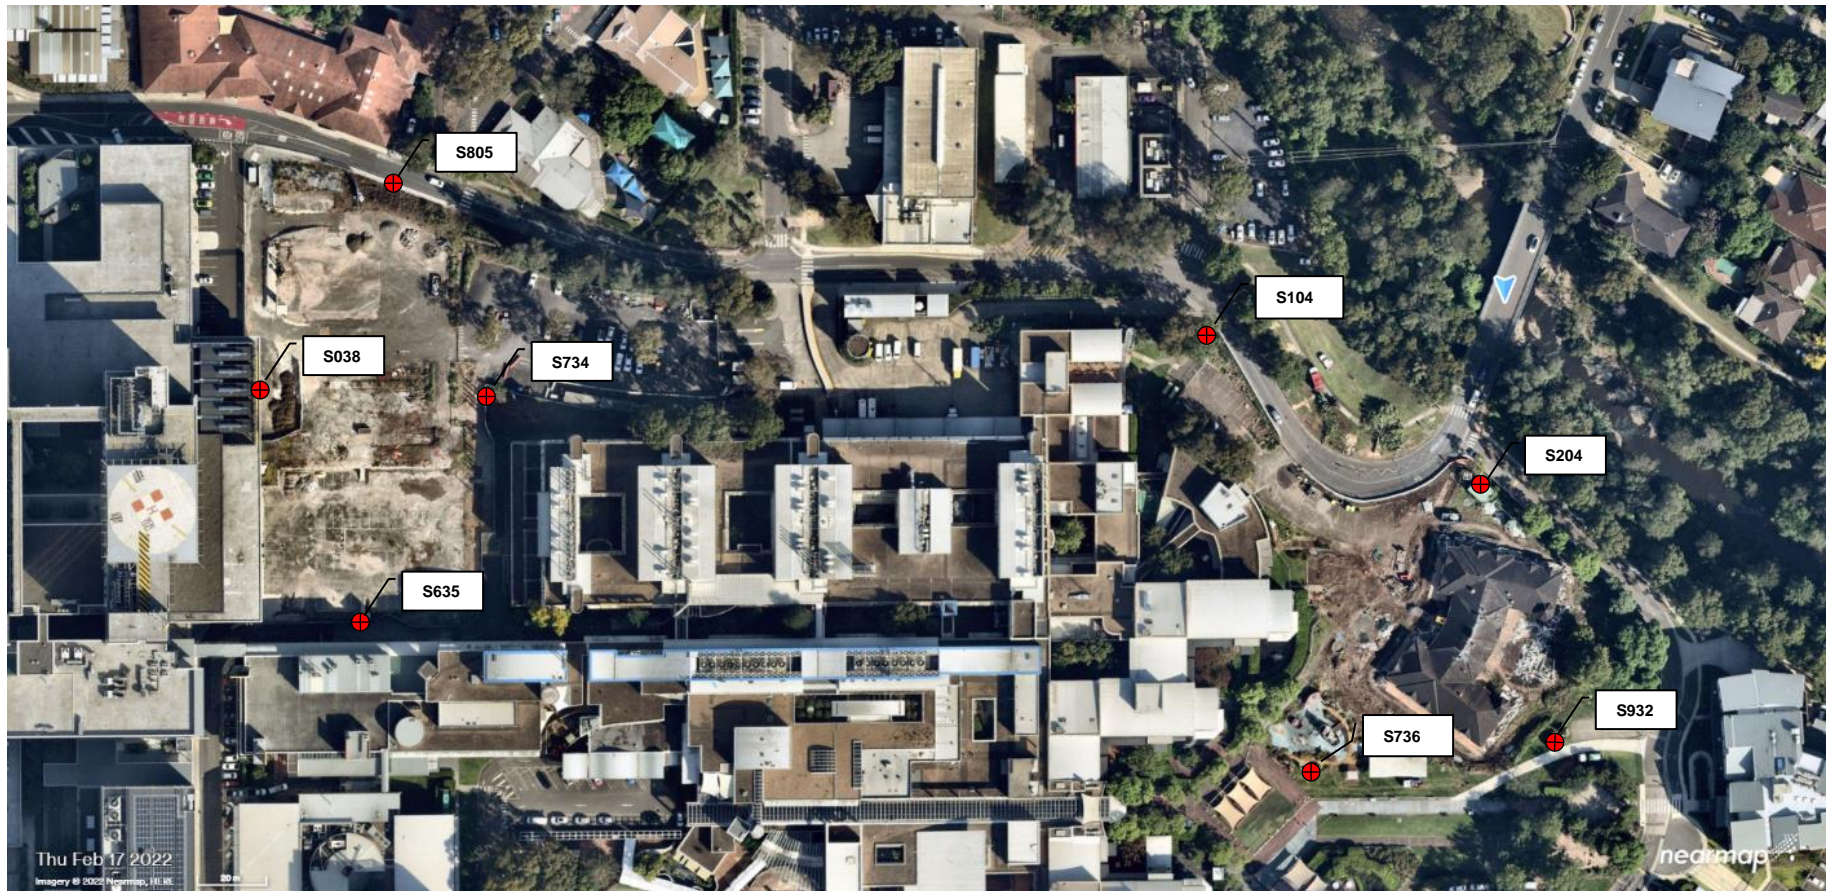

S110355.40-AAM1.v1-ControlAsbestosAirMonitoringReport-010422

Page 4 of 4



## CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

04 April 2022

**Attention:** Danny Khal  
**Company:** Ford Civil Contracting Pty Ltd  
**Email:** danny.khal@fordcivil.com.au  
**Address:** 9 Hattersley Street, Arncliffe NSW 2205

**SWE Report Reference:** S110355.41-AAM1.v1-02/04/2022  
**Site Address:** MSCP and PSB, Westmead Hospital  
**Sampling Date:** 02/04/2022  
**Sample Analysis Date:** 04/04/2022  
**Period of Sampling:** 02/04/2022 07:01 AM - 02/04/2022 03:01 PM  
**Scope of Work:** Control monitoring for asbestos fibres  
**SWE Laboratory:** Suite 15, 103 Majors Bay Road, Concord NSW 2137

**Accreditation number:** 17092

**Site number:** 18665

**1. Introduction:** Control monitoring for airborne asbestos fibres was undertaken by Safe Work and Environments Pty Ltd (SWE) is used to verify the effectiveness of control measures implemented to prevent fibre release as a result of asbestos removal/related work.

**2. Methods:** Airborne asbestos fibre monitoring was carried out in accordance with the Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres, 2nd Edition [NOHSC:3003 (2005)] and SWE's In-House Method 2 – Volume Measurement, Calibration and Standardisation. Analysis of collected filter membrane samples was performed in accordance with NOHSC:3003 (2005) and SWE's In-House Method 1 – Asbestos Fibre Count and Mount.

### 3. Results:

SWE REF.	LOCATION OF SAMPLE	FIBRES/ FIELDS	CONCENTRATION (FIBRES/mL)
S110355.41/S215/020422	MSCP site, northwest end of site, adj old maintenance car park, fencing	1.0/100	<0.01
S110355.41/S315/020422	MSCP site, Corner of Labyrinth Way and Redbank Road, fencing	1.0/100	<0.01
S110355.41/S805/020422	MSCP site, southeast end of site, adj site sheds, fencing	0.0/100	<0.01
S110355.41/S716/020422	MSCP site, southwest end, adj. small courtyard, fencing	0.0/100	<0.01
S110355.41/S895/020422	PSB site, northern end, fencing along Redbank Rd.	1.0/100	<0.01
S110355.41/S637/020422	PSB site, western end, fencing along CASB loading dock.	4.0/100	<0.01
S110355.41/S746/020422	PSB site, southern end, fencing along laneway	0.0/100	<0.01
S110355.41/S895/020422	PSB site, eastern end, fencing behind site sheds	2.0/100	<0.01
S110355.41/S902/020422	Field Blank	0/100	NA

## CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

04 April 2022

**4. Conclusion:** All air monitoring analytical results reported on in this report are below the lowest detectable level of 0.01 fibres/mL of air.

**Analysed and reported by:**



**Karl Grovenor**  
Analyst



**Rune Knoph**  
Approved Issuer of Reports

## CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

04 April 2022

### APPENDIX A – MONITOR LOCATIONS

## CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

04 April 2022





## CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

05 April 2022

**Attention:** Danny Khal  
**Company:** Ford Civil Contracting Pty Ltd  
**Email:** danny.khal@fordcivil.com.au  
**Address:** 9 Hattersley Street, Arncliffe NSW 2205

**SWE Report Reference:** S110355.42-AAM1.v1-04/04/2022  
**Site Address:** MSCP and PSB, Westmead Hospital  
**Sampling Date:** 04/04/2022  
**Sample Analysis Date:** 05/04/2022  
**Period of Sampling:** 04/02/2022 07:09 AM - 04/04/2022 03:28 PM  
**Scope of Work:** Control monitoring for asbestos fibres  
**SWE Laboratory:** Suite 15, 103 Majors Bay Road, Concord NSW 2137

**Accreditation number:** 17092

**Site number:** 18665

**1. Introduction:** Control monitoring for airborne asbestos fibres was undertaken by Safe Work and Environments Pty Ltd (SWE) is used to verify the effectiveness of control measures implemented to prevent fibre release as a result of asbestos removal/related work.

**2. Methods:** Airborne asbestos fibre monitoring was carried out in accordance with the Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres, 2nd Edition [NOHSC:3003 (2005)] and SWE's In-House Method 2 – Volume Measurement, Calibration and Standardisation. Analysis of collected filter membrane samples was performed in accordance with NOHSC:3003 (2005) and SWE's In-House Method 1 – Asbestos Fibre Count and Mount.

### 3. Results:

SWE REF.	LOCATION OF SAMPLE	FIBRES/ FIELDS	CONCENTRATION (FIBRES/mL)
S110355.42/S090/040422	MSCP site, northwest end of site, adj old maintenance car park, fencing	1.0/100	<0.01
S110355.42/S895/040422	MSCP site, Corner of Labyrinth Way and Redbank Road, fencing	0.0/100	<0.01
S110355.42/S098/040422	MSCP site, southeast end of site, adj site sheds, fencing	0.0/100	<0.01
S110355.42/S168/040422	MSCP site, southwest end, adj. small courtyard, fencing	0.0/100	<0.01
S110355.42/S983/040422	PSB site, northern end, fencing along Redbank Rd.	2.0/100	<0.01
S110355.42/S703/040422	PSB site, western end, fencing along CASB loading dock.	0.0/100	<0.01
S110355.42/S492/040422	PSB site, southern end, fencing along laneway	0.0/100	<0.01
S110355.42/P46/040422	PSB site, eastern end, fencing behind site sheds	0.0/100	<0.01
S110355.42/S209/040422	Field Blank	0.0/100	NA

## CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

05 April 2022

**4. Conclusion:** All air monitoring analytical results reported on in this report are below the lowest detectable level of 0.01 fibres/mL of air.

**Analysed and reported by:**



**Karl Grovenor**  
Analyst



**Rune Knoph**  
Approved Issuer of Reports

## **CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS**

05 April 2022

## **APPENDIX A – MONITOR LOCATIONS**

## CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

05 April 2022



S110355.42-AAM1.v1-ControlAsbestosAirMonitoringReport-040422

Page 4 of 4



## CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

06 April 2022

**Attention:** Danny Khal  
**Company:** Ford Civil Contracting Pty Ltd  
**Email:** danny.khal@fordcivil.com.au  
**Address:** 9 Hattersley Street, Arncliffe NSW 2205

**SWE Report Reference:** S110355.43-AAM1.v1-05/04/2022  
**Site Address:** MSCP and PSB, Westmead Hospital  
**Sampling Date:** 05/04/2022  
**Sample Analysis Date:** 06/04/2022  
**Period of Sampling:** 05/04/2022 07:07 AM - 05/04/2022 03:30 PM  
**Scope of Work:** Control monitoring for asbestos fibres  
**SWE Laboratory:** Suite 15, 103 Majors Bay Road, Concord NSW 2137

**Accreditation number:** 17092

**Site number:** 18665

**1. Introduction:** Asbestos air samples were collected by client and submitted to the Safe Work and Environments Pty Ltd (SWE) laboratory for analysis by the membrane filter mount and count methodology. The volume measurement sampling was carried out by a SWE approved trained third party, (Ford Civil Contracting Pty Ltd), and SWE is responsible for the NATA endorsed results and data herein relied upon.

**2. Methods:** Airborne asbestos fibre monitoring was carried out in accordance with the Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres, 2nd Edition [NOHSC:3003 (2005)] and SWE's In-House Method 2 – Volume Measurement, Calibration and Standardisation. Analysis of collected filter membrane samples was performed in accordance with NOHSC:3003 (2005) and SWE's In-House Method 1 – Asbestos Fibre Count and Mount.

### 3. Results:

SWE REF.	LOCATION OF SAMPLE	FIBRES/ FIELDS	CONCENTRATION (FIBRES/mL)
S110355.43/S087/050422	MSCP site, northwest end of site, adj old maintenance car park, fencing	0.0/100	<0.01
S110355.43/S841/050422	MSCP site, Corner of Labyrinth Way and Redbank Road, fencing	0.0/100	<0.01
S110355.43/P13/050422	MSCP site, southeast end of site, adj site sheds, fencing	0.0/100	<0.01
S110355.43/S307/050422	MSCP site, southwest end, adj. small courtyard, fencing	0.0/100	<0.01
S110355.43/S961/050422	PSB site, northern end, fencing along Redbank Rd.	0.0/100	<0.01
S110355.43/S050/050422	PSB site, western end, fencing along CASB loading dock.	1.5/100	<0.01
S110355.43/S937/050422	PSB site, southern end, fencing along laneway	0.0/100	<0.01
S110355.43/S176/050422	PSB site, eastern end, fencing behind site sheds	1.0/100	<0.01
S110355.43/S369/050422	Field Blank	0.0/100	NA

S110355.43-AAM1.v1-ControlAsbestosAirMonitoringReport-050422

Page 1 of 4

**Safe Work and Environments Pty Ltd 88127010995**

Suite 15, 103 Majors Bay Road, Concord NSW 2137

Phone: 02 8757 3611

Email: [info@swe.com.au](mailto:info@swe.com.au)

## CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

06 April 2022

**4. Conclusion:** All air monitoring analytical results reported on in this report are below the lowest detectable level of 0.01 fibres/mL of air.

**Analysed and reported by:**



**Karl Grovenor**  
Analyst



**Rune Knoph**  
Approved Issuer of Reports

## **CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS**

06 April 2022

## **APPENDIX A – MONITOR LOCATIONS**

## CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

06 April 2022



S110355.43-AAM1.v1-ControlAsbestosAirMonitoringReport-050422

Page 4 of 4



## CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

07 April 2022

**Attention:** Danny Khal  
**Company:** Ford Civil Contracting Pty Ltd  
**Email:** danny.khal@fordcivil.com.au  
**Address:** 9 Hattersley Street, Arncliffe NSW 2205

**SWE Report Reference:** S110355.44-AAM1.v1-06/04/2022  
**Site Address:** MSCP and PSB, Westmead Hospital  
**Sampling Date:** 06/04/2022  
**Sample Analysis Date:** 07/04/2022  
**Period of Sampling:** 06/04/2022 07:07 AM - 06/04/2022 03:27 PM  
**Scope of Work:** Control monitoring for asbestos fibres during excavation  
**SWE Laboratory:** Suite 15, 103 Majors Bay Road, Concord NSW 2137

**Accreditation number:** 17092

**Site number:** 18665

**1. Introduction:** Control monitoring for airborne asbestos fibres was undertaken by Safe Work and Environments Pty Ltd (SWE) is used to verify the effectiveness of control measures implemented to prevent fibre release as a result of asbestos removal/related work.

**2. Methods:** Airborne asbestos fibre monitoring was carried out in accordance with the Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres, 2nd Edition [NOHSC:3003 (2005)] and SWE's In-House Method 2 – Volume Measurement, Calibration and Standardisation. Analysis of collected filter membrane samples was performed in accordance with NOHSC:3003 (2005) and SWE's In-House Method 1 – Asbestos Fibre Count and Mount.

### 3. Results:

SWE REF.	LOCATION OF SAMPLE	FIBRES/ FIELDS	CONCENTRATION (FIBRES/mL)
S110355.44/S224/060422	MSCP site, northwest end of site, adj old maintenance car park, fencing	0.0/100	<0.01
S110355.44/S715/060422	MSCP site, Corner of Labyrinth Way and Redbank Road, fencing	0.0/100	<0.01
S110355.44/S077/060422	MSCP site, southeast end of site, adj site sheds, fencing	0.0/100	<0.01
S110355.44/S548/060422	MSCP site, southwest end, adj. small courtyard, fencing	VOID*	VOID*
S110355.44/S196/060422	PSB site, northern end, fencing along Redbank Rd.	0.0/100	<0.01
S110355.44/S897/060422	PSB site, western end, fencing along CASB loading dock.	VOID*	VOID*
S110355.44/S411/060422	PSB site, southern end, fencing along laneway	VOID*	VOID*
S110355.44/S308/060422	PSB site, eastern end, fencing behind site sheds	0.0/100	<0.01
S110355.44/S999/060422	Field Blank	0.0/100	NA

\*sample voided due to waterlogging of filter

S110355.44-AAM1.v1-ControlAsbestosAirMonitoringReport-060422

Page 1 of 4

**Safe Work and Environments Pty Ltd 88127010995**

Suite 15, 103 Majors Bay Road, Concord NSW 2137

Phone: 02 8757 3611

Email: [info@swe.com.au](mailto:info@swe.com.au)

## CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

07 April 2022

**4. Conclusion:** All air monitoring analytical results reported on in this report are below the lowest detectable level of 0.01 fibres/mL of air.

**Analysed and reported by:**



**Karl Grovenor**  
Analyst



**Rune Knoph**  
Approved Issuer of Reports

## **CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS**

07 April 2022

## **APPENDIX A – MONITOR LOCATIONS**

## CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

07 April 2022



S110355.44-AAM1.v1-ControlAsbestosAirMonitoringReport-060422

Page 4 of 4



## CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

12 April 2022

**Attention:** Danny Khal  
**Company:** Ford Civil Contracting Pty Ltd  
**Email:** danny.khal@fordcivil.com.au  
**Address:** 9 Hattersley Street, Arncliffe NSW 2205

**SWE Report Reference:** S110355.45-AAM1.v1-11/04/2022  
**Site Address:** MSCP and PSB, Westmead Hospital  
**Sampling Date:** 11/04/2022  
**Sample Analysis Date:** 12/04/2022  
**Period of Sampling:** 11/04/2022 07:07 AM - 11/04/2022 03:27 PM  
**Scope of Work:** Control monitoring for asbestos fibres  
**SWE Laboratory:** Suite 15, 103 Majors Bay Road, Concord NSW 2137

**Accreditation number:** 17092

**Site number:** 18665

**1. Introduction:** Control monitoring for airborne asbestos fibres was undertaken by Safe Work and Environments Pty Ltd (SWE) is used to verify the effectiveness of control measures implemented to prevent fibre release as a result of asbestos removal/related work.

**2. Methods:** Airborne asbestos fibre monitoring was carried out in accordance with the Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres, 2nd Edition [NOHSC:3003 (2005)] and SWE's In-House Method 2 – Volume Measurement, Calibration and Standardisation. Analysis of collected filter membrane samples was performed in accordance with NOHSC:3003 (2005) and SWE's In-House Method 1 – Asbestos Fibre Count and Mount.

### 3. Results:

SWE REF.	LOCATION OF SAMPLE	FIBRES/ FIELDS	CONCENTRATION (FIBRES/mL)
S110355.45/S984/110422	MSCP site, northwest end of site, adj old maintenance car park, fencing	0.0/100	<0.01
S110355.45/S465/110422	MSCP site, Corner of Labyrinth Way and Redbank Road, fencing	2.0/100	<0.01
S110355.45/S155/110422	MSCP site, southeast end of site, adj site sheds, fencing	1.0/100	<0.01
S110355.45/S051/110422	MSCP site, southwest end, adj. small courtyard, fencing	3.0/100	<0.01
S110355.45/S844/110422	PSB site, northern end, fencing along Redbank Rd.	2.0/100	<0.01
S110355.45/S232/110422	PSB site, western end, fencing along CASB loading dock.	0.0/100	<0.01
S110355.45/S901/110422	PSB site, southern end, fencing along laneway	1.0/100	<0.01
S110355.45/S965/110422	PSB site, eastern end, fencing behind site sheds	0.0/100	<0.01
S110355.45/S201/110422	Field Blank	0.0/100	NA

## CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

12 April 2022

**4. Conclusion:** All air monitoring analytical results reported on in this report are below the lowest detectable level of 0.01 fibres/mL of air.

**Analysed and reported by:**



**Karl Grovenor**  
Analyst



**Rune Knoph**  
Approved Issuer of Reports

## **CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS**

12 April 2022

## **APPENDIX A – MONITOR LOCATIONS**

## CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

12 April 2022



S110355.45-AAM1.v1-ControlAsbestosAirMonitoringReport-110422

Page 4 of 4



## CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

13 April 2022

**Attention:** Danny Khal  
**Company:** Ford Civil Contracting Pty Ltd  
**Email:** danny.khal@fordcivil.com.au  
**Address:** 9 Hattersley Street, Arncliffe NSW 2205

**SWE Report Reference:** S110355.46-AAM1.v1-12/04/2022  
**Site Address:** MSCP and PSB, Westmead Hospital  
**Sampling Date:** 12/04/2022  
**Sample Analysis Date:** 13/04/2022  
**Period of Sampling:** 12/04/2022 07:07 AM - 12/04/2022 03:27 PM  
**Scope of Work:** Control monitoring for asbestos fibres  
**SWE Laboratory:** Suite 15, 103 Majors Bay Road, Concord NSW 2137

**Accreditation number:** 17092

**Site number:** 18665

**1. Introduction:** Control monitoring for airborne asbestos fibres was undertaken by Safe Work and Environments Pty Ltd (SWE) is used to verify the effectiveness of control measures implemented to prevent fibre release as a result of asbestos removal/related work.

**2. Methods:** Airborne asbestos fibre monitoring was carried out in accordance with the Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres, 2nd Edition [NOHSC:3003 (2005)] and SWE's In-House Method 2 – Volume Measurement, Calibration and Standardisation. Analysis of collected filter membrane samples was performed in accordance with NOHSC:3003 (2005) and SWE's In-House Method 1 – Asbestos Fibre Count and Mount.

### 3. Results:

SWE REF.	LOCATION OF SAMPLE	FIBRES/ FIELDS	CONCENTRATION (FIBRES/mL)
S110355.46/S894/120422	MSCP site, northwest end of site, adj old maintenance car park, fencing	1.0/100	<0.01
S110355.46/S098/120422	MSCP site, Corner of Labyrinth Way and Redbank Road, fencing	1.0/100	<0.01
S110355.46/S970/120422	MSCP site, southeast end of site, adj site sheds, fencing	0.0/100	<0.01
S110355.46/S902/120422	MSCP site, southwest end, adj. small courtyard, fencing	1.0/100	<0.01
S110355.46/S000/120422	PSB site, northern end, fencing along Redbank Rd.	0.0/100	<0.01
S110355.46/S309/120422	PSB site, western end, fencing along CASB loading dock.	1.5/100	<0.01
S110355.46/S852/120422	PSB site, southern end, fencing along laneway	0.0/100	<0.01
S110355.46/S733/120422	PSB site, eastern end, fencing behind site sheds	0.0/100	<0.01
S110355.46/S669/120422	Field Blank	0.0/100	NA

## CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

13 April 2022

**4. Conclusion:** All air monitoring analytical results reported on in this report are below the lowest detectable level of 0.01 fibres/mL of air.

**Analysed and reported by:**



**Karl Grovenor**  
Analyst



**Rune Knoph**  
Approved Issuer of Reports


## **CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS**

13 April 2022

## **APPENDIX A – MONITOR LOCATIONS**

## CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

13 April 2022

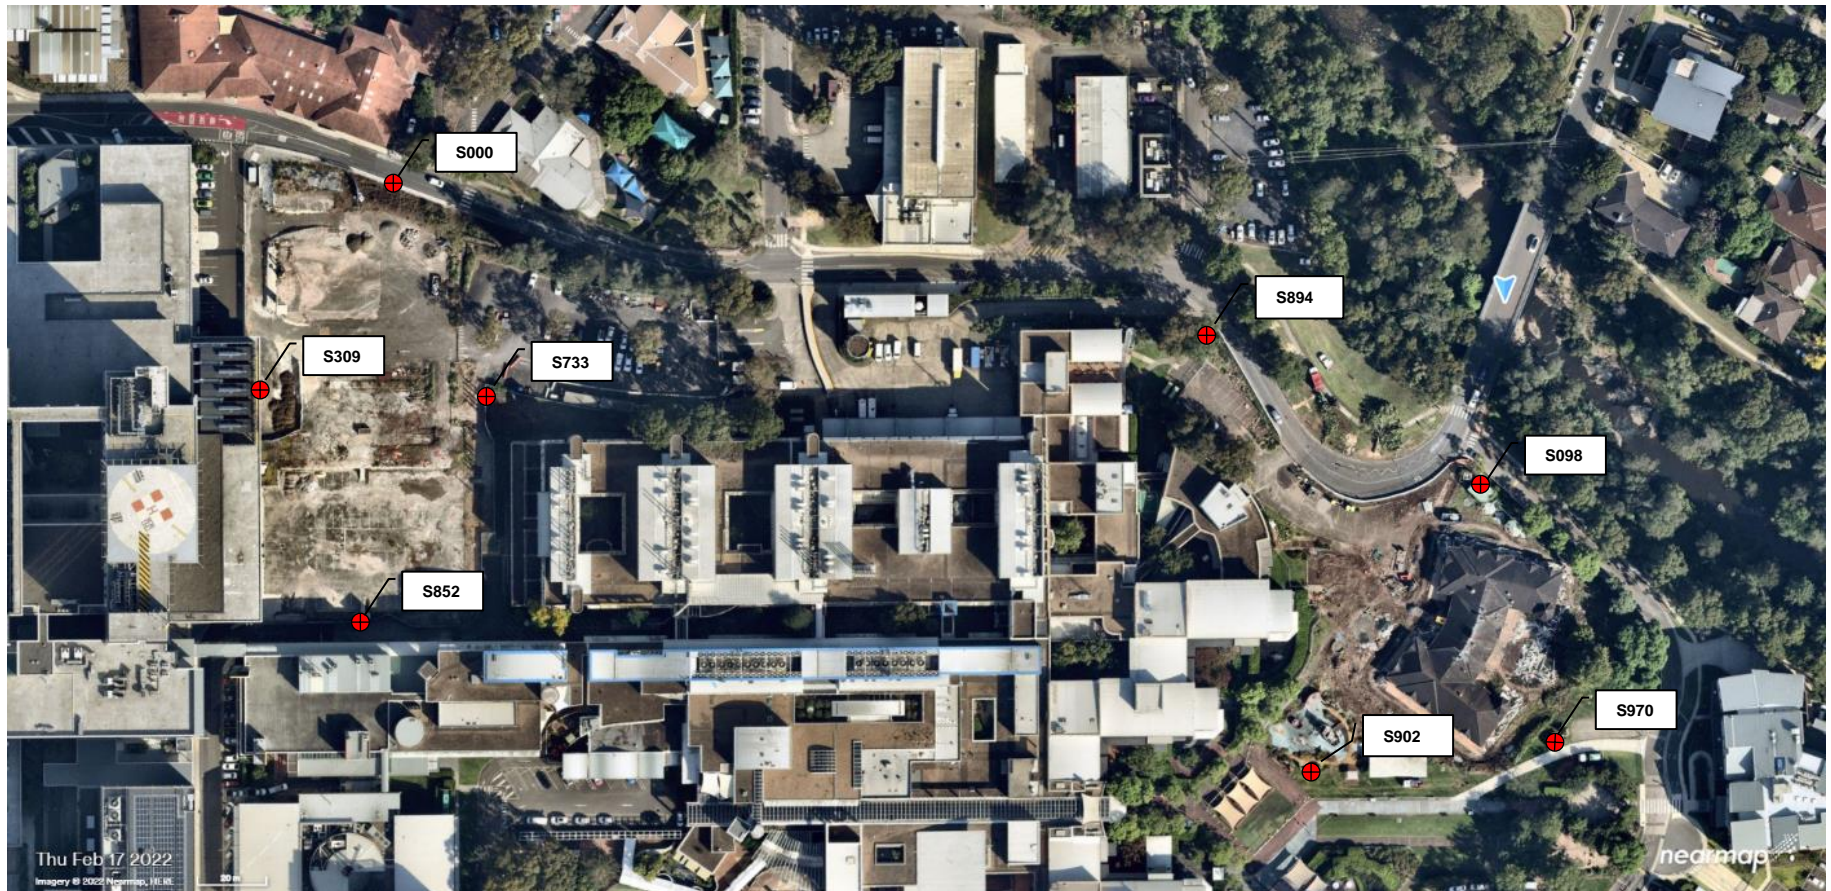

S110355.46-AAM1.v1-ControlAsbestosAirMonitoringReport-120422

Page 4 of 4



## CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

14 April 2022

**Attention:** Danny Khal  
**Company:** Ford Civil Contracting Pty Ltd  
**Email:** danny.khal@fordcivil.com.au  
**Address:** 9 Hattersley Street, Arncliffe NSW 2205

**SWE Report Reference:** S110355.47-AAM1.v1-13/04/2022  
**Site Address:** MSCP and PSB, Westmead Hospital  
**Sampling Date:** 13/04/2022  
**Sample Analysis Date:** 13/04/2022  
**Period of Sampling:** 13/04/2022 07:03 AM - 13/04/2022 03:25 PM  
**Scope of Work:** Control monitoring for asbestos fibres  
**SWE Laboratory:** Suite 15, 103 Majors Bay Road, Concord NSW 2137

**Accreditation number:** 17092

**Site number:** 18665

**1. Introduction:** Control monitoring for airborne asbestos fibres was undertaken by Safe Work and Environments Pty Ltd (SWE) is used to verify the effectiveness of control measures implemented to prevent fibre release as a result of asbestos removal/related work.

**2. Methods:** Airborne asbestos fibre monitoring was carried out in accordance with the Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres, 2nd Edition [NOHSC:3003 (2005)] and SWE's In-House Method 2 – Volume Measurement, Calibration and Standardisation. Analysis of collected filter membrane samples was performed in accordance with NOHSC:3003 (2005) and SWE's In-House Method 1 – Asbestos Fibre Count and Mount.

### 3. Results:

SWE REF.	LOCATION OF SAMPLE	FIBRES/ FIELDS	CONCENTRATION (FIBRES/mL)
S110355.47/S996/130422	MSCP site, northwest end of site, adj old maintenance car park, fencing	0.0/100	<0.01
S110355.47/S176/130422	MSCP site, Corner of Labyrinth Way and Redbank Road, fencing	0.0/100	<0.01
S110355.47/S959/130422	MSCP site, southeast end of site, adj site sheds, fencing	VOID*	VOID*
S110355.47/S221/130422	MSCP site, southwest end, adj. small courtyard, fencing	0.0/100	<0.01
S110355.47/S104/130422	PSB site, northern end, fencing along Redbank Rd.	0.0/100	<0.01
S110355.47/S619/130422	PSB site, western end, fencing along CASB loading dock.	0.0/100	<0.01
S110355.47/S285/130422	PSB site, eastern end, fencing behind site sheds	0.0/100	<0.01
S110355.47/S560/130422	PSB site, eastern end, fencing behind site sheds	0.0/100	<0.01
S110355.47/S361/130422	Field Blank	0.0/100	NA

\*=sample voided due to water ingress into filter

S110355.47-AAM1.v1-ControlAsbestosAirMonitoringReport-130422

Page 1 of 4

**Safe Work and Environments Pty Ltd 88127010995**

Suite 15, 103 Majors Bay Road, Concord NSW 2137

Phone: 02 8757 3611

 Email: [info@swe.com.au](mailto:info@swe.com.au)

## CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

14 April 2022

**4. Conclusion:** All air monitoring analytical results reported on in this report are below the lowest detectable level of 0.01 fibres/mL of air.

**Analysed and reported by:**



**Karl Grovenor**  
Analyst



**Rune Knoph**  
Approved Issuer of Reports

## **CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS**

14 April 2022

## **APPENDIX A – MONITOR LOCATIONS**

## CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

14 April 2022



S110355.47-AAM1.v1-ControlAsbestosAirMonitoringReport-130422

Page 4 of 4



## CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

19 April 2022

**Attention:** Danny Khal  
**Company:** Ford Civil Contracting Pty Ltd  
**Email:** danny.khal@fordcivil.com.au  
**Address:** 9 Hattersley Street, Arncliffe NSW 2205

**SWE Report Reference:** S110355.48-AAM1.v1-14/04/2022  
**Site Address:** MSCP and PSB, Westmead Hospital  
**Sampling Date:** 14/04/2022  
**Sample Analysis Date:** 19/04/2022  
**Period of Sampling:** 14/04/2022 07:04 AM - 14/04/2022 02:26 PM  
**Scope of Work:** Control monitoring for asbestos fibres  
**SWE Laboratory:** Suite 15, 103 Majors Bay Road, Concord NSW 2137

**Accreditation number:** 17092

**Site number:** 18665

**1. Introduction:** Control monitoring for airborne asbestos fibres was undertaken by Safe Work and Environments Pty Ltd (SWE) is used to verify the effectiveness of control measures implemented to prevent fibre release as a result of asbestos removal/related work.

**2. Methods:** Airborne asbestos fibre monitoring was carried out in accordance with the Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres, 2nd Edition [NOHSC:3003 (2005)] and SWE's In-House Method 2 – Volume Measurement, Calibration and Standardisation. Analysis of collected filter membrane samples was performed in accordance with NOHSC:3003 (2005) and SWE's In-House Method 1 – Asbestos Fibre Count and Mount.

### 3. Results:

SWE REF.	LOCATION OF SAMPLE	FIBRES/ FIELDS	CONCENTRATION (FIBRES/mL)
S110355.48/S227/140422	MSCP site, northwest end of site, adj old maintenance car park, fencing	0.0/100	<0.01
S110355.48/S635/140422	MSCP site, Corner of Labyrinth Way and Redbank Road, fencing	1.0/100	<0.01
S110355.48/S851/140422	MSCP site, southeast end of site, adj site sheds, fencing	3.5/100	<0.01
S110355.48/S038/140422	MSCP site, southwest end, adj. small courtyard, fencing	0.0/100	<0.01
S110355.48/S800/140422	PSB site, northern end, fencing along Redbank Rd.	0.0/100	<0.01
S110355.48/S401/140422	PSB site, western end, fencing along CASB loading dock.	0.0/100	<0.01
S110355.48/S826/140422	PSB site, southern end, fencing along laneway	1.0/100	<0.01
S110355.48/S058/140422	PSB site, eastern end, fencing behind site sheds	1.0/100	<0.01
S110355.48/S901/140422	Field Blank	0.0/100	NA

## CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

19 April 2022

**4. Conclusion:** All air monitoring analytical results reported on in this report are below the lowest detectable level of 0.01 fibres/mL of air.

**Analysed and reported by:**



**Karl Grovenor**  
Analyst



**Rune Knoph**  
Approved Issuer of Reports

## **CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS**

19 April 2022

## **APPENDIX A – MONITOR LOCATIONS**

## CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

19 April 2022



S110355.48-AAM1.v1-ControlAsbestosAirMonitoringReport-140422

Page 4 of 4



## CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

20 April 2022

**Attention:** Danny Khal  
**Company:** Ford Civil Contracting Pty Ltd  
**Email:** danny.khal@fordcivil.com.au  
**Address:** 9 Hattersley Street, Arncliffe NSW 2205

**SWE Report Reference:** S110355.49-AAM1.v1-19/04/2022  
**Site Address:** MSCP and PSB, Westmead Hospital  
**Sampling Date:** 19/04/2022  
**Sample Analysis Date:** 20/04/2022  
**Period of Sampling:** 19/04/2022 07:03 AM - 19/04/2022 03:28 PM  
**Scope of Work:** Control monitoring for asbestos fibres  
**SWE Laboratory:** Suite 15, 103 Majors Bay Road, Concord NSW 2137

**Accreditation number:** 17092 **Site number:** 18665

**1. Introduction:** Control monitoring for airborne asbestos fibres was undertaken by Safe Work and Environments Pty Ltd (SWE) is used to verify the effectiveness of control measures implemented to prevent fibre release as a result of asbestos removal/related work.

**2. Methods:** Airborne asbestos fibre monitoring was carried out in accordance with the Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres, 2nd Edition [NOHSC:3003 (2005)] and SWE's In-House Method 2 – Volume Measurement, Calibration and Standardisation. Analysis of collected filter membrane samples was performed in accordance with NOHSC:3003 (2005) and SWE's In-House Method 1 – Asbestos Fibre Count and Mount.

### 3. Results:

SWE REF.	LOCATION OF SAMPLE	FIBRES/ FIELDS	CONCENTRATION (FIBRES/mL)
S110355.49/S233/190422	MSCP site, northwest end of site, adj old maintenance car park, fencing	0.0/100	<0.01
S110355.49/S501/190422	MSCP site, fencing adj. Redbank Rd, west end	1.0/100	<0.01
S110355.49/S980/190422	MSCP site, fencing adj. Redbank Rd, east end	0.5/100	<0.01
S110355.49/S784/190422	MSCP site, Corner of Labyrinth Way and Redbank Road, fencing	1.0/100	<0.01
S110355.49/S204/190422	MSCP site, southeast end of site, adj site sheds, fencing	0.0/100	<0.01
S110355.49/S747/190422	MSCP site, southwest end, adj. small courtyard, fencing	0.0/100	<0.01
S110355.49/S933/190422	PSB site, northern end, fencing along Redbank Rd.	0.0/100	<0.01
S110355.49/S969/190422	PSB site, western end, fencing along CASB loading dock.	0.0/100	<0.01
S110355.49/S182/190422	PSB site, southern end, fencing along laneway	2.0/100	<0.01
S110355.49/S007/190422	PSB site, eastern end, fencing behind site sheds	0.0/100	<0.01
S110355.49/S808/190422	Field Blank	0.0/100	NA

## CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

20 April 2022

**4. Conclusion:** All air monitoring analytical results reported on in this report are below the lowest detectable level of 0.01 fibres/mL of air.

**Analysed and reported by:**



**Karl Grovenor**  
Analyst



**Rune Knoph**  
Approved Issuer of Reports

## **CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS**

20 April 2022

## **APPENDIX A – MONITOR LOCATIONS**

## CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

20 April 2022





## CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

21 April 2022

**Attention:** Danny Khal  
**Company:** Ford Civil Contracting Pty Ltd  
**Email:** danny.khal@fordcivil.com.au  
**Address:** 9 Hattersley Street, Arncliffe NSW 2205

**SWE Report Reference:** S110355.50-AAM1.v1-20/04/2022  
**Site Address:** MSCP and PSB, Westmead Hospital  
**Sampling Date:** 20/04/2022  
**Sample Analysis Date:** 21/04/2022  
**Period of Sampling:** 20/04/2022 07:04 AM - 20/04/2022 03:30 PM  
**Scope of Work:** Control monitoring for asbestos fibres  
**SWE Laboratory:** Suite 15, 103 Majors Bay Road, Concord NSW 2137  
**Accreditation number:** 17092 **Site number:** 18665

**1. Introduction:** Control monitoring for airborne asbestos fibres was undertaken by Safe Work and Environments Pty Ltd (SWE) is used to verify the effectiveness of control measures implemented to prevent fibre release as a result of asbestos removal/related work.

**2. Methods:** Airborne asbestos fibre monitoring was carried out in accordance with the Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres, 2nd Edition [NOHSC:3003 (2005)] and SWE's In-House Method 2 – Volume Measurement, Calibration and Standardisation. Analysis of collected filter membrane samples was performed in accordance with NOHSC:3003 (2005) and SWE's In-House Method 1 – Asbestos Fibre Count and Mount.

### 3. Results:

SWE REF.	LOCATION OF SAMPLE	FIBRES/ FIELDS	CONCENTRATION (FIBRES/mL)
S110355.50/S210/200422	MSCP site, northwest end of site, adj old maintenance car park, fencing	0.0/100	<0.01
S110355.50/S921/200422	MSCP site, test pit temporary fencing adj. Redbank Rd, west end	3.0/100	<0.01
S110355.50/S918/200422	MSCP site, fencing adj. Redbank Rd, west end	0.0/100	<0.01
S110355.50/S736/200422	MSCP site, Corner of Labyrinth Way and Redbank Road, fencing	1.0/100	<0.01
S110355.50/S960/200422	MSCP site, southeast end of site, adj site sheds, fencing	0.0/100	<0.01
S110355.50/S945/200422	MSCP site, southwest end, adj. small courtyard, fencing	0.0/100	<0.01
S110355.50/S894/200422	PSB site, northern end, fencing along Redbank Rd.	1.0/100	<0.01
S110355.50/S947/200422	PSB site, western end, fencing along CASB loading dock.	0.0/100	<0.01
S110355.50/S895/200422	PSB site, southern end, fencing along laneway	1.0/100	<0.01
S110355.50/S934/200422	PSB site, eastern end, fencing behind site sheds	0.0/100	<0.01
S110355.50/S704/200422	Field Blank	0.0/100	NA

## CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

21 April 2022

**4. Conclusion:** All air monitoring analytical results reported on in this report are below the lowest detectable level of 0.01 fibres/mL of air.

**Analysed and reported by:**



**Karl Grovenor**  
Analyst



**Rune Knoph**  
Approved Issuer of Reports

## **CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS**

21 April 2022

## **APPENDIX A – MONITOR LOCATIONS**

## CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

21 April 2022



S110355.50-AAM1.v1-ControlAsbestosAirMonitoringReport-200422

Page 4 of 4



## CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

22 April 2022

**Attention:** Danny Khal  
**Company:** Ford Civil Contracting Pty Ltd  
**Email:** danny.khal@fordcivil.com.au  
**Address:** 9 Hattersley Street, Arncliffe NSW 2205

**SWE Report Reference:** S110355.51-AAM1.v1-21/04/2022  
**Site Address:** MSCP and PSB, Westmead Hospital  
**Sampling Date:** 21/04/2022  
**Sample Analysis Date:** 22/04/2022  
**Period of Sampling:** 21/04/2022 07:04 AM - 21/04/2022 03:29 PM  
**Scope of Work:** Control monitoring for asbestos fibres  
**SWE Laboratory:** Suite 15, 103 Majors Bay Road, Concord NSW 2137

**Accreditation number:** 17092 **Site number:** 18665

**1. Introduction:** Control monitoring for airborne asbestos fibres was undertaken by Safe Work and Environments Pty Ltd (SWE) is used to verify the effectiveness of control measures implemented to prevent fibre release as a result of asbestos removal/related work.

**2. Methods:** Airborne asbestos fibre monitoring was carried out in accordance with the Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres, 2nd Edition [NOHSC:3003 (2005)] and SWE's In-House Method 2 – Volume Measurement, Calibration and Standardisation. Analysis of collected filter membrane samples was performed in accordance with NOHSC:3003 (2005) and SWE's In-House Method 1 – Asbestos Fibre Count and Mount.

### 3. Results:

SWE REF.	LOCATION OF SAMPLE	FIBRES/ FIELDS	CONCENTRATION (FIBRES/mL)
S110355.51/S393/210422	MSCP site, northwest end of site, adj old maintenance car park, fencing	0.0/100	<0.01
S110355.51/S392/210422	MSCP site, fencing adj. Redbank Rd, west end	2.0/100	<0.01
S110355.51/S238/210422	MSCP site, fencing adj. Redbank Rd, east end	0.0/100	<0.01
S110355.51/S849/210422	MSCP site, Corner of Labyrinth Way and Redbank Road, fencing	0.0/100	<0.01
S110355.51/S549/210422	MSCP site, southeast end of site, adj site sheds, fencing	0.0/100	<0.01
S110355.51/S119/210422	MSCP site, southwest end, adj. small courtyard, fencing	1.0/100	<0.01
S110355.51/S816/210422	PSB site, northern end, fencing along Redbank Rd.	0.0/100	<0.01
S110355.51/S525/210422	PSB site, western end, fencing along CASB loading dock.	0.0/100	<0.01
S110355.51/S777/210422	PSB site, southern end, fencing along laneway	0.0/100	<0.01
S110355.51/S336/210422	PSB site, eastern end, fencing behind site sheds	0.0/100	<0.01
S110355.51/S555/210422	Field Blank	0.0/100	NA

## CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

22 April 2022

**4. Conclusion:** All air monitoring analytical results reported on in this report are below the lowest detectable level of 0.01 fibres/mL of air.

**Analysed and reported by:**



**Karl Grovenor**  
Analyst



**Rune Knoph**  
Approved Issuer of Reports

## **CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS**

22 April 2022

## **APPENDIX A – MONITOR LOCATIONS**

## CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

22 April 2022



S110355.51-AAM1.v1-ControlAsbestosAirMonitoringReport-210422

Page 4 of 4



## CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

26 April 2022

**Attention:** Danny Khal  
**Company:** Ford Civil Contracting Pty Ltd  
**Email:** danny.khal@fordcivil.com.au  
**Address:** 9 Hattersley Street, Arncliffe NSW 2205

**SWE Report Reference:** S110355.52-AAM1.v1-22/04/2022  
**Site Address:** MSCP and PSB, Westmead Hospital  
**Sampling Date:** 22/04/2022  
**Sample Analysis Date:** 26/04/2022  
**Period of Sampling:** 22/04/2022 07:10 AM - 22/04/2022 03:02 PM  
**Scope of Work:** Control monitoring for asbestos fibres  
**SWE Laboratory:** Suite 15, 103 Majors Bay Road, Concord NSW 2137

**Accreditation number:** 17092 **Site number:** 18665

**1. Introduction:** Control monitoring for airborne asbestos fibres was undertaken by Safe Work and Environments Pty Ltd (SWE) is used to verify the effectiveness of control measures implemented to prevent fibre release as a result of asbestos removal/related work.

**2. Methods:** Airborne asbestos fibre monitoring was carried out in accordance with the Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres, 2nd Edition [NOHSC:3003 (2005)] and SWE's In-House Method 2 – Volume Measurement, Calibration and Standardisation. Analysis of collected filter membrane samples was performed in accordance with NOHSC:3003 (2005) and SWE's In-House Method 1 – Asbestos Fibre Count and Mount.

### 3. Results:

SWE REF.	LOCATION OF SAMPLE	FIBRES/ FIELDS	CONCENTRATION (FIBRES/mL)
S110355.52/S846/220422	MSCP site, northwest end of site, adj old maintenance car park, fencing	1.0/100	<0.01
S110355.52/S538/220422	MSCP site, fencing adj. Redbank Rd, west end	1.0/100	<0.01
S110355.52/S257/220422	MSCP site, fencing adj. Redbank Rd, east end	0.0/100	<0.01
S110355.52/S561/220422	MSCP site, Corner of Labyrinth Way and Redbank Road, fencing	0.0/100	<0.01
S110355.52/S724/220422	MSCP site, southeast end of site, adj site sheds, fencing	0.0/100	<0.01
S110355.52/S325/220422	MSCP site, southwest end, adj. small courtyard, fencing	0.0/100	<0.01
S110355.52/S482/220422	PSB site, northern end, fencing along Redbank Rd.	0.0/100	<0.01
S110355.52/S338/220422	PSB site, western end, fencing along CASB loading dock.	1.0/100	<0.01
S110355.52/S963/220422	PSB site, southern end, fencing along laneway	3.5/100	<0.01
S110355.52/S932/220422	PSB site, eastern end, fencing behind site sheds	2.0/100	<0.01
S110355.52/S201/220422	Field Blank	0.0/100	NA

## CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

26 April 2022

**4. Conclusion:** All air monitoring analytical results reported on in this report are below the lowest detectable level of 0.01 fibres/mL of air.

**Analysed and reported by:**



**Karl Grovenor**  
Analyst



**Rune Knoph**  
Approved Issuer of Reports

## **CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS**

26 April 2022

### **APPENDIX A – MONITOR LOCATIONS**

## CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

26 April 2022





## CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

26 April 2022

**Attention:** Danny Khal  
**Company:** Ford Civil Contracting Pty Ltd  
**Email:** danny.khal@fordcivil.com.au  
**Address:** 9 Hattersley Street, Arncliffe NSW 2205

**SWE Report Reference:** S110355.53-AAM1.v1-23/04/2022  
**Site Address:** MSCP and PSB, Westmead Hospital  
**Sampling Date:** 23/04/2022  
**Sample Analysis Date:** 26/04/2022  
**Period of Sampling:** 23/04/2022 07:00 AM - 23/04/2022 03:00 PM  
**Scope of Work:** Control monitoring for asbestos fibres  
**SWE Laboratory:** Suite 15, 103 Majors Bay Road, Concord NSW 2137

**Accreditation number:** 17092 **Site number:** 18665

**1. Introduction:** Control monitoring for airborne asbestos fibres was undertaken by Safe Work and Environments Pty Ltd (SWE) is used to verify the effectiveness of control measures implemented to prevent fibre release as a result of asbestos removal/related work.

**2. Methods:** Airborne asbestos fibre monitoring was carried out in accordance with the Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres, 2nd Edition [NOHSC:3003 (2005)] and SWE's In-House Method 2 – Volume Measurement, Calibration and Standardisation. Analysis of collected filter membrane samples was performed in accordance with NOHSC:3003 (2005) and SWE's In-House Method 1 – Asbestos Fibre Count and Mount.

### 3. Results:

SWE REF.	LOCATION OF SAMPLE	FIBRES/ FIELDS	CONCENTRATION (FIBRES/mL)
S110355.53/S620/230422	MSCP site, northwest end of site, adj old maintenance car park, fencing	0.0/100	<0.01
S110355.53/S893/230422	MSCP site, fencing adj. Redbank Rd, west end	1.5/100	<0.01
S110355.53/S118/230422	MSCP site, fencing adj. Redbank Rd, east end	2.0/100	<0.01
S110355.53/S496/230422	MSCP site, Corner of Labyrinth Way and Redbank Road, fencing	0.0/100	<0.01
S110355.53/S014/230422	PSB site, eastern end, fencing behind site sheds	0.5/100	<0.01
S110355.53/S650/230422	MSCP site, southwest end, adj. small courtyard, fencing	0.0/100	<0.01
S110355.53/S096/230422	PSB site, northern end, fencing along Redbank Rd.	0.0/100	<0.01
S110355.53/S291/230422	PSB site, western end, fencing along CASB loading dock.	2.0/100	<0.01
S110355.53/S155/230422	PSB site, southern end, fencing along laneway	VOID*	VOID*
S110355.53/S826/230422	PSB site, eastern end, fencing behind site sheds	0.0/100	<0.01
S110355.53/S669/230422	Field Blank	0.0/100	NA

\* - sample voided due to excess dust loading

S110355.53-AAM1.v1-ControlAsbestosAirMonitoringReport-230422

Page 1 of 4

**Safe Work and Environments Pty Ltd 88127010995**  
Suite 15, 103 Majors Bay Road, Concord NSW 2137  
Phone: 02 8757 3611  
Email: [info@swe.com.au](mailto:info@swe.com.au)

## CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

26 April 2022

**4. Conclusion:** All air monitoring analytical results reported on in this report are below the lowest detectable level of 0.01 fibres/mL of air.

**Analysed and reported by:**



**Karl Grovenor**  
Analyst



**Rune Knoph**  
Approved Issuer of Reports

## CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

26 April 2022

### APPENDIX A – MONITOR LOCATIONS

## CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

26 April 2022





## CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

27 April 2022

**Attention:** Danny Khal  
**Company:** Ford Civil Contracting Pty Ltd  
**Email:** danny.khal@fordcivil.com.au  
**Address:** 9 Hattersley Street, Arncliffe NSW 2205

**SWE Report Reference:** S110355.54-AAM1.v1-26/04/2022  
**Site Address:** MSCP and PSB, Westmead Hospital  
**Sampling Date:** 26/04/2022  
**Sample Analysis Date:** 27/04/2022  
**Period of Sampling:** 26/04/2022 07:10 AM - 26/04/2022 03:41 PM  
**Scope of Work:** Control monitoring for asbestos fibres  
**SWE Laboratory:** Suite 15, 103 Majors Bay Road, Concord NSW 2137

**Accreditation number:** 17092 **Site number:** 18665

**1. Introduction:** Control monitoring for airborne asbestos fibres was undertaken by Safe Work and Environments Pty Ltd (SWE) is used to verify the effectiveness of control measures implemented to prevent fibre release as a result of asbestos removal/related work.

**2. Methods:** Airborne asbestos fibre monitoring was carried out in accordance with the Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres, 2nd Edition [NOHSC:3003 (2005)] and SWE's In-House Method 2 – Volume Measurement, Calibration and Standardisation. Analysis of collected filter membrane samples was performed in accordance with NOHSC:3003 (2005) and SWE's In-House Method 1 – Asbestos Fibre Count and Mount.

### 3. Results:

SWE REF.	LOCATION OF SAMPLE	FIBRES/ FIELDS	CONCENTRATION (FIBRES/mL)
S110355.54/S587/260422	MSCP site, northwest end of site, adj old maintenance car park, fencing	0.0/100	<0.01
S110355.54/S146/260422	MSCP site, fencing adj. Redbank Rd, west end	0.0/100	<0.01
S110355.54/S181/260422	MSCP site, fencing adj. Redbank Rd, west end	1.0/100	<0.01
S110355.54/S215/260422	MSCP site, Corner of Labyrinth Way and Redbank Road, fencing	0.0/100	<0.01
S110355.54/S125/260422	MSCP site, southeast end of site, adj site sheds, fencing	0.0/100	<0.01
S110355.54/S971/260422	MSCP site, southwest end, adj. small courtyard, fencing	0.0/100	<0.01
S110355.54/S806/260422	PSB site, northern end, fencing along Redbank Rd.	0.0/100	<0.01
S110355.54/S490/260422	PSB site, western end, fencing along CASB loading dock.	0.0/100	<0.01
S110355.54/S994/260422	PSB site, southern end, fencing along laneway	0.5/100	<0.01
S110355.54/S237/260422	PSB site, eastern end, fencing behind site sheds	0.0/100	<0.01
S110355.54/S911/260422	Field Blank	0.0/100	NA

## CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

27 April 2022

**4. Conclusion:** All air monitoring analytical results reported on in this report are below the lowest detectable level of 0.01 fibres/mL of air.

**Analysed and reported by:**



**Karl Grovenor**  
Analyst



**Rune Knoph**  
Approved Issuer of Reports

## **CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS**

27 April 2022

## **APPENDIX A – MONITOR LOCATIONS**

## CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

27 April 2022



S110355.54-AAM1.v1-ControlAsbestosAirMonitoringReport-260422

Page 4 of 4



## CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

28 April 2022

**Attention:** Danny Khal  
**Company:** Ford Civil Contracting Pty Ltd  
**Email:** danny.khal@fordcivil.com.au  
**Address:** 9 Hattersley Street, Arncliffe NSW 2205

**SWE Report Reference:** S110355.55-AAM1.v1-27/04/2022  
**Site Address:** MSCP and PSB, Westmead Hospital  
**Sampling Date:** 27/04/2022  
**Sample Analysis Date:** 28/04/2022  
**Period of Sampling:** 27/04/2022 07:09 AM - 27/04/2022 03:31 PM  
**Scope of Work:** Control monitoring for asbestos fibres  
**SWE Laboratory:** Suite 15, 103 Majors Bay Road, Concord NSW 2137

**Accreditation number:** 17092

**Site number:** 18665

**1. Introduction:** Control monitoring for airborne asbestos fibres was undertaken by Safe Work and Environments Pty Ltd (SWE) is used to verify the effectiveness of control measures implemented to prevent fibre release as a result of asbestos removal/related work.

**2. Methods:** Airborne asbestos fibre monitoring was carried out in accordance with the Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres, 2nd Edition [NOHSC:3003 (2005)] and SWE's In-House Method 2 – Volume Measurement, Calibration and Standardisation. Analysis of collected filter membrane samples was performed in accordance with NOHSC:3003 (2005) and SWE's In-House Method 1 – Asbestos Fibre Count and Mount.

### 3. Results:

SWE REF.	LOCATION OF SAMPLE	FIBRES/ FIELDS	CONCENTRATION (FIBRES/mL)
S110355.55/S797/270422	MSCP site, northwest end of site, adj old maintenance car park, fencing	1.0/100	<0.01
S110355.55/S226/270422	MSCP site, fencing adj. Redbank Rd, west end	2.0/100	<0.01
S110355.55/S926/270422	MSCP site, fencing adj. Redbank Rd, east end	VOID*	VOID*
S110355.55/S072/270422	MSCP site, Corner of Labyrinth Way and Redbank Road, fencing	0.0/100	<0.01
S110355.55/S979/270422	MSCP site, southeast end of site, adj site sheds, fencing	0.0/100	<0.01
S110355.55/S978/270422	MSCP site, southwest end, adj. small courtyard, fencing	0.5/100	<0.01
S110355.55/S590/270422	PSB site, northern end, fencing along Redbank Rd.	0.0/100	<0.01
S110355.55/S200/270422	PSB site, western end, fencing along CASB loading dock.	0.0/100	<0.01
S110355.55/S893/270422	PSB site, southern end, fencing along laneway	3.0/100	<0.01
S110355.55/S010/270422	PSB site, eastern end, fencing behind site sheds	0.0/100	<0.01
S110355.55/S333/270422	Field Blank	0.0/100	NA

\* - sample voided due to excess dust loading

S110355.55-AAM1.v1-ControlAsbestosAirMonitoringReport-270422

Page 1 of 4

**Safe Work and Environments Pty Ltd 88127010995**

Suite 15, 103 Majors Bay Road, Concord NSW 2137

Phone: 02 8757 3611

Email: [info@swe.com.au](mailto:info@swe.com.au)

## CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

28 April 2022

**4. Conclusion:** All air monitoring analytical results reported on in this report are below the lowest detectable level of 0.01 fibres/mL of air.

**Analysed and reported by:**



**Karl Grovenor**  
Analyst



**Rune Knoph**  
Approved Issuer of Reports

## **CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS**

28 April 2022

## **APPENDIX A – MONITOR LOCATIONS**

## CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

28 April 2022



S110355.55-AAM1.v1-ControlAsbestosAirMonitoringReport-270422

Page 4 of 4



## CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

29 April 2022

**Attention:** Danny Khal  
**Company:** Ford Civil Contracting Pty Ltd  
**Email:** danny.khal@fordcivil.com.au  
**Address:** 9 Hattersley Street, Arncliffe NSW 2205

**SWE Report Reference:** S110355.56-AAM1.v1-28/04/2022  
**Site Address:** MSCP and PSB, Westmead Hospital  
**Sampling Date:** 28/04/2022  
**Sample Analysis Date:** 29/04/2022  
**Period of Sampling:** 28/04/2022 07:05 AM - 28/04/2022 03:30 PM  
**Scope of Work:** Control monitoring for asbestos fibres  
**SWE Laboratory:** Suite 15, 103 Majors Bay Road, Concord NSW 2137

**Accreditation number:** 17092                      **Site number:** 18665

**1. Introduction:** Control monitoring for airborne asbestos fibres was undertaken by Safe Work and Environments Pty Ltd (SWE) is used to verify the effectiveness of control measures implemented to prevent fibre release as a result of asbestos removal/related work.

**2. Methods:** Airborne asbestos fibre monitoring was carried out in accordance with the Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres, 2nd Edition [NOHSC:3003 (2005)] and SWE's In-House Method 2 – Volume Measurement, Calibration and Standardisation. Analysis of collected filter membrane samples was performed in accordance with NOHSC:3003 (2005) and SWE's In-House Method 1 – Asbestos Fibre Count and Mount.

### 3. Results:

SWE REF.	LOCATION OF SAMPLE	FIBRES/ FIELDS	CONCENTRATION (FIBRES/mL)
S110355.56/S747/280422	MSCP site, northwest end of site, adj old maintenance car park, fencing	0.0/100	<0.01
S110355.56/S983/280422	MSCP site, fencing adj. Redbank Rd, west end	0.0/100	<0.01
S110355.56/S506/280422	MSCP site, fencing adj. Redbank Rd, east end	3.0/100	<0.01
S110355.56/S190/280422	MSCP site, Corner of Labyrinth Way and Redbank Road, fencing	1.0/100	<0.01
S110355.56/S231/280422	MSCP site, southeast end of site, adj site sheds, fencing	0.0/100	<0.01
S110355.56/S334/280422	MSCP site, southwest end, adj. small courtyard, fencing	0.0/100	<0.01
S110355.56/S925/280422	PSB site, northern end, fencing along Redbank Rd.	0.0/100	<0.01
S110355.56/S832/280422	PSB site, western end, fencing along CASB loading dock.	0.0/100	<0.01
S110355.56/S537/280422	PSB site, southern end, fencing along laneway	0.0/100	<0.01
S110355.56/S791/280422	PSB site, eastern end, fencing behind site sheds	1.0/100	<0.01
S110355.56/S500/280422	Field Blank	0.0/100	NA

## CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

29 April 2022

**4. Conclusion:** All air monitoring analytical results reported on in this report are below the lowest detectable level of 0.01 fibres/mL of air.

**Analysed and reported by:**



**Karl Grovenor**  
Analyst



**Rune Knoph**  
Approved Issuer of Reports

## **CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS**

29 April 2022

### **APPENDIX A – MONITOR LOCATIONS**

## CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

29 April 2022



S110355.56-AAM1.v1-ControlAsbestosAirMonitoringReport-280422

Page 4 of 4



## CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

02 May 2022

**Attention:** Danny Khal  
**Company:** Ford Civil Contracting Pty Ltd  
**Email:** danny.khal@fordcivil.com.au  
**Address:** 9 Hattersley Street, Arncliffe NSW 2205

**SWE Report Reference:** S110355.57-AAM1.v1-29/04/2022  
**Site Address:** MSCP and PSB, Westmead Hospital  
**Sampling Date:** 29/04/2022  
**Sample Analysis Date:** 02/05/2022  
**Period of Sampling:** 29/04/2022 07:05 AM - 29/04/2022 02:59 PM  
**Scope of Work:** Control monitoring for asbestos fibres  
**SWE Laboratory:** Suite 15, 103 Majors Bay Road, Concord NSW 2137

**Accreditation number:** 17092 **Site number:** 18665

**1. Introduction:** Control monitoring for airborne asbestos fibres was undertaken by Safe Work and Environments Pty Ltd (SWE) is used to verify the effectiveness of control measures implemented to prevent fibre release as a result of asbestos removal/related work.

**2. Methods:** Airborne asbestos fibre monitoring was carried out in accordance with the Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres, 2nd Edition [NOHSC:3003 (2005)] and SWE's In-House Method 2 – Volume Measurement, Calibration and Standardisation. Analysis of collected filter membrane samples was performed in accordance with NOHSC:3003 (2005) and SWE's In-House Method 1 – Asbestos Fibre Count and Mount.

### 3. Results:

SWE REF.	LOCATION OF SAMPLE	FIBRES/ FIELDS	CONCENTRATION (FIBRES/mL)
S110355.57/S802/290422	MSCP site, northwest end of site, adj old maintenance car park, fencing	0.0/100	<0.01
S110355.57/S139/290422	MSCP site, fencing adj. Redbank Rd, west end	2.0/100	<0.01
S110355.57/S098/290422	MSCP site, fencing adj. Redbank Rd, east end	0.0/100	<0.01
S110355.57/S194/290422	MSCP site, Corner of Labyrinth Way and Redbank Road, fencing	0.0/100	<0.01
S110355.57/S492/290422	PSB site, eastern end, fencing behind site sheds	0.0/100	<0.01
S110355.57/S599/290422	MSCP site, southwest end, adj. small courtyard, fencing	1.0/100	<0.01
S110355.57/S241/290422	PSB site, northern end, fencing along Redbank Rd.	0.5/100	<0.01
S110355.57/S741/290422	PSB site, western end, fencing along CASB loading dock.	0.0/100	<0.01
S110355.57/S735/290422	PSB site, southern end, fencing along laneway	0.0/100	<0.01
S110355.57/S232/290422	PSB site, eastern end, fencing behind site sheds	0.0/100	<0.01
S110355.57/S573/290422	Field Blank	0.0/100	NA

## CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

02 May 2022

**4. Conclusion:** All air monitoring analytical results reported on in this report are below the lowest detectable level of 0.01 fibres/mL of air.

**Analysed and reported by:**



**Karl Grovenor**  
Analyst



**Rune Knoph**  
Approved Issuer of Reports

## **CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS**

02 May 2022

## **APPENDIX A – MONITOR LOCATIONS**

## CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

02 May 2022



S110355.57-AAM1.v1-ControlAsbestosAirMonitoringReport-290422

Page 4 of 4



## CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

02 May 2022

**Attention:** Danny Khal  
**Company:** Ford Civil Contracting Pty Ltd  
**Email:** danny.khal@fordcivil.com.au  
**Address:** 9 Hattersley Street, Arncliffe NSW 2205

**SWE Report Reference:** S110355.58-AAM1.v1-30/04/2022  
**Site Address:** MSCP and PSB, Westmead Hospital  
**Sampling Date:** 30/04/2022  
**Sample Analysis Date:** 02/05/2022  
**Period of Sampling:** 30/04/2022 07:00 AM - 30/04/2022 03:00 PM  
**Scope of Work:** Control monitoring for asbestos fibres  
**SWE Laboratory:** Suite 15, 103 Majors Bay Road, Concord NSW 2137

**Accreditation number:** 17092

**Site number:** 18665

**1. Introduction:** Control monitoring for airborne asbestos fibres was undertaken by Safe Work and Environments Pty Ltd (SWE) is used to verify the effectiveness of control measures implemented to prevent fibre release as a result of asbestos removal/related work.

**2. Methods:** Airborne asbestos fibre monitoring was carried out in accordance with the Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres, 2nd Edition [NOHSC:3003 (2005)] and SWE's In-House Method 2 – Volume Measurement, Calibration and Standardisation. Analysis of collected filter membrane samples was performed in accordance with NOHSC:3003 (2005) and SWE's In-House Method 1 – Asbestos Fibre Count and Mount.

### 3. Results:

SWE REF.	LOCATION OF SAMPLE	FIBRES/ FIELDS	CONCENTRATION (FIBRES/mL)
S110355.58/S097/300422	MSCP site, northwest end of site, adj old maintenance car park, fencing	5.0/100	<0.01
S110355.58/S997/300422	MSCP site, fencing adj. Redbank Rd, west end	2.0/100	<0.01
S110355.58/S882/300422	MSCP site, fencing adj. Redbank Rd, east end	VOID*	VOID*
S110355.58/S808/300422	MSCP site, Corner of Labyrinth Way and Redbank Road, fencing	0.0/100	<0.01
S110355.58/S990/300422	MSCP site, southeast end of site, adj site sheds, fencing	0.0/100	<0.01
S110355.58/S408/300422	MSCP site, southwest end, adj. small courtyard, fencing	0.0/100	<0.01
S110355.58/S489/300422	PSB site, northern end, fencing along Redbank Rd.	2.5/100	<0.01
S110355.58/S979/300422	PSB site, western end, fencing along CASB loading dock.	0.0/100	<0.01
S110355.58/S915/300422	PSB site, southern end, fencing along laneway	0.0/100	<0.01
S110355.58/S989/300422	PSB site, eastern end, fencing behind site sheds	0.0/100	<0.01
S110355.58/S401/300422	Field Blank	0.0/100	NA

\* - sample voided due to excess dust loading on filter

S110355.58-AAM1.v1-ControlAsbestosAirMonitoringReport-300422

Page 1 of 4

## CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

02 May 2022

**4. Conclusion:** All air monitoring analytical results reported on in this report are below the lowest detectable level of 0.01 fibres/mL of air.

**Analysed and reported by:**



**Karl Grovenor**  
Analyst



**Rune Knoph**  
Approved Issuer of Reports

## **CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS**

02 May 2022

### **APPENDIX A – MONITOR LOCATIONS**

## CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

02 May 2022

