

CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

02 June 2022

Attention: Danny Khal
Company: Ford Civil Contracting Pty Ltd
Email: miguel.canas@fordcivil.com.au
Address: 9 Hattersley Street, Arncliffe NSW 2205

SWE Report Reference: S110355.84-AAM1.v1-01/06/2022
Site Address: MSCP and PSB, Westmead Hospital
Sampling Date: 01/06/2022
Sample Analysis Date: 02/06/2022
Period of Sampling: 01/06/2022 06:50 AM - 02/06/2022 03:55 PM
Scope of Work: Air Monitoring during civil works of asbestos impacted soils
SWE Laboratory: Suite 15, 103 Majors Bay Road, Concord NSW 2137

Accreditation number: 17092

Site number: 18665

1. Introduction: Control monitoring for airborne asbestos fibres was undertaken by Safe Work and Environments Pty Ltd (SWE) is used to verify the effectiveness of control measures implemented to prevent fibre release as a result of asbestos removal/related work.

2. Methods: Airborne asbestos fibre monitoring was carried out in accordance with the Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres, 2nd Edition [NOHSC:3003 (2005)] and SWE's In-House Method 2 – Volume Measurement, Calibration and Standardisation. Analysis of collected filter membrane samples was performed in accordance with NOHSC:3003 (2005) and SWE's In-House Method 1 – Asbestos Fibre Count and Mount.

3. Results:

SWE REF.	LOCATION OF SAMPLE	FIBRES/ FIELDS	CONCENTRATION (FIBRES/mL)
S110355.84/S408/010622	MSCP site, northwest end of site, adj old maintenance car park, fencing	0.0/100	<0.01
S110355.84/S703/010622	MSCP site, Corner of Labyrinth Way and Redbank Road, fencing	0.0/100	<0.01
S110355.84/S582/010622	MSCP site, southeast end of site, adj site sheds, fencing	0.0/100	<0.01
S110355.84/S168/010622	MSCP site, southwest end, adj. small courtyard, fencing	0.0/100	<0.01
S110355.84/S715/010622	PSB site, northern end, fencing along Redbank Rd.	0.0/100	<0.01
S110355.84/S902/010622	PSB site, western end, fencing along CASB loading dock.	0.0/100	<0.01
S110355.84/S281/010622	PSB site, southern end, fencing along laneway	0.0/100	<0.01
S110355.84/S773/010622	PSB site, eastern end, fencing behind site sheds	0.0/100	<0.01
S110355.84/S934/010622	Mons Road, Southwest of compound, adjacent site gate	2.0/100	<0.01

CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

02 June 2022

S110355.84/S891/010622	Blank	0.0/100	NA
------------------------	-------	---------	----

4. Conclusion: All air monitoring analytical results reported on in this report are below the lowest detectable level of 0.01 fibres/mL of air.

Analysed and reported by:



Evan Dickson
Analyst



Rune Knoph
Approved Issuer of Reports

CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

02 June 2022

APPENDIX A – MONITOR LOCATIONS

CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

02 June 2022



S110355.84-AAM1.v1-ControlAsbestosAirMonitoringReport-010622

Page 4 of 5

CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

02 June 2022



CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

03 June 2022

Attention: Danny Khal
Company: Ford Civil Contracting Pty Ltd
Email: miguel.canas@fordcivil.com.au
Address: 9 Hattersley Street, Arncliffe NSW 2205

SWE Report Reference: S110355.85-AAM1.v1-02/06/2022
Site Address: MSCP and PSB, Westmead Hospital
Sampling Date: 02/06/2022
Sample Analysis Date: 03/06/2022
Period of Sampling: 02/06/2022 07:19 AM - 02/06/2022 03:46 PM
Scope of Work: Air Monitoring during civil works of asbestos impacted soils
SWE Laboratory: Suite 15, 103 Majors Bay Road, Concord NSW 2137

Accreditation number: 17092

Site number: 18665

1. Introduction: Control monitoring for airborne asbestos fibres was undertaken by Safe Work and Environments Pty Ltd (SWE) is used to verify the effectiveness of control measures implemented to prevent fibre release as a result of asbestos removal/related work.

2. Methods: Airborne asbestos fibre monitoring was carried out in accordance with the Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres, 2nd Edition [NOHSC:3003 (2005)] and SWE's In-House Method 2 – Volume Measurement, Calibration and Standardisation. Analysis of collected filter membrane samples was performed in accordance with NOHSC:3003 (2005) and SWE's In-House Method 1 – Asbestos Fibre Count and Mount.

3. Results:

SWE REF.	LOCATION OF SAMPLE	FIBRES/ FIELDS	CONCENTRATION (FIBRES/mL)
S110355.85/S307/020622	MSCP site, northwest end of site, adj old maintenance car park, fencing	0.0/100	<0.01
S110355.85/S058/020622	MSCP site, Corner of Labyrinth Way and Redbank Road, fencing	1.0/100	<0.01
S110355.85/S777/020622	MSCP site, southeast end of site, adj site sheds, fencing	0.0/100	<0.01
S110355.85/S997/020622	MSCP site, southwest end, adj. small courtyard, fencing	0.0/100	<0.01
S110355.85/S506/020622	PSB site, northern end, fencing along Redbank Rd.	0.0/100	<0.01
S110355.85/S083/020622	PSB site, western end, fencing along CASB loading dock.	2.0/100	<0.01
S110355.85/S496/020622	PSB site, southern end, fencing along laneway	0.0/100	<0.01
S110355.85/S913/020622	PSB site, eastern end, fencing behind site sheds	2.0/100	<0.01
S110355.85/S933/020622	Mons Road, Southwest of compound, adjacent site gate	2.0/100	<0.01

CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

03 June 2022

S110355.85/S077/020622	Mons Road, Northeast of compound, on fence	3.5/100	<0.01
S110355.85/S101/020622	Blank	0.0/100	NA

4. Conclusion: All air monitoring analytical results reported on in this report are below the lowest detectable level of 0.01 fibres/mL of air.

Analysed and reported by:



Evan Dickson
Analyst



Rune Knoph
Approved Issuer of Reports

CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

03 June 2022

APPENDIX A – MONITOR LOCATIONS

CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

03 June 2022



S110355.85-AAM1.v1-ControlAsbestosAirMonitoringReport-020622

Page 4 of 5

CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

03 June 2022



CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

06 June 2022

Attention: Danny Khal
Company: Ford Civil Contracting Pty Ltd
Email: miguel.canas@fordcivil.com.au
Address: 9 Hattersley Street, Arncliffe NSW 2205

Accredited for compliance
with ISO/IEC 17025 -
Testing

SWE Report Reference: S110355.86-AAM1.v1-03/06/2022
Site Address: MSCP and PSB, Westmead Hospital
Sampling Date: 03/06/2022
Sample Analysis Date: 06/06/2022
Period of Sampling: 03/06/2022 07:20 AM - 03/06/2022 03:52 PM
Scope of Work: Air Monitoring during civil works of asbestos impacted soils
SWE Laboratory: Suite 15, 103 Majors Bay Road, Concord NSW 2137

Accreditation number: 17092

Site number: 18665

1. Introduction: Control monitoring for airborne asbestos fibres was undertaken by Safe Work and Environments Pty Ltd (SWE) is used to verify the effectiveness of control measures implemented to prevent fibre release as a result of asbestos removal/related work.

2. Methods: Airborne asbestos fibre monitoring was carried out in accordance with the Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres, 2nd Edition [NOHSC:3003 (2005)] and SWE's In-House Method 2 – Volume Measurement, Calibration and Standardisation. Analysis of collected filter membrane samples was performed in accordance with NOHSC:3003 (2005) and SWE's In-House Method 1 – Asbestos Fibre Count and Mount.

3. Results:

SWE REF.	LOCATION OF SAMPLE	FIBRES/ FIELDS	CONCENTRATION (FIBRES/mL)
S110355.86/S603/030622	MSCP site, northwest end of site, adj old maintenance car park, fencing	0.0/100	<0.01
S110355.86/S098/030622	MSCP site, Corner of Labyrinth Way and Redbank Road, fencing	0.0/100	<0.01
S110355.86/S918/030622	MSCP site, southeast end of site, adj site sheds, fencing	0.0/100	<0.01
S110355.86/S178/030622	MSCP site, southwest end, adj. small courtyard, fencing	0.0/100	<0.01
S110355.86/S097/030622	PSB site, northern end, fencing along Redbank Rd.	1.0/100	<0.01
S110355.86/S756/030622	PSB site, western end, fencing along CASB loading dock.	0.0/100	<0.01
S110355.86/S989/030622	PSB site, southern end, fencing along laneway	1.0/100	<0.01
S110355.86/S979/030622	PSB site, eastern end, fencing behind site sheds	0.0/100	<0.01
S110355.86/S821/030622	Mons Road, Southwest of compound, adjacent site gate	0.0/100	<0.01

CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

06 June 2022

S110355.86/S231/030622	Mons Road, Northeast of compound, on fence	1.0/100	<0.01
S110355.86/S101/030622	Blank	0.0/100	NA

4. Conclusion: All air monitoring analytical results reported on in this report are below the lowest detectable level of 0.01 fibres/mL of air.

Analysed and reported by:



Evan Dickson
Analyst



Rune Knoph
Approved Issuer of Reports


CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

06 June 2022

APPENDIX A – MONITOR LOCATIONS

CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

06 June 2022

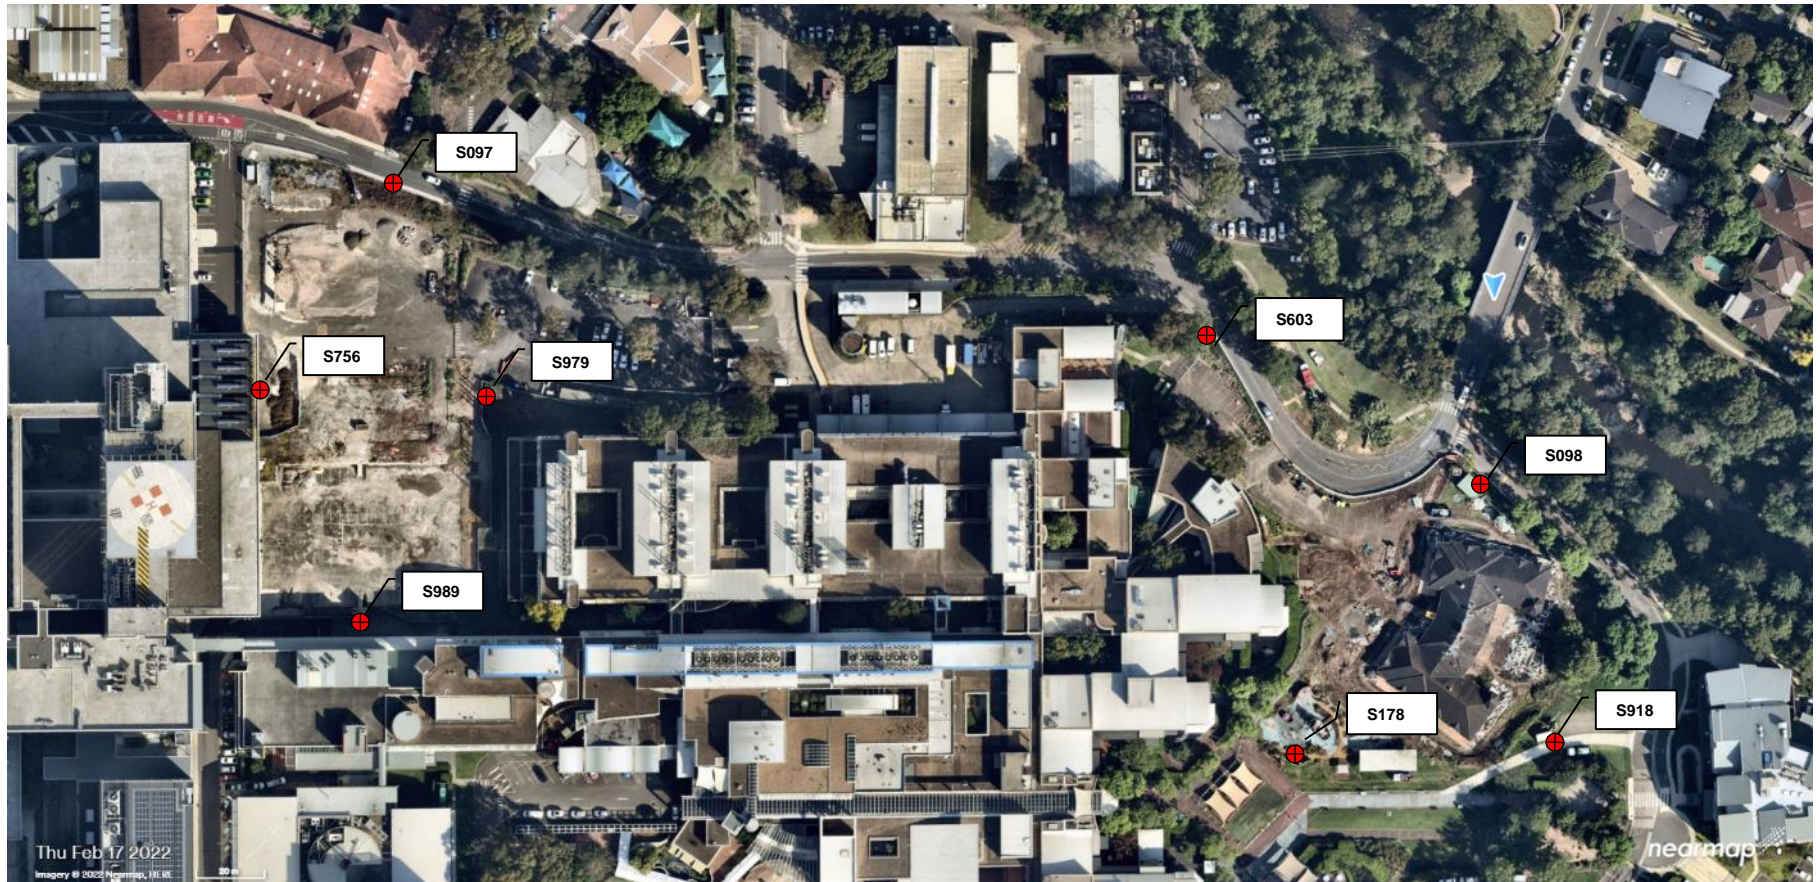

S110355.86-AAM1.v1-ControlAsbestosAirMonitoringReport-030622

Page 4 of 5

Safe Work and Environments Pty Ltd 88127010995
Suite 15, 103 Majors Bay Road, Concord NSW 2137
Phone: 02 8757 3611
Email: info@swe.com.au

CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

06 June 2022



S110355.86-AAM1.v1-ControlAsbestosAirMonitoringReport-030622

Page 5 of 5

Safe Work and Environments Pty Ltd 88127010995
Suite 15, 103 Majors Bay Road, Concord NSW 2137
Phone: 02 8757 3611
Email: info@swe.com.au

CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

06 June 2022

Accredited for compliance
with ISO/IEC 17025 -
Testing

Attention: Danny Khal
Company: Ford Civil Contracting Pty Ltd
Email: miguel.canas@fordcivil.com.au
Address: 9 Hattersley Street, Arncliffe NSW 2205

SWE Report Reference: S110355.87-AAM1.v1-04/06/2022
Site Address: MSCP and PSB, Westmead Hospital
Sampling Date: 04/06/2022
Sample Analysis Date: 06/06/2022
Period of Sampling: 04/06/2022 07:02 AM - 04/06/2022 03:22 PM
Scope of Work: Air Monitoring during civil works of asbestos impacted soils
SWE Laboratory: Suite 15, 103 Majors Bay Road, Concord NSW 2137

Accreditation number: 17092

Site number: 18665

1. Introduction: Control monitoring for airborne asbestos fibres was undertaken by Safe Work and Environments Pty Ltd (SWE) is used to verify the effectiveness of control measures implemented to prevent fibre release as a result of asbestos removal/related work.

2. Methods: Airborne asbestos fibre monitoring was carried out in accordance with the Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres, 2nd Edition [NOHSC:3003 (2005)] and SWE's In-House Method 2 – Volume Measurement, Calibration and Standardisation. Analysis of collected filter membrane samples was performed in accordance with NOHSC:3003 (2005) and SWE's In-House Method 1 – Asbestos Fibre Count and Mount.

3. Results:

SWE REF.	LOCATION OF SAMPLE	FIBRES/ FIELDS	CONCENTRATION (FIBRES/mL)
S110355.87/S576/040622	MSCP site, northwest end of site, adj old maintenance car park, fencing	0.0/100	<0.01
S110355.87/S934/040622	MSCP site, Corner of Labyrinth Way and Redbank Road, fencing	0.0/100	<0.01
S110355.87/S615/040622	MSCP site, southeast end of site, adj site sheds, fencing	0.0/100	<0.01
S110355.87/S055/040622	MSCP site, southwest end, adj. small courtyard, fencing	1.0/100	<0.01
S110355.87/S155/040622	PSB site, northern end, fencing along Redbank Rd.	0.0/100	<0.01
S110355.87/S733/040622	PSB site, western end, fencing along CASB loading dock.	1.0/100	<0.01
S110355.87/S482/040622	PSB site, southern end, fencing along laneway	0.0/100	<0.01
S110355.87/S741/040622	PSB site, eastern end, fencing behind site sheds	0.0/100	<0.01
S110355.87/S101/040622	Blank	0.0/100	NA

CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

06 June 2022

4. Conclusion: All air monitoring analytical results reported on in this report are below the lowest detectable level of 0.01 fibres/mL of air.

Analysed and reported by:



Evan Dickson
Analyst



Rune Knoph
Approved Issuer of Reports

CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

06 June 2022

APPENDIX A – MONITOR LOCATIONS

CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

06 June 2022



S110355.87-AAM1.v1-ControlAsbestosAirMonitoringReport-040622

Page 4 of 4

CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

07 June 2022

Accredited for compliance
with ISO/IEC 17025 -
Testing

Attention: Danny Khal
Company: Ford Civil Contracting Pty Ltd
Email: miguel.canas@fordcivil.com.au
Address: 9 Hattersley Street, Arncliffe NSW 2205

SWE Report Reference: S110355.88-AAM1.v1-06/06/2022
Site Address: MSCP and PSB, Westmead Hospital
Sampling Date: 06/06/2022
Sample Analysis Date: 07/06/2022
Period of Sampling: 06/06/2022 07:03 AM - 06/06/2022 03:40 PM
Scope of Work: Air Monitoring during civil works of asbestos impacted soils
SWE Laboratory: Suite 15, 103 Majors Bay Road, Concord NSW 2137

Accreditation number: 17092

Site number: 18665

1. Introduction: Control monitoring for airborne asbestos fibres was undertaken by Safe Work and Environments Pty Ltd (SWE) is used to verify the effectiveness of control measures implemented to prevent fibre release as a result of asbestos removal/related work.

2. Methods: Airborne asbestos fibre monitoring was carried out in accordance with the Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres, 2nd Edition [NOHSC:3003 (2005)] and SWE's In-House Method 2 – Volume Measurement, Calibration and Standardisation. Analysis of collected filter membrane samples was performed in accordance with NOHSC:3003 (2005) and SWE's In-House Method 1 – Asbestos Fibre Count and Mount.

3. Results:

SWE REF.	LOCATION OF SAMPLE	FIBRES/ FIELDS	CONCENTRATION (FIBRES/mL)
S110355.88/S851/060622	MSCP site, northwest end of site, adj old maintenance car park, fencing	0.0/100	<0.01
S110355.88/S182/060622	MSCP site, Corner of Labyrinth Way and Redbank Road, fencing	1.0/100	<0.01
S110355.88/S625/060622	MSCP site, southeast end of site, adj site sheds, fencing	0.0/100	<0.01
S110355.88/S743/060622	MSCP site, southwest end, adj. small courtyard, fencing	0.0/100	<0.01
S110355.88/S571/060622	PSB site, northern end, fencing along Redbank Rd.	2.0/100	<0.01
S110355.88/S285/060622	PSB site, western end, fencing along CASB loading dock.	0.0/100	<0.01
S110355.88/S894/060622	PSB site, southern end, fencing along laneway	0.0/100	<0.01
S110355.88/S780/060622	PSB site, eastern end, fencing behind site sheds	0.0/100	<0.01

CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

07 June 2022

S110355.88/S224/060622	Mons Road, Southwest of compound, adjacent site gate	0.0/100	<0.01
S110355.88/S509/060622	Mons Road, Northeast of compound, on fence	0.0/100	<0.01
S110355.88/S101/060622	Blank	0.0/100	NA

4. Conclusion: All air monitoring analytical results reported on in this report are below the lowest detectable level of 0.01 fibres/mL of air.

Analysed and reported by:



Alexandar Mitevski
Analyst



Rune Knoph
Approved Issuer of Reports

CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

07 June 2022

APPENDIX A – MONITOR LOCATIONS

CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

07 June 2022



S110355.88-AAM1.v1-ControlAsbestosAirMonitoringReport-060622

Page 4 of 5

CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

07 June 2022



CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

08 June 2022

Attention: Danny Khal
Company: Ford Civil Contracting Pty Ltd
Email: miguel.canas@fordcivil.com.au
Address: 9 Hattersley Street, Arncliffe NSW 2205

Accredited for compliance
with ISO/IEC 17025 -
Testing

SWE Report Reference: S110355.89-AAM1.v1-07/06/2022
Site Address: MSCP and PSB, Westmead Hospital
Sampling Date: 07/06/2022
Sample Analysis Date: 08/06/2022
Period of Sampling: 07/06/2022 07:03 AM - 07/06/2022 03:40 PM
Scope of Work: Air Monitoring during civil works of asbestos impacted soils
SWE Laboratory: Suite 15, 103 Majors Bay Road, Concord NSW 2137

Accreditation number: 17092

Site number: 18665

1. Introduction: Control monitoring for airborne asbestos fibres was undertaken by Safe Work and Environments Pty Ltd (SWE) is used to verify the effectiveness of control measures implemented to prevent fibre release as a result of asbestos removal/related work.

2. Methods: Airborne asbestos fibre monitoring was carried out in accordance with the Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres, 2nd Edition [NOHSC:3003 (2005)] and SWE's In-House Method 2 – Volume Measurement, Calibration and Standardisation. Analysis of collected filter membrane samples was performed in accordance with NOHSC:3003 (2005) and SWE's In-House Method 1 – Asbestos Fibre Count and Mount.

3. Results:

SWE REF.	LOCATION OF SAMPLE	FIBRES/ FIELDS	CONCENTRATION (FIBRES/mL)
S110355.89/S338/070622	MSCP site, northwest end of site, adj old maintenance car park, fencing	1.0/100	<0.01
S110355.89/S848/070622	MSCP site, Corner of Labyrinth Way and Redbank Road, fencing	0.0/100	<0.01
S110355.89/S635/070622	MSCP site, southeast end of site, adj site sheds, fencing	1.0/100	<0.01
S110355.89/S199/070622	MSCP site, southwest end, adj. small courtyard, fencing	1.0/100	<0.01
S110355.89/S190/070622	PSB site, northern end, fencing along Redbank Rd	2.0/100	<0.01
S110355.89/S583/070622	PSB site, western end, fencing along CASB loading dock	0.0/100	<0.01
S110355.89/A190/070622	PSB site, southern end, fencing along laneway	0.0/100	<0.01
S110355.89/S747/070622	PSB site, eastern end, fencing behind site sheds	0.0/100	<0.01
S110355.89/S220/070622	Mons Road, Southwest of compound, adjacent site gate	0.0/100	<0.01

CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

08 June 2022

S110355.89/S227/070622	Mons Road, Northeast of compound, on fence	0.0/100	<0.01
S110355.89/S101/070622	Blank	0.0/100	NA

4. Conclusion: All air monitoring analytical results reported on in this report are below the lowest detectable level of 0.01 fibres/mL of air.

Analysed and reported by:



Evan Dickson
Analyst



Rune Knoph
Approved Issuer of Reports

CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

08 June 2022

APPENDIX A – MONITOR LOCATIONS

CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

08 June 2022



CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

08 June 2022



CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

09 June 2022

Attention: Danny Khal
Company: Ford Civil Contracting Pty Ltd
Email: miguel.canas@fordcivil.com.au
Address: 9 Hattersley Street, Arncliffe NSW 2205

Accredited for compliance
with ISO/IEC 17025 -
Testing

SWE Report Reference: S110355.90-AAM1.v1-08/06/2022
Site Address: MSCP and PSB, Westmead Hospital
Sampling Date: 08/06/2022
Sample Analysis Date: 09/06/2022
Period of Sampling: 08/06/2022 06:55 AM - 08/06/2022 03:25 PM
Scope of Work: Air Monitoring during civil works of asbestos impacted soils
SWE Laboratory: Suite 15, 103 Majors Bay Road, Concord NSW 2137

Accreditation number: 17092

Site number: 18665

1. Introduction: Control monitoring for airborne asbestos fibres was undertaken by Safe Work and Environments Pty Ltd (SWE) is used to verify the effectiveness of control measures implemented to prevent fibre release as a result of asbestos removal/related work.

2. Methods: Airborne asbestos fibre monitoring was carried out in accordance with the Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres, 2nd Edition [NOHSC:3003 (2005)] and SWE's In-House Method 2 – Volume Measurement, Calibration and Standardisation. Analysis of collected filter membrane samples was performed in accordance with NOHSC:3003 (2005) and SWE's In-House Method 1 – Asbestos Fibre Count and Mount.

3. Results:

SWE REF.	LOCATION OF SAMPLE	FIBRES/ FIELDS	CONCENTRATION (FIBRES/mL)
S110355.90/P77/080622	MSCP site, northwest end of site, adj old maintenance car park, fencing	0.0/100	<0.01
S110355.90/ELS1069/080622	MSCP site, Corner of Labyrinth Way and Redbank Road, fencing	1.0/100	<0.01
S110355.90/P84/080622	MSCP site, southeast end of site, adj site sheds, fencing	0.0/100	<0.01
S110355.90/S222/080622	MSCP site, southwest end, adj. small courtyard, fencing	0.0/100	<0.01
S110355.90/ELS1074/080622	PSB site, northern end, fencing along Redbank Rd	1.0/100	<0.01
S110355.90/S928/080622	PSB site, western end, fencing along CASB loading dock	0.0/100	<0.01
S110355.90/S538/080622	PSB site, southern end, fencing along laneway	2.0/100	<0.01
S110355.90/P12/080622	PSB site, eastern end, fencing behind site sheds	0.0/100	<0.01

CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

09 June 2022

4. Conclusion: All air monitoring analytical results reported on in this report are below the lowest detectable level of 0.01 fibres/mL of air.

Analysed and reported by:



Evan Dickson
Analyst



Rune Knoph
Approved Issuer of Reports


CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

09 June 2022

APPENDIX A – MONITOR LOCATIONS

CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

09 June 2022

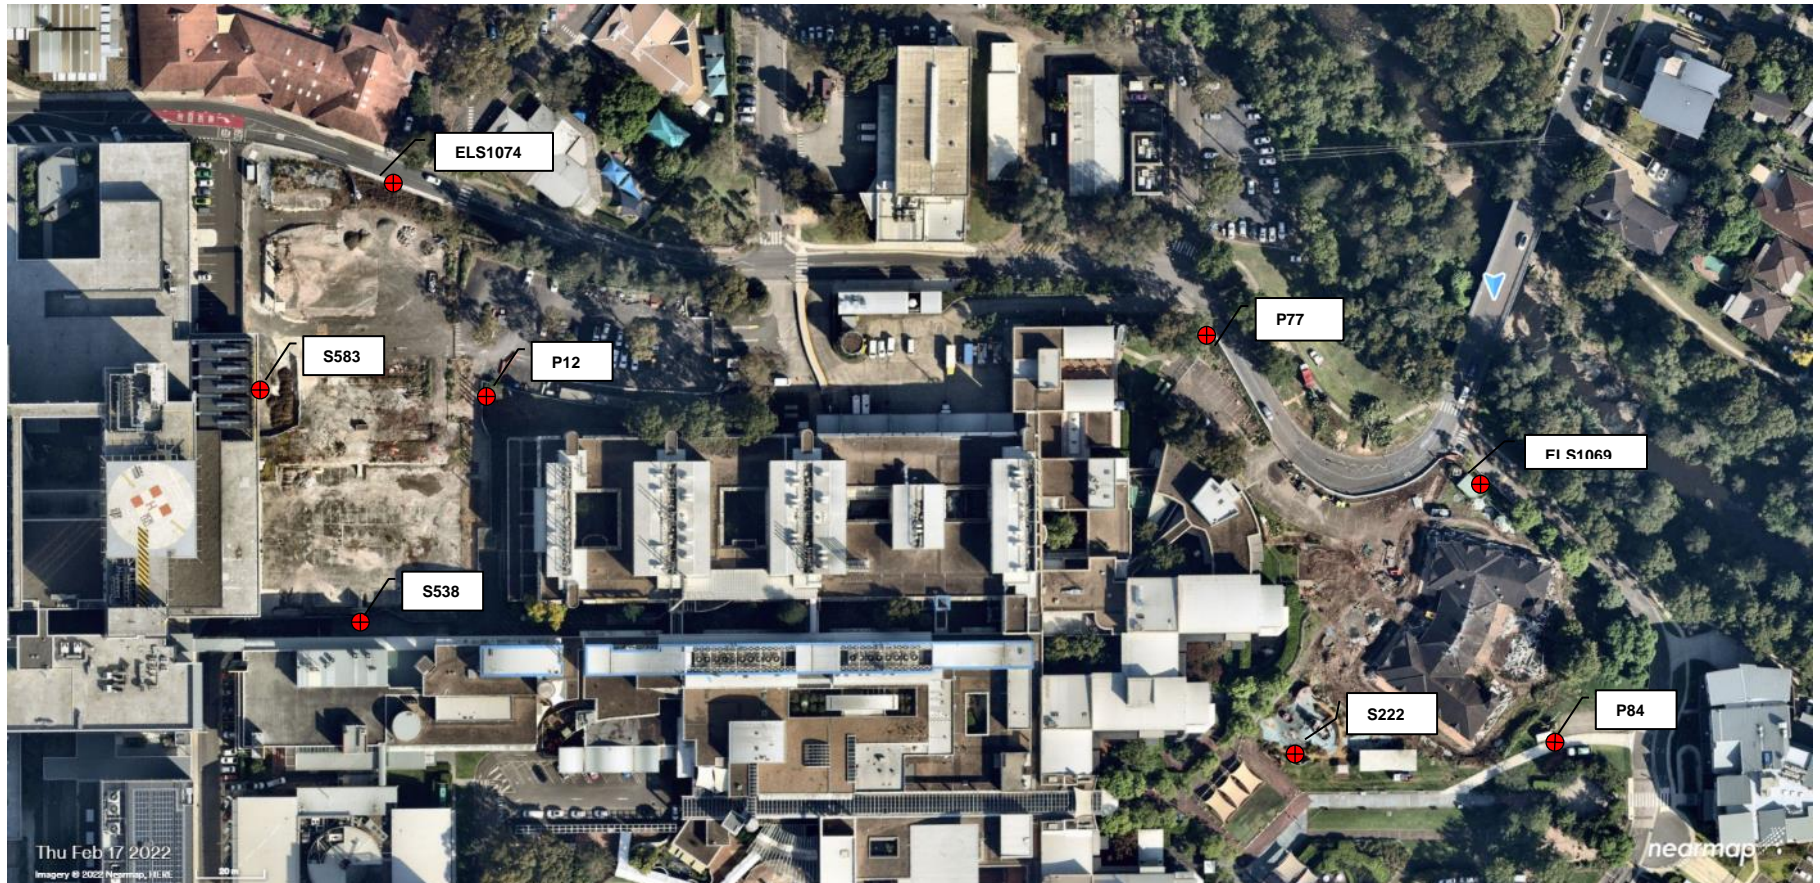

CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

10 June 2022

Attention: Danny Khal
Company: Ford Civil Contracting Pty Ltd
Email: miguel.canas@fordcivil.com.au
Address: 9 Hattersley Street, Arncliffe NSW 2205

SWE Report Reference: S110355.91-AAM1.v1-09/06/2022
Site Address: MSCP and PSB, Westmead Hospital
Sampling Date: 09/06/2022
Sample Analysis Date: 10/06/2022
Period of Sampling: 09/06/2022 06:45 AM - 09/06/2022 03:00 PM
Scope of Work: Air Monitoring during civil works of asbestos impacted soils
SWE Laboratory: Suite 15, 103 Majors Bay Road, Concord NSW 2137

Accreditation number: 17092

Site number: 18665

1. Introduction: Control monitoring for airborne asbestos fibres was undertaken by Safe Work and Environments Pty Ltd (SWE) is used to verify the effectiveness of control measures implemented to prevent fibre release as a result of asbestos removal/related work.

2. Methods: Airborne asbestos fibre monitoring was carried out in accordance with the Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres, 2nd Edition [NOHSC:3003 (2005)] and SWE's In-House Method 2 – Volume Measurement, Calibration and Standardisation. Analysis of collected filter membrane samples was performed in accordance with NOHSC:3003 (2005) and SWE's In-House Method 1 – Asbestos Fibre Count and Mount.

3. Results:

SWE REF.	LOCATION OF SAMPLE	FIBRES/ FIELDS	CONCENTRATION (FIBRES/mL)
S110355.91/S233/090622	MSCP site, northwest end of site, adj old maintenance car park, fencing	3.0/100	<0.01
S110355.91/S720/090622	MSCP site, Corner of Labyrinth Way and Redbank Road, fencing	1.0/100	<0.01
S110355.91/S626/090622	MSCP site, southeast end of site, adj site sheds, fencing	0.0/100	<0.01
S110355.91/S756/090622	MSCP site, southwest end, adj. small courtyard, fencing	0.0/100	<0.01
S110355.91/S703/090622	PSB site, northern end, fencing along Redbank Rd.	0.0/100	<0.01
S110355.91/S757/090622	PSB site, western end, fencing along CASB loading dock.	0.0/100	<0.01
S110355.91/S072/090622	PSB site, southern end, fencing along laneway	0.0/100	<0.01
S110355.91/S232/090622	PSB site, eastern end, fencing behind site sheds	1.0/100	<0.01
S110355.91/S101/090622	Blank	0.0/100	NA

4. Conclusion: All air monitoring analytical results reported on in this report are below the lowest detectable level of 0.01 fibres/mL of air.

CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

10 June 2022

Analysed and reported by:



Alexandar Mitevski
Analyst



Rune Knoph
Approved Issuer of Reports

CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

15 June 2022

Attention: Danny Khal
Company: Ford Civil Contracting Pty Ltd
Email: miguel.canas@fordcivil.com.au
Address: 9 Hattersley Street, Arncliffe NSW 2205

Accredited for compliance
with ISO/IEC 17025 -
Testing

SWE Report Reference: S110355.92-AAM1.v1-10/06/2022
Site Address: MSCP and PSB, Westmead Hospital
Sampling Date: 10/06/2022
Sample Analysis Date: 15/06/2022
Period of Sampling: 10/06/2022 07:00 AM - 10/06/2022 03:14 PM
Scope of Work: Air Monitoring during civil works of asbestos impacted soils
SWE Laboratory: Suite 15, 103 Majors Bay Road, Concord NSW 2137

Accreditation number: 17092

Site number: 18665

1. Introduction: Asbestos air samples were collected by client and submitted to the Safe Work and Environments Pty Ltd (SWE) laboratory for analysis by the membrane filter mount and count methodology. The volume measurement sampling was carried out by a SWE approved trained third party, (Ford Civil Contracting Pty Ltd), and SWE is responsible for the NATA endorsed results and data herein relied upon.

2. Methods: Airborne asbestos fibre monitoring was carried out in accordance with the Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres, 2nd Edition [NOHSC:3003 (2005)] and SWE's In-House Method 2 – Volume Measurement, Calibration and Standardisation. Analysis of collected filter membrane samples was performed in accordance with NOHSC:3003 (2005) and SWE's In-House Method 1 – Asbestos Fibre Count and Mount.

3. Results:

SWE REF.	LOCATION OF SAMPLE	FIBRES/ FIELDS	CONCENTRATION (FIBRES/mL)
S110355.92/S959/100622	MSCP site, northwest end of site, adj old maintenance car park, fencing	0.0/100	<0.01
S110355.92/S140/100622	MSCP site, Corner of Labyrinth Way and Redbank Road, fencing	1.0/100	<0.01
S110355.92/S773/100622	MSCP site, southeast end of site, adj site sheds, fencing	0.0/100	<0.01
S110355.92/S978/100622	MSCP site, southwest end, adj. small courtyard, fencing	0.0/100	<0.01
S110355.92/S281/100622	PSB site, northern end, fencing along Redbank Rd	0.0/100	<0.01
S110355.92/S340/100622	PSB site, western end, fencing along CASB loading dock	0.0/100	<0.01
S110355.92/S558/100622	PSB site, southern end, fencing along laneway	0.0/100	<0.01
S110355.92/S650/100622	PSB site, eastern end, fencing behind site sheds	1.0/100	<0.01

CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

15 June 2022

S110355.92/S741/100622	Field Blank	0.0/100	NA
------------------------	-------------	---------	----

4. Conclusion: All air monitoring analytical results reported on in this report are below the lowest detectable level of 0.01 fibres/mL of air.

Analysed and reported by:



Evan Dickson
Analyst



Rune Knoph
Approved Issuer of Reports

CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

15 June 2022

APPENDIX A – MONITOR LOCATIONS

CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

15 June 2022



CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

15 June 2022

Attention: Danny Khal
Company: Ford Civil Contracting Pty Ltd
Email: miguel.canas@fordcivil.com.au
Address: 9 Hattersley Street, Arncliffe NSW 2205

Accredited for compliance
with ISO/IEC 17025 -
Testing

SWE Report Reference: S110355.93-AAM1.v1-14/06/2022
Site Address: MSCP and PSB, Westmead Hospital
Sampling Date: 14/06/2022
Sample Analysis Date: 15/06/2022
Period of Sampling: 14/06/2022 08:05 AM - 14/06/2022 04:00 PM
Scope of Work: Air Monitoring during civil works of asbestos impacted soils
SWE Laboratory: Suite 15, 103 Majors Bay Road, Concord NSW 2137

Accreditation number: 17092

Site number: 18665

1. Introduction: Control monitoring for airborne asbestos fibres was undertaken by Safe Work and Environments Pty Ltd (SWE) is used to verify the effectiveness of control measures implemented to prevent fibre release as a result of asbestos removal/related work.

2. Methods: Airborne asbestos fibre monitoring was carried out in accordance with the Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres, 2nd Edition [NOHSC:3003 (2005)] and SWE's In-House Method 2 – Volume Measurement, Calibration and Standardisation. Analysis of collected filter membrane samples was performed in accordance with NOHSC:3003 (2005) and SWE's In-House Method 1 – Asbestos Fibre Count and Mount.

3. Results:

SWE REF.	LOCATION OF SAMPLE	FIBRES/ FIELDS	CONCENTRATION (FIBRES/mL)
S110355.93/S894/140622	MSCP site, northwest end of site, adj old maintenance car park, fencing	0.0/100	<0.01
S110355.93/S933/140622	MSCP site, Corner of Labyrinth Way and Redbank Road, fencing	0.0/100	<0.01
S110355.93/S097/140622	MSCP site, southeast end of site, adj site sheds, fencing	0.0/100	<0.01
S110355.93/S197/140622	MSCP site, southwest end, adj. small courtyard, fencing	0.0/100	<0.01
S110355.93/S098/140622	PSB site, northern end, fencing along Redbank Rd	1.0/100	<0.01
S110355.93/S913/140622	PSB site, western end, fencing along CASB loading dock	0.0/100	<0.01
S110355.93/S982/140622	PSB site, southern end, fencing along laneway	1.0/100	<0.01
S110355.93/S747/140622	PSB site, eastern end, fencing behind site sheds	0.0/100	<0.01
S110355.93/S101/140622	Field Blank	0.0/100	NA

CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

15 June 2022

4. Conclusion: All air monitoring analytical results reported on in this report are below the lowest detectable level of 0.01 fibres/mL of air.

Analysed and reported by:



Evan Dickson
Analyst



Rune Knoph
Approved Issuer of Reports

CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

15 June 2022

APPENDIX A – MONITOR LOCATIONS

CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

15 June 2022



CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

16 June 2022

Attention: Danny Khal
Company: Ford Civil Contracting Pty Ltd
Email: miguel.canas@fordcivil.com.au
Address: 9 Hattersley Street, Arncliffe NSW 2205

Accredited for compliance
with ISO/IEC 17025 -
Testing

SWE Report Reference: S110355.94-AAM1.v1-15/06/2022
Site Address: MSCP and PSB, Westmead Hospital
Sampling Date: 15/06/2022
Sample Analysis Date: 16/06/2022
Period of Sampling: 15/06/2022 06:55 AM - 15/06/2022 03:05 PM
Scope of Work: Air Monitoring during civil works of asbestos impacted soils
SWE Laboratory: Suite 15, 103 Majors Bay Road, Concord NSW 2137

Accreditation number: 17092

Site number: 18665

1. Introduction: Control monitoring for airborne asbestos fibres was undertaken by Safe Work and Environments Pty Ltd (SWE) is used to verify the effectiveness of control measures implemented to prevent fibre release as a result of asbestos removal/related work.

2. Methods: Airborne asbestos fibre monitoring was carried out in accordance with the Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres, 2nd Edition [NOHSC:3003 (2005)] and SWE's In-House Method 2 – Volume Measurement, Calibration and Standardisation. Analysis of collected filter membrane samples was performed in accordance with NOHSC:3003 (2005) and SWE's In-House Method 1 – Asbestos Fibre Count and Mount.

3. Results:

SWE REF.	LOCATION OF SAMPLE	FIBRES/ FIELDS	CONCENTRATION (FIBRES/mL)
S110355.94/S592/150622	MSCP site, northwest end of site, adj old maintenance car park, fencing	1.0/100	<0.01
S110355.94/S196/150622	MSCP site, Corner of Labyrinth Way and Redbank Road, fencing	0.0/100	<0.01
S110355.94/S895/150622	MSCP site, southeast end of site, adj site sheds, fencing	0.0/100	<0.01
S110355.94/S016/150622	MSCP site, southwest end, adj. small courtyard, fencing	0.0/100	<0.01
S110355.94/S160/150622	PSB site, northern end, fencing along Redbank Rd	0.0/100	<0.01
S110355.94/S961/150622	PSB site, western end, fencing along CASB loading dock	0.0/100	<0.01
S110355.94/S971/150622	PSB site, southern end, fencing along laneway	0.0/100	<0.01
S110355.94/S168/150622	PSB site, eastern end, fencing behind site sheds	0.0/100	<0.01
S110355.94/S995/150622	Field Blank	0.0/100	NA

CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

16 June 2022

- 4. Conclusion:** All air monitoring analytical results reported on in this report are below the lowest detectable level of 0.01 fibres/mL of air.

Analysed and reported by:



Rune Knoph

Approved Issuer of Reports

CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

16 June 2022

APPENDIX A – MONITOR LOCATIONS

CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

16 June 2022



S110355.94-AAM1.v1-ControlAsbestosAirMonitoringReport-150622

Page 4 of 4

CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

17 June 2022

Accredited for compliance
with ISO/IEC 17025 -
Testing

Attention: Danny Khal
Company: Ford Civil Contracting Pty Ltd
Email: miguel.canas@fordcivil.com.au
Address: 9 Hattersley Street, Arncliffe NSW 2205

SWE Report Reference: S110355.95-AAM1.v1-16/06/2022
Site Address: MSCP and PSB, Westmead Hospital
Sampling Date: 16/06/2022
Sample Analysis Date: 17/06/2022
Period of Sampling: 16/06/2022 06:52 AM - 16/06/2022 04:09 PM
Scope of Work: Air Monitoring during civil works of asbestos impacted soils
SWE Laboratory: Suite 15, 103 Majors Bay Road, Concord NSW 2137

Accreditation number: 17092

Site number: 18665

1. Introduction: Control monitoring for airborne asbestos fibres was undertaken by Safe Work and Environments Pty Ltd (SWE) is used to verify the effectiveness of control measures implemented to prevent fibre release as a result of asbestos removal/related work.

2. Methods: Airborne asbestos fibre monitoring was carried out in accordance with the Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres, 2nd Edition [NOHSC:3003 (2005)] and SWE's In-House Method 2 – Volume Measurement, Calibration and Standardisation. Analysis of collected filter membrane samples was performed in accordance with NOHSC:3003 (2005) and SWE's In-House Method 1 – Asbestos Fibre Count and Mount.

3. Results:

SWE REF.	LOCATION OF SAMPLE	FIBRES/ FIELDS	CONCENTRATION (FIBRES/mL)
S110355.95/3234/160622	MSCP site, northwest end of site, adj old maintenance car park, fencing	1.0/100	<0.01
S110355.95/3249/160622	MSCP site, Corner of Labyrinth Way and Redbank Road, fencing	1.0/100	<0.01
S110355.95/6367/160622	MSCP site, southeast end of site, adj site sheds, fencing	2.0/100	<0.01
S110355.95/3293/160622	MSCP site, southwest end, adj. small courtyard, fencing	1.0/100	<0.01
S110355.95/6272/160622	PSB site, northern end, fencing along Redbank Rd	0.0/100	<0.01
S110355.95/3323/160622	PSB site, western end, fencing along CASB loading dock	0.0/100	<0.01
S110355.95/3319/160622	PSB site, southern end, fencing along laneway	0.0/100	<0.01
S110355.95/P65/160622	PSB site, eastern end, fencing behind site sheds	1.0/100	<0.01
S110355.95/3447/160622	Field Blank	0.0/100	NA

CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

17 June 2022

4. Conclusion: All air monitoring analytical results reported on in this report are below the lowest detectable level of 0.01 fibres/mL of air.

Analysed and reported by:



Rune Knoph

Approved Issuer of Reports

CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

17 June 2022

APPENDIX A – MONITOR LOCATIONS

CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

17 June 2022



CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

20 June 2022

Attention: Danny Khal
Company: Ford Civil Contracting Pty Ltd
Email: miguel.canas@fordcivil.com.au
Address: 9 Hattersley Street, Arncliffe NSW 2205

SWE Report Reference: S110355.96-AAM1.v1-17/06/2022
Site Address: MSCP and PSB, Westmead Hospital
Sampling Date: 17/06/2022
Sample Analysis Date: 20/06/2022
Period of Sampling: 17/06/2022 07:11 AM - 17/06/2022 03:49 PM
Scope of Work: Air Monitoring during civil works of asbestos impacted soils
SWE Laboratory: Suite 15, 103 Majors Bay Road, Concord NSW 2137

Accreditation number: 17092

Site number: 18665

1. Introduction: Control monitoring for airborne asbestos fibres was undertaken by Safe Work and Environments Pty Ltd (SWE) is used to verify the effectiveness of control measures implemented to prevent fibre release as a result of asbestos removal/related work.

2. Methods: Airborne asbestos fibre monitoring was carried out in accordance with the Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres, 2nd Edition [NOHSC:3003 (2005)] and SWE's In-House Method 2 – Volume Measurement, Calibration and Standardisation. Analysis of collected filter membrane samples was performed in accordance with NOHSC:3003 (2005) and SWE's In-House Method 1 – Asbestos Fibre Count and Mount.

3. Results:

SWE REF.	LOCATION OF SAMPLE	FIBRES/ FIELDS	CONCENTRATION (FIBRES/mL)
S110355.96/S537/170622	MSCP site, northwest end of site, adj old maintenance car park, fencing	2.0/100	<0.01
S110355.96/S635/170622	MSCP site, Corner of Labyrinth Way and Redbank Road, fencing	1.0/100	<0.01
S110355.96/S077/170622	MSCP site, southeast end of site, adj site sheds, fencing	0.0/100	<0.01
S110355.96/P75/170622	MSCP site, southwest end, adj. small courtyard, fencing	0.0/100	<0.01
S110355.96/S822/170622	PSB site, northern end, fencing along Redbank Rd	0.0/100	<0.01
S110355.96/S391/170622	PSB site, western end, fencing along CASB loading dock	0.0/100	<0.01
S110355.96/S780/170622	PSB site, southern end, fencing along laneway	0.0/100	<0.01
S110355.96/3215/170622	PSB site, eastern end, fencing behind site sheds	0.0/100	<0.01
S110355.96/S974/170622	Field Blank	0.0/100	NA

CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

20 June 2022

4. Conclusion: All air monitoring analytical results reported on in this report are below the lowest detectable level of 0.01 fibres/mL of air.

Analysed and reported by:



Rune Knoph

Approved Issuer of Reports

CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

20 June 2022

APPENDIX A – MONITOR LOCATIONS

CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

20 June 2022



S110355.96-AAM1.v1-ControlAsbestosAirMonitoringReport-170622

Page 4 of 4

Safe Work and Environments Pty Ltd 88127010995
Suite 15, 103 Majors Bay Road, Concord NSW 2137
Phone: 02 8757 3611
Email: info@swe.com.au

CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

20 June 2022

Attention: Danny Khal
Company: Ford Civil Contracting Pty Ltd
Email: miguel.canas@fordcivil.com.au
Address: 9 Hattersley Street, Arncliffe NSW 2205

SWE Report Reference: S110355.97-AAM1.v1-18/06/2022
Site Address: MSCP and PSB, Westmead Hospital
Sampling Date: 18/06/2022
Sample Analysis Date: 20/06/2022
Period of Sampling: 18/06/2022 07:05 AM - 18/06/2022 03:01 PM
Scope of Work: Air Monitoring during civil works of asbestos impacted soils
SWE Laboratory: Suite 15, 103 Majors Bay Road, Concord NSW 2137

Accreditation number: 17092

Site number: 18665

1. Introduction: Control monitoring for airborne asbestos fibres was undertaken by Safe Work and Environments Pty Ltd (SWE) is used to verify the effectiveness of control measures implemented to prevent fibre release as a result of asbestos removal/related work.

2. Methods: Airborne asbestos fibre monitoring was carried out in accordance with the Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres, 2nd Edition [NOHSC:3003 (2005)] and SWE's In-House Method 2 – Volume Measurement, Calibration and Standardisation. Analysis of collected filter membrane samples was performed in accordance with NOHSC:3003 (2005) and SWE's In-House Method 1 – Asbestos Fibre Count and Mount.

3. Results:

SWE REF.	LOCATION OF SAMPLE	FIBRES/ FIELDS	CONCENTRATION (FIBRES/mL)
S110355.97/8459/180622	MSCP site, northwest end of site, adj old maintenance car park, fencing	0.0/100	<0.01
S110355.97/0392/180622	MSCP site, corner of Labyrinth Way and Redbank Road, fencing	0.0/100	<0.01
S110355.97/S226/180622	MSCP site, southeast end of site, adj site sheds, fencing	0.0/100	<0.01
S110355.97/3255/180622	MSCP site, southwest end, adj. small courtyard, fencing	0.0/100	<0.01
S110355.97/3486/180622	PSB site, northern end, fencing along Redbank Rd	0.0/100	<0.01
S110355.97/S104/180622	PSB site, western end, fencing along CASB loading dock	0.0/100	<0.01
S110355.97/3385/180622	PSB site, southern end, fencing along laneway	0.0/100	<0.01
S110355.97/3082/180622	PSB site, eastern end, fencing behind site sheds	0.0/100	<0.01
S110355.97/S102/180622	Field Blank	0.0/100	NA

CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

20 June 2022

4. Conclusion: All air monitoring analytical results reported on in this report are below the lowest detectable level of 0.01 fibres/mL of air.

Analysed and reported by:



Rune Knoph

Approved Issuer of Reports

CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

20 June 2022

APPENDIX A – MONITOR LOCATIONS

CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

20 June 2022



S110355.97-AAM1.v1-ControlAsbestosAirMonitoringReport-180622

Page 4 of 4

CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

21 June 2022

Attention: Danny Khal
Company: Ford Civil Contracting Pty Ltd
Email: miguel.canas@fordcivil.com.au
Address: 9 Hattersley Street, Arncliffe NSW 2205

SWE Report Reference: S110355.98-AAM1.v1-20/06/2022
Site Address: MSCP and PSB, Westmead Hospital
Sampling Date: 20/06/2022
Sample Analysis Date: 21/06/2022
Period of Sampling: 20/06/2022 07:14 AM - 20/06/2022 03:42 PM
Scope of Work: Air Monitoring during civil works of asbestos impacted soils
SWE Laboratory: Suite 15, 103 Majors Bay Road, Concord NSW 2137

Accreditation number: 17092

Site number: 18665

1. Introduction: Control monitoring for airborne asbestos fibres was undertaken by Safe Work and Environments Pty Ltd (SWE) is used to verify the effectiveness of control measures implemented to prevent fibre release as a result of asbestos removal/related work.

2. Methods: Airborne asbestos fibre monitoring was carried out in accordance with the Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres, 2nd Edition [NOHSC:3003 (2005)] and SWE's In-House Method 2 – Volume Measurement, Calibration and Standardisation. Analysis of collected filter membrane samples was performed in accordance with NOHSC:3003 (2005) and SWE's In-House Method 1 – Asbestos Fibre Count and Mount.

3. Results:

SWE REF.	LOCATION OF SAMPLE	FIBRES/ FIELDS	CONCENTRATION (FIBRES/mL)
S110355.98/S178/200622	MSCP site, northwest end of site, adj old maintenance car park, fencing	0.0/100	<0.01
S110355.98/S970/200622	MSCP site, corner of Labyrinth Way and Redbank Road, fencing	0.0/100	<0.01
S110355.98/0604/200622	MSCP site, southeast end of site, adj site sheds, fencing	1.0/100	<0.01
S110355.98/S058/200622	MSCP site, southwest end, adj. small courtyard, fencing	0.0/100	<0.01
S110355.98/3336/200622	PSB site, northern end, fencing along Redbank Rd	0.0/100	<0.01
S110355.98/6293/200622	PSB site, western end, fencing along CASB loading dock	0.0/100	<0.01
S110355.98/S183/200622	PSB site, southern end, fencing along laneway	0.0/100	<0.01
S110355.98/3530/200622	PSB site, eastern end, fencing behind site sheds	0.0/100	<0.01
S110355.98/3202/200622	Adjacent childcare centre, sewer compound, west temporary fence	1.0/100	<0.01
S110355.98/3439/200622	Field Blank	0.0/100	NA

CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

21 June 2022

4. Conclusion: All air monitoring analytical results reported on in this report are below the lowest detectable level of 0.01 fibres/mL of air.

Analysed and reported by:



Rune Knoph

Approved Issuer of Reports


CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

21 June 2022

APPENDIX A – MONITOR LOCATIONS

CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

21 June 2022

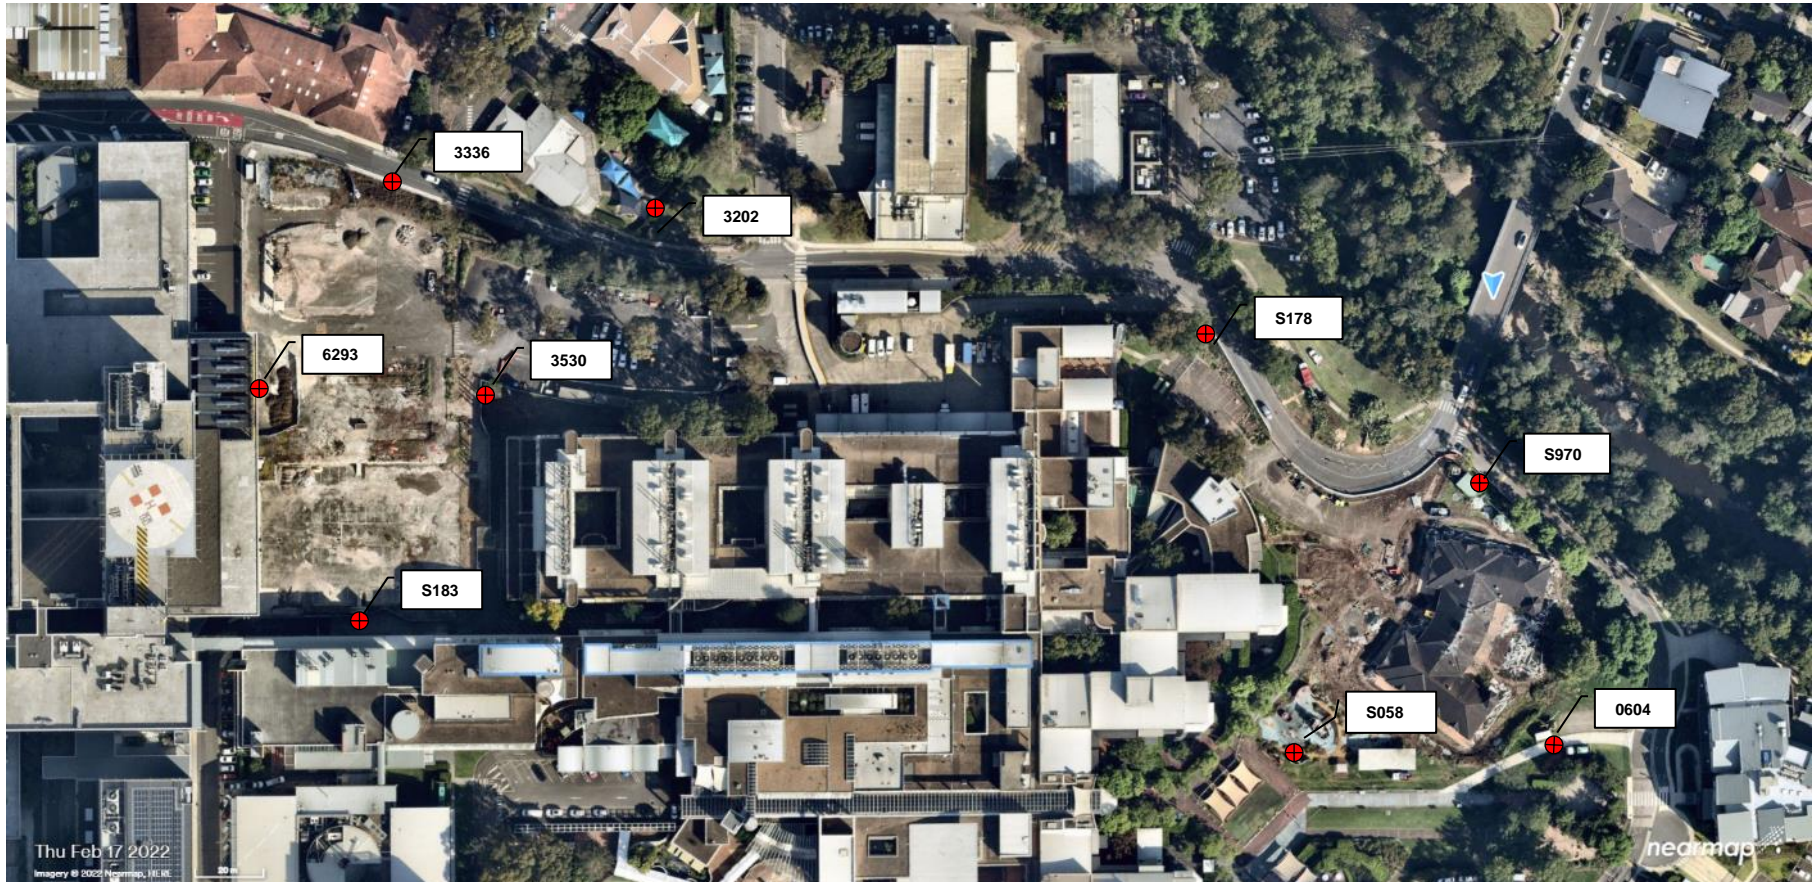

CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

22 June 2022

Attention: Danny Khal
Company: Ford Civil Contracting Pty Ltd
Email: miguel.canas@fordcivil.com.au
Address: 9 Hattersley Street, Arncliffe NSW 2205

SWE Report Reference: S110355.99-AAM1.v1-21/06/2022
Site Address: MSCP and PSB, Westmead Hospital
Sampling Date: 21/06/2022
Sample Analysis Date: 22/06/2022
Period of Sampling: 21/06/2022 07:05 AM - 21/06/2022 03:11 PM
Scope of Work: Air Monitoring during civil works of asbestos impacted soils
SWE Laboratory: Suite 15, 103 Majors Bay Road, Concord NSW 2137

Accreditation number: 17092

Site number: 18665

1. Introduction: Control monitoring for airborne asbestos fibres was undertaken by Safe Work and Environments Pty Ltd (SWE) is used to verify the effectiveness of control measures implemented to prevent fibre release as a result of asbestos removal/related work.

2. Methods: Airborne asbestos fibre monitoring was carried out in accordance with the Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres, 2nd Edition [NOHSC:3003 (2005)] and SWE's In-House Method 2 – Volume Measurement, Calibration and Standardisation. Analysis of collected filter membrane samples was performed in accordance with NOHSC:3003 (2005) and SWE's In-House Method 1 – Asbestos Fibre Count and Mount.

3. Results:

SWE REF.	LOCATION OF SAMPLE	FIBRES/ FIELDS	CONCENTRATION (FIBRES/mL)
S110355.99/3214/210622	MSCP site, southwest end, adj. small courtyard, fencing	0.0/100	<0.01
S110355.99/3436/210622	MSCP site, southeast end of site, adj site sheds, fencing	0.0/100	<0.01
S110355.99/S800/210622	MSCP site, corner of Labyrinth Way and Redbank Road, fencing	0.0/100	<0.01
S110355.99/3292/210622	MSCP site, northwest end of site, adj old maintenance car park, fencing	0.0/100	<0.01
S110355.99/S498/210622	Sewer compound, adjacent childcare centre, west temporary fencing	2.0/100	<0.01
S110355.99/3459/210622	PSB site, northern end, fencing along Redbank Rd	0.0/100	<0.01
S110355.99/3360/210622	PSB site, western end, fencing along CASB loading dock	1.0/100	<0.01
S110355.99/3216/210622	PSB site, southern end, fencing along laneway	0.0/100	<0.01
S110355.99/S941/210622	PSB site, eastern end, fencing behind site sheds	0.0/100	<0.01
S110355.99/S851/210622	Field Blank	0.0/100	NA

CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

22 June 2022

4. Conclusion: All air monitoring analytical results reported on in this report are below the lowest detectable level of 0.01 fibres/mL of air.

Analysed and reported by:



Rune Knoph

Approved Issuer of Reports


CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

22 June 2022

APPENDIX A – MONITOR LOCATIONS

CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

22 June 2022

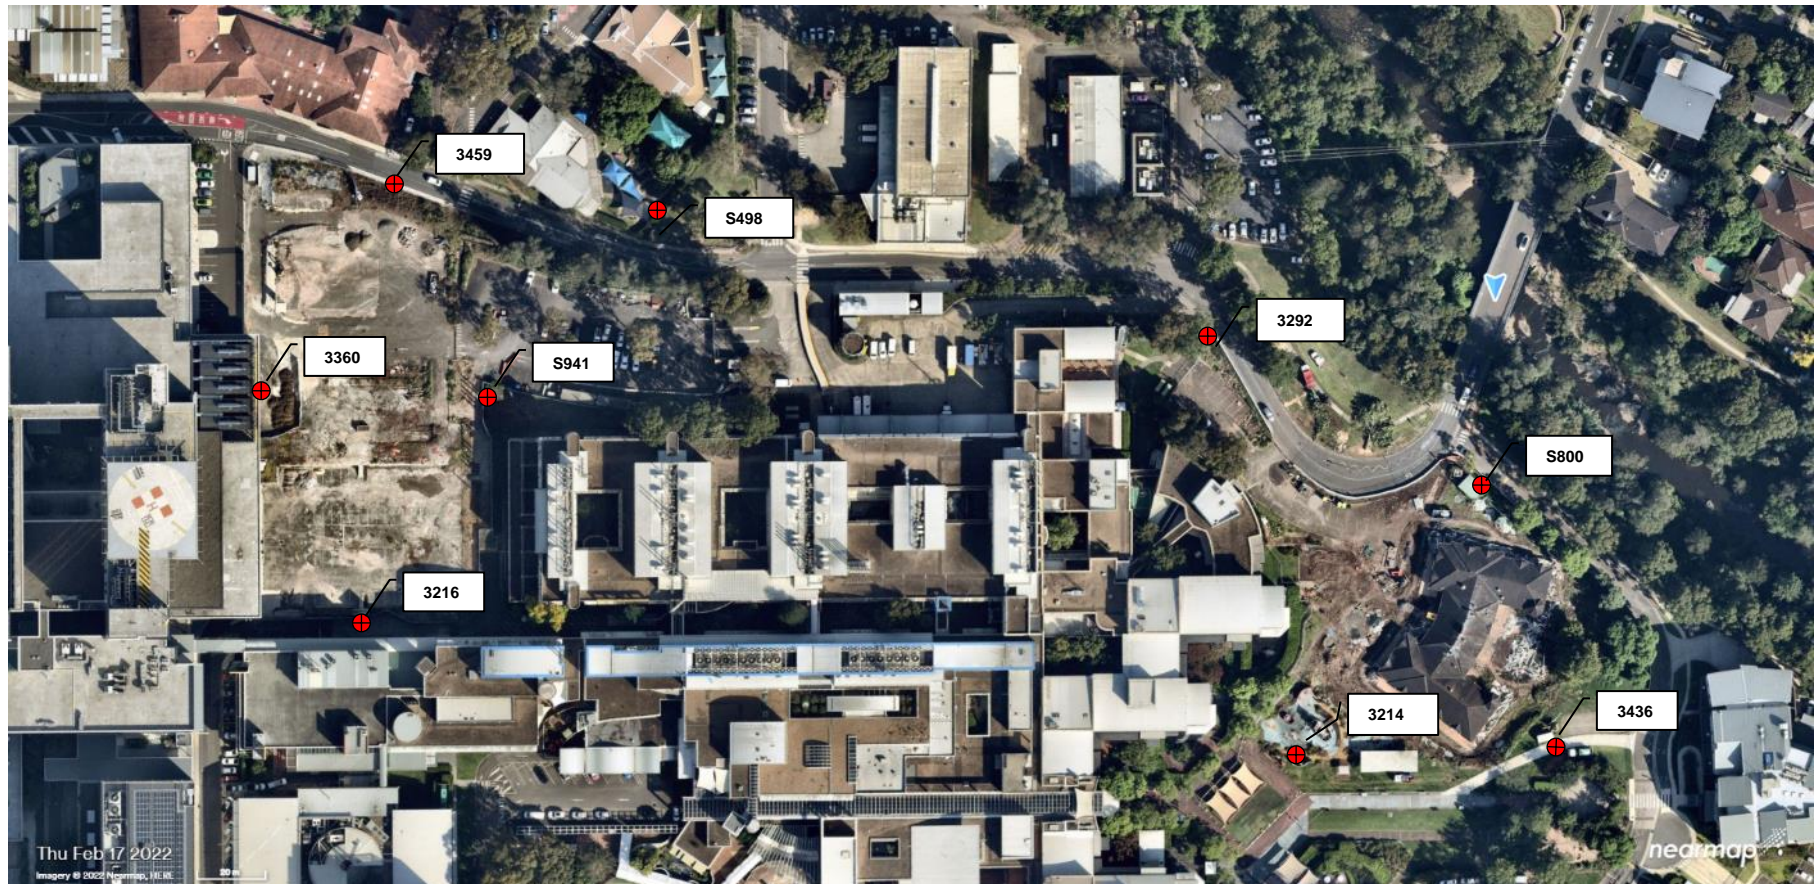

CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

22 June 2022

Attention: Danny Khal
Company: Ford Civil Contracting Pty Ltd
Email: miguel.canas@fordcivil.com.au
Address: 9 Hattersley Street, Arncliffe NSW 2205

SWE Report Reference: S110355.100-AAM1.v1-22/06/2022
Site Address: MSCP and PSB, Westmead Hospital
Sampling Date: 22/06/2022
Sample Analysis Date: 22/06/2022
Period of Sampling: 22/06/2022 07:05 AM - 22/06/2022 02:17 PM
Scope of Work: Air Monitoring during civil works of asbestos impacted soils
SWE Laboratory: Suite 15, 103 Majors Bay Road, Concord NSW 2137

Accreditation number: 17092

Site number: 18665

1. Introduction: Control monitoring for airborne asbestos fibres was undertaken by Safe Work and Environments Pty Ltd (SWE) is used to verify the effectiveness of control measures implemented to prevent fibre release as a result of asbestos removal/related work.

2. Methods: Airborne asbestos fibre monitoring was carried out in accordance with the Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres, 2nd Edition [NOHSC:3003 (2005)] and SWE's In-House Method 2 – Volume Measurement, Calibration and Standardisation. Analysis of collected filter membrane samples was performed in accordance with NOHSC:3003 (2005) and SWE's In-House Method 1 – Asbestos Fibre Count and Mount.

3. Results:

SWE REF.	LOCATION OF SAMPLE	FIBRES/ FIELDS	CONCENTRATION (FIBRES/mL)
S110355.100/S979/220622	MSCP site, southwest end, adj. small courtyard, fencing	0.0/100	<0.01
S110355.100/S849/220622	MSCP site, southeast end of site, adj site sheds, fencing	0.0/100	<0.01
S110355.100/S059/220622	MSCP site, corner of Labyrinth Way and Redbank Road, fencing	0.0/100	<0.01
S110355.100/S155/220622	MSCP site, northwest end of site, adj old maintenance car park, fencing	0.0/100	<0.01
S110355.100/S918/220622	Sewer compound, adjacent childcare centre, west temporary fencing	0.0/100	<0.01
S110355.100/S003/220622	PSB site, northern end, fencing along Redbank Rd	0.0/100	<0.01
S110355.100/S096/220622	PSB site, western end, fencing along CASB loading dock	0.0/100	<0.01
S110355.100/S715/220622	PSB site, southern end, fencing along laneway	0.0/100	<0.01
S110355.100/S227/220622	PSB site, eastern end, fencing behind site sheds	0.0/100	<0.01
S110355.100/S190/220622	Sewer compound, adjacent decontamination unit, east temporary fence	1.0/100	<0.01

CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

22 June 2022

S110355.100/S799/220622	Field Blank	0.0/100	NA
-------------------------	-------------	---------	----

4. Conclusion: All air monitoring analytical results reported on in this report are below the lowest detectable level of 0.01 fibres/mL of air.

Analysed and reported by:



Rune Knoph

Approved Issuer of Reports


CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

22 June 2022

APPENDIX A – MONITOR LOCATIONS

CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

22 June 2022

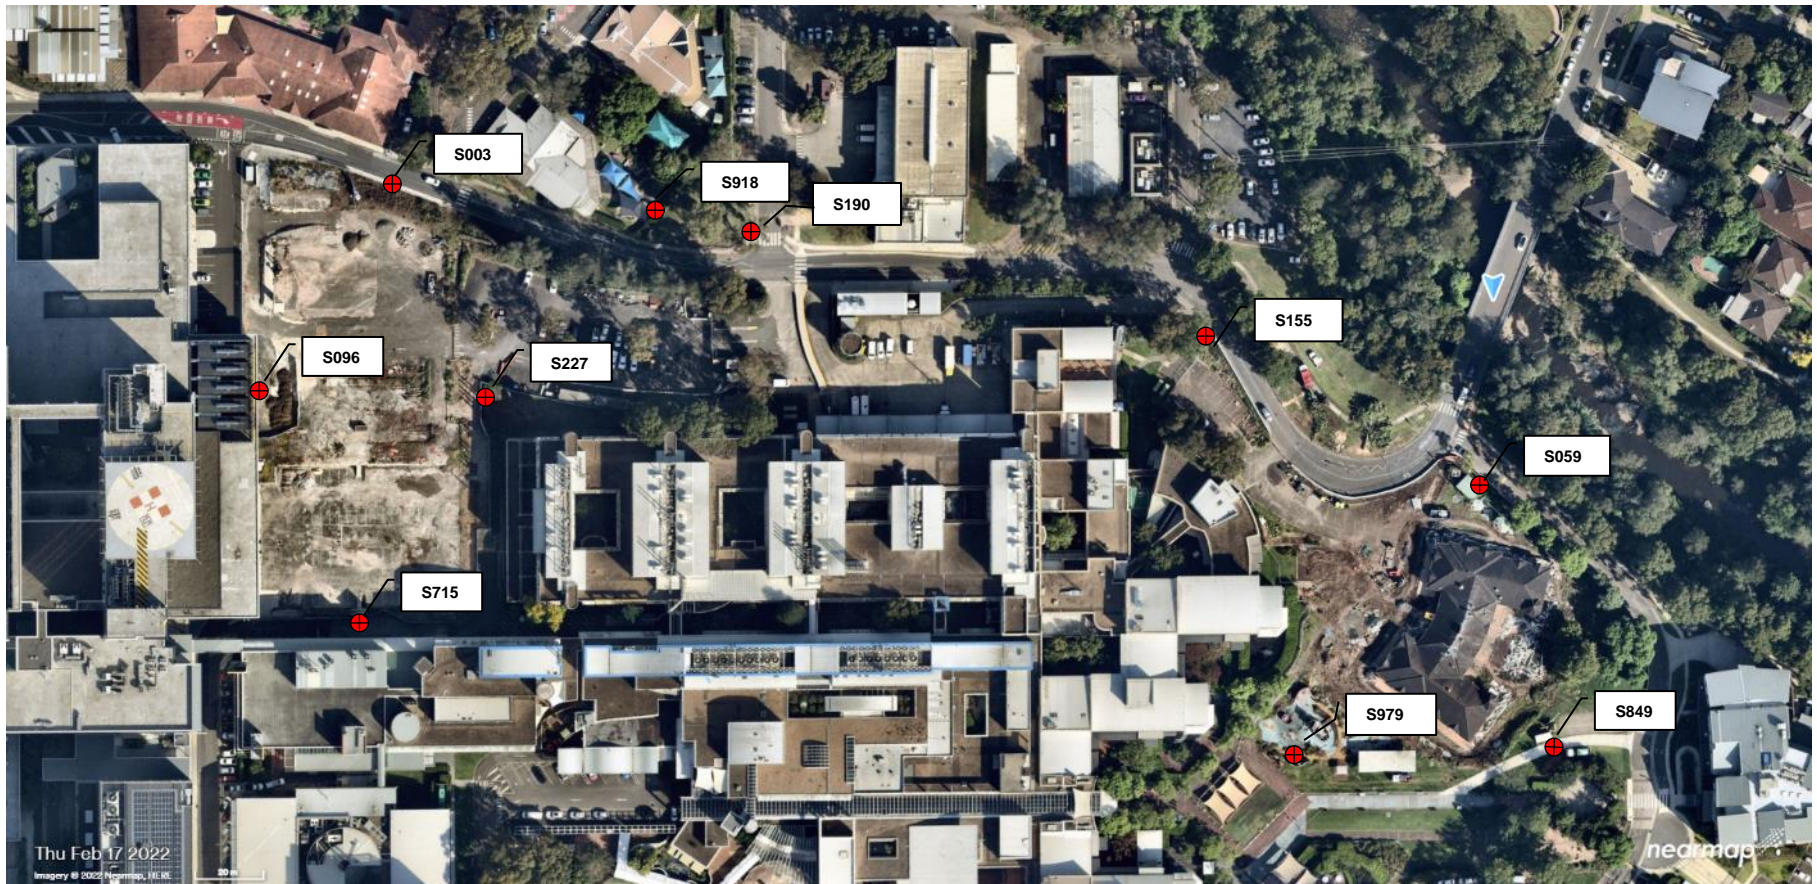

S110355.100-AAM1.v1-ControlAsbestosAirMonitoringReport-220622

Page 4 of 4

CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

23 June 2022

Attention: Danny Khal
Company: Ford Civil Contracting Pty Ltd
Email: miguel.canas@fordcivil.com.au
Address: 9 Hattersley Street, Arncliffe NSW 2205

SWE Report Reference: S110355.101-AAM1.v1-23/06/2022
Site Address: MSCP and PSB, Westmead Hospital
Sampling Date: 23/06/2022
Sample Analysis Date: 23/06/2022
Period of Sampling: 23/06/2022 07:00 AM - 23/06/2022 02:18 PM
Scope of Work: Air Monitoring during civil works of asbestos impacted soils
SWE Laboratory: Suite 15, 103 Majors Bay Road, Concord NSW 2137

Accreditation number: 17092

Site number: 18665

1. Introduction: Control monitoring for airborne asbestos fibres was undertaken by Safe Work and Environments Pty Ltd (SWE) is used to verify the effectiveness of control measures implemented to prevent fibre release as a result of asbestos removal/related work.

2. Methods: Airborne asbestos fibre monitoring was carried out in accordance with the Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres, 2nd Edition [NOHSC:3003 (2005)] and SWE's In-House Method 2 – Volume Measurement, Calibration and Standardisation. Analysis of collected filter membrane samples was performed in accordance with NOHSC:3003 (2005) and SWE's In-House Method 1 – Asbestos Fibre Count and Mount.

3. Results:

SWE REF.	LOCATION OF SAMPLE	FIBRES/ FIELDS	CONCENTRATION (FIBRES/mL)
S110355.101/S509/230622	MSCP site, southwest end, adj. small courtyard, fencing	1.0/100	<0.01
S110355.101/S338/230622	MSCP site, southeast end of site, adj site sheds, fencing	1.0/100	<0.01
S110355.101/S934/230622	MSCP site, corner of Labyrinth Way and Redbank Road, fencing	0.0/100	<0.01
S110355.101/S848/230622	MSCP site, northwest end of site, adj old maintenance car park, fencing	0.0/100	<0.01
S110355.101/S560/230622	Sewer compound, adjacent decontamination unit, east temporary fence	1.0/100	<0.01
S110355.101/S935/230622	Sewer compound, adjacent childcare centre, west temporary fence	0.0/100	<0.01
S110355.101/S583/230622	PSB site, northern end, fencing along Redbank Rd	2.0/100	<0.01
S110355.101/S961/230622	PSB site, western end, fencing along CASB loading dock	0.0/100	<0.01
S110355.101/S928/230622	PSB site, southern end, fencing along laneway	0.0/100	<0.01
S110355.101/S629/230622	PSB site, eastern end, fencing behind site sheds	0.0/100	<0.01

CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

23 June 2022

S110355.101/S743/230622	Field Blank	0.0/100	NA
-------------------------	-------------	---------	----

4. Conclusion: All air monitoring analytical results reported on in this report are below the lowest detectable level of 0.01 fibres/mL of air.

Analysed and reported by:



Rune Knoph

Approved Issuer of Reports


CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

23 June 2022

APPENDIX A – MONITOR LOCATIONS

CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

23 June 2022

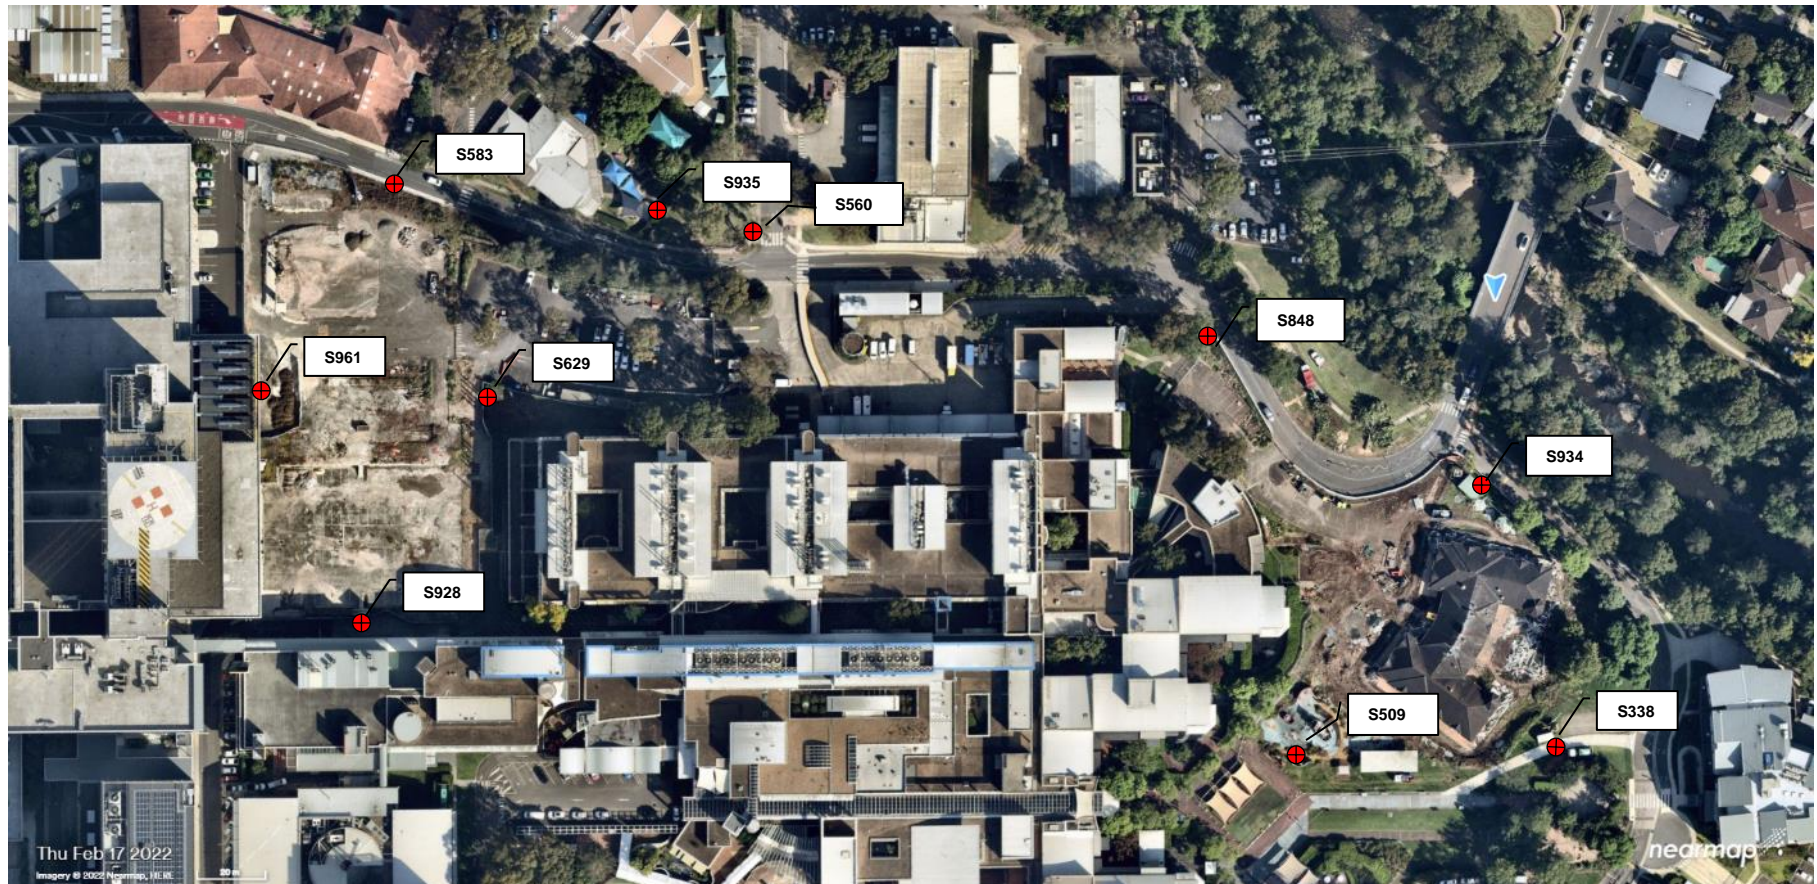

CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

24 June 2022

Attention: Danny Khal
Company: Ford Civil Contracting Pty Ltd
Email: miguel.canas@fordcivil.com.au
Address: 9 Hattersley Street, Arncliffe NSW 2205

SWE Report Reference: S110355.102-AAM1.v1-24/06/2022
Site Address: MSCP and PSB, Westmead Hospital
Sampling Date: 24/06/2022
Sample Analysis Date: 24/06/2022
Period of Sampling: 24/06/2022 07:00 AM - 24/06/2022 02:08 PM
Scope of Work: Air Monitoring during civil works of asbestos impacted soils
SWE Laboratory: Suite 15, 103 Majors Bay Road, Concord NSW 2137

Accreditation number: 17092

Site number: 18665

1. Introduction: Control monitoring for airborne asbestos fibres was undertaken by Safe Work and Environments Pty Ltd (SWE) is used to verify the effectiveness of control measures implemented to prevent fibre release as a result of asbestos removal/related work.

2. Methods: Airborne asbestos fibre monitoring was carried out in accordance with the Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres, 2nd Edition [NOHSC:3003 (2005)] and SWE's In-House Method 2 – Volume Measurement, Calibration and Standardisation. Analysis of collected filter membrane samples was performed in accordance with NOHSC:3003 (2005) and SWE's In-House Method 1 – Asbestos Fibre Count and Mount.

3. Results:

SWE REF.	LOCATION OF SAMPLE	FIBRES/ FIELDS	CONCENTRATION (FIBRES/mL)
S110355.102/S978/240622	MSCP site, southwest end, adj. small courtyard, fencing	2.0/100	<0.01
S110355.102/S182/240622	MSCP site, southeast end of site, adj site sheds, fencing	0.0/100	<0.01
S110355.102/S732/240622	MSCP site, corner of Labyrinth Way and Redbank Road, fencing	1.0/100	<0.01
S110355.102/S535/240622	MSCP site, northwest end of site, adj old maintenance car park, fencing	0.0/100	<0.01
S110355.102/S097/240622	Sewer compound, adjacent decontamination unit, east temporary fence	1.0/100	<0.01
S110355.102/S895/240622	Sewer compound, adjacent childcare centre, west temporary fence	1.0/100	<0.01
S110355.102/S650/240622	PSB site, northern end, fencing along Redbank Rd	0.0/100	<0.01
S110355.102/S978-1/240622	PSB site, western end, fencing along CASB loading dock	0.0/100	<0.01
S110355.102/S482/240622	PSB site, southern end, fencing along laneway	0.0/100	<0.01
S110355.102/S154/240622	PSB site, eastern end, fencing behind site sheds	1.0/100	<0.01

CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

24 June 2022

S110355.102/S340/240622	PSB site, gate 1 entry	0.0/100	<0.01
S110355.102/S108/240622	Field Blank	0.0/100	NA

4. Conclusion: All air monitoring analytical results reported on in this report are below the lowest detectable level of 0.01 fibres/mL of air.

Analysed and reported by:



Rune Knoph

Approved Issuer of Reports


CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

24 June 2022

APPENDIX A – MONITOR LOCATIONS

CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

24 June 2022

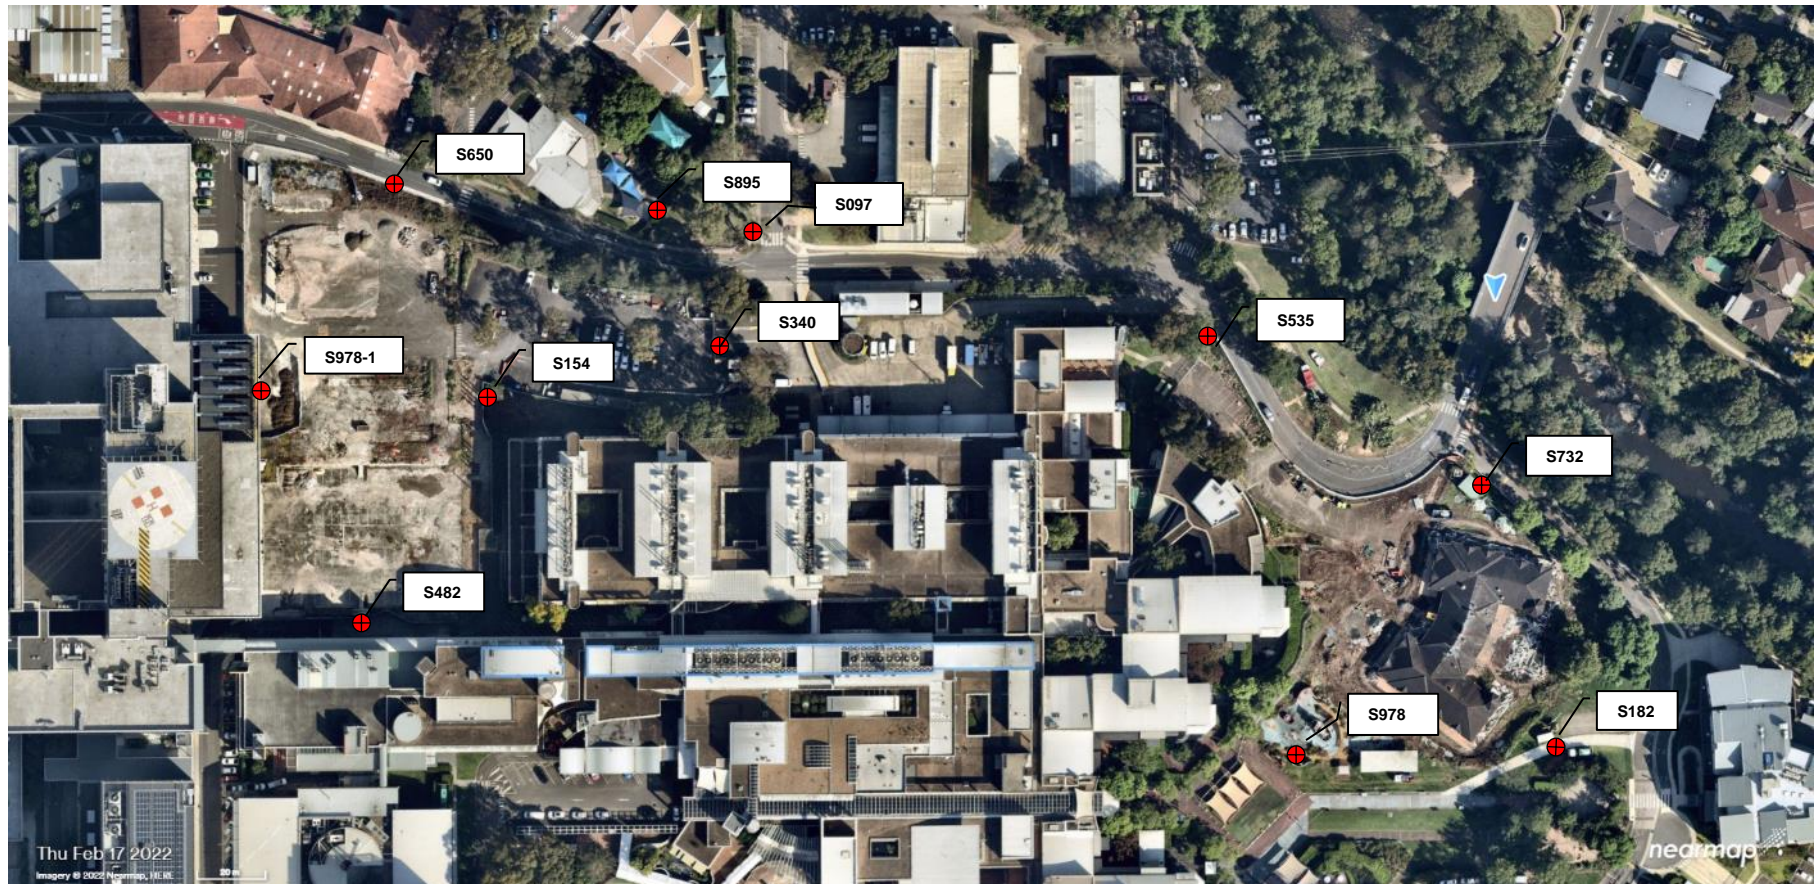

S110355.102-AAM1.v1-ControlAsbestosAirMonitoringReport-240622

Page 4 of 4

CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

27 June 2022

Attention: Danny Khal
Company: Ford Civil Contracting Pty Ltd
Email: miguel.canas@fordcivil.com.au
Address: 9 Hattersley Street, Arncliffe NSW 2205

SWE Report Reference: S110355.103-AAM1.v1-25/06/2022
Site Address: MSCP and PSB, Westmead Hospital
Sampling Date: 25/06/2022
Sample Analysis Date: 27/06/2022
Period of Sampling: 25/06/2022 07:00 AM - 25/06/2022 03:00 PM
Scope of Work: Air Monitoring during civil works of asbestos impacted soils
SWE Laboratory: Suite 15, 103 Majors Bay Road, Concord NSW 2137

Accreditation number: 17092

Site number: 18665

1. Introduction: Control monitoring for airborne asbestos fibres was undertaken by Safe Work and Environments Pty Ltd (SWE) is used to verify the effectiveness of control measures implemented to prevent fibre release as a result of asbestos removal/related work.

2. Methods: Airborne asbestos fibre monitoring was carried out in accordance with the Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres, 2nd Edition [NOHSC:3003 (2005)] and SWE's In-House Method 2 – Volume Measurement, Calibration and Standardisation. Analysis of collected filter membrane samples was performed in accordance with NOHSC:3003 (2005) and SWE's In-House Method 1 – Asbestos Fibre Count and Mount.

3. Results:

SWE REF.	LOCATION OF SAMPLE	FIBRES/ FIELDS	CONCENTRATION (FIBRES/mL)
S110355.103/S014/250622	MSCP site, southwest end, adj. small courtyard, fencing	0.0/100	<0.01
S110355.103/S221/250622	MSCP site, southeast end of site, adj site sheds, fencing	1.0/100	<0.01
S110355.103/S558/250622	MSCP site, corner of Labyrinth Way and Redbank Road, fencing	0.0/100	<0.01
S110355.103/S247/250622	MSCP site, northwest end of site, adj old maintenance car park, fencing	0.0/100	<0.01
S110355.103/S852/250622	Sewer compound, adjacent decontamination unit, east temporary fence	0.0/100	<0.01
S110355.103/S913/250622	Sewer compound, adjacent childcare centre, west temporary fence	0.0/100	<0.01
S110355.103/S994/250622	PSB site, northern end, fencing along Redbank Rd	0.0/100	<0.01
S110355.103/S082/250622	PSB site, western end, fencing along CASB loading dock	0.0/100	<0.01
S110355.103/S797/250622	PSB site, southern end, fencing along laneway	1.0/100	<0.01
S110355.103/S581/250622	PSB site, eastern end, fencing behind site sheds	0.0/100	<0.01

CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

27 June 2022

S110355.103/S826/250622	PSB site, gate 1 entry	0.0/100	<0.01
S110355.103/S169/250622	Field Blank	0.0/100	NA

4. Conclusion: All air monitoring analytical results reported on in this report are below the lowest detectable level of 0.01 fibres/mL of air.

Analysed and reported by:



Rune Knoph

Approved Issuer of Reports


CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

27 June 2022

APPENDIX A – MONITOR LOCATIONS

CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

27 June 2022

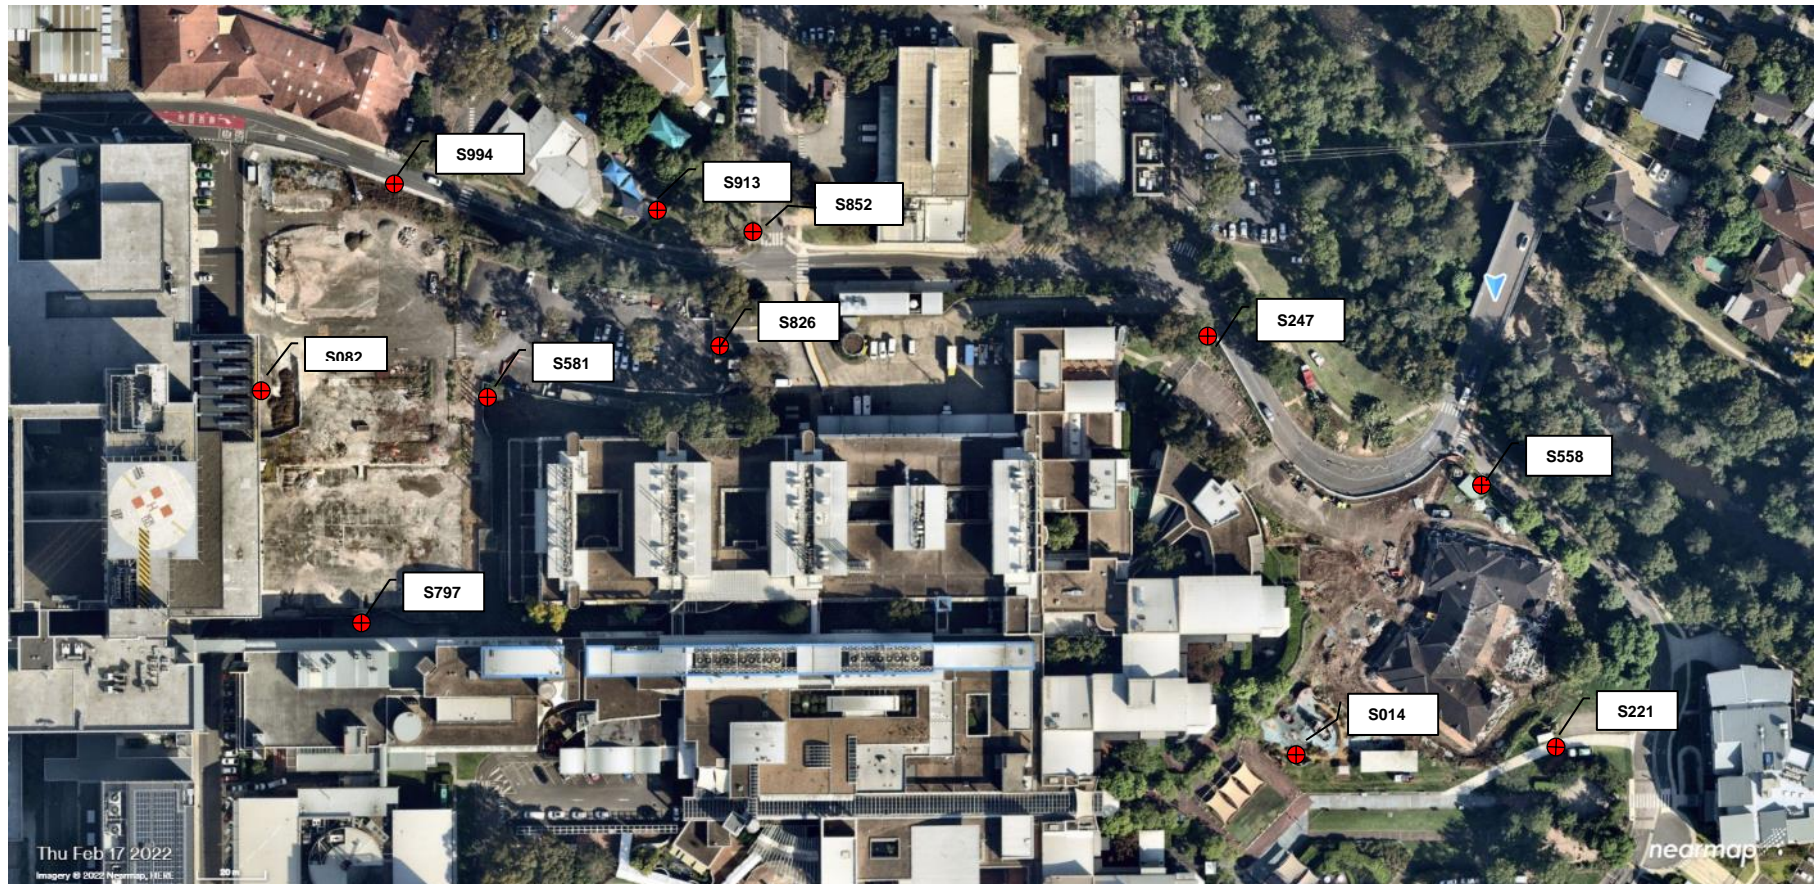

S110355.103-AAM1.v1-ControlAsbestosAirMonitoringReport-250622

Page 4 of 4

CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

27 June 2022

Attention: Danny Khal
Company: Ford Civil Contracting Pty Ltd
Email: miguel.canas@fordcivil.com.au
Address: 9 Hattersley Street, Arncliffe NSW 2205

SWE Report Reference: S110355.104-AAM1.v1-27/06/2022
Site Address: MSCP and PSB, Westmead Hospital
Sampling Date: 27/06/2022
Sample Analysis Date: 27/06/2022
Period of Sampling: 27/06/2022 06:58 AM - 27/06/2022 02:52 PM
Scope of Work: Air Monitoring during civil works of asbestos impacted soils
SWE Laboratory: Suite 15, 103 Majors Bay Road, Concord NSW 2137

Accreditation number: 17092

Site number: 18665

1. Introduction: Control monitoring for airborne asbestos fibres was undertaken by Safe Work and Environments Pty Ltd (SWE) is used to verify the effectiveness of control measures implemented to prevent fibre release as a result of asbestos removal/related work.

2. Methods: Airborne asbestos fibre monitoring was carried out in accordance with the Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres, 2nd Edition [NOHSC:3003 (2005)] and SWE's In-House Method 2 – Volume Measurement, Calibration and Standardisation. Analysis of collected filter membrane samples was performed in accordance with NOHSC:3003 (2005) and SWE's In-House Method 1 – Asbestos Fibre Count and Mount.

3. Results:

SWE REF.	LOCATION OF SAMPLE	FIBRES/ FIELDS	CONCENTRATION (FIBRES/mL)
S110355.104/S087/270622	MSCP site, southwest end, adj. small courtyard, fencing	3.0/100	<0.01
S110355.104/S194/270622	MSCP site, southeast end of site, adj site sheds, fencing	1.0/100	<0.01
S110355.104/S971/270622	MSCP site, corner of Labyrinth Way and Redbank Road, fencing	0.0/100	<0.01
S110355.104/S899/270622	MSCP site, northwest end of site, adj old maintenance car park, fencing	2.0/100	<0.01
S110355.104/S784/270622	Sewer compound, adjacent decontamination unit, east temporary fence	0.0/100	<0.01
S110355.104/S997/270622	Sewer compound, adjacent childcare centre, west temporary fence	1.0/100	<0.01
S110355.104/S747/270622	PSB site, northern end, fencing along Redbank Rd	0.0/100	<0.01
S110355.104/S016/270622	PSB site, western end, fencing along CASB loading dock	0.0/100	<0.01
S110355.104/S926/270622	PSB site, southern end, fencing along laneway	0.0/100	<0.01
S110355.104/S773/270622	PSB site, eastern end, fencing behind site sheds	0.0/100	<0.01

CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

27 June 2022

S110355.104/S408/270622	PSB site, gate 1 entry	0.0/100	<0.01
S110355.104/S934/270622	Mons Road gate	0.0/100	<0.01
S110355.104/S740/270622	Field Blank	0.0/100	NA

4. Conclusion: All air monitoring analytical results reported on in this report are below the lowest detectable level of 0.01 fibres/mL of air.

Analysed and reported by:



Rune Knoph

Approved Issuer of Reports


CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

27 June 2022

APPENDIX A – MONITOR LOCATIONS

CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

27 June 2022

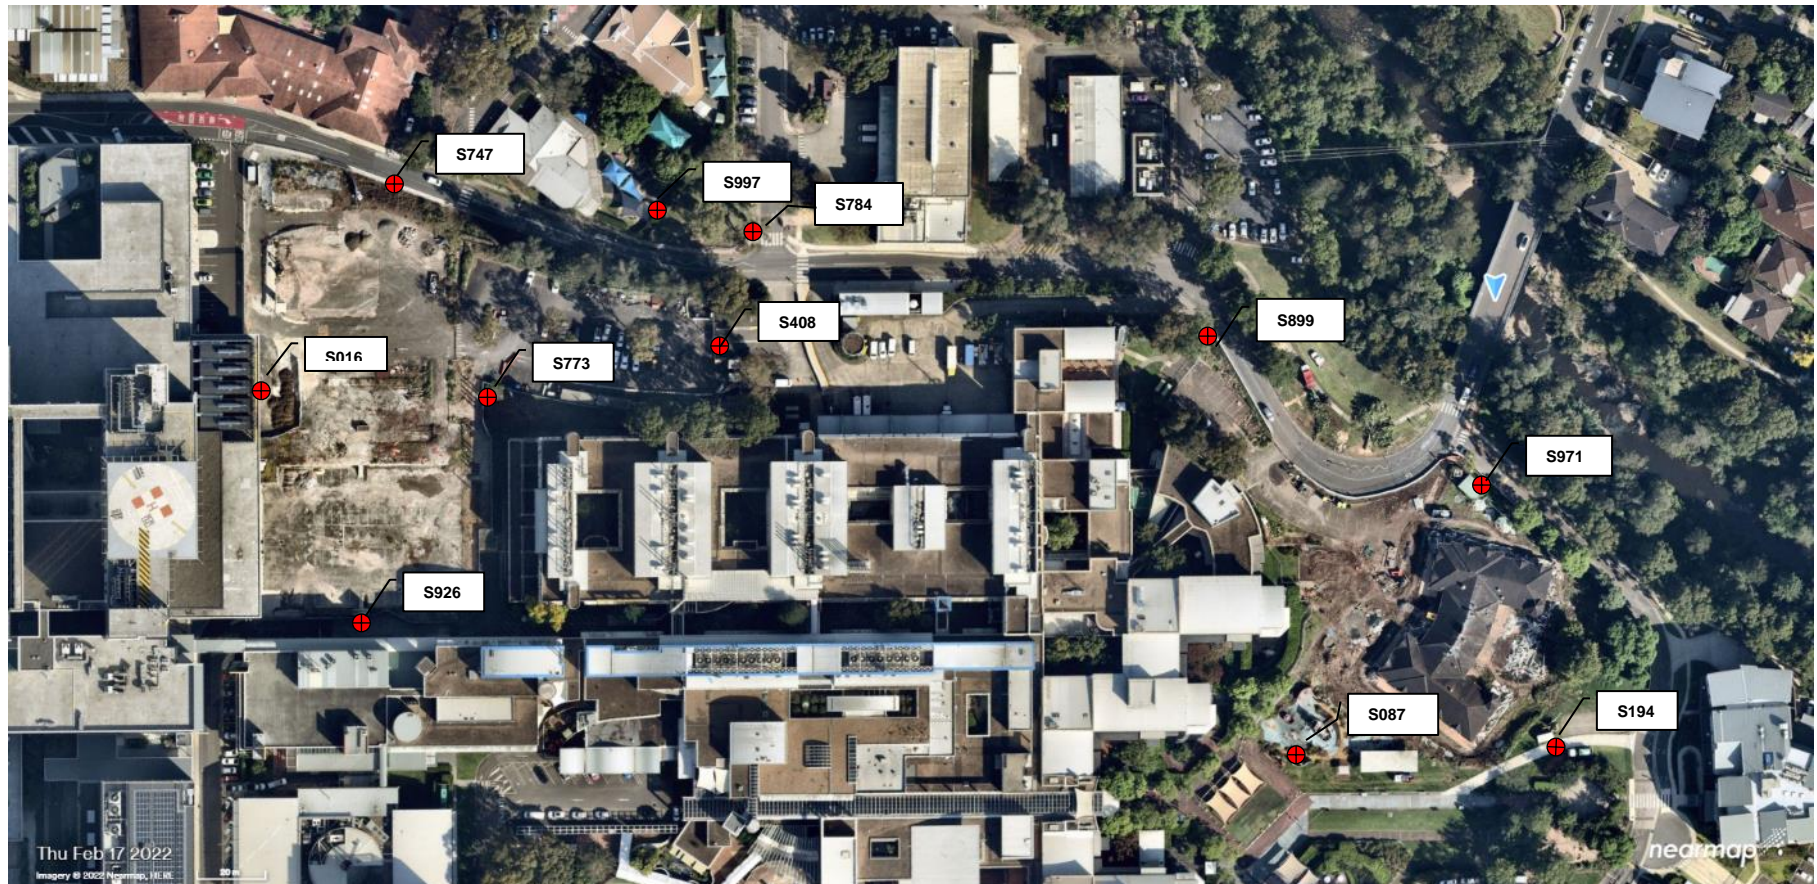

S110355.104-AAM1.v1-ControlAsbestosAirMonitoringReport-270622

Page 4 of 5

CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

27 June 2022



CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

28 June 2022

Attention: Danny Khal
Company: Ford Civil Contracting Pty Ltd
Email: miguel.canas@fordcivil.com.au
Address: 9 Hattersley Street, Arncliffe NSW 2205

SWE Report Reference: S110355.105-AAM1.v1-28/06/2022
Site Address: MSCP and PSB, Westmead Hospital
Sampling Date: 28/06/2022
Sample Analysis Date: 28/06/2022
Period of Sampling: 28/06/2022 07:06 AM - 28/06/2022 02:33 PM
Scope of Work: Air Monitoring during civil works of asbestos impacted soils
SWE Laboratory: Suite 15, 103 Majors Bay Road, Concord NSW 2137

Accreditation number: 17092

Site number: 18665

1. Introduction: Control monitoring for airborne asbestos fibres was undertaken by Safe Work and Environments Pty Ltd (SWE) is used to verify the effectiveness of control measures implemented to prevent fibre release as a result of asbestos removal/related work.

2. Methods: Airborne asbestos fibre monitoring was carried out in accordance with the Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres, 2nd Edition [NOHSC:3003 (2005)] and SWE's In-House Method 2 – Volume Measurement, Calibration and Standardisation. Analysis of collected filter membrane samples was performed in accordance with NOHSC:3003 (2005) and SWE's In-House Method 1 – Asbestos Fibre Count and Mount.

3. Results:

SWE REF.	LOCATION OF SAMPLE	FIBRES/ FIELDS	CONCENTRATION (FIBRES/mL)
S110355.105/S098/280622	MSCP site, southwest end, adj. small courtyard, fencing	0.0/100	<0.01
S110355.105/S603/280622	MSCP site, southeast end of site, adj site sheds, fencing	0.0/100	<0.01
S110355.105/S487/280622	MSCP site, corner of Labyrinth Way and Redbank Road, fencing	1.0/100	<0.01
S110355.105/S987/280622	MSCP site, northwest end of site, adj old maintenance car park, fencing	0.0/100	<0.01
S110355.105/S590/280622	Sewer compound, adjacent childcare centre, west temporary fence	0.0/100	<0.01
S110355.105/S525/280622	PSB site, northern end, fencing along Redbank Rd	0.0/100	<0.01
S110355.105/S176/280622	PSB site, western end, fencing along CASB loading dock	1.0/100	<0.01
S110355.105/S808/280622	PSB site, southern end, fencing along laneway	0.0/100	<0.01
S110355.105/S210/280622	PSB site, eastern end, fencing behind site sheds	0.0/100	<0.01
S110355.105/S392280622	PSB site, gate 1 entry	0.0/100	<0.01

CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

28 June 2022

S110355.105/P79/280622	Mons Road Compound Entry Point	0.0/100	<0.01
S110355.105/S135/280622	Mons Road, before boom gate, fencing	0.0/100	<0.01
S110355.105/CX636338/280622	Field Blank	0.0/100	NA

4. Conclusion: All air monitoring analytical results reported on in this report are below the lowest detectable level of 0.01 fibres/mL of air.

Analysed and reported by:



Rune Knoph

Approved Issuer of Reports


CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

28 June 2022

APPENDIX A – MONITOR LOCATIONS

CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

28 June 2022

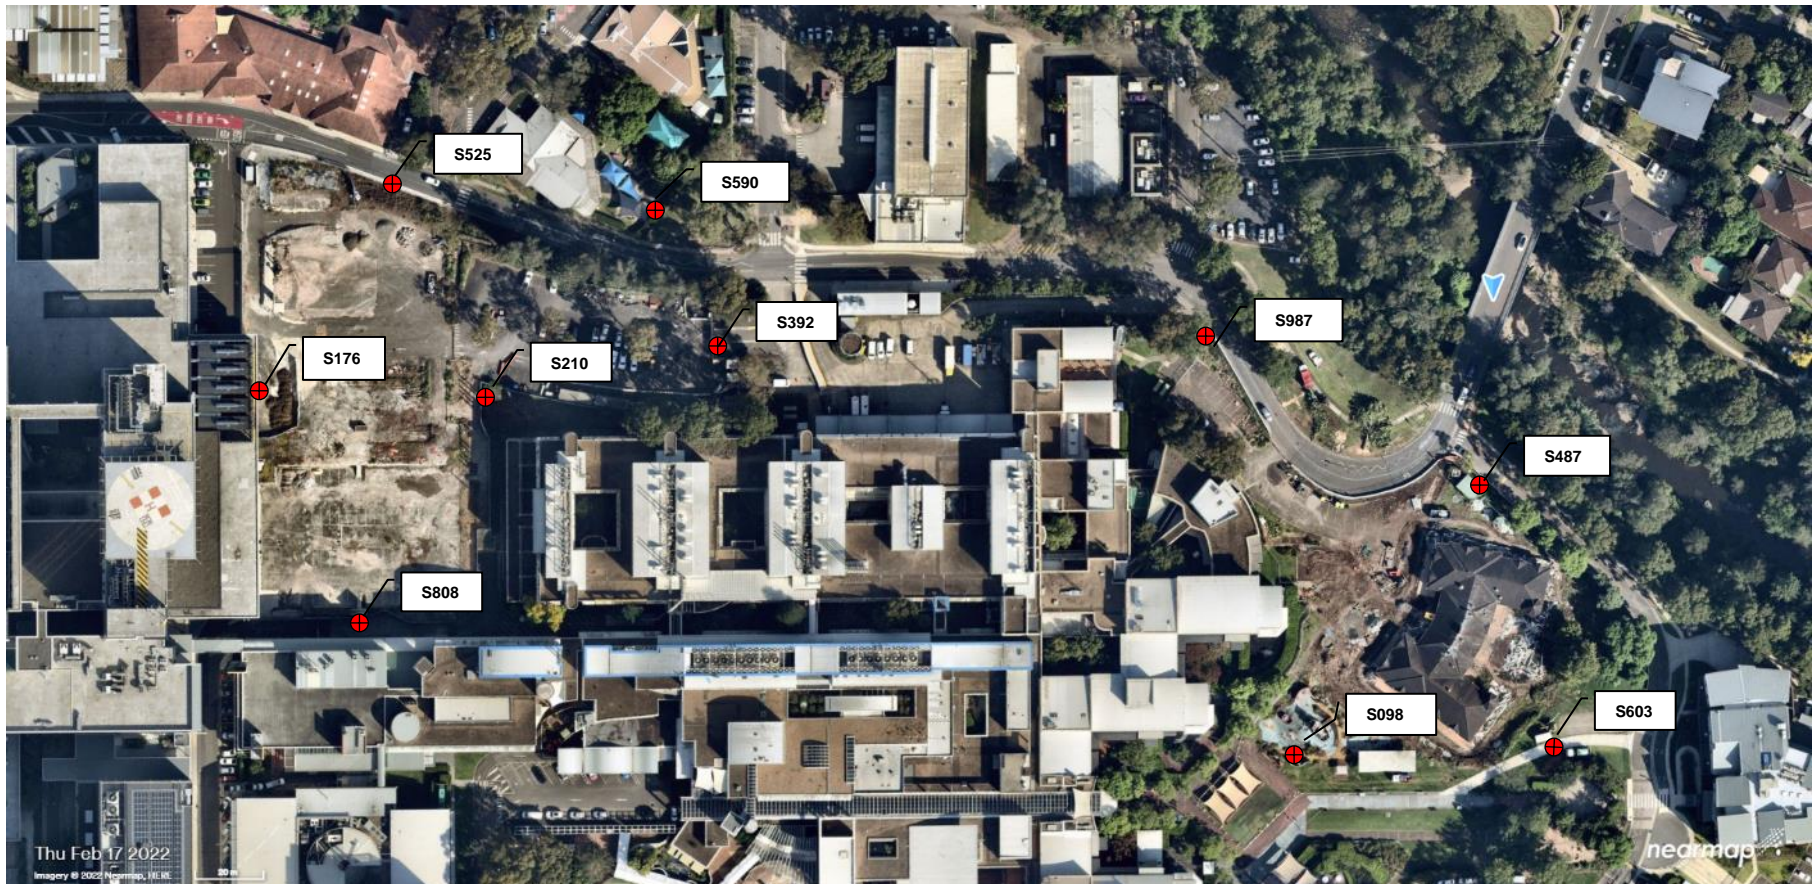

S110355.105-AAM1.v1-ControlAsbestosAirMonitoringReport-280622

Page 4 of 5

CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

28 June 2022



S110355.105-AAM1.v1-ControlAsbestosAirMonitoringReport-280622

Page 5 of 5

CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

29 June 2022

Attention: Danny Khal
Company: Ford Civil Contracting Pty Ltd
Email: miguel.canas@fordcivil.com.au
Address: 9 Hattersley Street, Arncliffe NSW 2205

SWE Report Reference: S110355.106-AAM1.v1-29/06/2022
Site Address: MSCP and PSB, Westmead Hospital
Sampling Date: 29/06/2022
Sample Analysis Date: 29/06/2022
Period of Sampling: 29/06/2022 07:00 AM - 29/06/2022 02:42 PM
Scope of Work: Air Monitoring during civil works of asbestos impacted soils
SWE Laboratory: Suite 15, 103 Majors Bay Road, Concord NSW 2137

Accreditation number: 17092

Site number: 18665

1. Introduction: Control monitoring for airborne asbestos fibres was undertaken by Safe Work and Environments Pty Ltd (SWE) is used to verify the effectiveness of control measures implemented to prevent fibre release as a result of asbestos removal/related work.

2. Methods: Airborne asbestos fibre monitoring was carried out in accordance with the Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres, 2nd Edition [NOHSC:3003 (2005)] and SWE's In-House Method 2 – Volume Measurement, Calibration and Standardisation. Analysis of collected filter membrane samples was performed in accordance with NOHSC:3003 (2005) and SWE's In-House Method 1 – Asbestos Fibre Count and Mount.

3. Results:

SWE REF.	LOCATION OF SAMPLE	FIBRES/ FIELDS	CONCENTRATION (FIBRES/mL)
S110355.106/S506/290622	MSCP site, southwest end, adj. small courtyard, fencing	1.0/100	<0.01
S110355.106/S592/290622	MSCP site, southeast end of site, adj site sheds, fencing	0.0/100	<0.01
S110355.106/S821/290622	MSCP site, corner of Labyrinth Way and Redbank Road, fencing	0.0/100	<0.01
S110355.106/S199/290622	MSCP site, northwest end of site, adj old maintenance car park, fencing	1.0/100	<0.01
S110355.106/S307/290622	Sewer compound, adjacent childcare centre, west temporary fencing	0.0/100	<0.01
S110355.106/S898/290622	PSB site, northern end, fencing along Redbank Rd	0.0/100	<0.01
S110355.106/S732/290622	PSB site, western end, fencing along CASB loading dock	0.0/100	<0.01
S110355.106/S947/290622	PSB site, southern end, fencing along laneway	0.0/100	<0.01
S110355.106/S571/290622	PSB site, eastern end, fencing behind site sheds	0.0/100	<0.01
S110355.106/E328/290622	PSB site, gate 1 entry	0.0/100	<0.01
S110355.106/P23/290622	Mons Road, entry point	0.0/100	<0.01

CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

29 June 2022

S110355.106/DP030/290622	Mons Road, before boom gate, fencing	0.0/100	<0.01
S110355.106/6305/290622	Field Blank	0.0/100	NA

4. Conclusion: All air monitoring analytical results reported on in this report are below the lowest detectable level of 0.01 fibres/mL of air.

Analysed and reported by:



Rune Knoph

Approved Issuer of Reports


CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

29 June 2022

APPENDIX A – MONITOR LOCATIONS

CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

29 June 2022

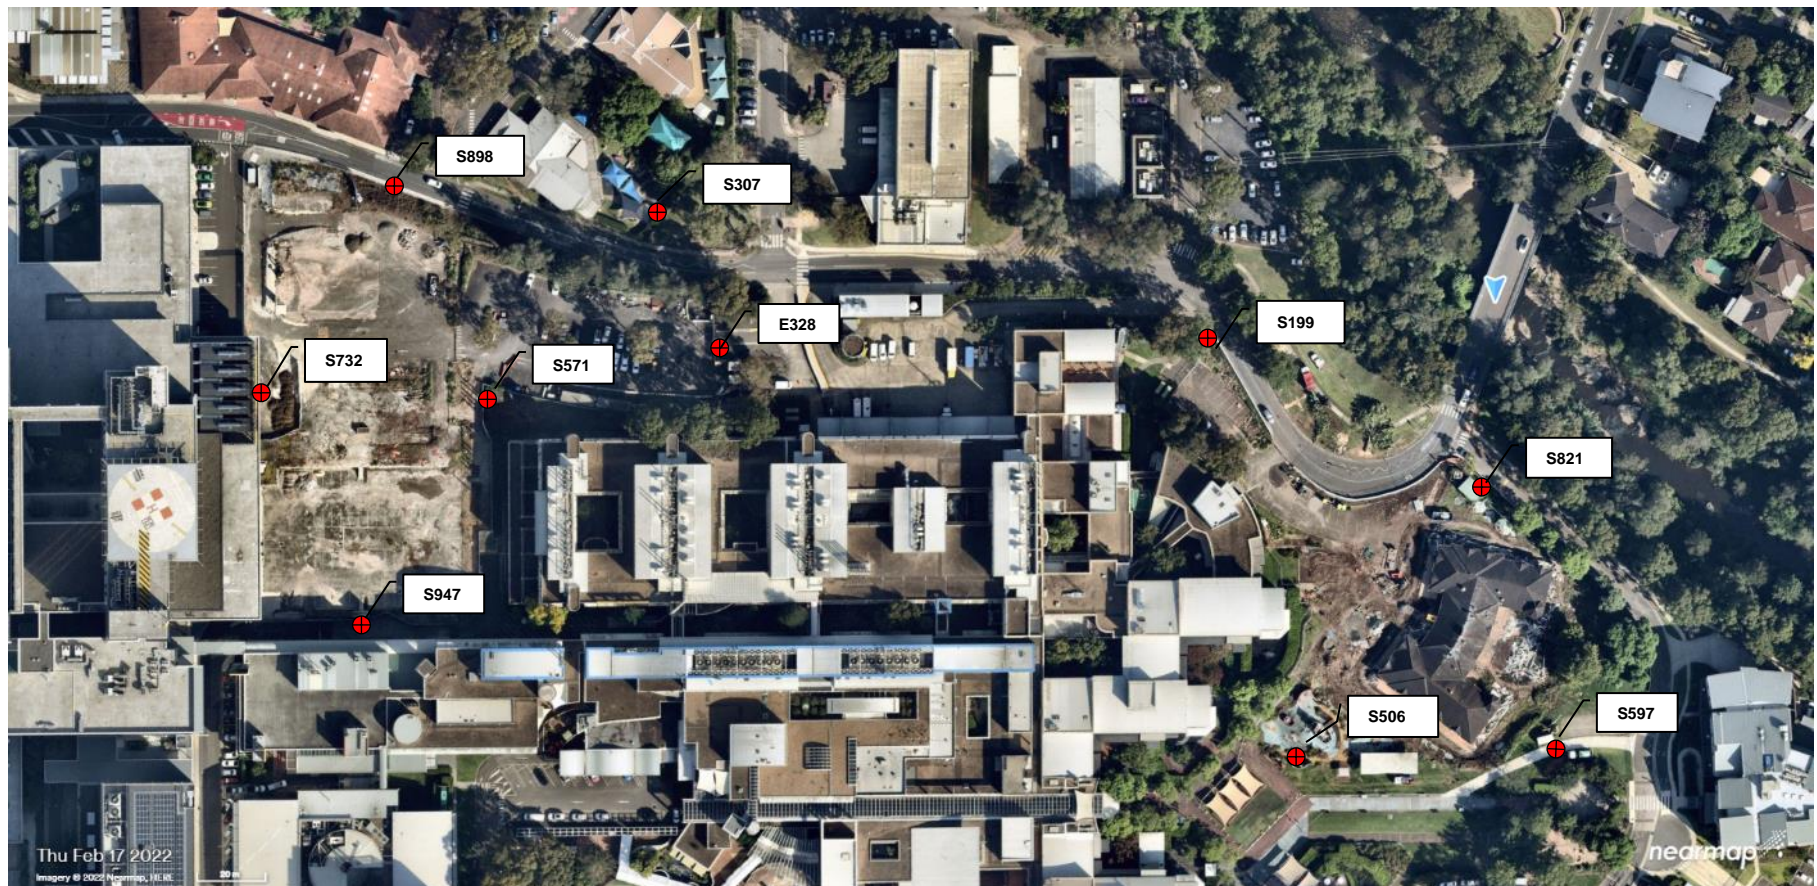

S110355.106-AAM1.v1-ControlAsbestosAirMonitoringReport-290622

Page 4 of 5

CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

29 June 2022



CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

30 June 2022

Attention: Danny Khal
Company: Ford Civil Contracting Pty Ltd
Email: miguel.canas@fordcivil.com.au
Address: 9 Hattersley Street, Arncliffe NSW 2205

SWE Report Reference: S110355.107-AAM1.v1-30/06/2022
Site Address: MSCP and PSB, Westmead Hospital
Sampling Date: 30/06/2022
Sample Analysis Date: 30/06/2022
Period of Sampling: 30/06/2022 07:02 AM - 30/06/2022 02:14 PM
Scope of Work: Air Monitoring during civil works of asbestos impacted soils
SWE Laboratory: Suite 15, 103 Majors Bay Road, Concord NSW 2137

Accreditation number: 17092

Site number: 18665

1. Introduction: Control monitoring for airborne asbestos fibres was undertaken by Safe Work and Environments Pty Ltd (SWE) is used to verify the effectiveness of control measures implemented to prevent fibre release as a result of asbestos removal/related work.

2. Methods: Airborne asbestos fibre monitoring was carried out in accordance with the Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres, 2nd Edition [NOHSC:3003 (2005)] and SWE's In-House Method 2 – Volume Measurement, Calibration and Standardisation. Analysis of collected filter membrane samples was performed in accordance with NOHSC:3003 (2005) and SWE's In-House Method 1 – Asbestos Fibre Count and Mount.

3. Results:

SWE REF.	LOCATION OF SAMPLE	FIBRES/ FIELDS	CONCENTRATION (FIBRES/mL)
S110355.107/S038/300622	MSCP site, southwest end, adj. small courtyard, fencing	1.0/100	<0.01
S110355.107/S824/300622	MSCP site, southeast end of site, adj site sheds, fencing	0.0/100	<0.01
S110355.107/P29/300622	MSCP site, corner of Labyrinth Way and Redbank Road, fencing	0.0/100	<0.01
S110355.107/S465/300622	MSCP site, northwest end of site, adj old maintenance car park, fencing	1.0/100	<0.01
S110355.107/S756/300622	Sewer compound, adjacent childcare centre, west temporary fencing	0.0/100	<0.01
S110355.107/S055/300622	PSB site, northern end, fencing along Redbank Rd	0.0/100	<0.01
S110355.107/S339/300622	PSB site, western end, fencing along CASB loading dock	0.0/100	<0.01
S110355.107/S196/300622	PSB site, southern end, fencing along laneway	0.0/100	<0.01
S110355.107/S196/300622	PSB site, eastern end, fencing behind site sheds	0.0/100	<0.01
S110355.107/3198/300622	PSB site, gate 1 entry	0.0/100	<0.01
S110355.107/3546/300622	Mons Road, entry point	0.0/100	<0.01

CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

30 June 2022

S110355.107/3651/300622	Mons Road, before boom gate, fencing	0.0/100	<0.01
S110355.107/6262/300622	Field Blank	0.0/100	NA

4. Conclusion: All air monitoring analytical results reported on in this report are below the lowest detectable level of 0.01 fibres/mL of air.

Analysed and reported by:



Rune Knoph

Approved Issuer of Reports


CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

30 June 2022

APPENDIX A – MONITOR LOCATIONS

CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

30 June 2022

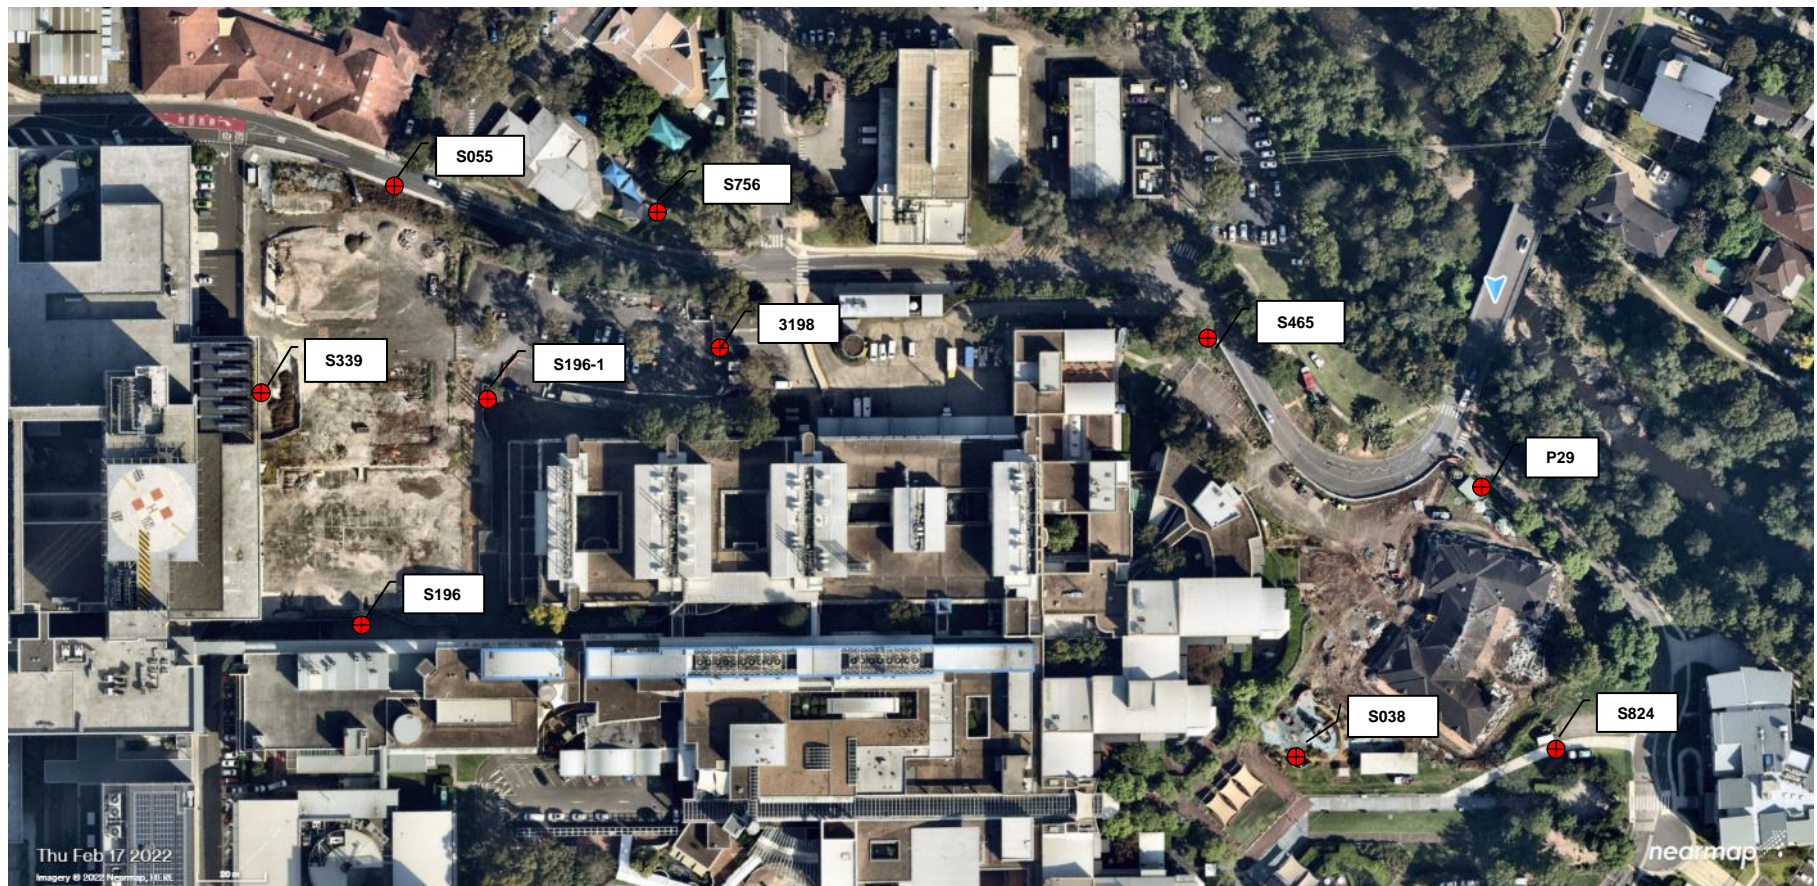

S110355.107-AAM1.v1-ControlAsbestosAirMonitoringReport-300622

Page 4 of 5

CONTROL AIR MONITORING FOR ASBESTOS FIBRES RESULTS

30 June 2022

