

Memorandum

To	Travis Searle	Date	1 December 2021
Copies	Samuel Grieve	Reference number	
From	Pranav Rawal	File reference	
Subject	Campbelltown Hospital Redevelopment: Summary of Recently Recorded Vibration Data		

This memo summarises the vibration data collected over the past week of 03/10/2021 to 10/10/2021 at the Medical Imaging Facility at Campbelltown Hospital.

Figure 1 below shows the measured vibration levels at the Medical Imaging Facility and is presented against various acceptability criteria. For reference, the current trigger level, based on typical equipment is $V_{RMS} = 0.0375$ mm/s.

All events that exceed the trigger level during the monitored period are reported below.

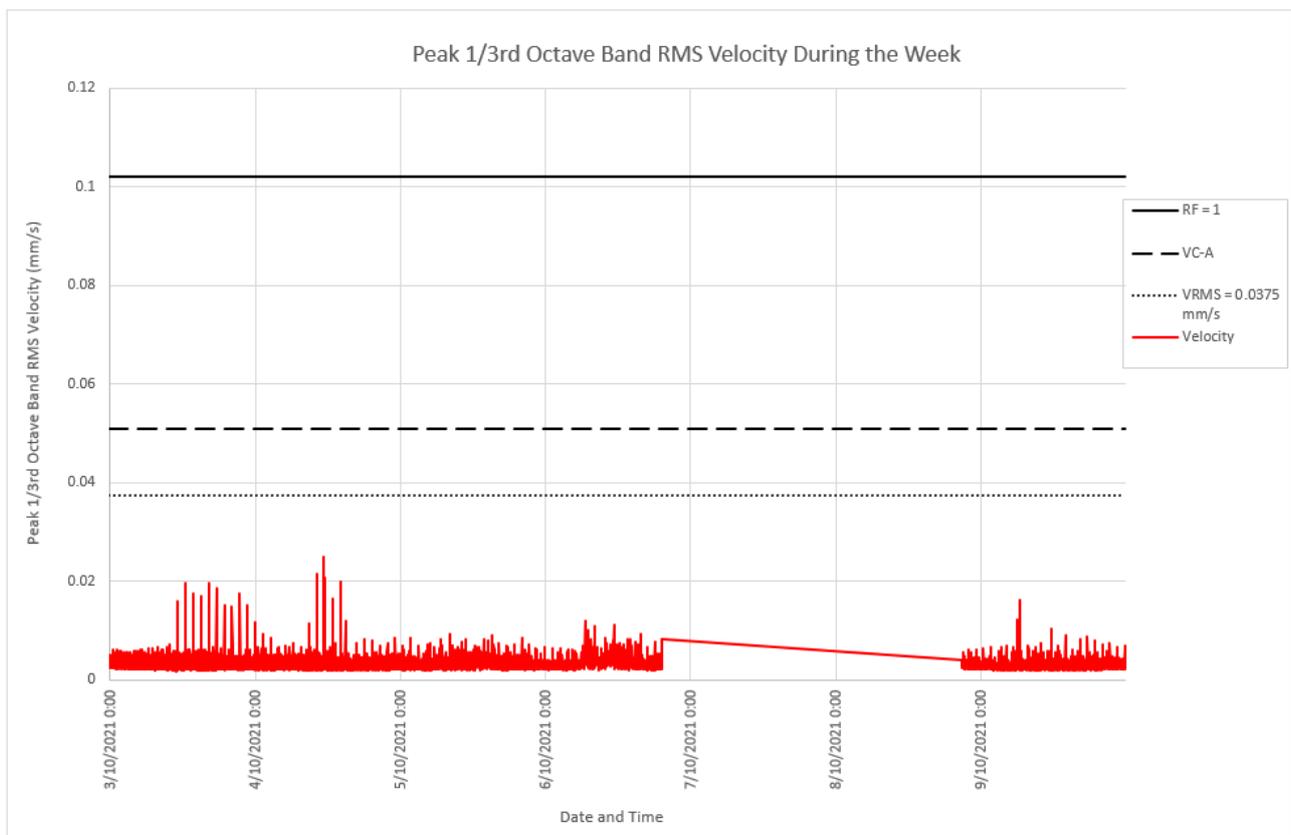


Figure 1: Measured vibration levels for 03/10/2021 to 06/10/2021 at the Medical Imaging Facility

Memorandum

Note that the vibration logger went down on 6/10/2021. Data was unrecoverable for a period of time until 9/10/2021.

Further investigations of vibration patterns at times of exceedances can be performed upon request.