

Memorandum

ARUP

To	Travis Searle	Date	7 October 2021
Copies	Samuel Grieve	Reference number	
From	Pranav Rawal	File reference	
Subject	Campbelltown Hospital Redevelopment: Summary of Recently Recorded Vibration Data		

This memo summarises the vibration data collected over the past week of 26/09/2021 to 02/10/2021 at the Medical Imaging Facility at Campbelltown Hospital.

Figure 1 below shows the measured vibration levels at the Medical Imaging Facility and is presented against various acceptability criteria. For reference, the current trigger level, based on typical equipment is $V_{RMS} = 0.0375$ mm/s.

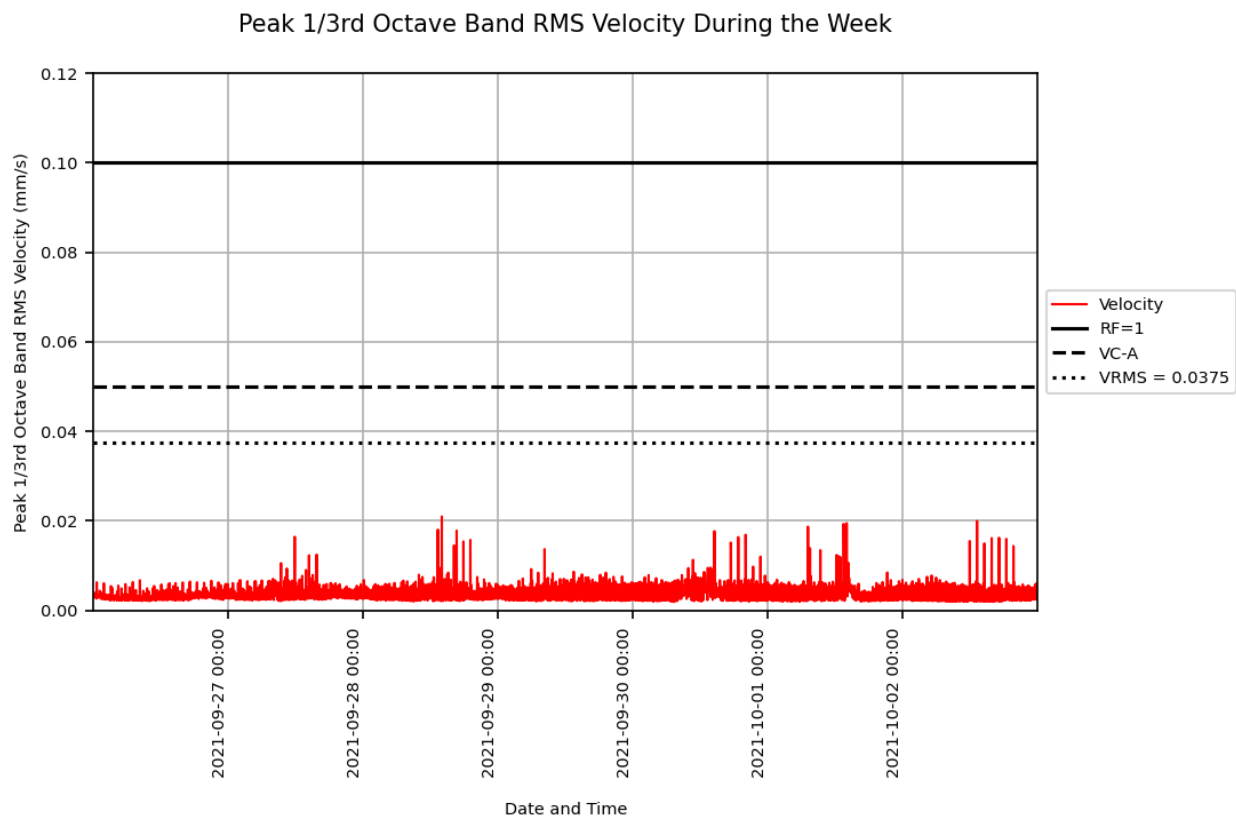


Figure 1: Measured vibration levels for 26/09/2021 to 02/10/2021 at the Medical Imaging Facility

No events exceeded the trigger level during the monitored period.

Memorandum

Further investigations of vibration patterns at times of exceedances can be performed upon request.