

Health Infrastructure NSW  
**Westmead PSB and MSCP**  
**Construction Noise Monitoring**

Noise monitoring report  
2024-03-01 to 2024-03-31

AC28

v1 | 17 April 2024

This report takes into account the particular instructions and requirements of our client.

It is not intended for and should not be relied upon by any third party and no responsibility is undertaken to any third party.

Job number 271985

Arup  
Arup Pty Ltd ABN 18 000 966 165






**Arup**  
Level 10 201 Kent Street  
PO Box 76 Millers Point  
Sydney 2000  
Australia  
[www.arup.com](http://www.arup.com)

**ARUP**

# Document Verification

# ARUP

<b>Job title</b>		Westmead PSB and MSCP Construction Noise Monitoring		<b>Job number</b>		271985	
<b>Document title</b>		Noise monitoring report 2024-03-01 to 2024-03-31		<b>File reference</b>		v1	
<b>Document ref</b>		AC28					
<b>Revision</b>	<b>Date</b>	<b>Filename</b>	271985-AC28 v1 PSB and MSCP Noise monitoring - March 2024.pdf				
v1	16/03/24	<b>Description</b>	Issue				
			Prepared by	Checked by	Approved by		
		Name	Matthew Boutte	Clemence Terraz	Clemence Terraz		
		Signature					
		<b>Filename</b>					
		<b>Description</b>					
			Prepared by	Checked by	Approved by		
		Name					
		Signature					
		<b>Filename</b>					
		<b>Description</b>					
			Prepared by	Checked by	Approved by		
		Name					
		Signature					

Issue Document Verification with Document



# Contents

---

	Page
<b>1 Introduction</b>	<b>1</b>
<b>2 Noise logger locations</b>	<b>2</b>
2.1 Noise Logger relocation	4
<b>3 Noise Management Levels</b>	<b>6</b>
3.1 Management Level updates	6
<b>4 Noise monitoring results</b>	<b>7</b>
4.1 Outages	7
4.2 Exceedances	7
4.3 Daily noise monitoring results	8

## Appendices

### Appendix A

Noise Monitoring Daily Results

# 1 Introduction

---

Arup has been retained to carry on with the work originally contracted by PwC/Scyne. The work included the installation of noise monitors in various locations within the Westmead Precinct and the reporting of noise levels recorded. The noise loggers are within the Central Acute Services Building (CASB), Children's Hospital Westmead (CHW) and Kids Research (KR) and Ronald McDonald House (RMH) buildings to monitor construction noise from the Paediatric Service Building (PSB) and Multi Storey Car Park (MSCP) development sites in the Westmead Precinct.

The noise loggers are configured to send email and SMS notifications to stakeholders when construction Noise Management Levels (NMLs) are exceeded.


This report details noise measurement results from **1 March 2024 to 31 March 2024** inclusive.

## 2 Noise logger locations

---

Acoustic Research Labs Ngara noise loggers have been installed in the locations shown in Figure 1 and Figure 2 below.

The noise loggers were calibrated by Acoustic Research Labs (NATA-accredited calibration) in November 2021. In accordance with NATA standards, the noise loggers should be recalibrated every two years. Consequently, Arup has initiated the organisation of the recalibration of the loggers.

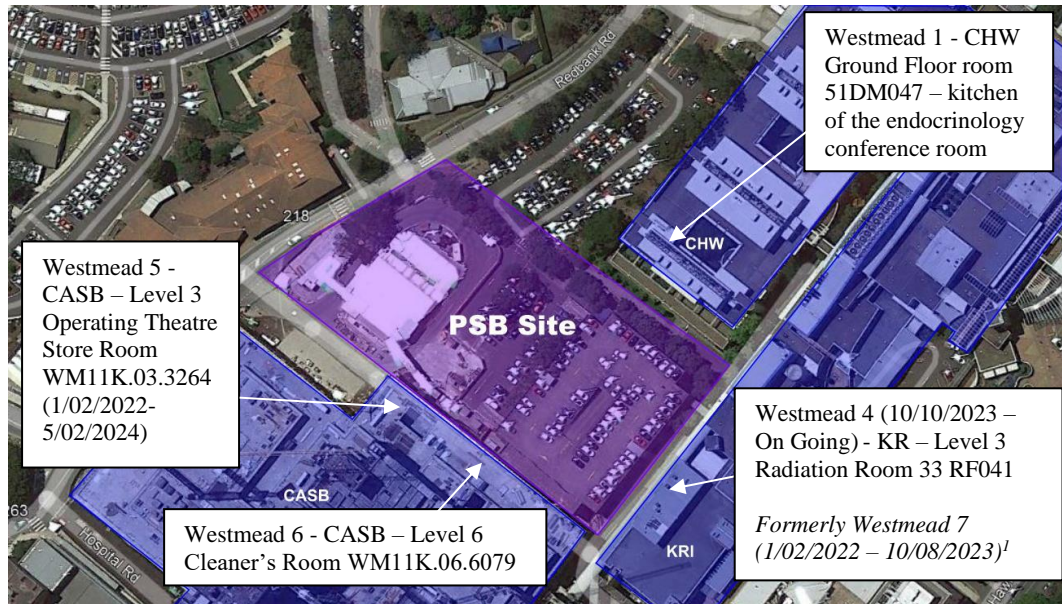

**Note 1:** Westmead 7 noise logger was temporarily repurposed for another project on the 10/8/2023. See Section 0.

Figure 1: PSB noise monitoring locations.



Figure 2: MSCP noise monitoring locations.

## 2.1 Noise Logger relocation

- No monthly update.

A summary of all noise logger relocations can be found in Table 1 below:

Table 1: Logger relocation records

Logger ID	Original Location	Location	
	Location	Date Moved	Location
Westmead 7	KR Level 3 Radiation Room 33 RF041	10/8/23	<i>Removed from site to support another project (VVMF project)</i>
Westmead 4	Off site to support another project (VVMF project)	10/10/23	KR Level 3 Radiation Room 33 RF041
Westmead 1	CHW Ground Floor room 51DM047	18/10/23	<i>Removed from site for manufacturer calibration</i>
Westmead 2	CHW Level 2 Parent Kitchen 92BW025	18/10/23	<i>Removed from site for manufacturer calibration</i>
Westmead 3	RMH Level 1 Store Room 101	18/10/23	<i>Removed from site for manufacturer calibration</i>
Westmead 1	<i>Removed from site for manufacturer calibration</i>	6/12/23	CHW Ground Floor room 51DM047
Westmead 2	<i>Removed from site for manufacturer calibration</i>	6/12/23	CHW Level 2 Parent Kitchen 92BW025
Westmead 3	<i>Removed from site for manufacturer calibration</i>	6/12/23	RMH Level 1 Store Room 101
Westmead 4	KR Level 3 Radiation Room 33 RF041	6/12/23	<i>Removed from site for manufacturer calibration</i>

Westmead 5	CASB Level 3 Operating Theatre Store Room WM11K.03.3264	6/12/23	<i>Removed from site for manufacturer calibration</i>
Westmead 4	<i>Removed from site for manufacturer calibration</i>	12/21/23	KR Level 3 Radiation Room 33 RF041
Westmead 5	<i>Removed from site for manufacturer calibration</i>	12/21/23	CASB Level 3 Operating Theatre Store Room WM11K.03.3264
Westmead 6	CASB Level 6 Cleaner's Room WM11K.06.6079	5/02/2024	<i>Removed from site for manufacturer calibration</i>
Westmead 4	KR Level 3 Radiation Room 33 RF041	5/02/2024	<i>Removed from site for repair</i>
Westmead 5	CASB Level 3 Operating Theatre Store Room WM11K.03.3264	5/02/2024	<i>Removed from site to support another project (VVMF project)</i>



### 3 Noise Management Levels

The current construction Noise Management Levels for each internal monitoring location are set out in Table 2.

Measurement data taken from ‘standard’ construction work hours for the project only are assessed against the Noise Management Level criteria, being:

- 7am-6pm Mon-Fri
- 8am-1pm Sat
- No work on Sundays and Public Holidays.

As part of the previous installation works a baseline noise study was conducted to determine appropriate noise management level. Refer to Arup’s *Baseline noise measurements* report [1] for details regarding how these Management Levels were nominated.

Table 2: Baseline noise measurement results.

Logger ID	Location	Noise Management Level (upper limit), dB L <sub>Aeq,15min</sub>
Westmead 1	CHW Ground Floor room 51DM047 – kitchen of the endocrinology conference room (facing PSB site)	60
Westmead 2	CHW Level 2 Parent Kitchen 92BW025 (facing MSCP site)	64
Westmead 3	RMH Level 1 Store Room 101 (facing MSCP site)	47
Westmead 4	KR Level 3 Radiation Room 33 RF041 (facing PSB site)	58
Westmead 5	CASB Level 3 Operating Theatre Store Room WM11K.03.3264 (facing PSB site)	50
Westmead 6	CASB Level 6 Cleaner’s Room WM11K.06.6079 (facing PSB site)	52

#### 3.1 Management Level updates

- None to date.

## 4 Noise monitoring results

### 4.1 Outages

Noise monitoring outages are shown below. This excludes outages related to logger data collection and calibration.

Table 3: Noise logger outages during monitoring period.

Logger Id	Noise logger location	Outages
Westmead 1	CHW Ground Floor room 51DM047 – kitchen of the endocrinology conference room (facing PSB site)	3/03/2024: 10:30 – 13:00
Westmead 5	CASB Level 3 Operating Theatre Store Room WM11K.03.3264 (facing PSB site)	1/03/2024 – 31/02/2024
Westmead 6	CASB Level 6 Cleaner’s Room WM11K.06.6079 (facing PSB site)	1/02/2024 – On Going <sup>2</sup>
Westmead 4	KR Level 3 Radiation Room 33 RF041(facing PSB site)	1/02/2024 – On Going <sup>2</sup>
Westmead 7	KR Level 3 Radiation Room 33 RF041(facing PSB site)	N/A <sup>1</sup>
Westmead 2	CHW Level 2 Parent Kitchen 92BW025 (facing MSCP site)	3/03/2024: 07:30 – 17:45 16/03/2024 – 28/03/2024
Westmead 3	RMH Level 1 Store Room 101 (facing MSCP site)	–

**Note:**

- Westmead 7 logger was relocated to the WIMR bike store room on Thursday 10 August 2023 to support the VVMF construction project.
- Westmead 6 and Westmead 4 loggers were removed for calibration and repair and await instruction for redeployment.

### 4.2 Exceedances

The number of Management Level exceedances recorded at each noise monitoring location during the assessment period are shown below.

Table 4: Recorded Management Level exceedances.

Logger Id	Noise logger location	Noise Management Level exceedance instances
Westmead 1	CHW Ground Floor room 51DM047 – kitchen of the endocrinology conference room (facing PSB site)	18
Westmead 5	CASB Level 3 Operating Theatre Store Room WM11K.03.3264 (facing PSB site)	-
Westmead 6	CASB Level 6 Cleaner’s Room WM11K.06.6079 (facing PSB site)	-
Westmead 4	KR Level 3 Radiation Room 33 RF041(facing PSB site)	-

Logger Id	Noise logger location	Noise Management Level exceedance instances
Westmead 7	KR Level 3 Radiation Room 33 RF041(facing PSB site)	N/A <sup>1</sup>
Westmead 2	CHW Level 2 Parent Kitchen 92BW025 (facing MSCP site)	9
Westmead 3	RMH Level 1 Store Room 101 (facing MSCP site)	17

Note 1: Westmead 7 logger was relocated to the WIMR bike store room on Thursday 10 August 2023 to support the VVMF construction project, hence all potential exceedances recorded by this logger are currently not relevant for this project.

It is the responsibility of the Principal Contractor to respond to each Noise Management Level exceedance when it occurs and record the outcome of the exceedance investigation (cause of NML exceedance, any noise mitigation measures implemented to address the exceedance, etc.).

### 4.3 Daily noise monitoring results

Daily noise monitoring results are showing for each location in Appendix A.

## Works Cited


- [1] Arup, “Baseline noise measurements report,” Sydney, 2022.


## **Appendix A**

### **Noise Monitoring Daily Results**


# A1 CHW Ground Floor room 51DM047 (Westmead 1)


---

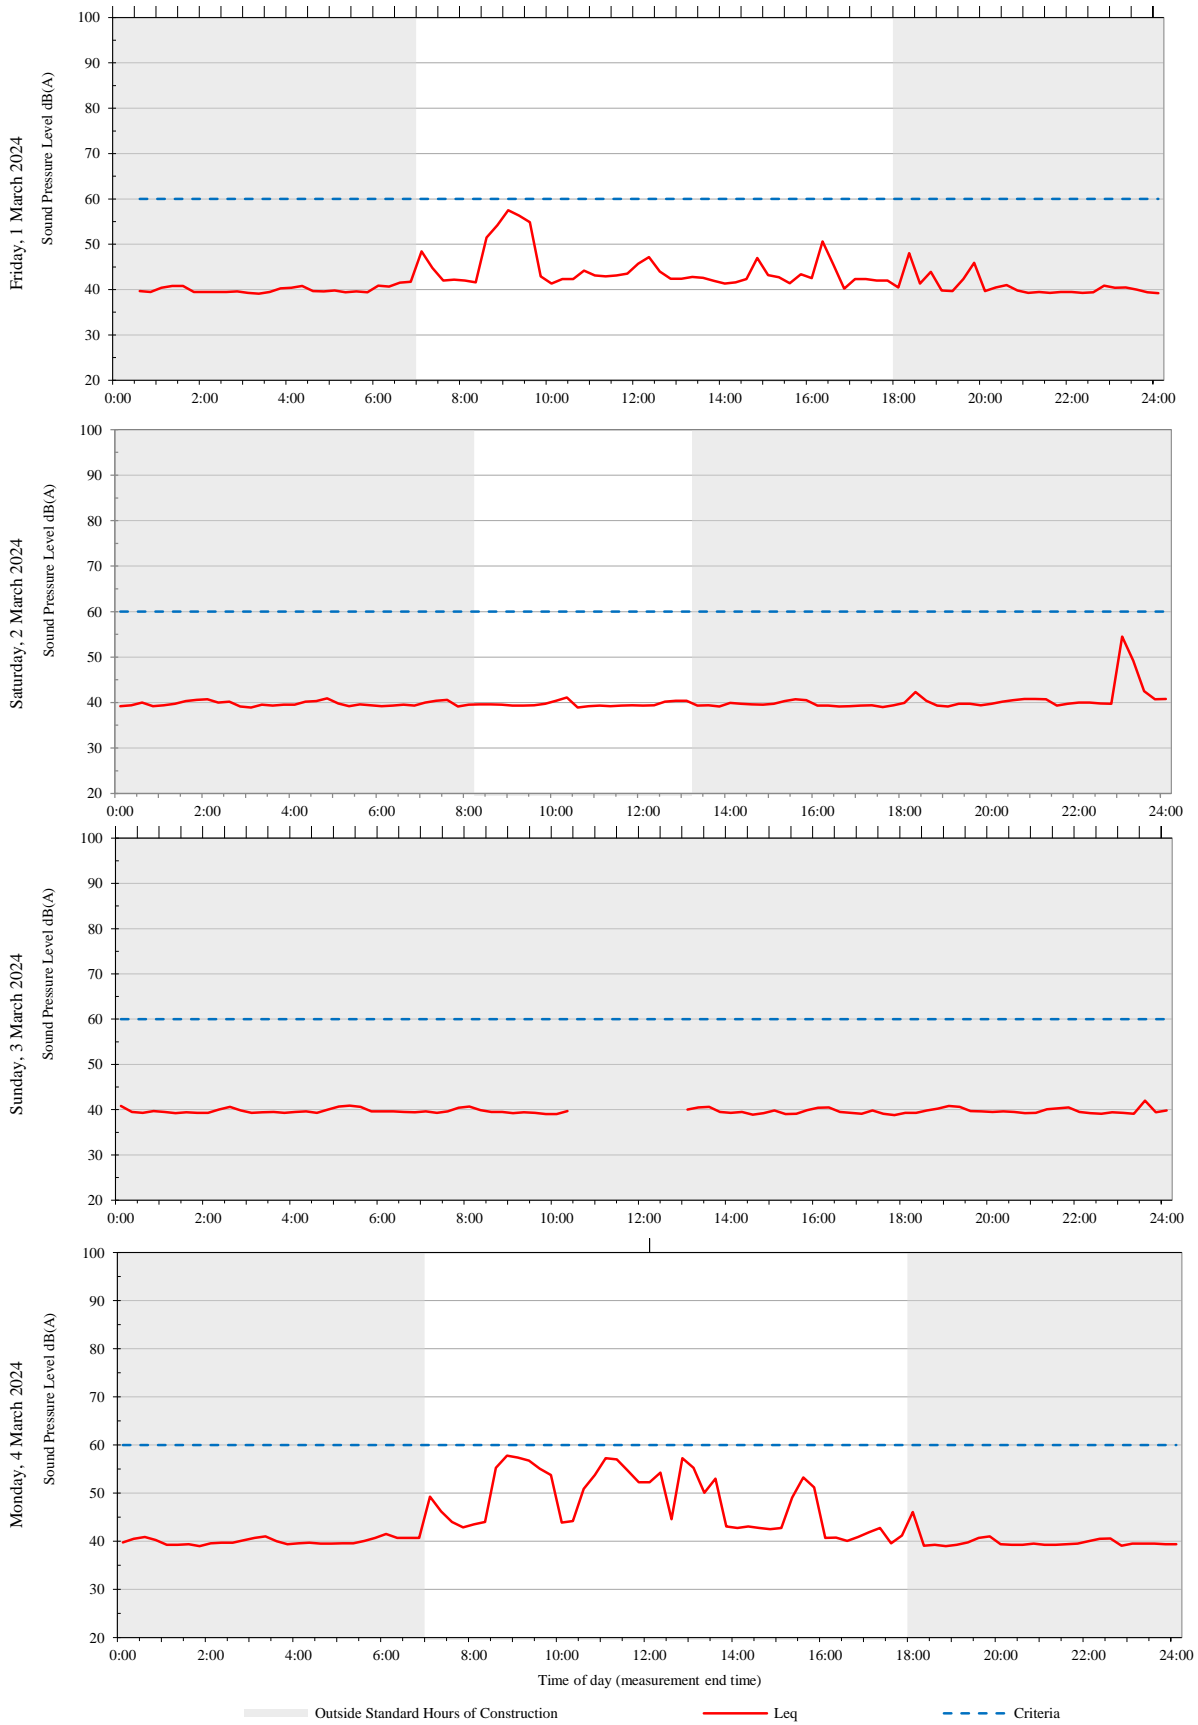


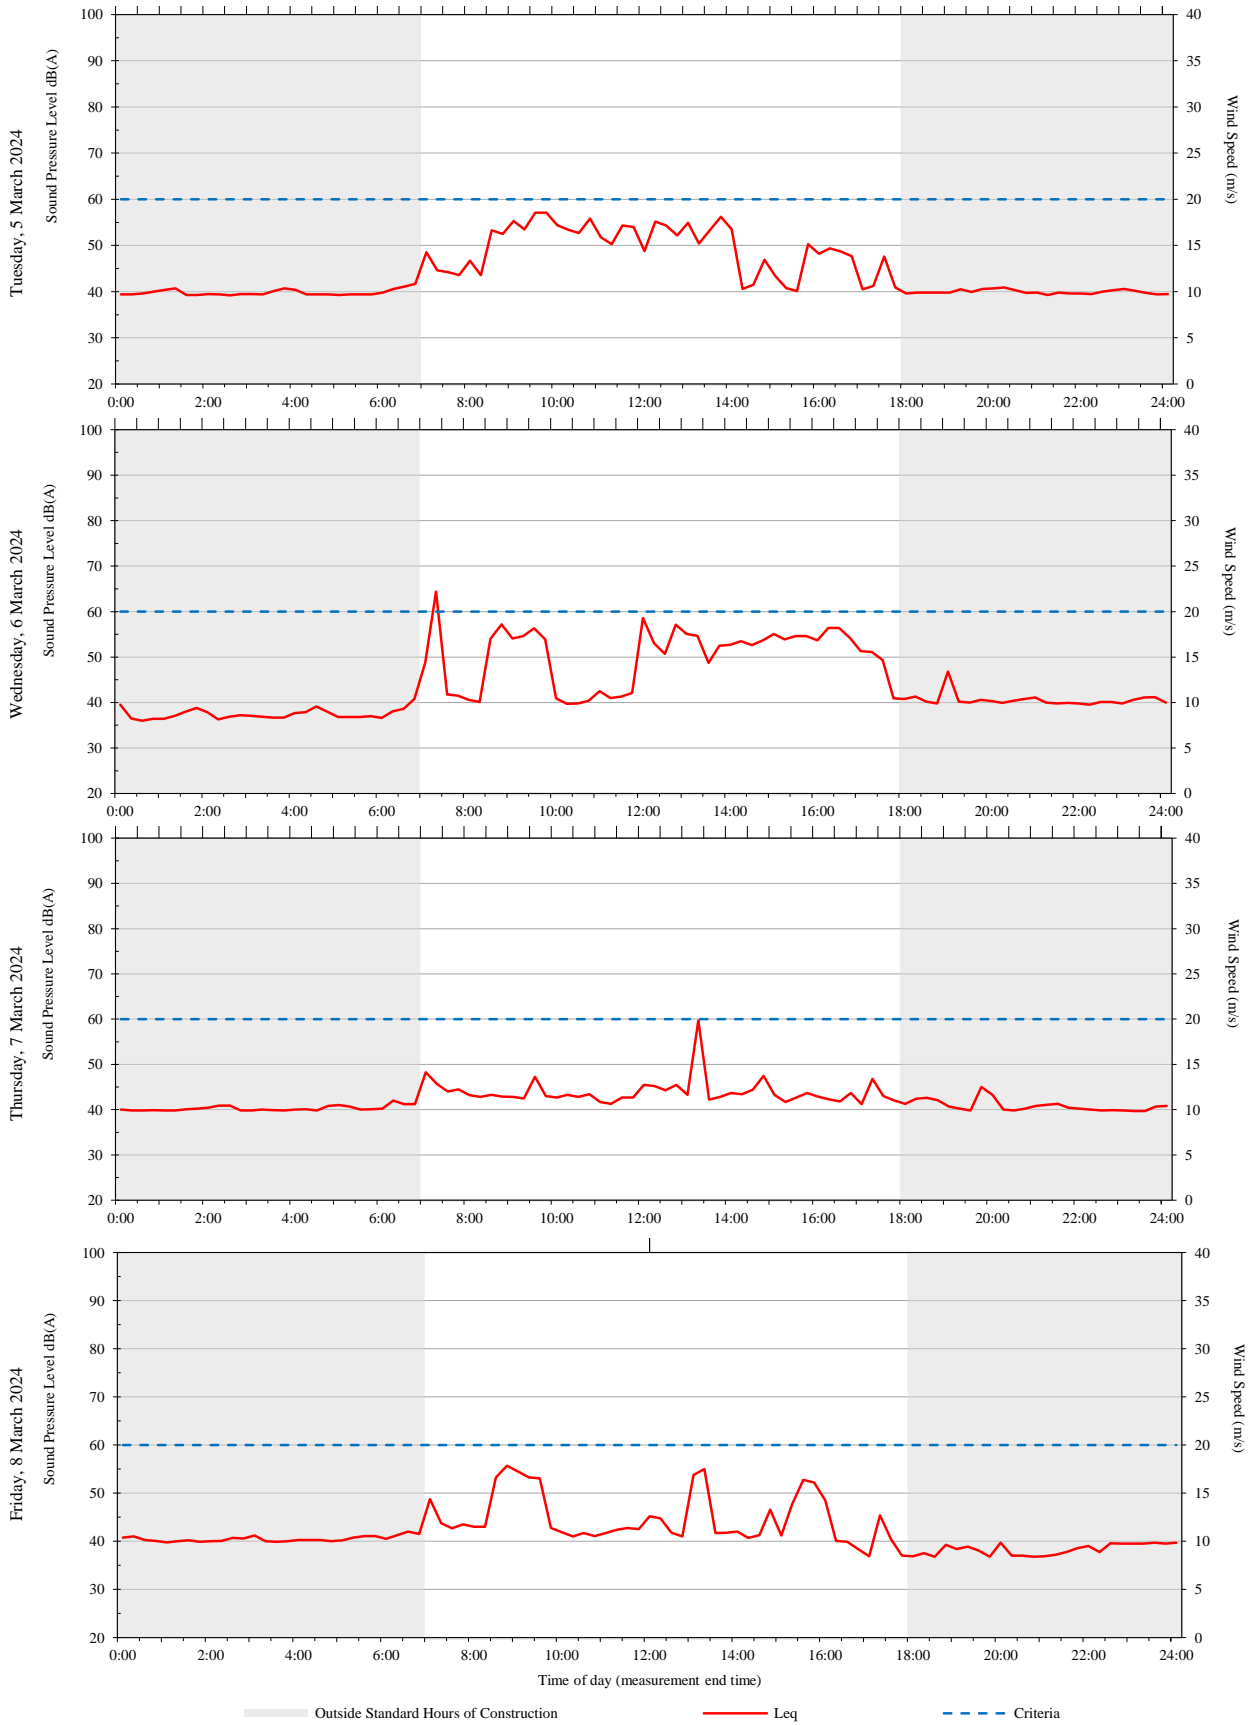



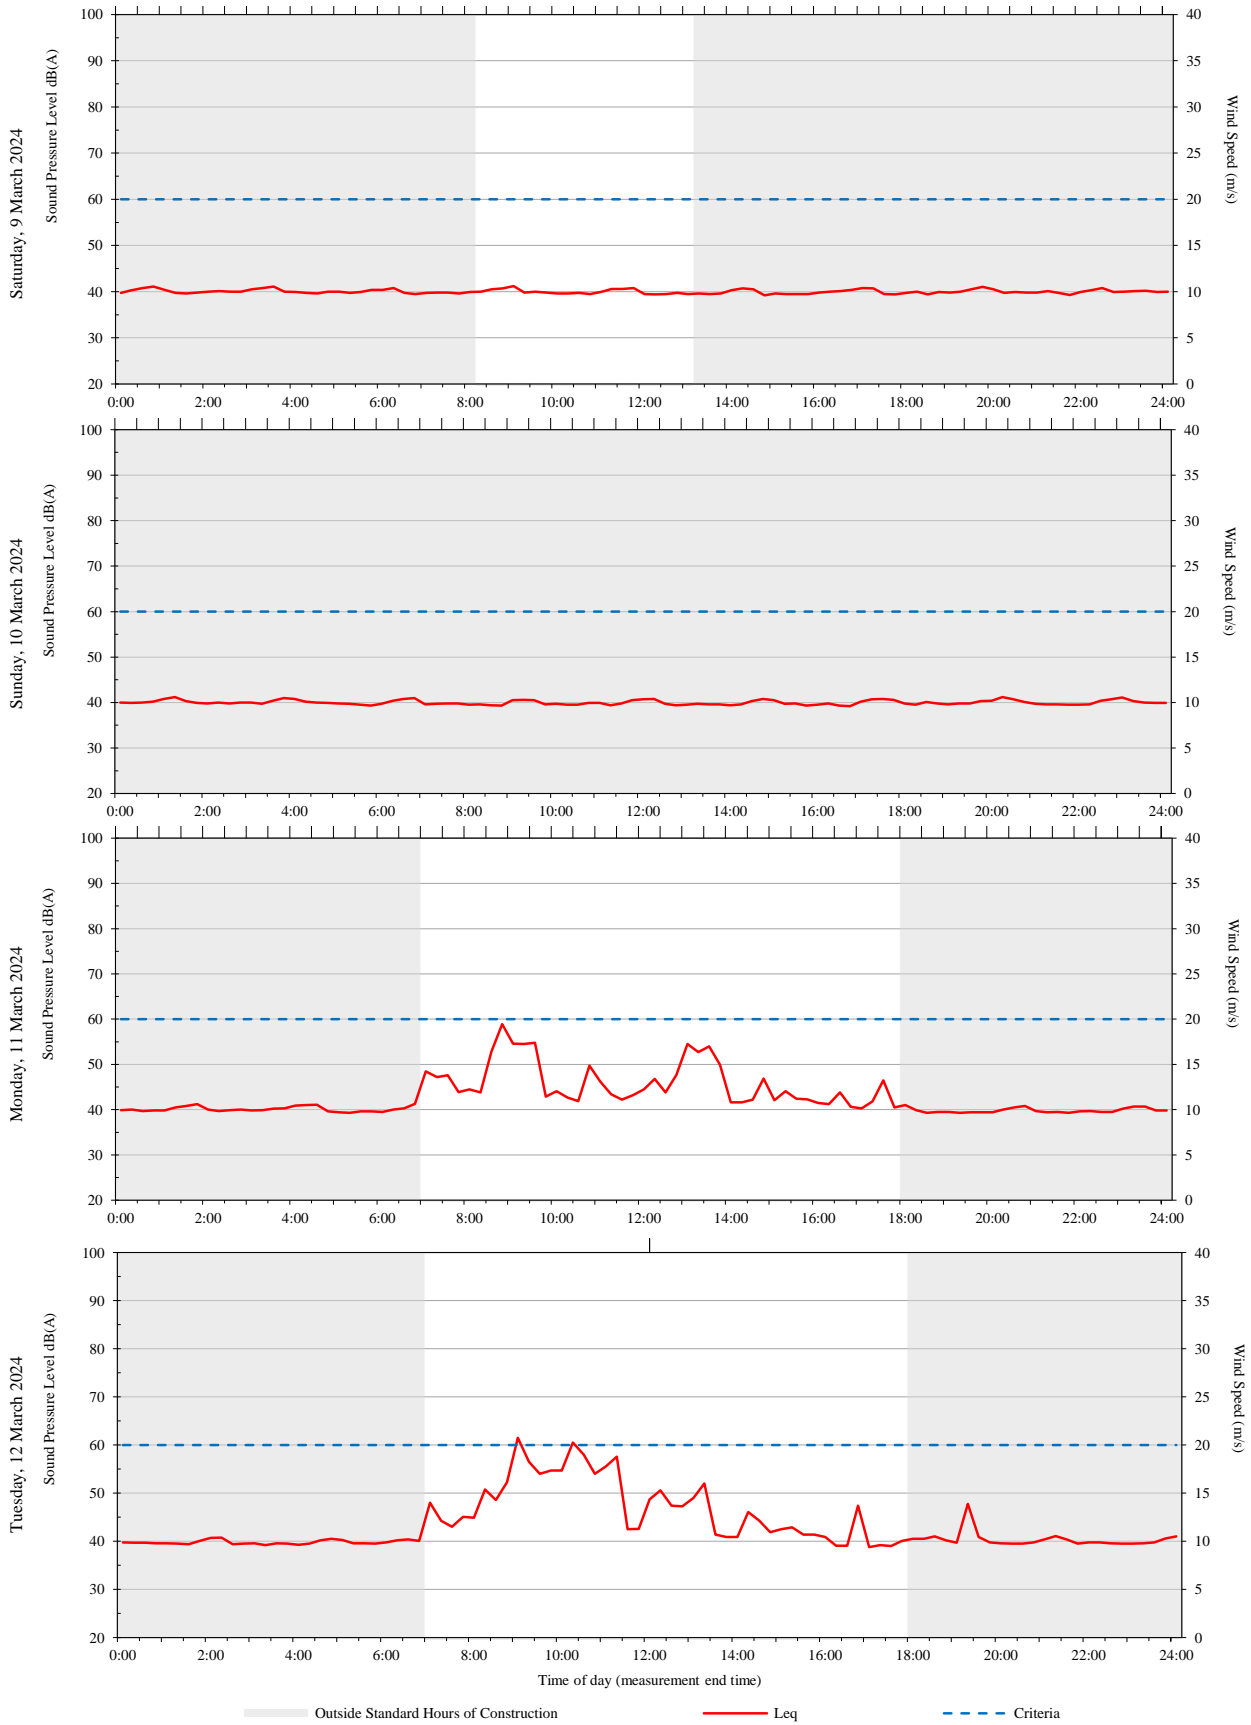


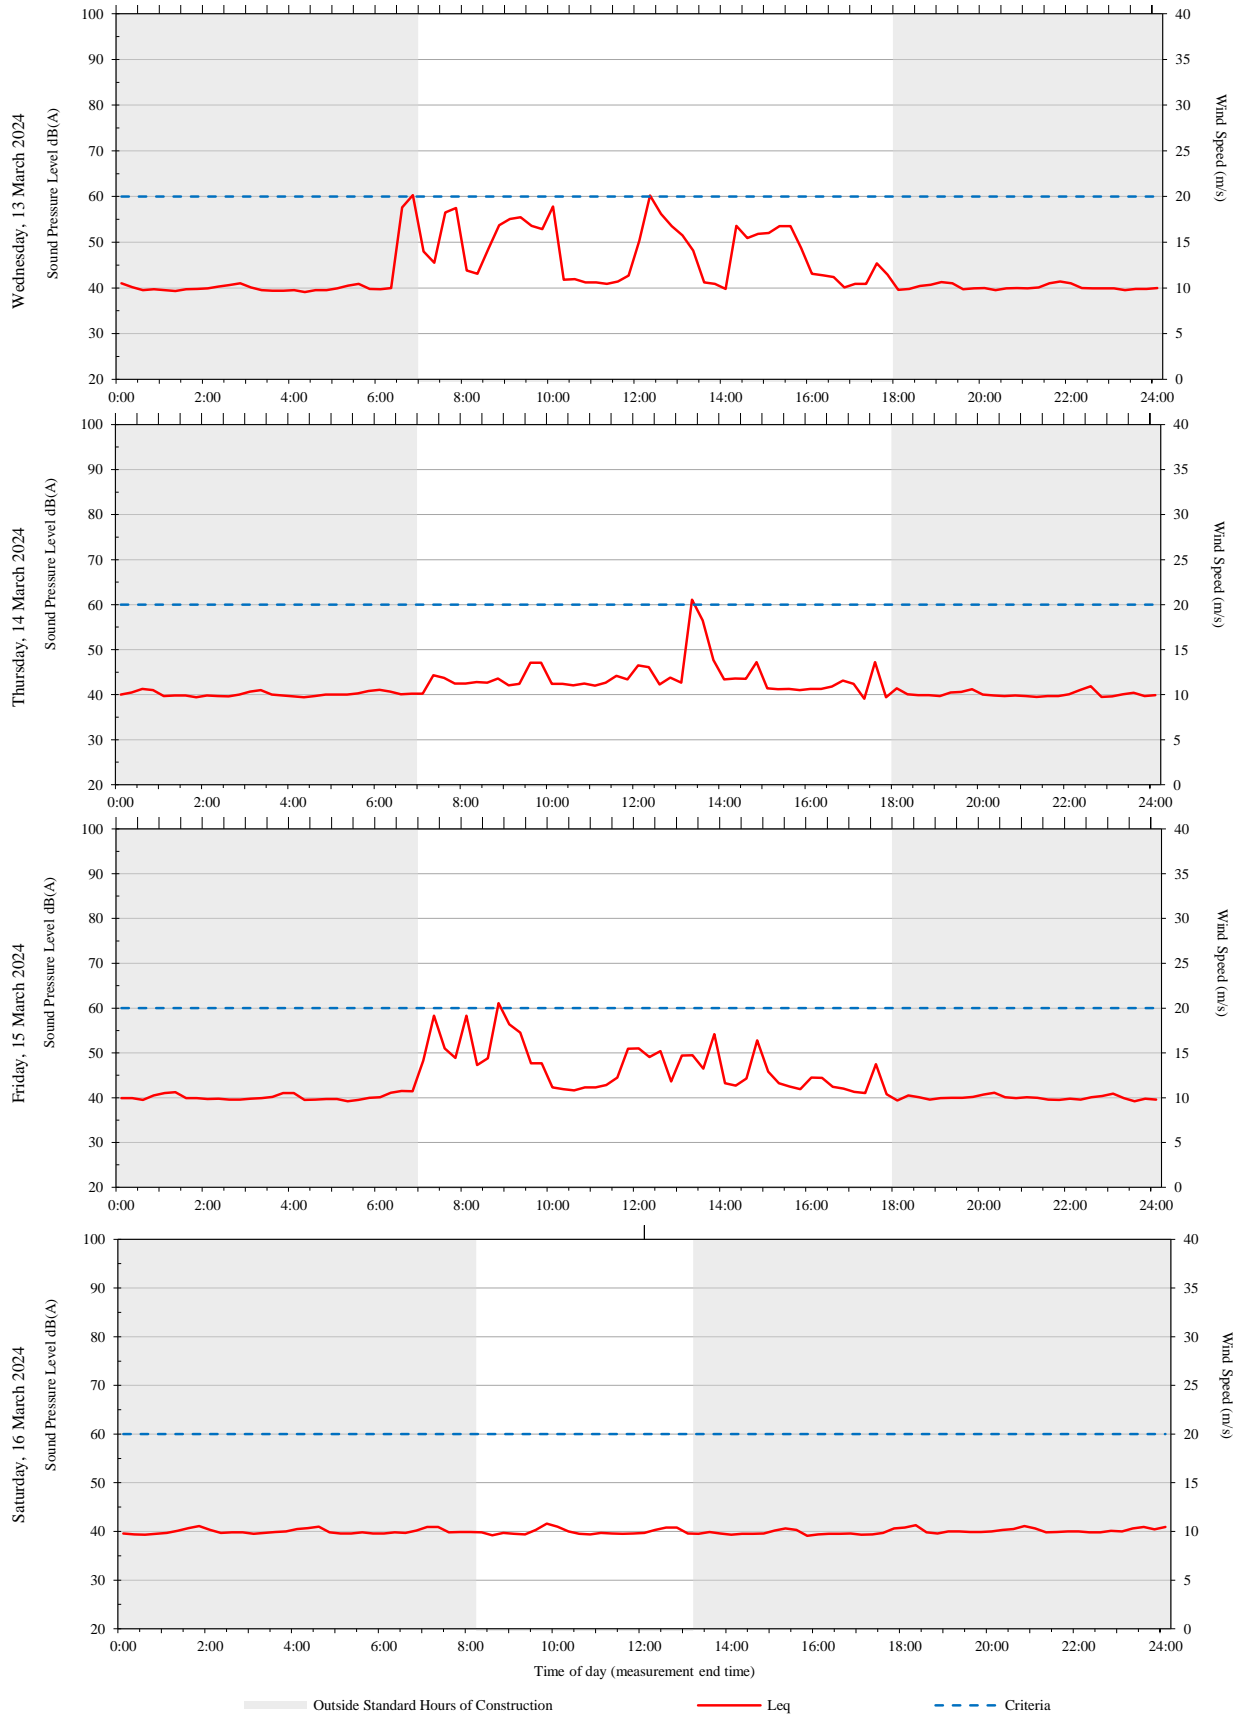


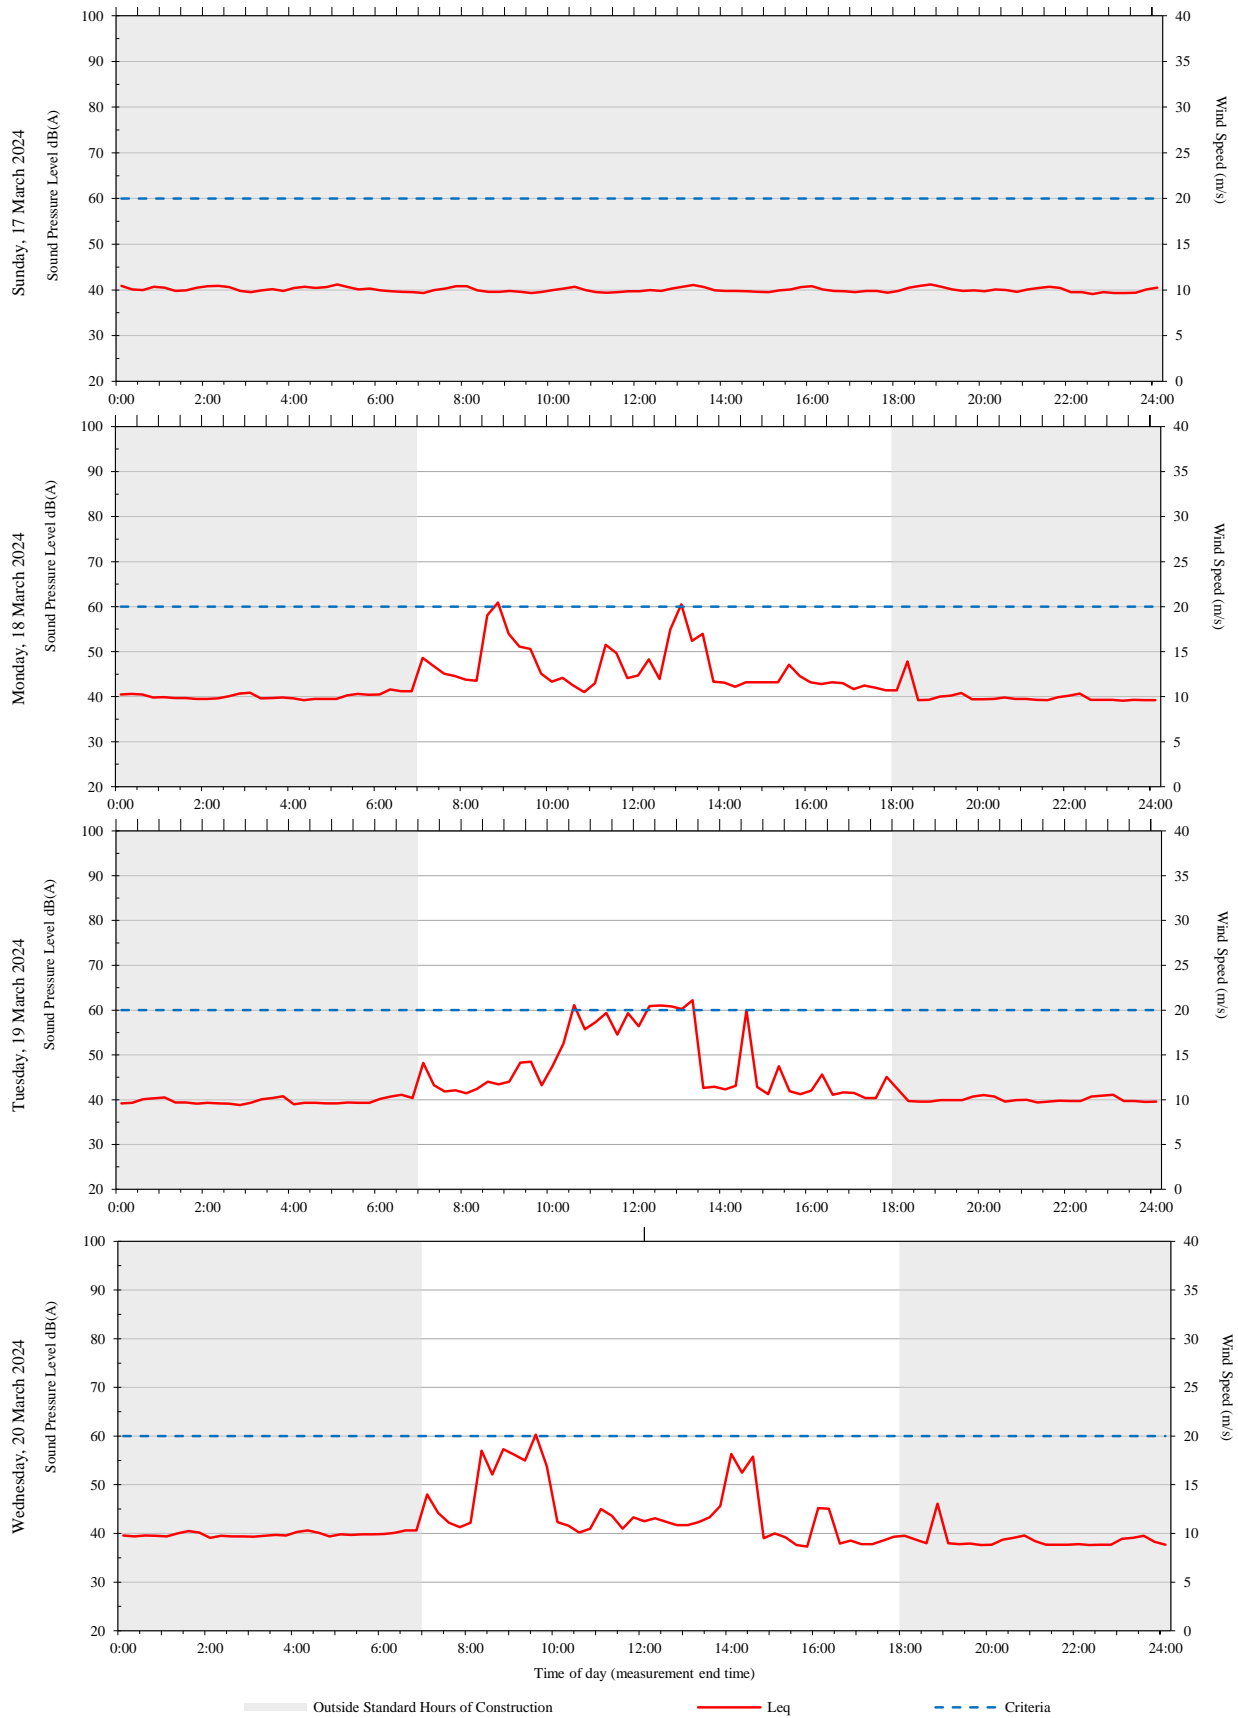

# Unattended monitoring: CHW Ground Floor room 51DM047 (Internal)


ARUP

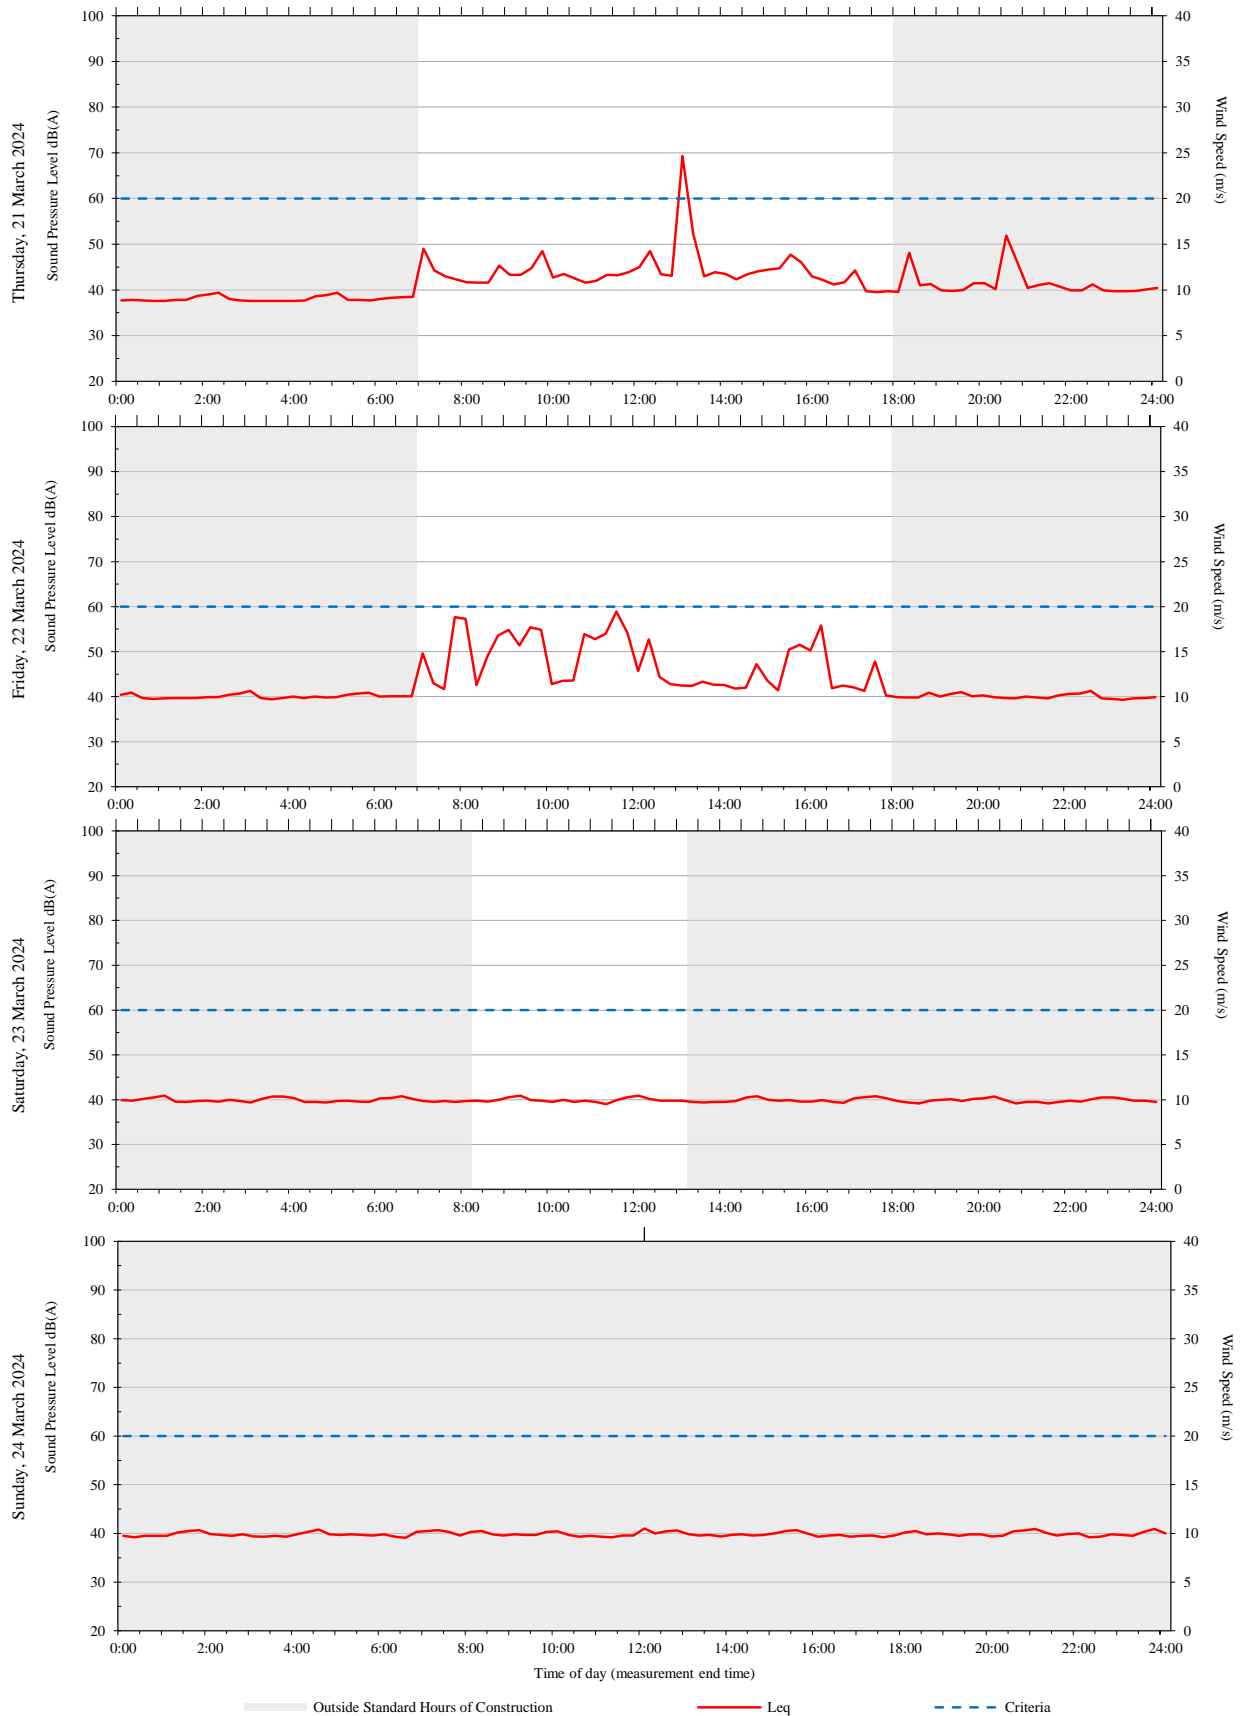

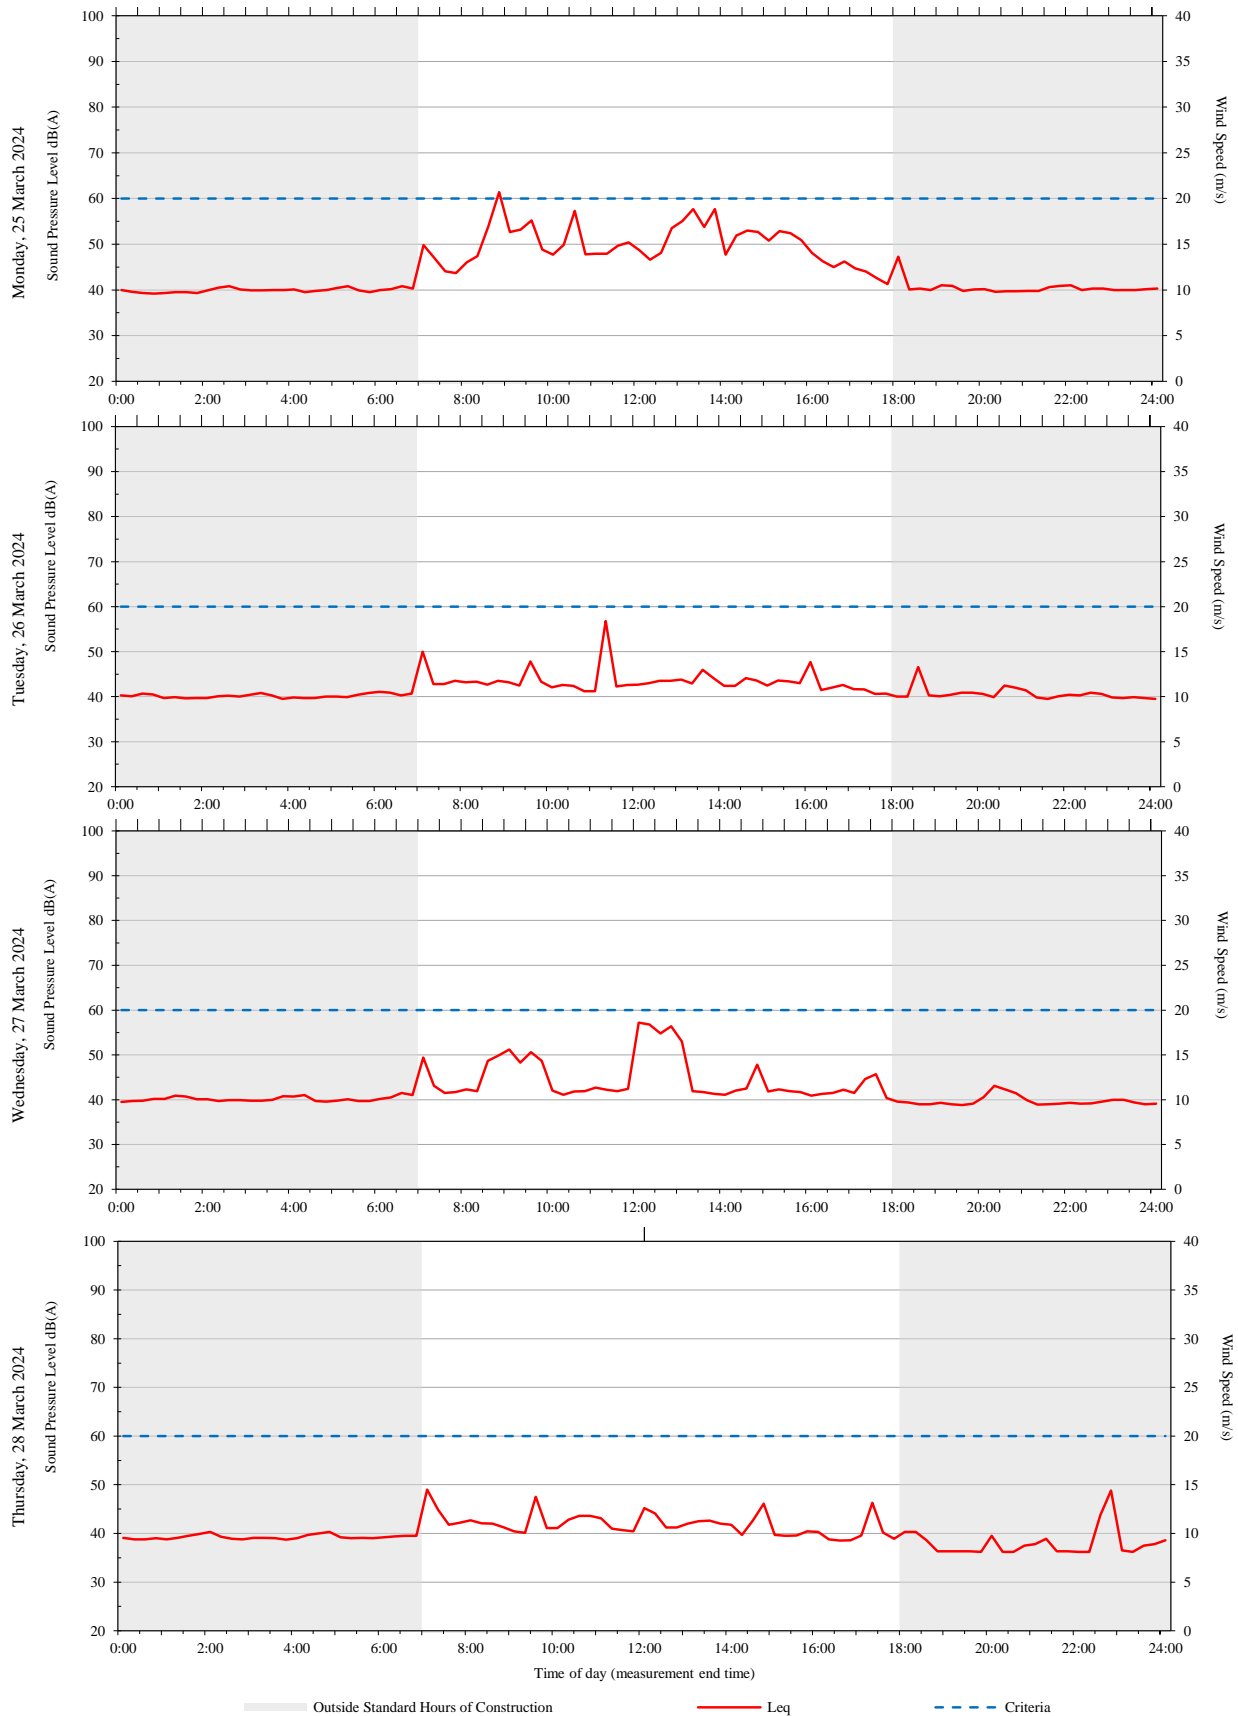

Unattended monitoring: CHW Ground Floor room 51DM047 (Internal)


ARUP

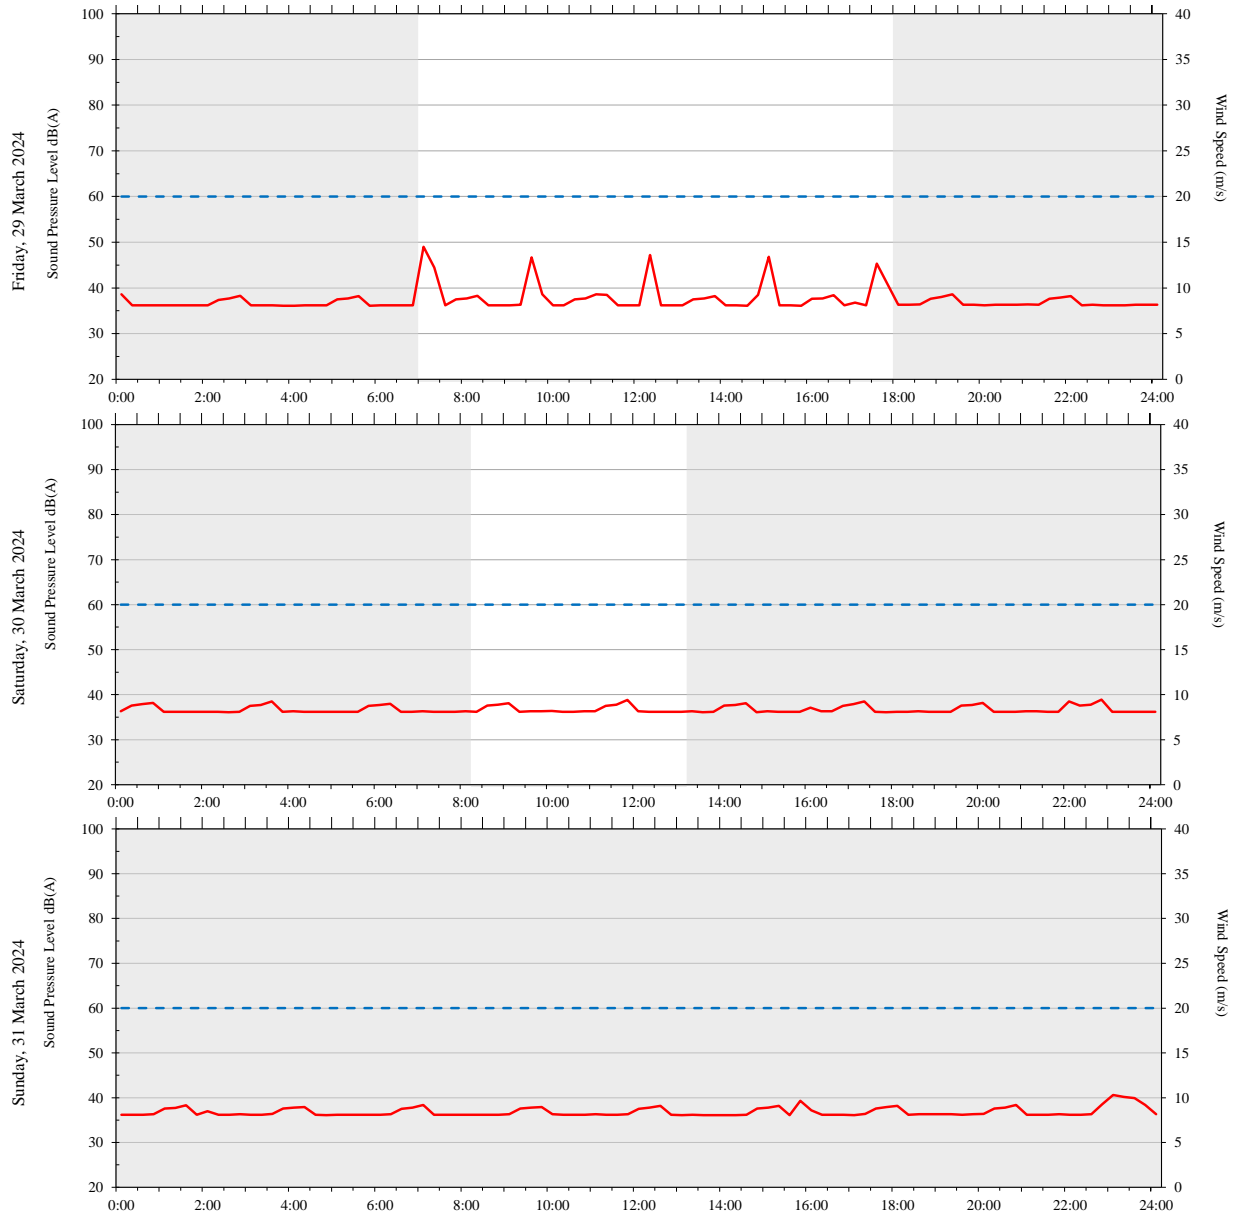


## **A2 CHW Level 2 Parent Kitchen 92BW025 (facing MSCP site) (Westmead 2)**


---

Unattended monitoring: CHW Level 2 Parent Kitchen 92BW025 (Internal)

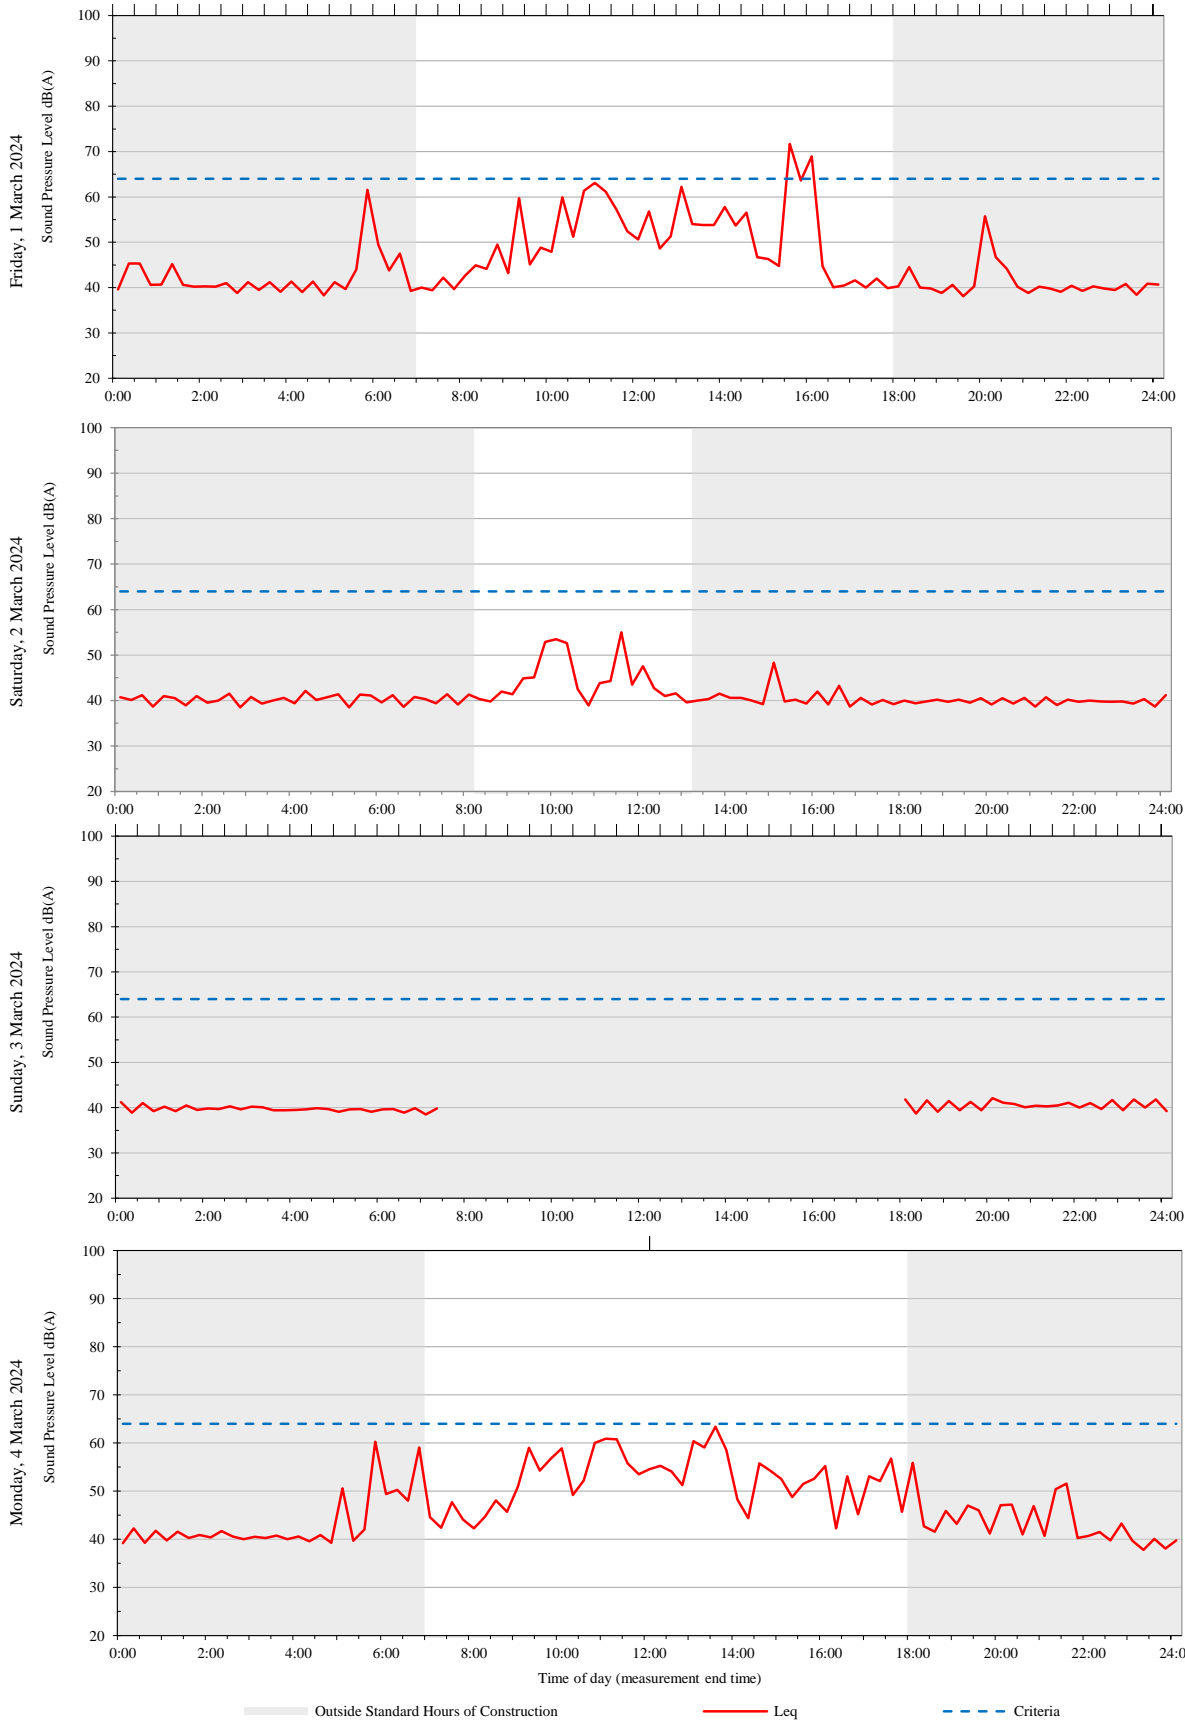




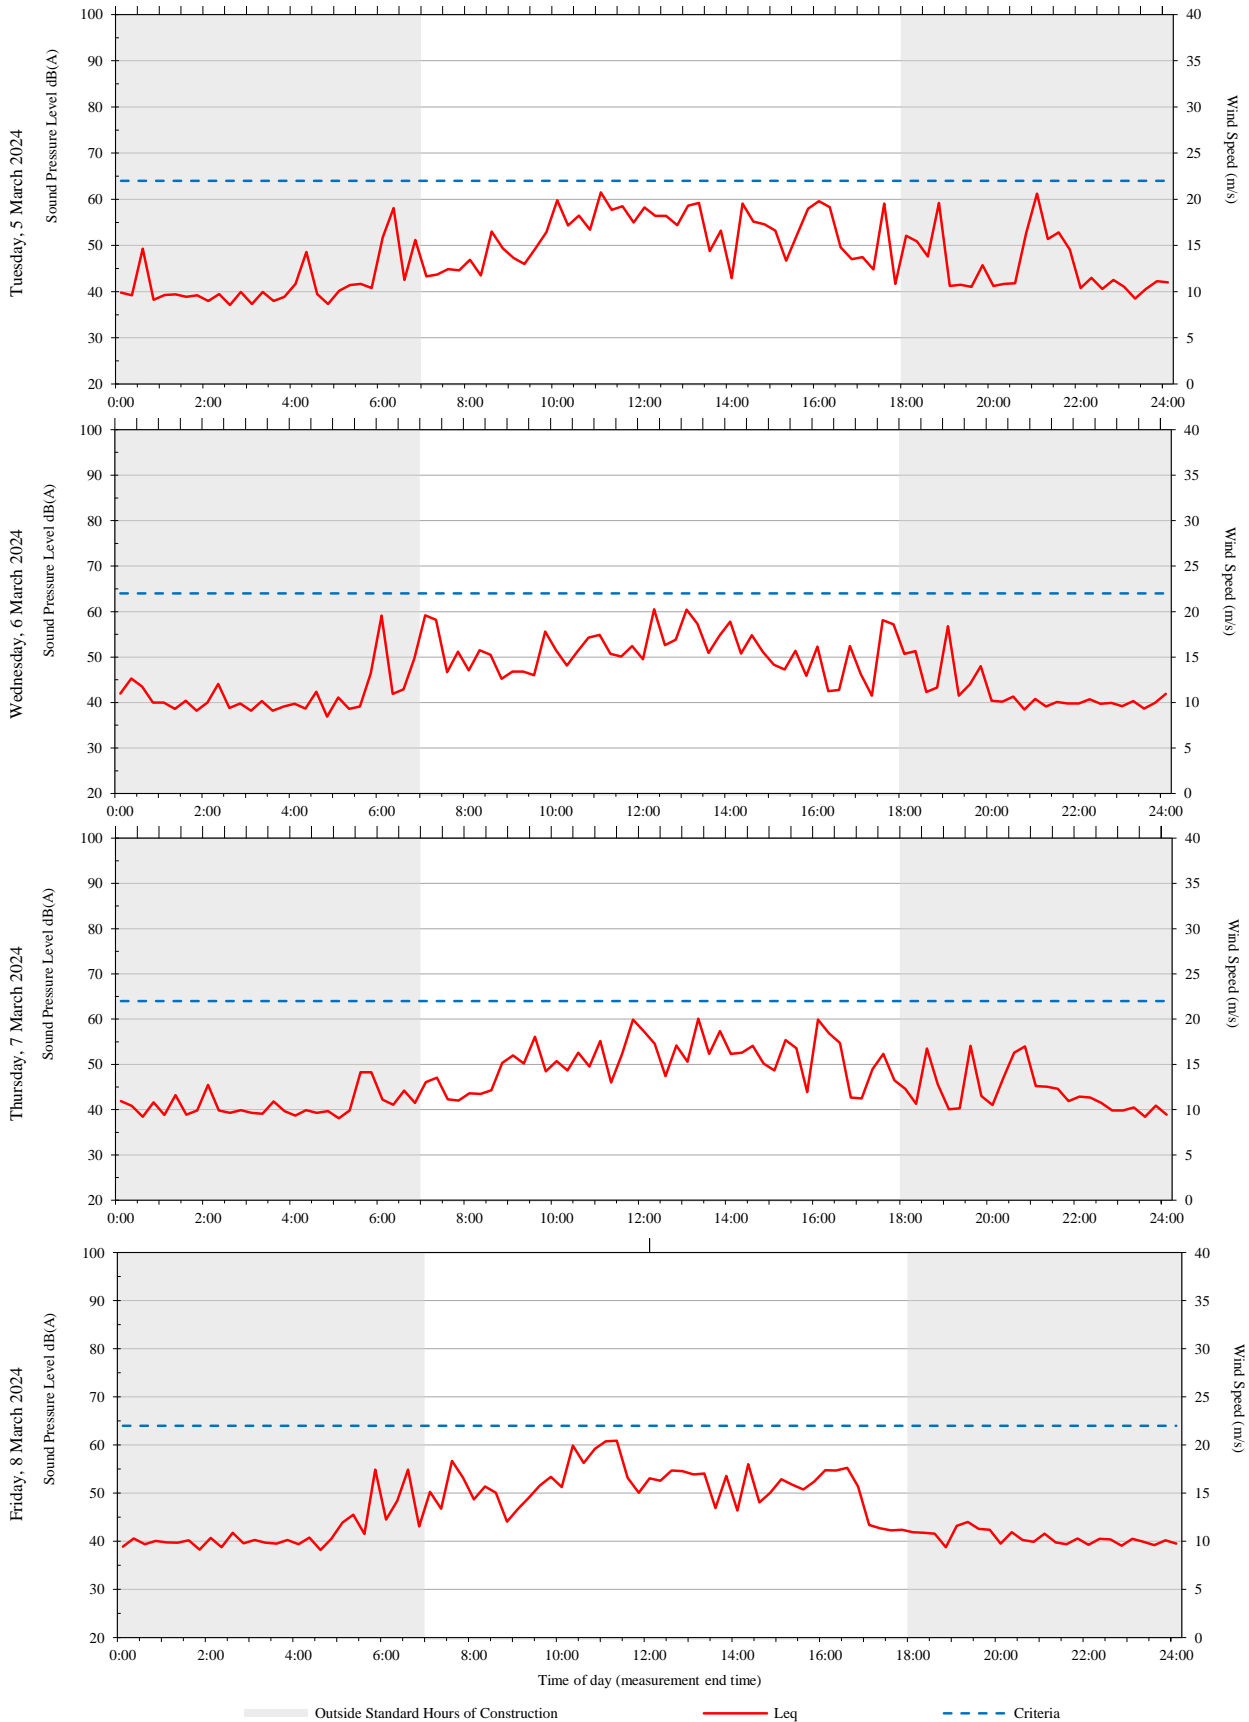

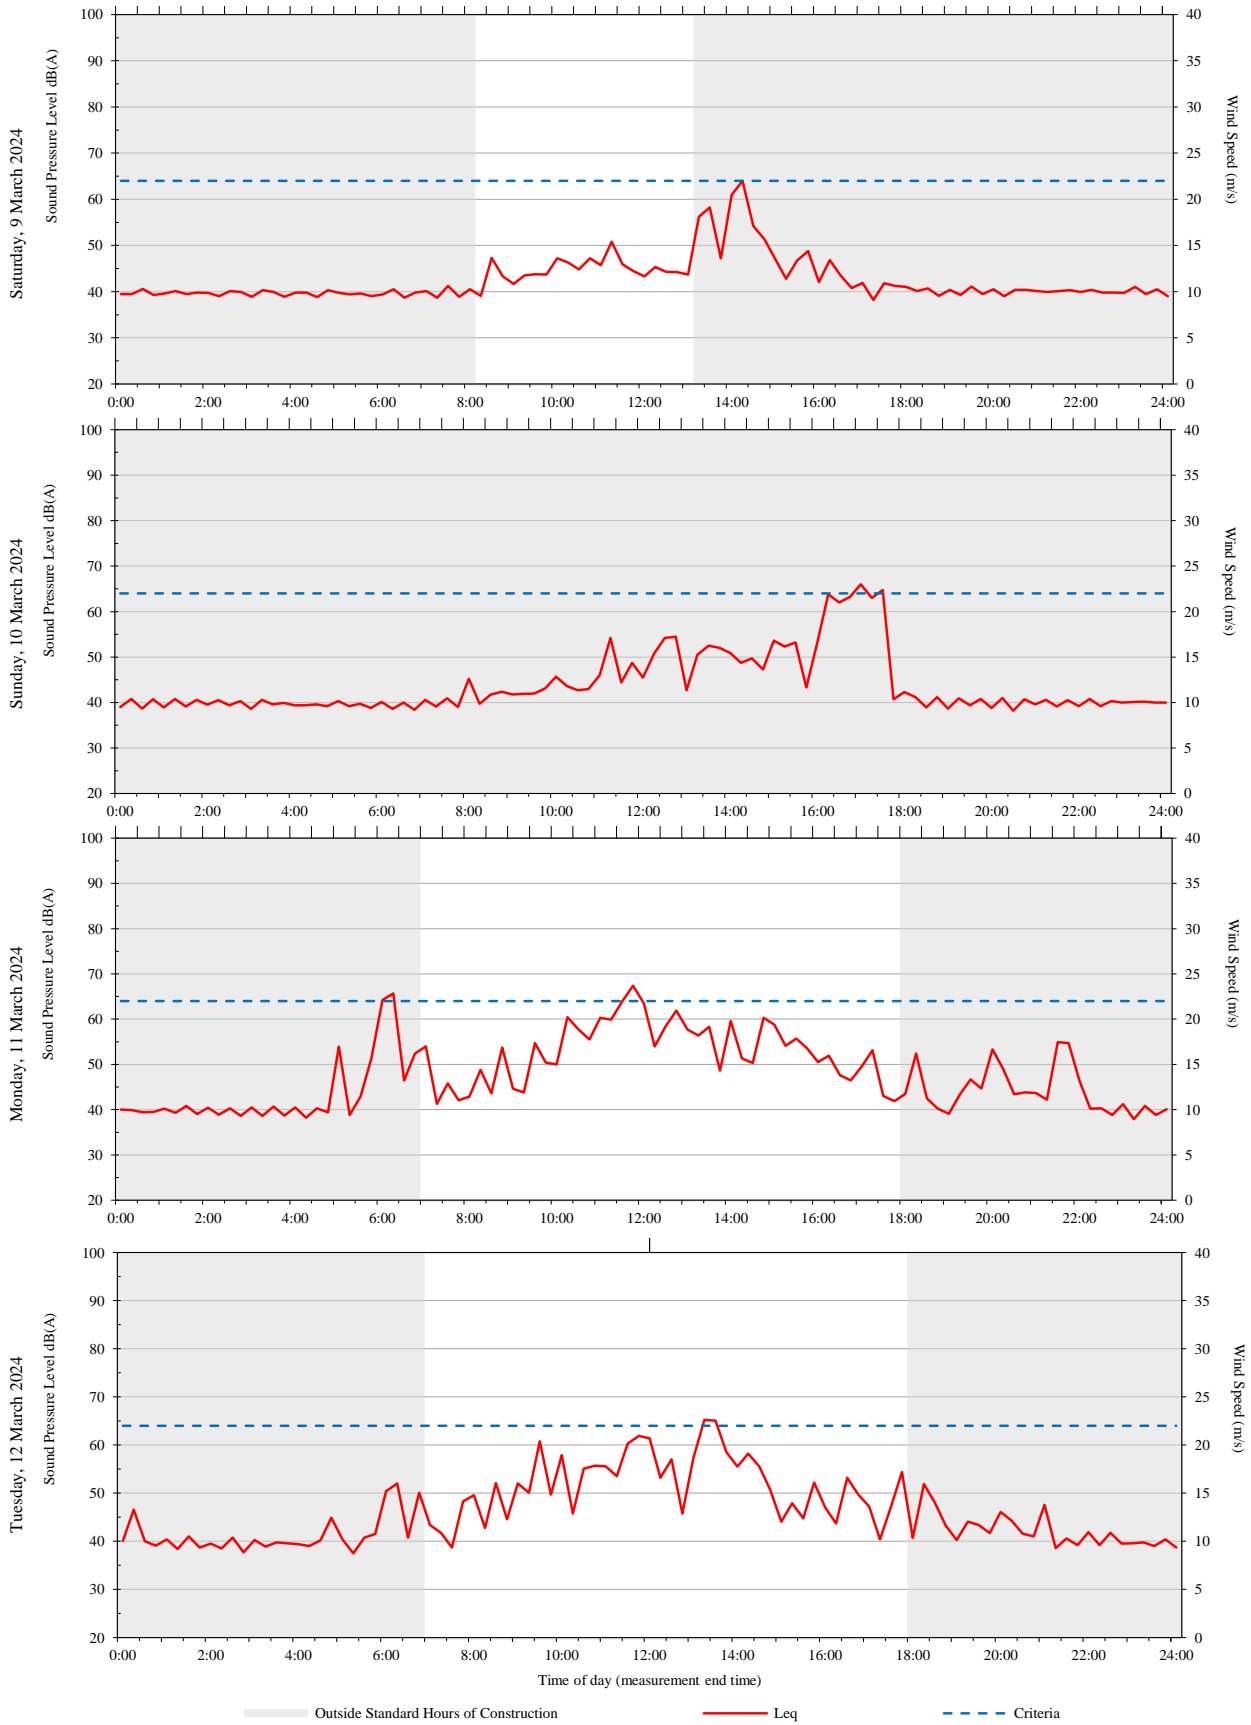


Unattended monitoring: CHW Level 2 Parent Kitchen 92BW025 (Internal)

ARUP

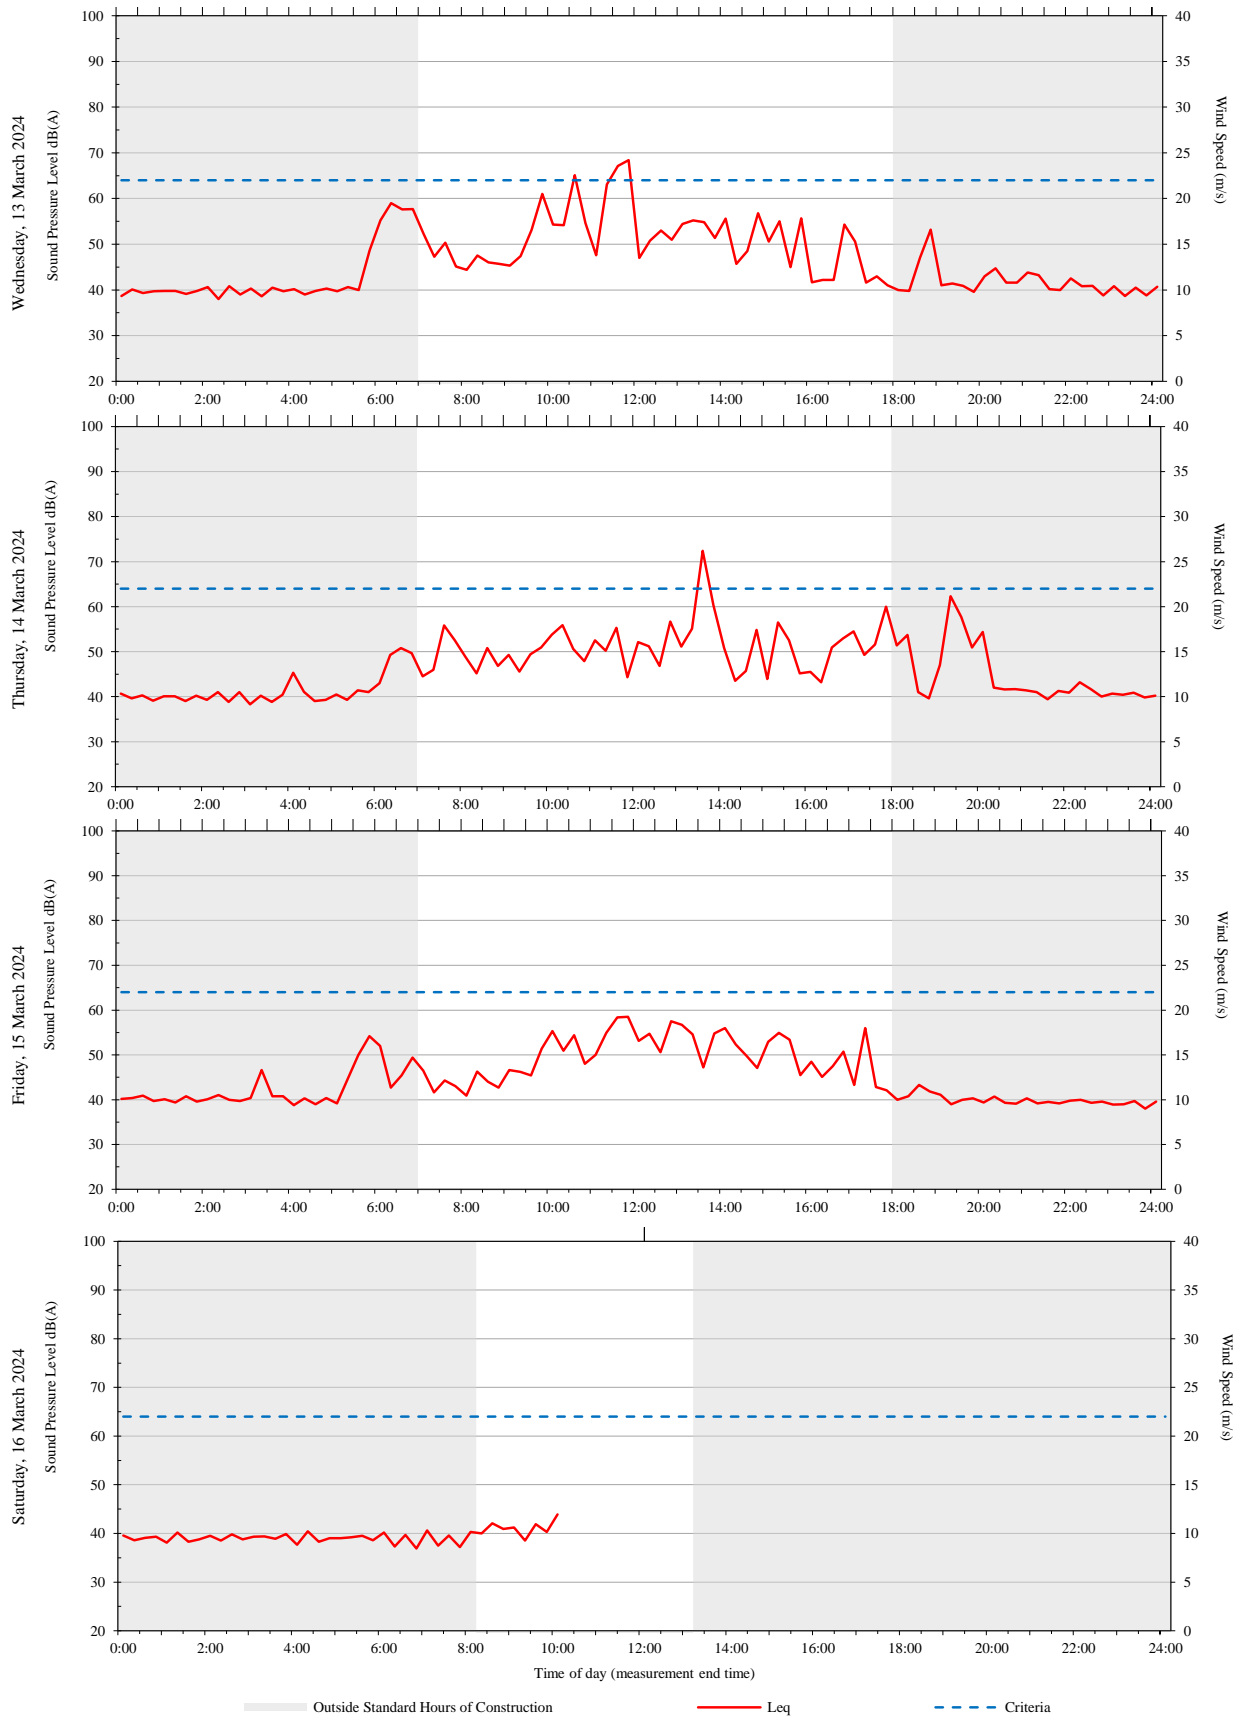


Unattended monitoring: CHW Level 2 Parent Kitchen 92BW025 (Internal)

ARUP

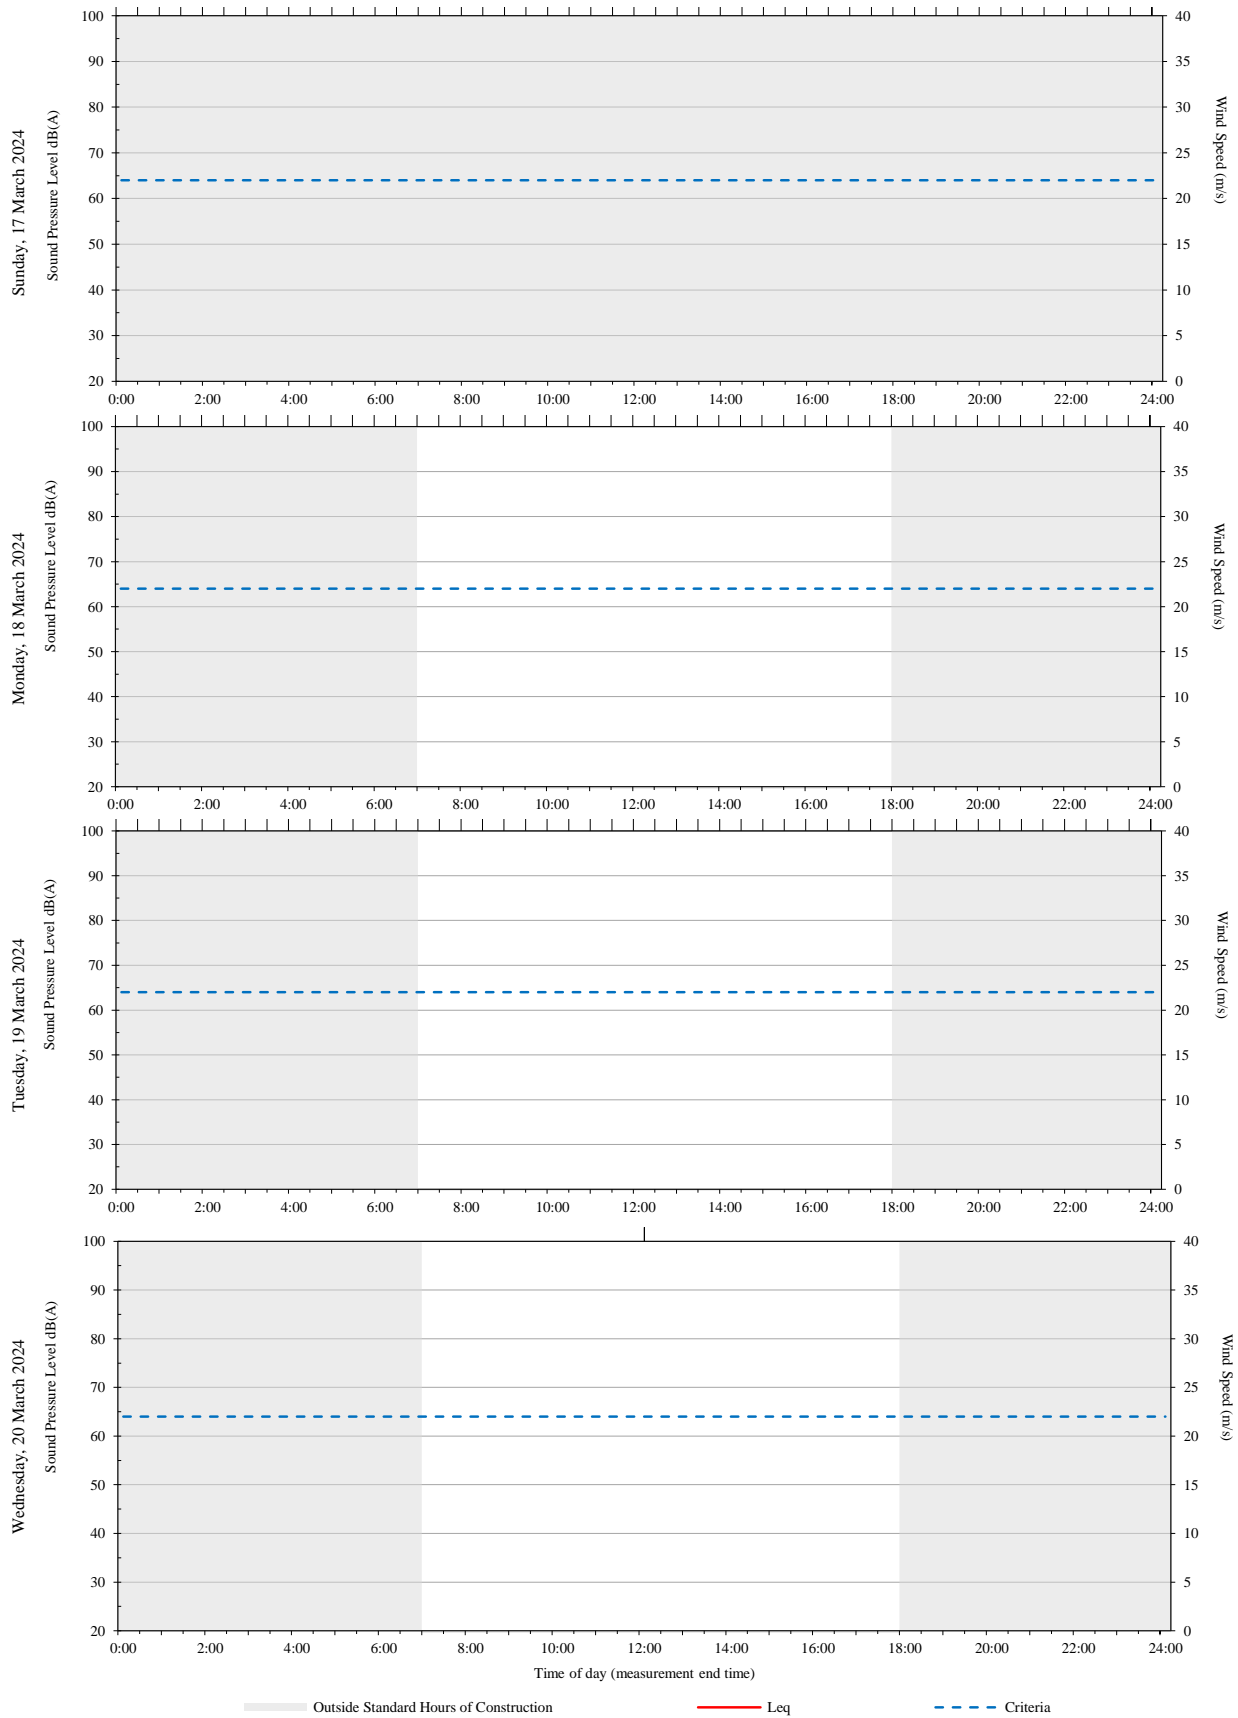


Unattended monitoring: CHW Level 2 Parent Kitchen 92BW025 (Internal)

ARUP

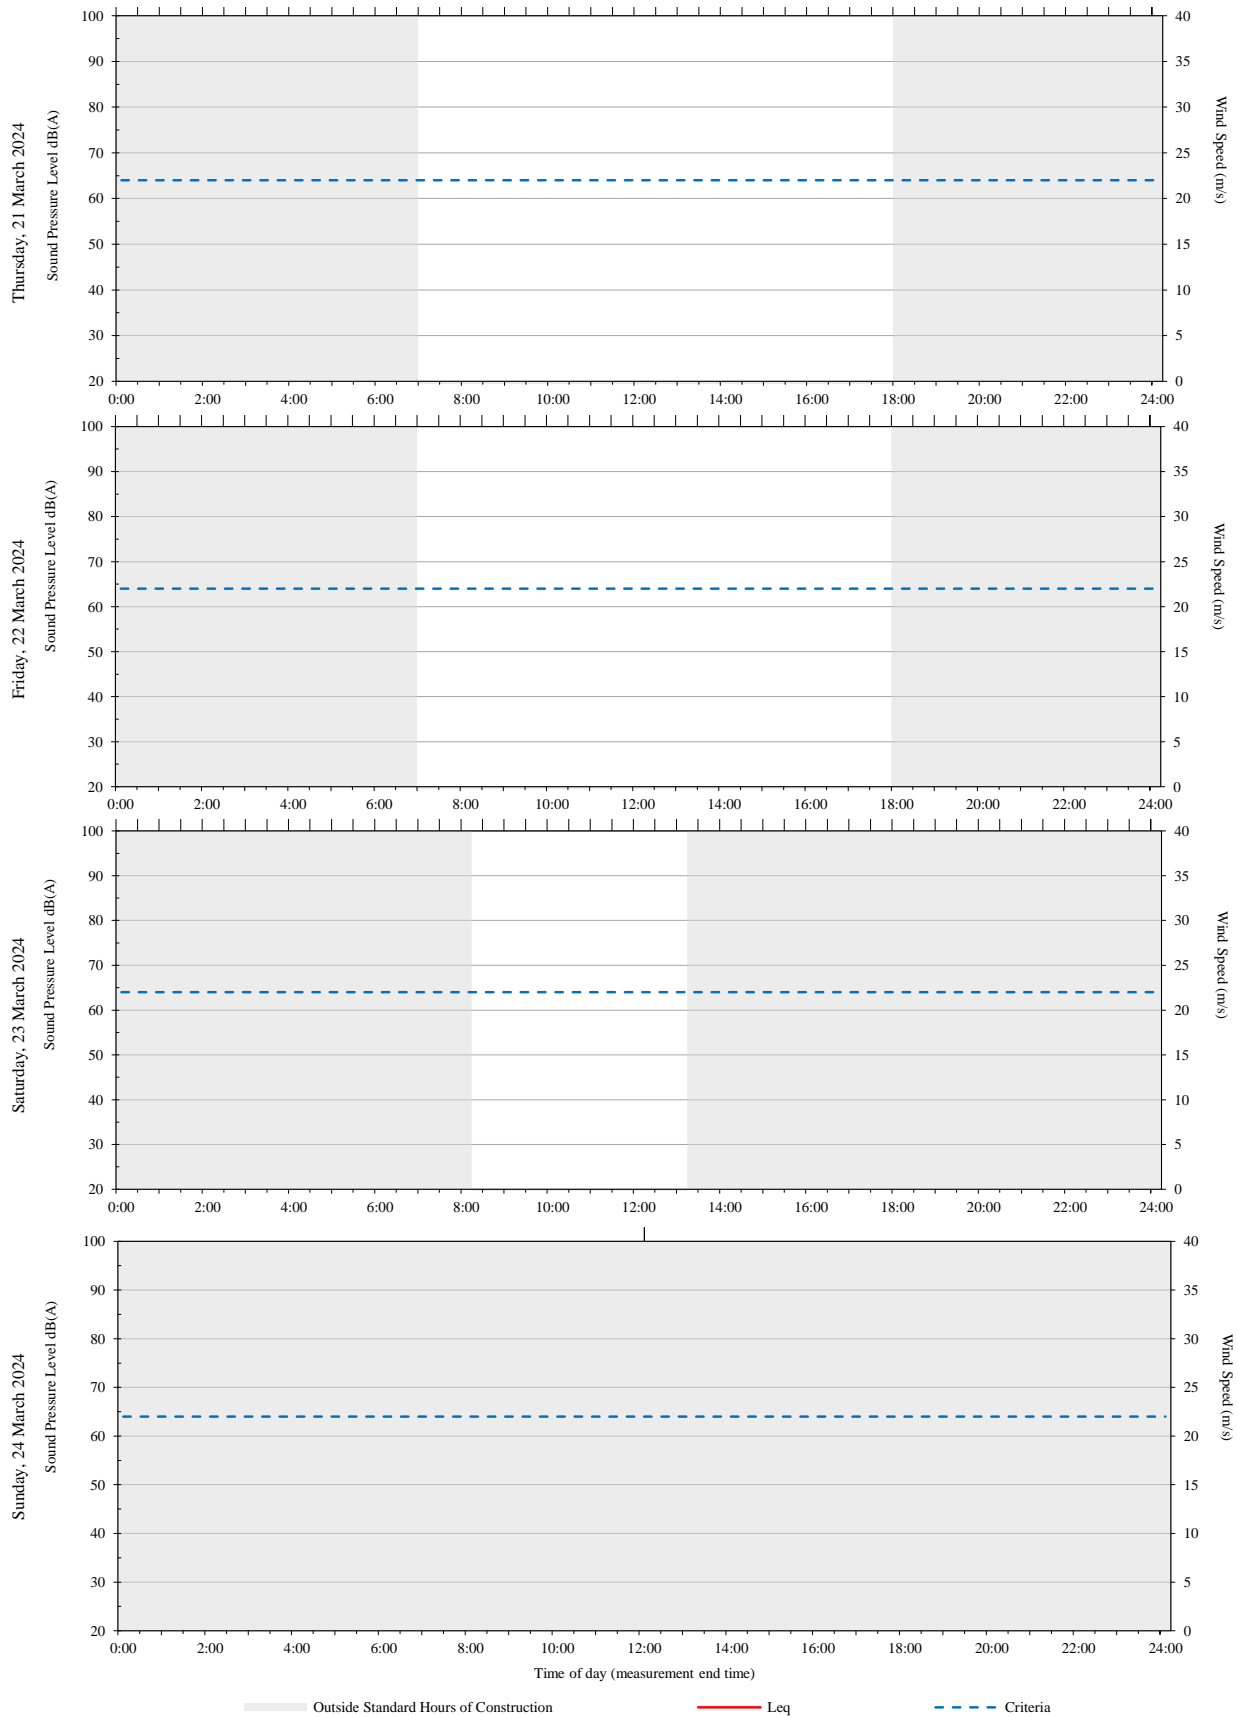


Unattended monitoring: CHW Level 2 Parent Kitchen 92BW025 (Internal)

ARUP

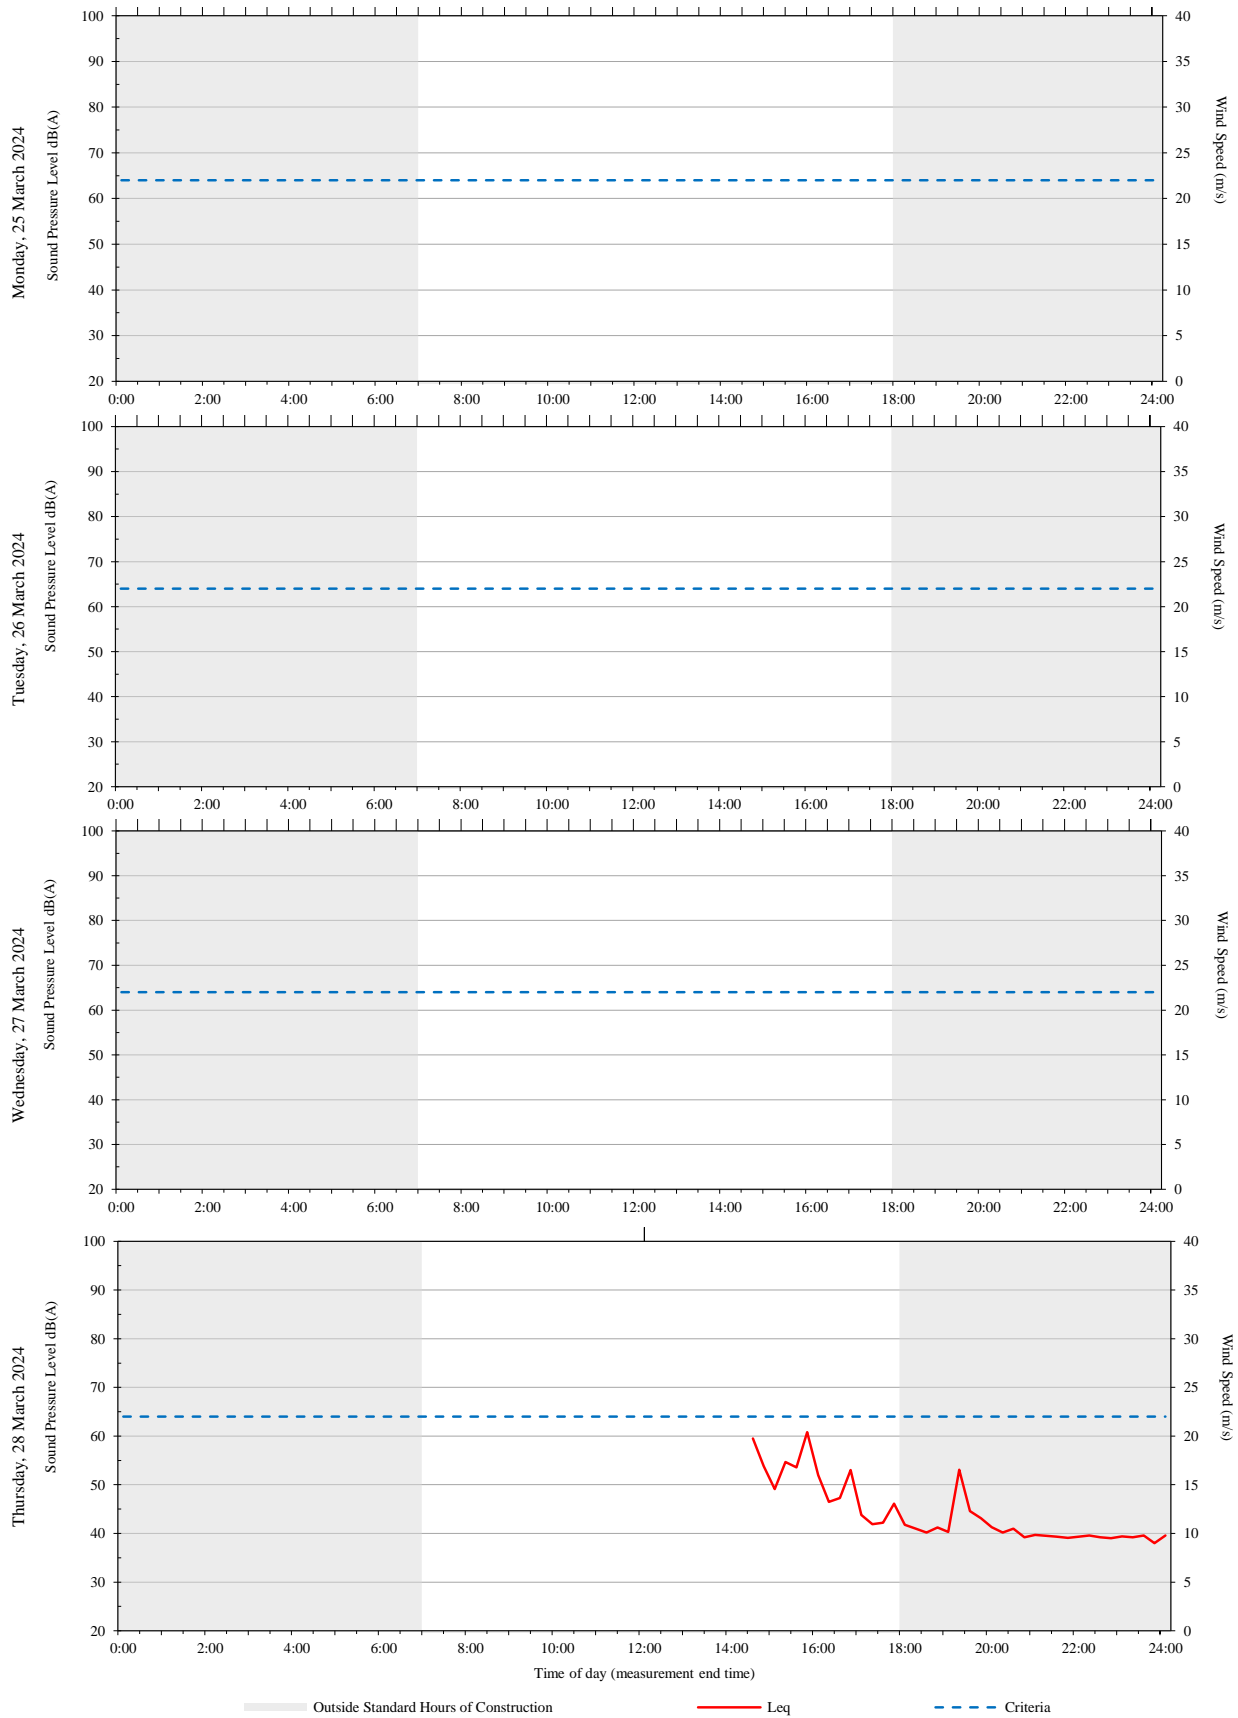

Unattended monitoring: CHW Level 2 Parent Kitchen 92BW025 (Internal)

ARUP

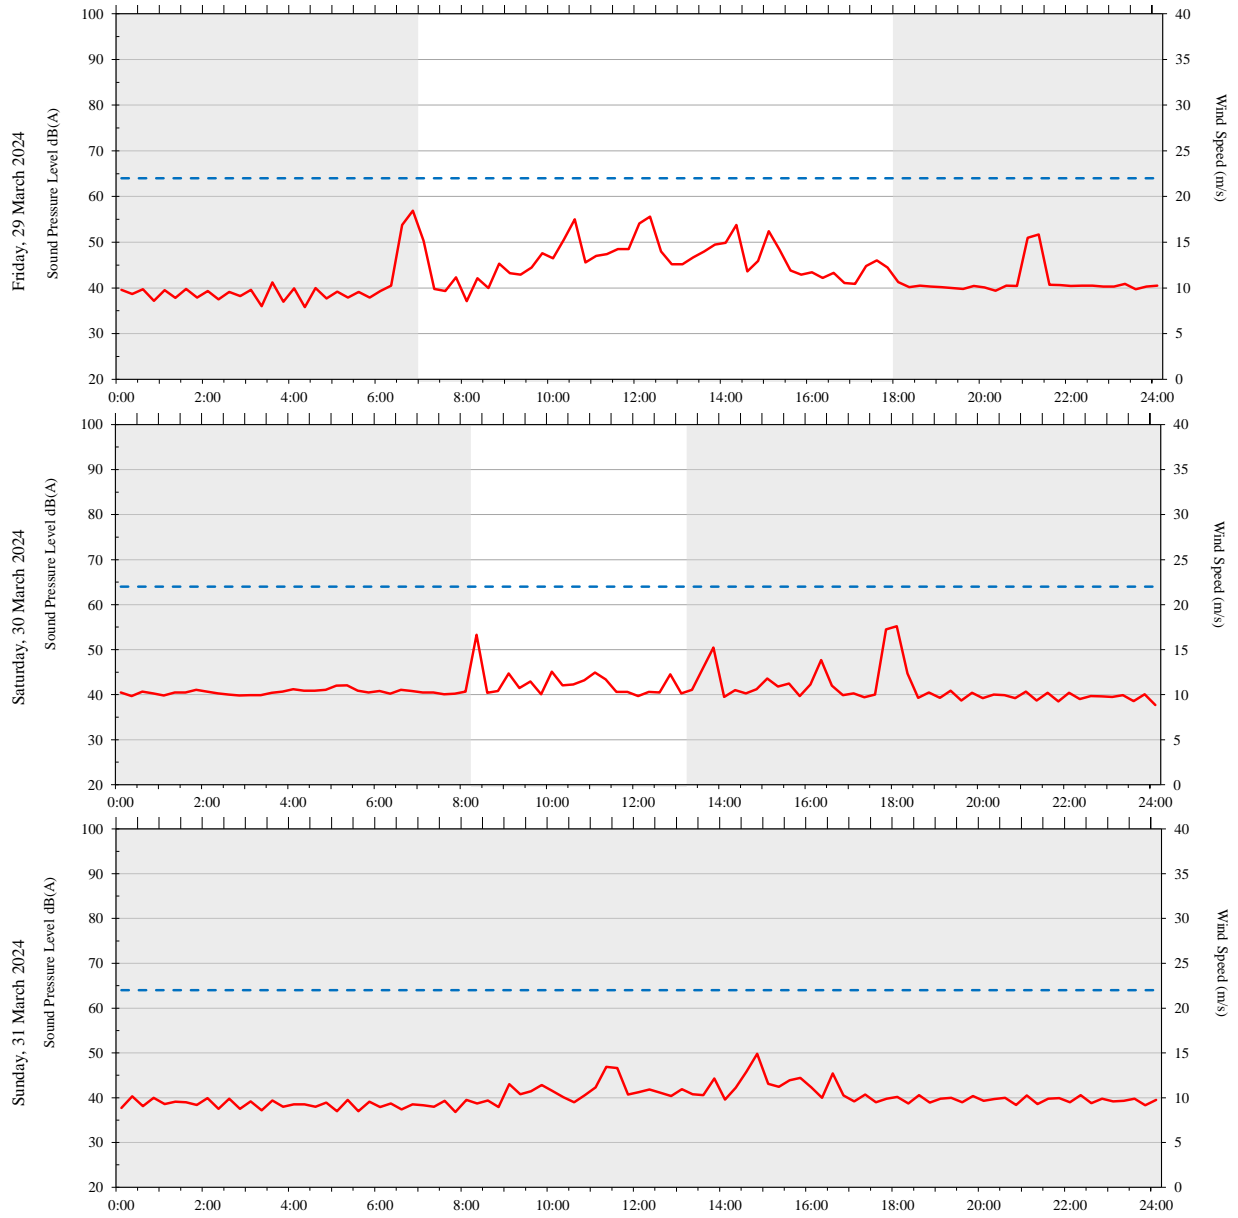


# A3 RMH Level 1 Store Room 101 (Westmead 3)


---




Unattended monitoring: RMH Level 1 Store Room 101 (Internal)

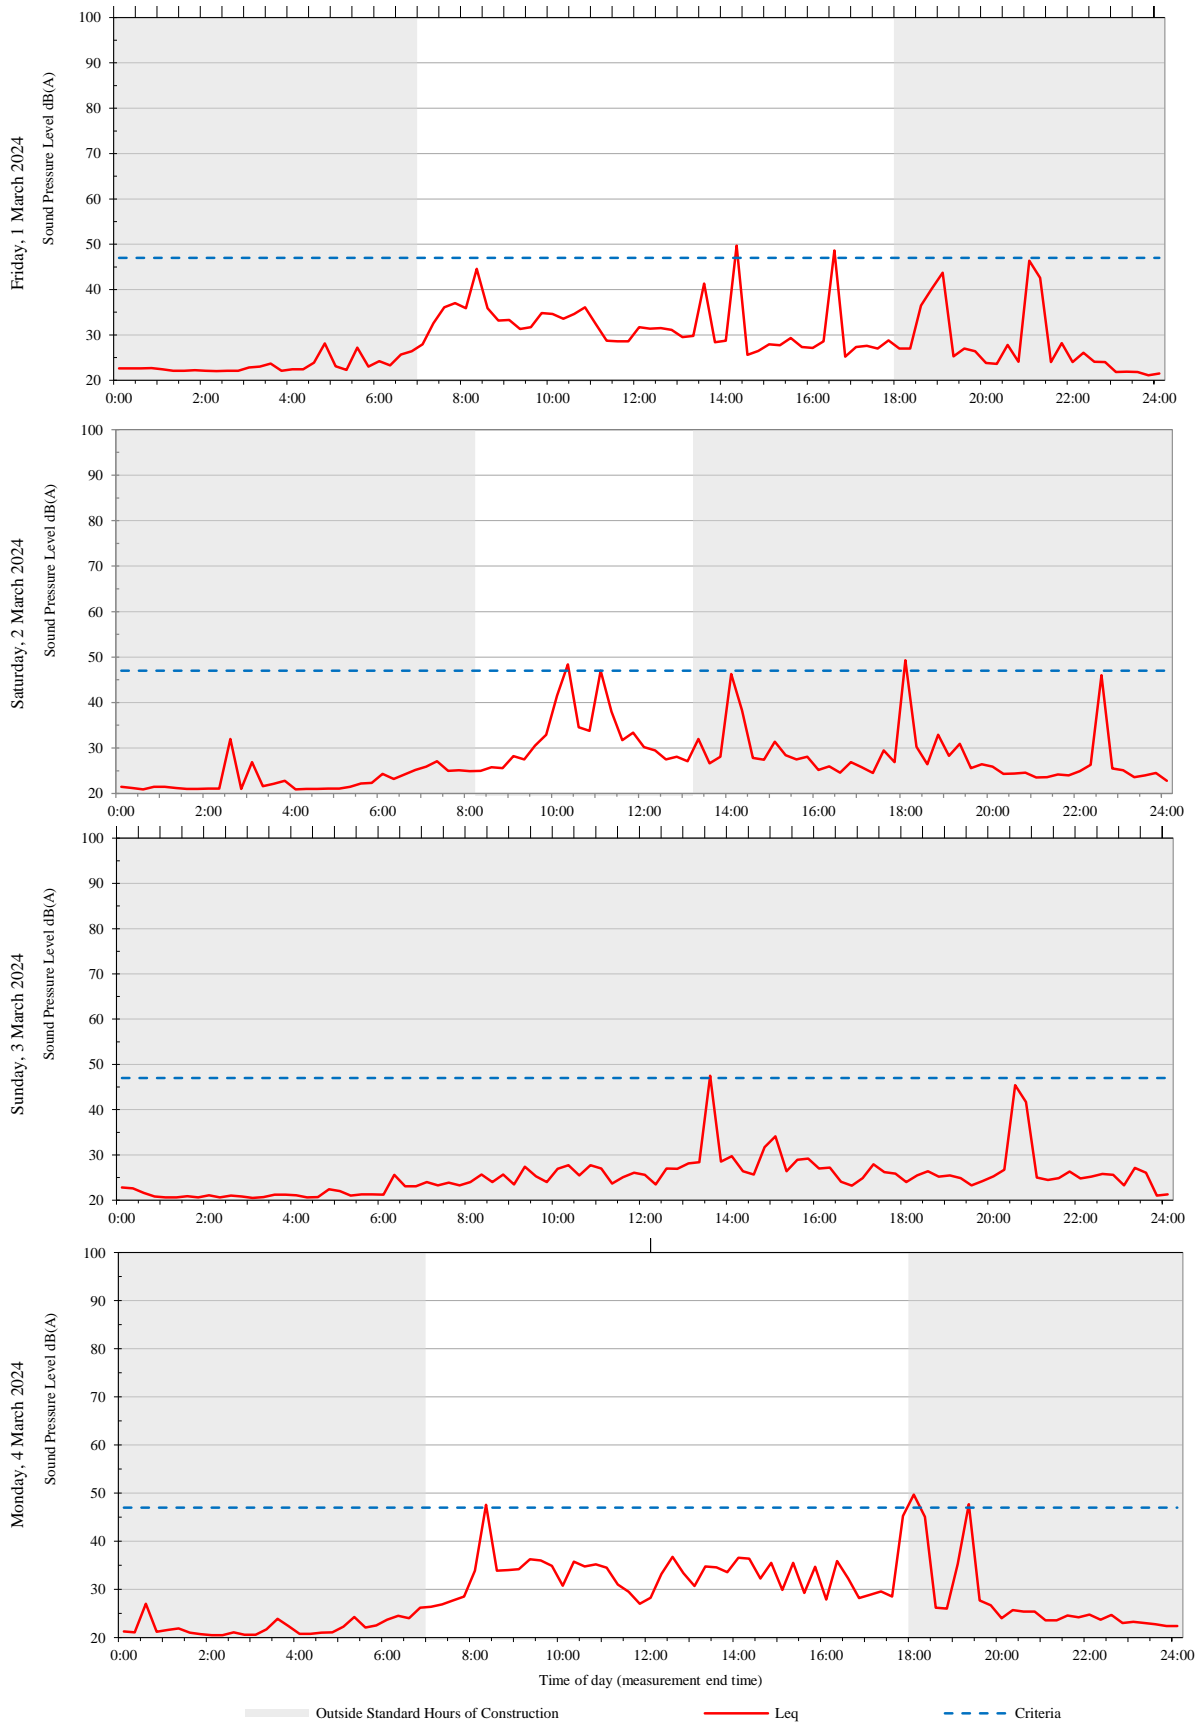

Unattended monitoring: RMH Level 1 Store Room 101 (Internal)

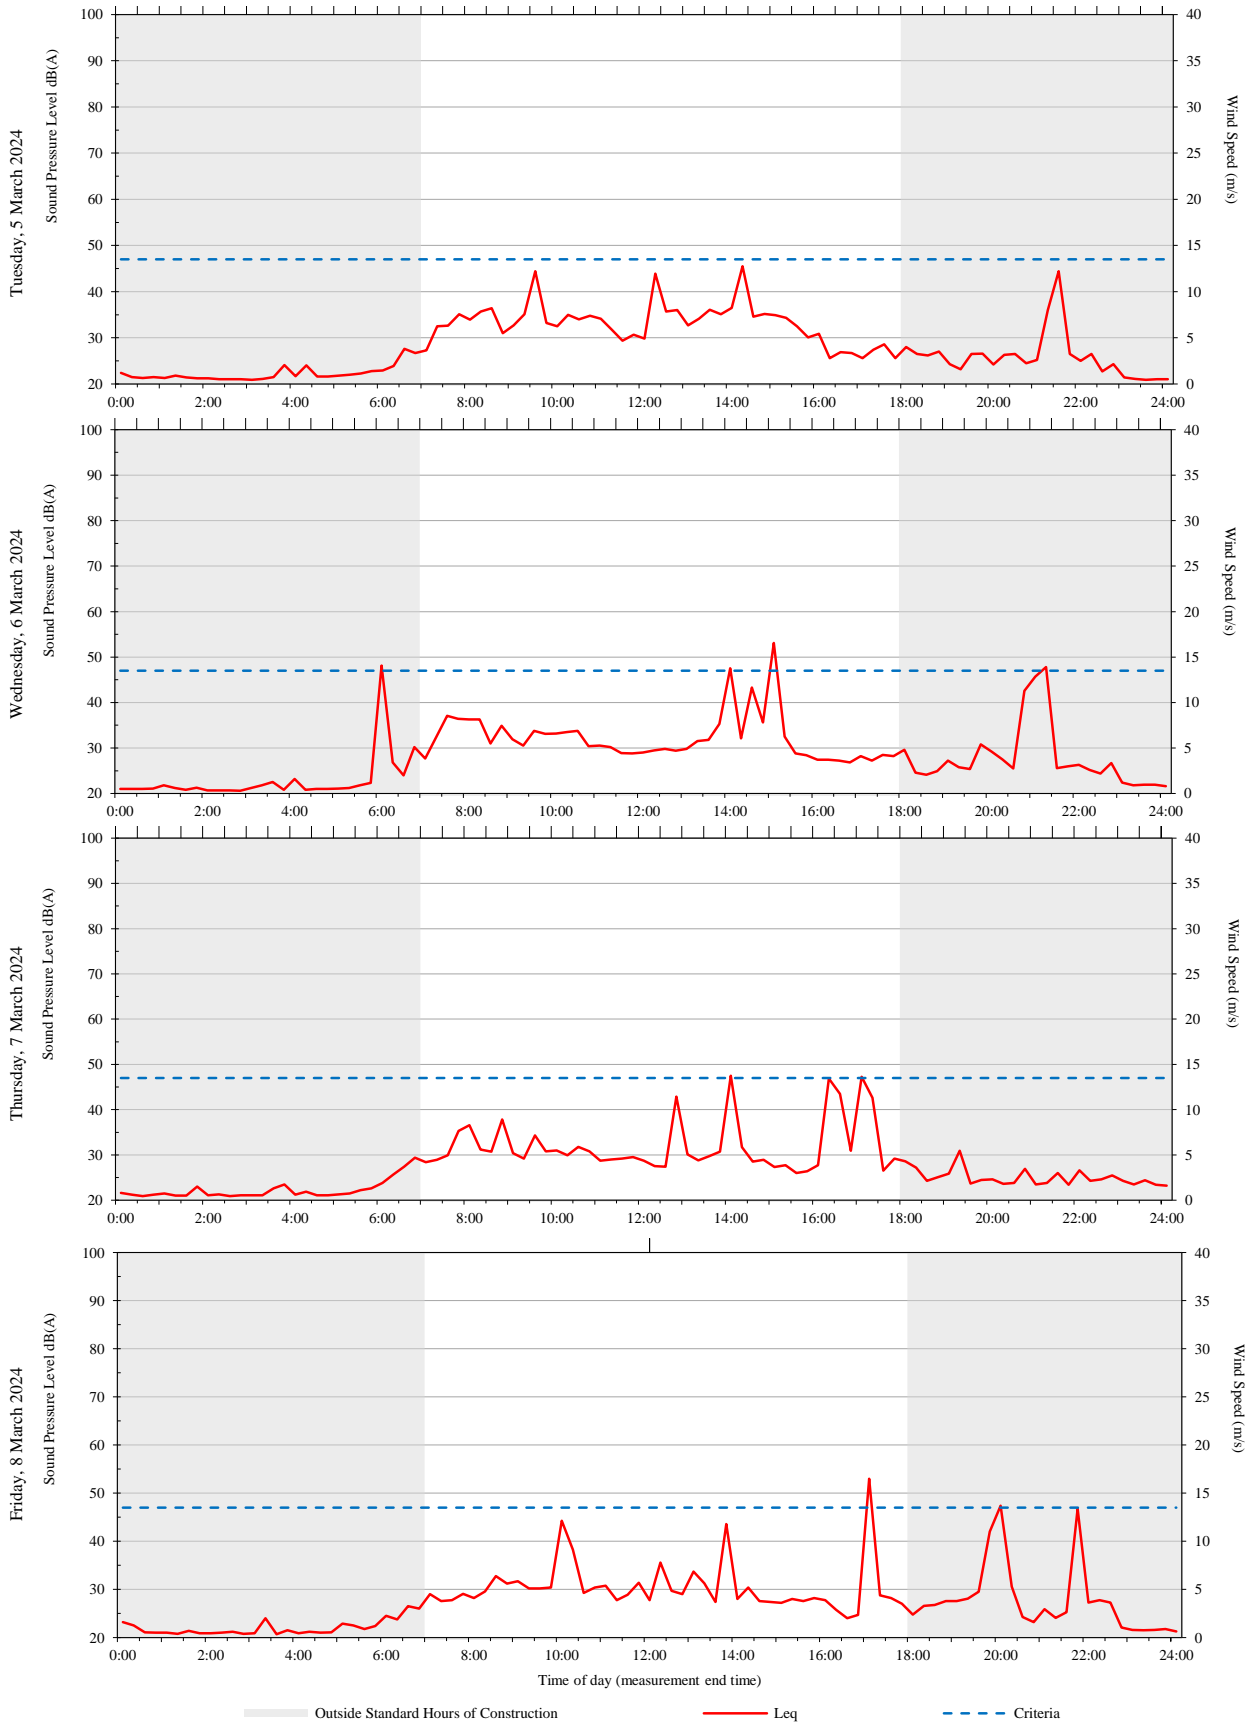


Unattended monitoring: RMH Level 1 Store Room 101 (Internal)

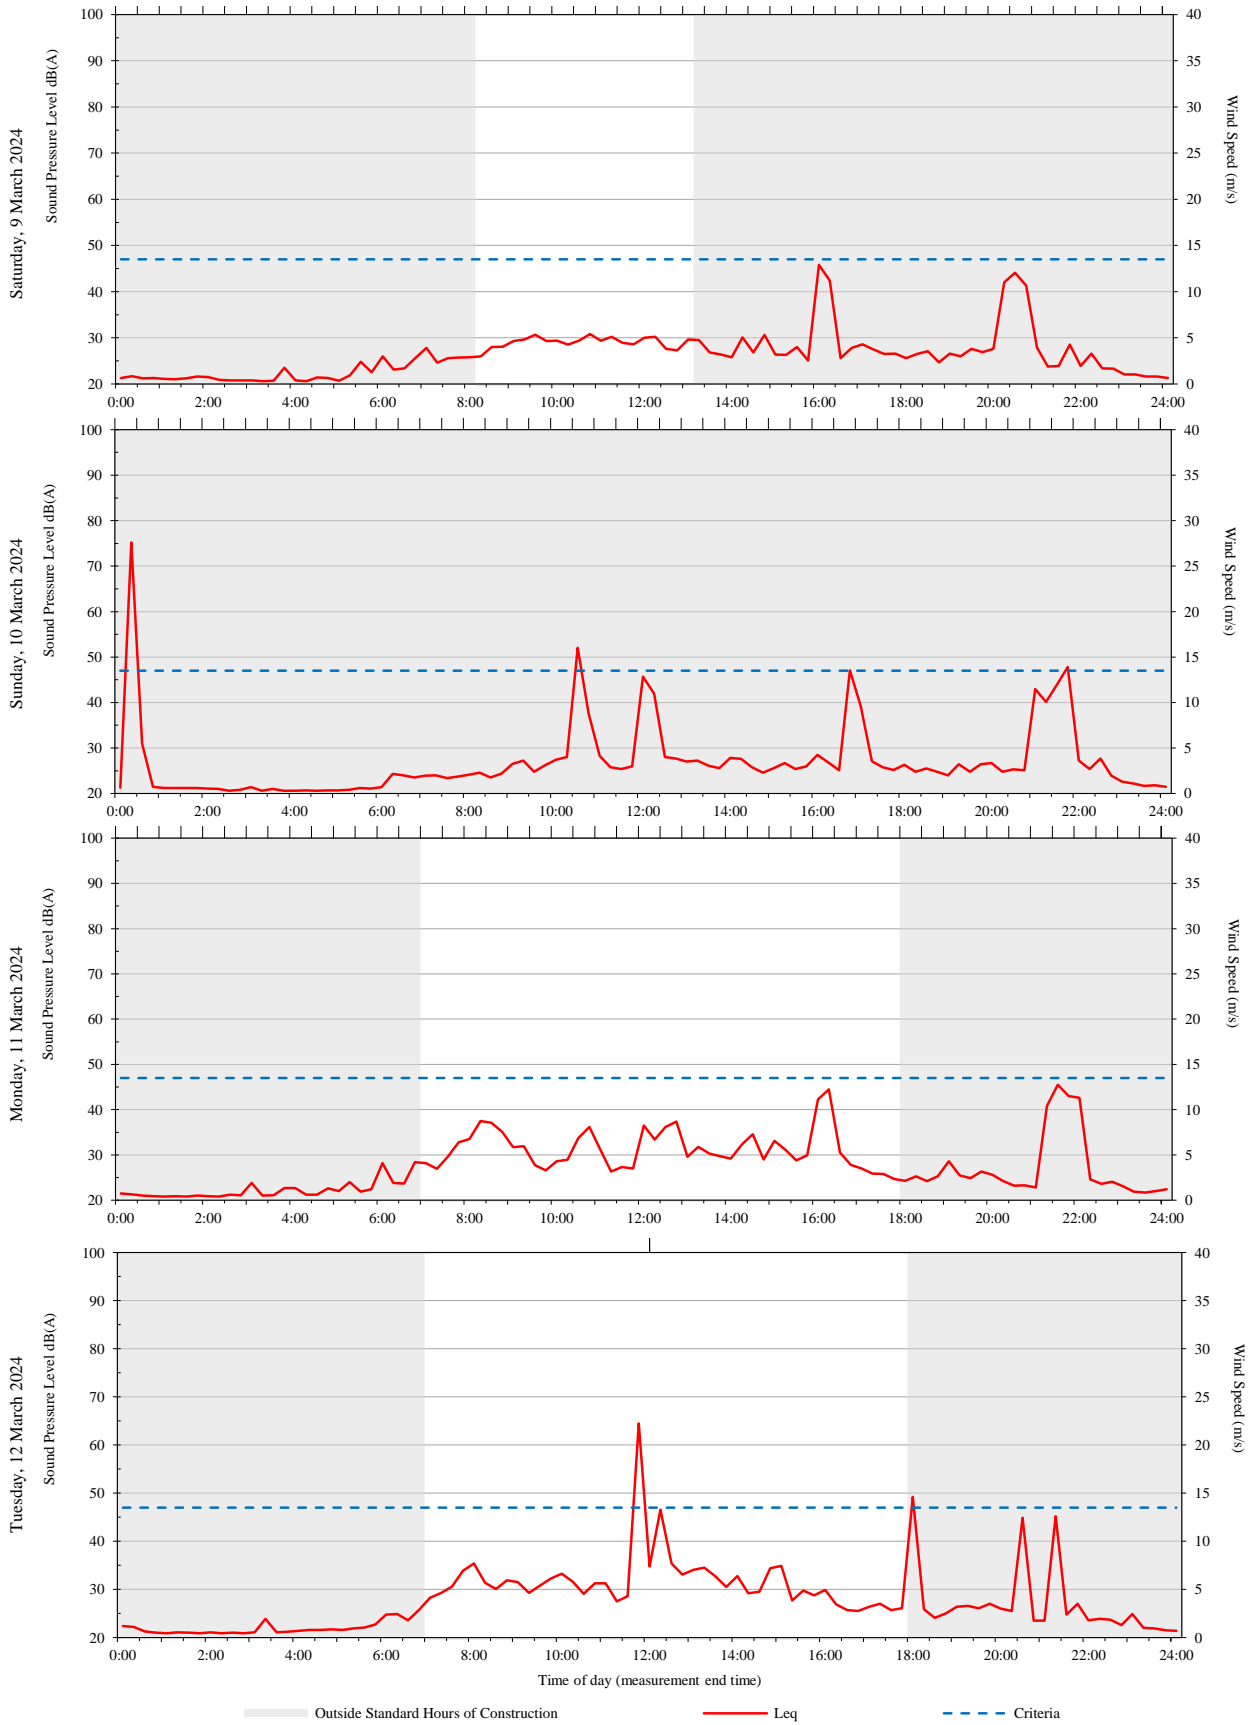


# Unattended monitoring: RMH Level 1 Store Room 101 (Internal)

ARUP

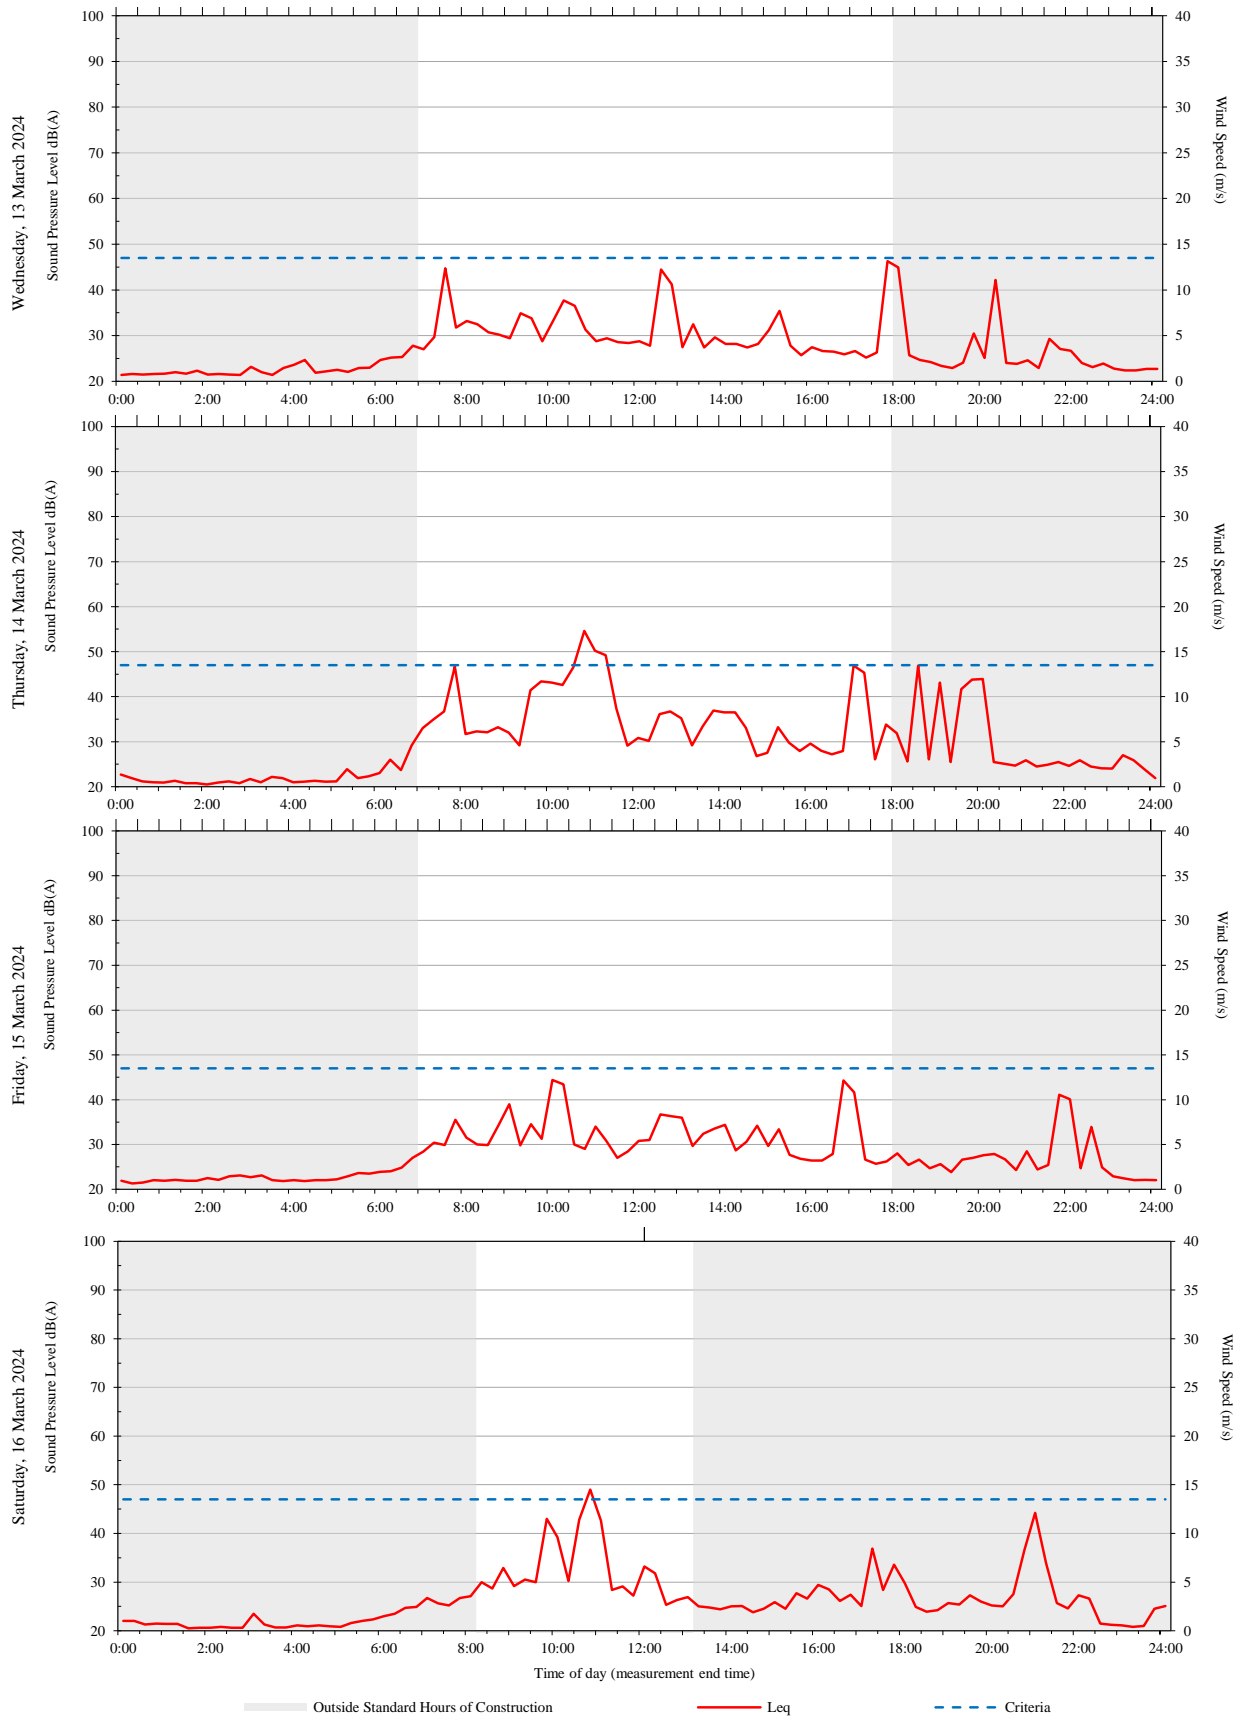


Unattended monitoring: RMH Level 1 Store Room 101 (Internal)

ARUP

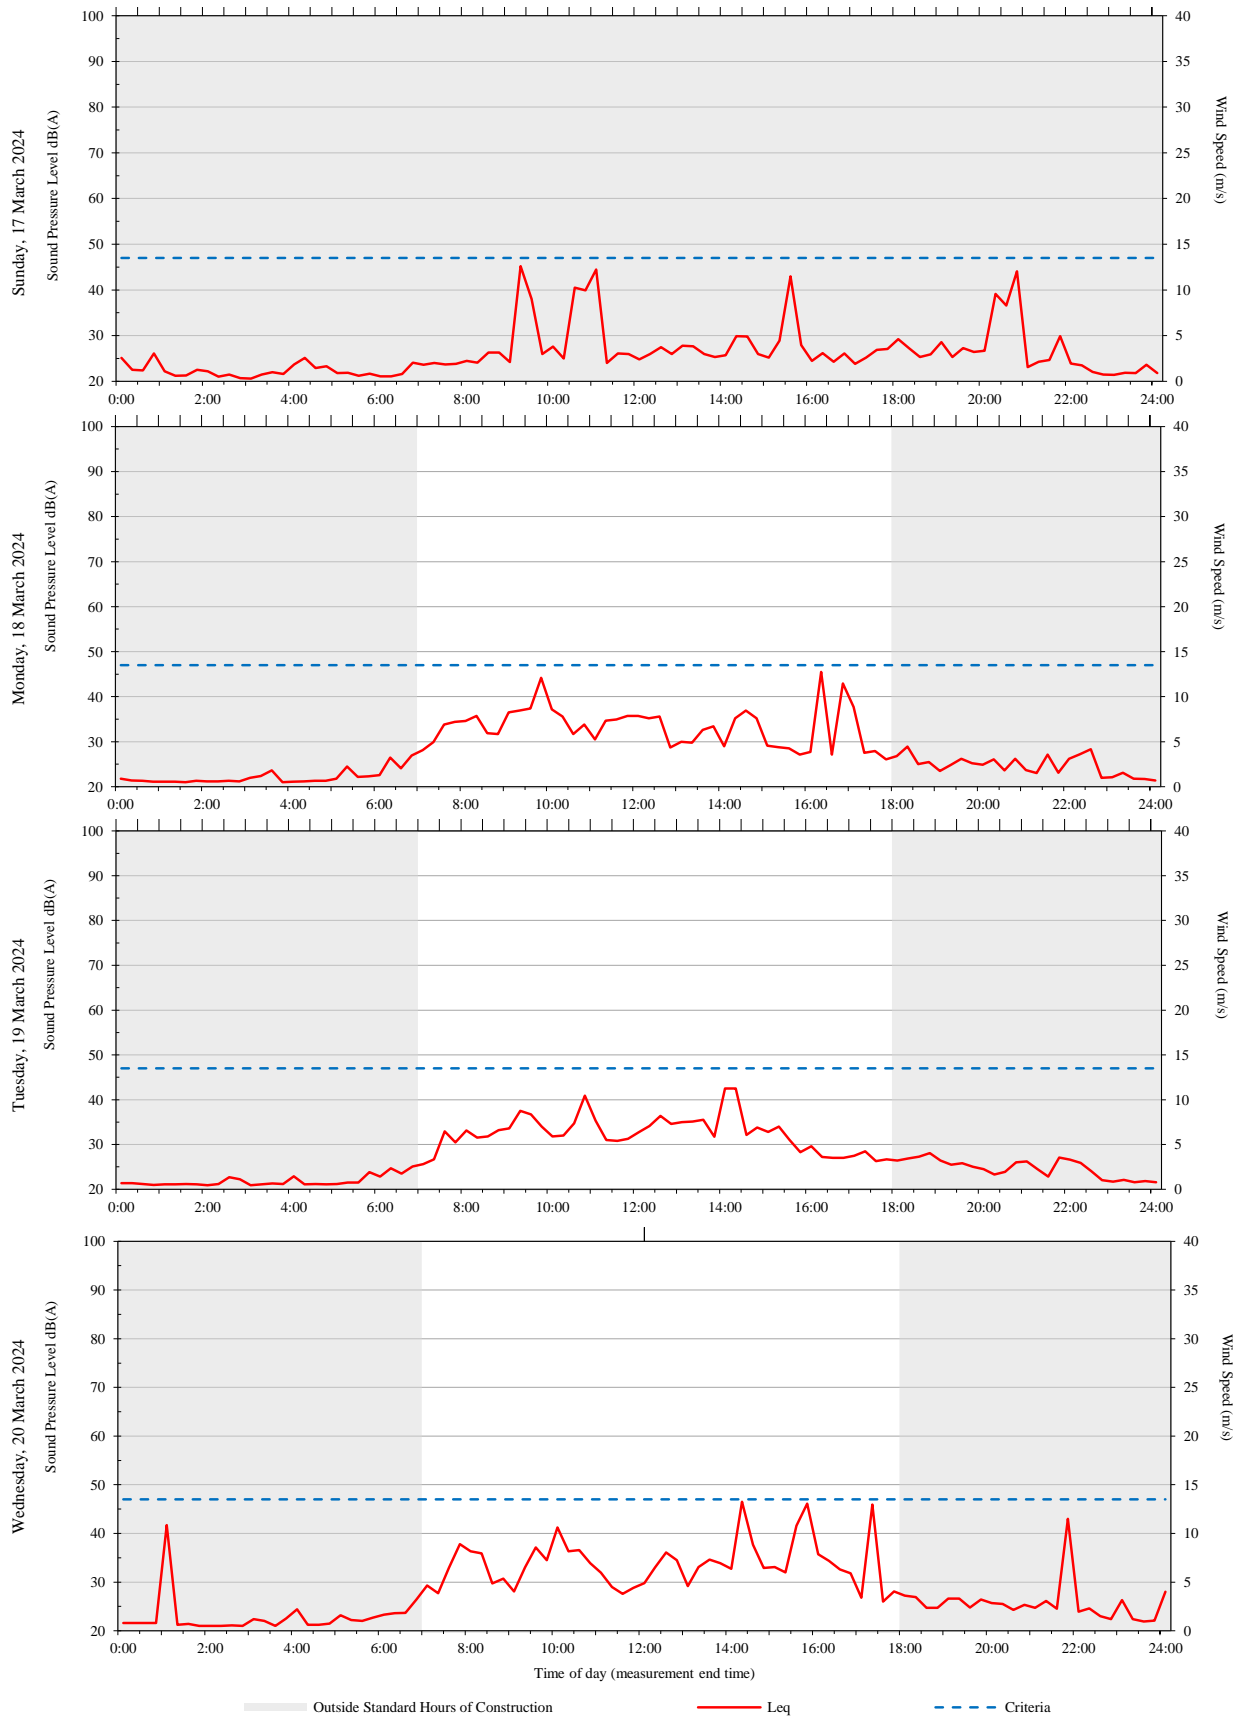


# Unattended monitoring: RMH Level 1 Store Room 101 (Internal)

ARUP

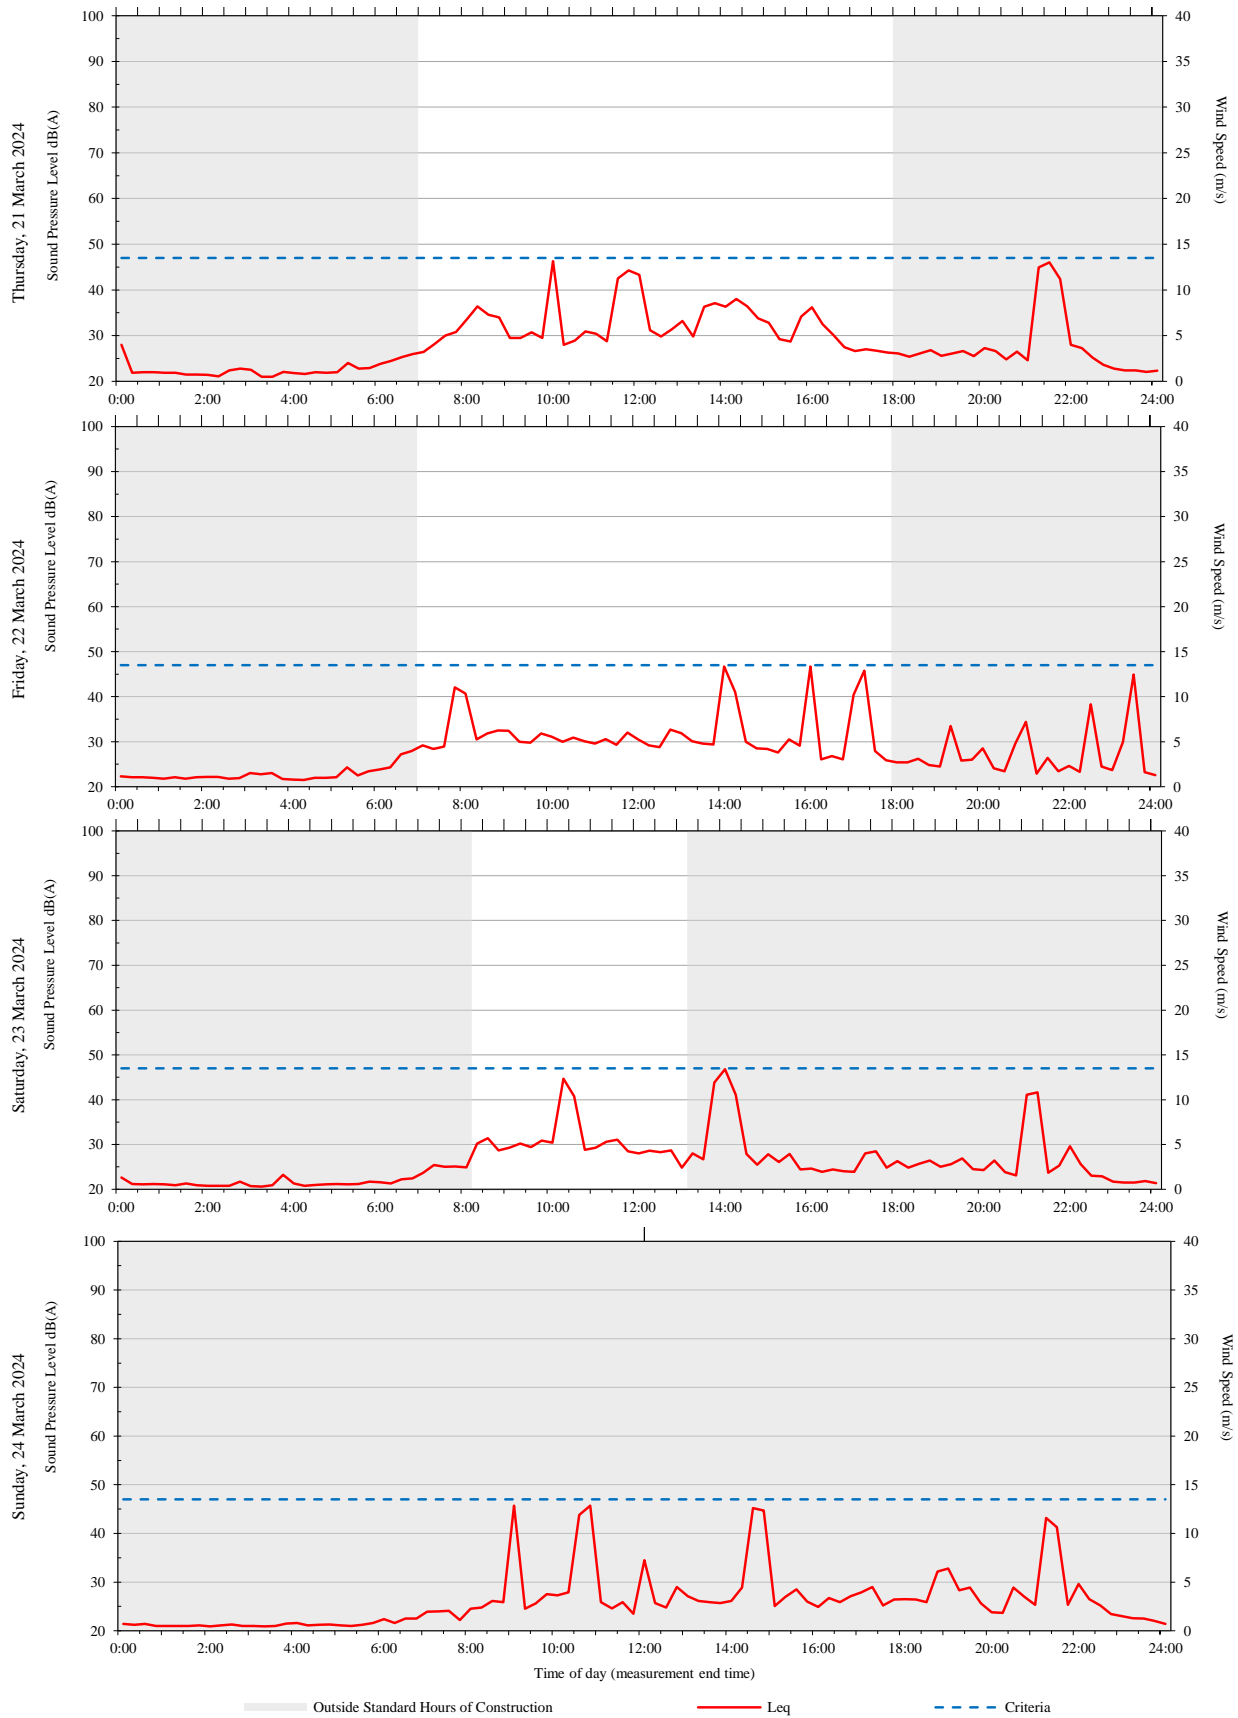


Unattended monitoring: RMH Level 1 Store Room 101 (Internal)

ARUP

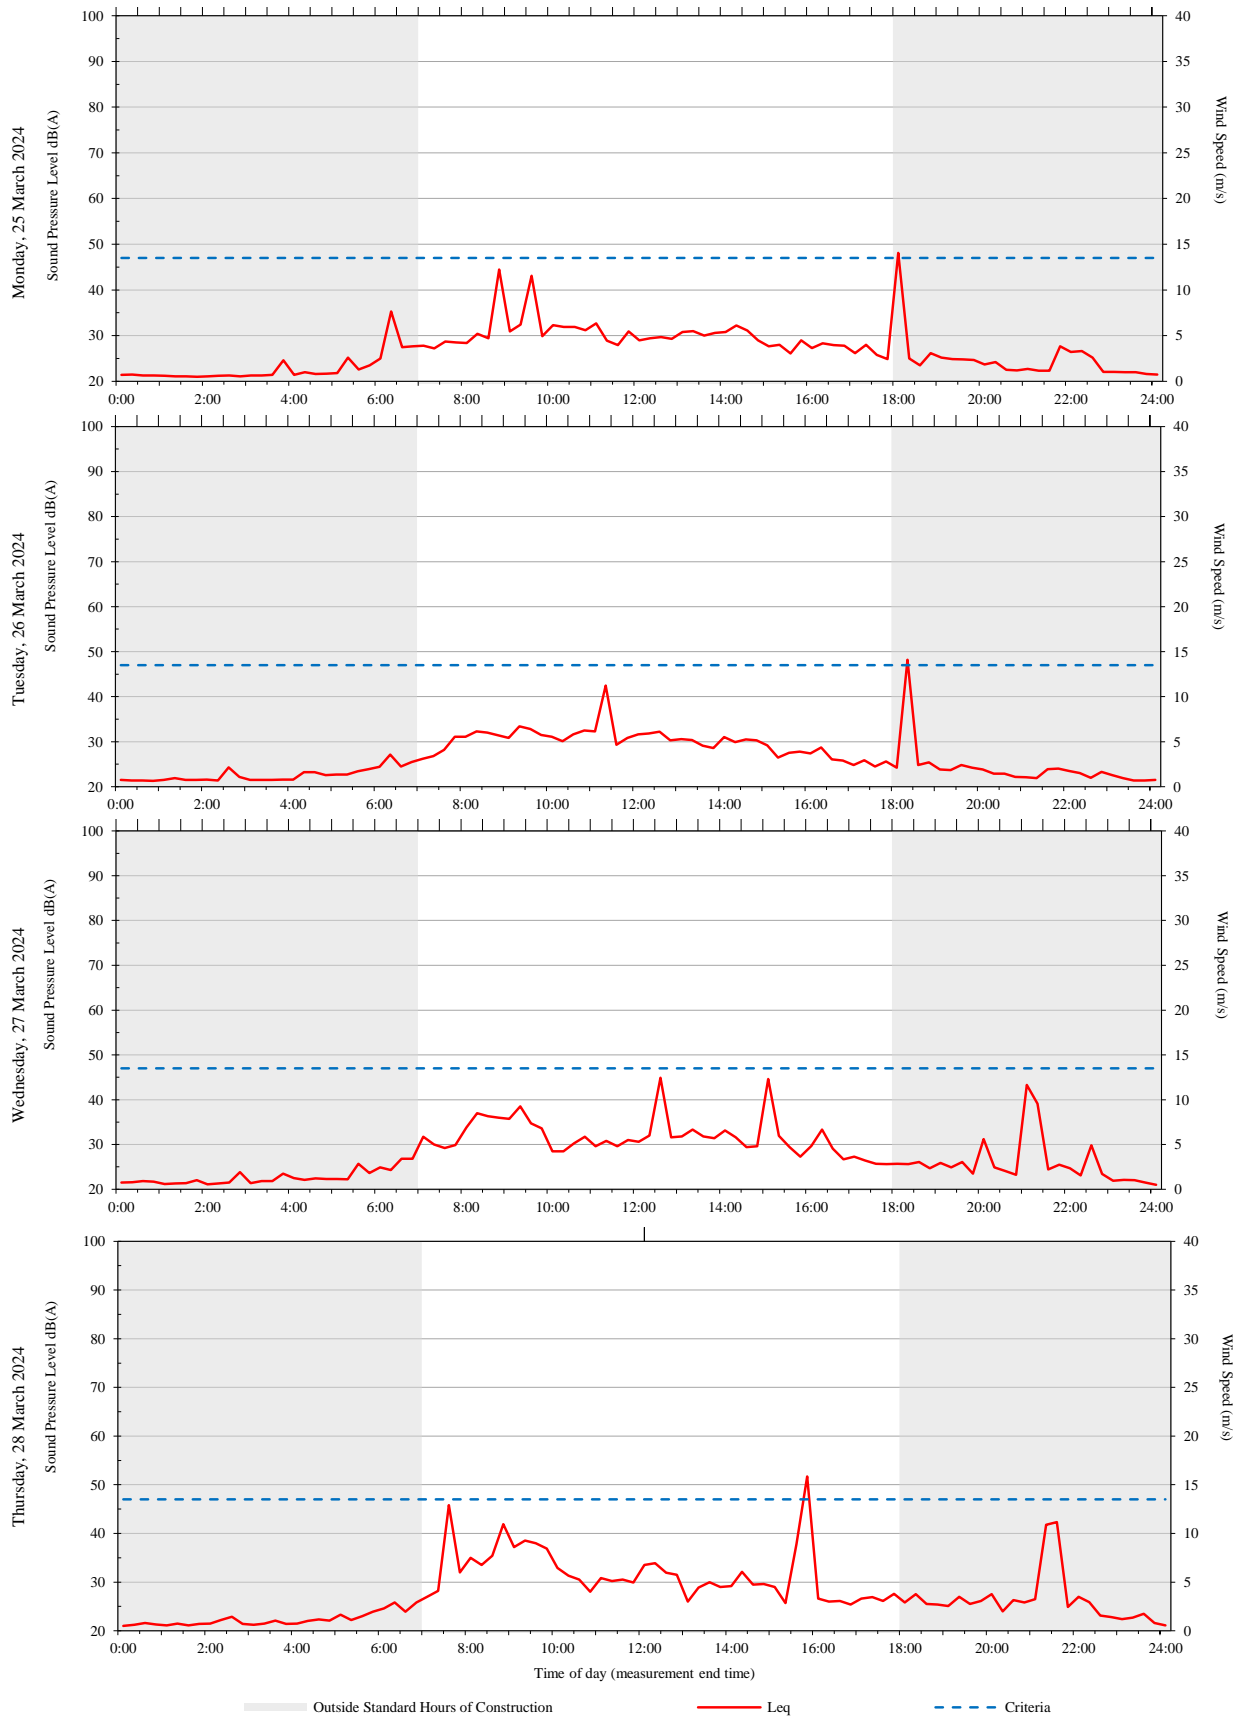

# Unattended monitoring: RMH Level 1 Store Room 101 (Internal)

ARUP

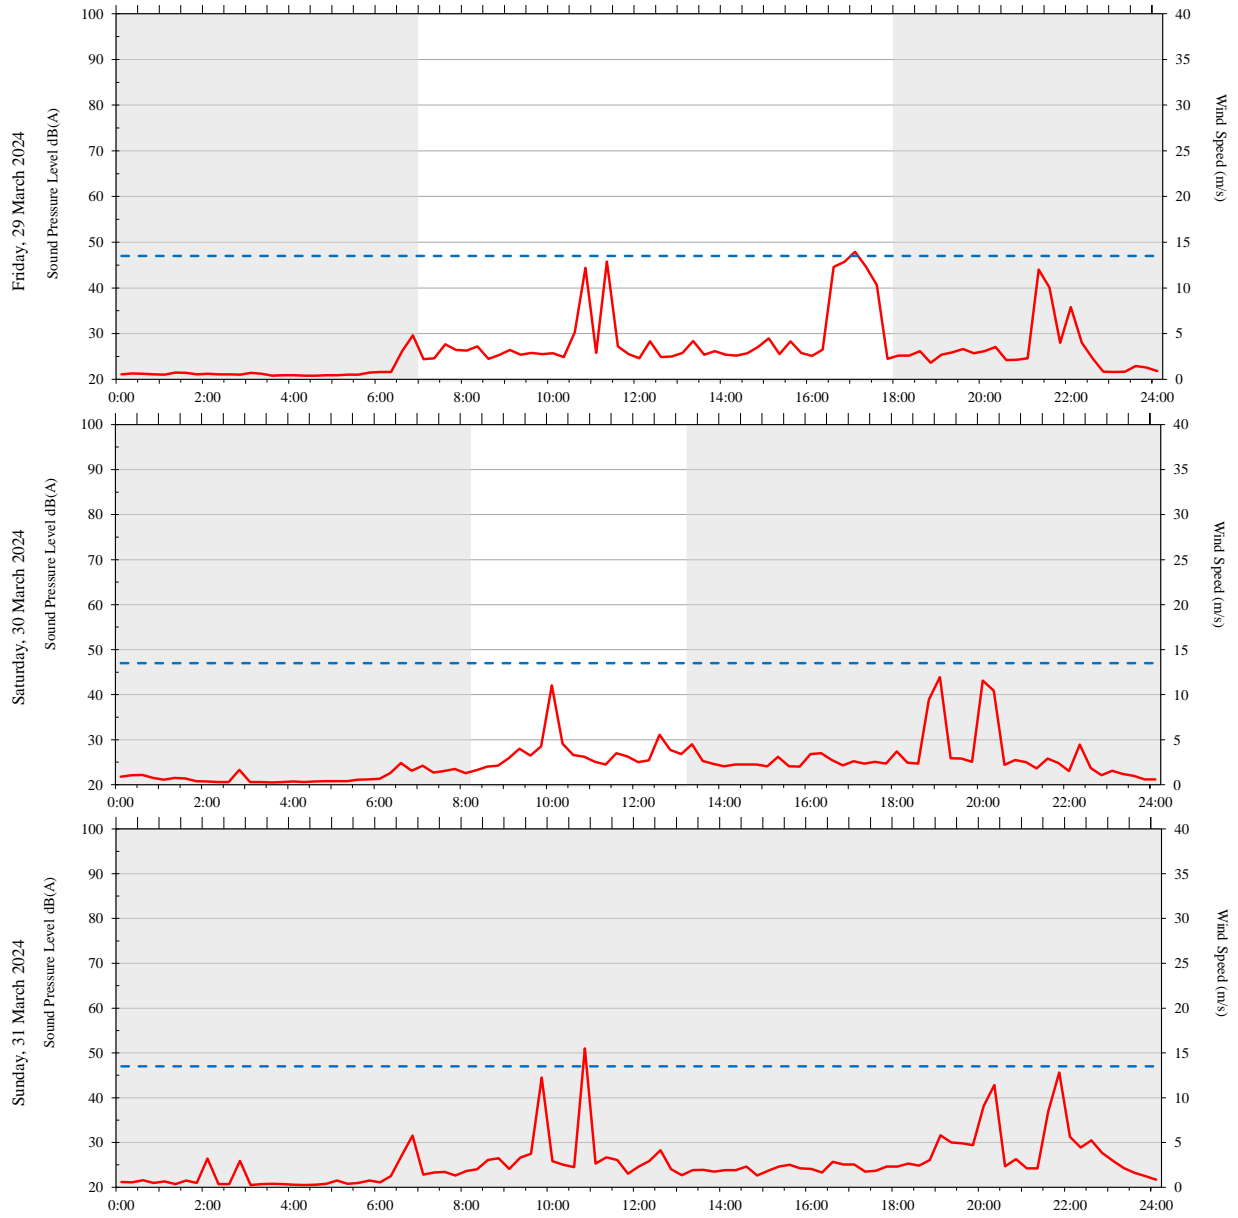



**Health Infrastructure NSW**

## Westmead VVMF Construction Noise Monitoring

Noise monitoring report 2024-03-01 to 2024-03-31

Reference: AC12

v1 | 16 April 2024

This report takes into account the particular instructions and requirements of our client. It is not intended for and should not be relied upon by any third party and no responsibility is undertaken to any third party.

Job number 271985




Arup Australia Pty Ltd | ABN 76 625 912 665

**Arup Australia Pty Ltd**  
Level 5  
151 Clarence Street  
Sydney  
NSW, 2000  
Australia  
[arup.com](http://arup.com)

## Document Verification

**Project title** Westmead VVMF Construction Noise Monitoring  
**Document title** Noise monitoring report 2024-03-01 to 2024-03-31  
**Job number** 271985  
**Document ref** AC12  
**File reference**

Revision	Date	Filename	
1	16/04/24	283812_v1_VVMF CNIA- Mar2024	Issue

	Prepared by	Checked by	Approved by
<b>Name</b>	Matthew Boutte	Mathew Simon	Clemence Terraz
<b>Signature</b>			

**Filename**  
**Description**

	Prepared by	Checked by	Approved by
<b>Name</b>			
<b>Signature</b>			

**Filename**  
**Description**

	Prepared by	Checked by	Approved by
<b>Name</b>			
<b>Signature</b>			

Issue Document Verification with Document

## Contents

---

1.	Introduction	1
2.	Noise logger location	2
2.1	Noise logger relocation	4
3.	Noise Management Levels	4
3.1	Management Level updates	5
4.	Noise monitoring results	6
4.1	Outages	6
4.2	Exceedances	6

### Tables

Table 1:	Logger relocation records	4
Table 2:	Noise Management Levels	5
Table 3:	Noise logger outages during monitoring period	6
Table 4:	Recorded NML exceedances	6

### Figures

Figure 1:	VVMF noise monitoring locations	3
-----------	---------------------------------	---

### Appendices

Appendix A		A-7
Noise monitoring results		A-7
A.1	WIMR L1 Bike Room (C.1.06)	A-8

# 1. Introduction

Arup has been commissioned by Health Infrastructure NSW to install a noise monitor within the Westmead Institute for Medical Research (WIMR) to monitor and manage noise from the construction of the Viral Vector Manufacturing Facility (VVMF) in the Westmead Precinct.


The noise logger was deployed on the 8<sup>th</sup> of March 2023 and has been setup to send email and SMS notifications to stakeholders when construction Noise Management Levels (NMLs) are exceeded.

This report details noise measurement results from **1 March 2024** to **31 March 2024** inclusive.

## 2. Noise logger location

One Acoustic Research Labs Ngara noise logger is installed at the location shown in Figure 1 below.

Westmead 5 was calibrated by Acoustic Research Labs (NATA accredited calibration) in December 2023.

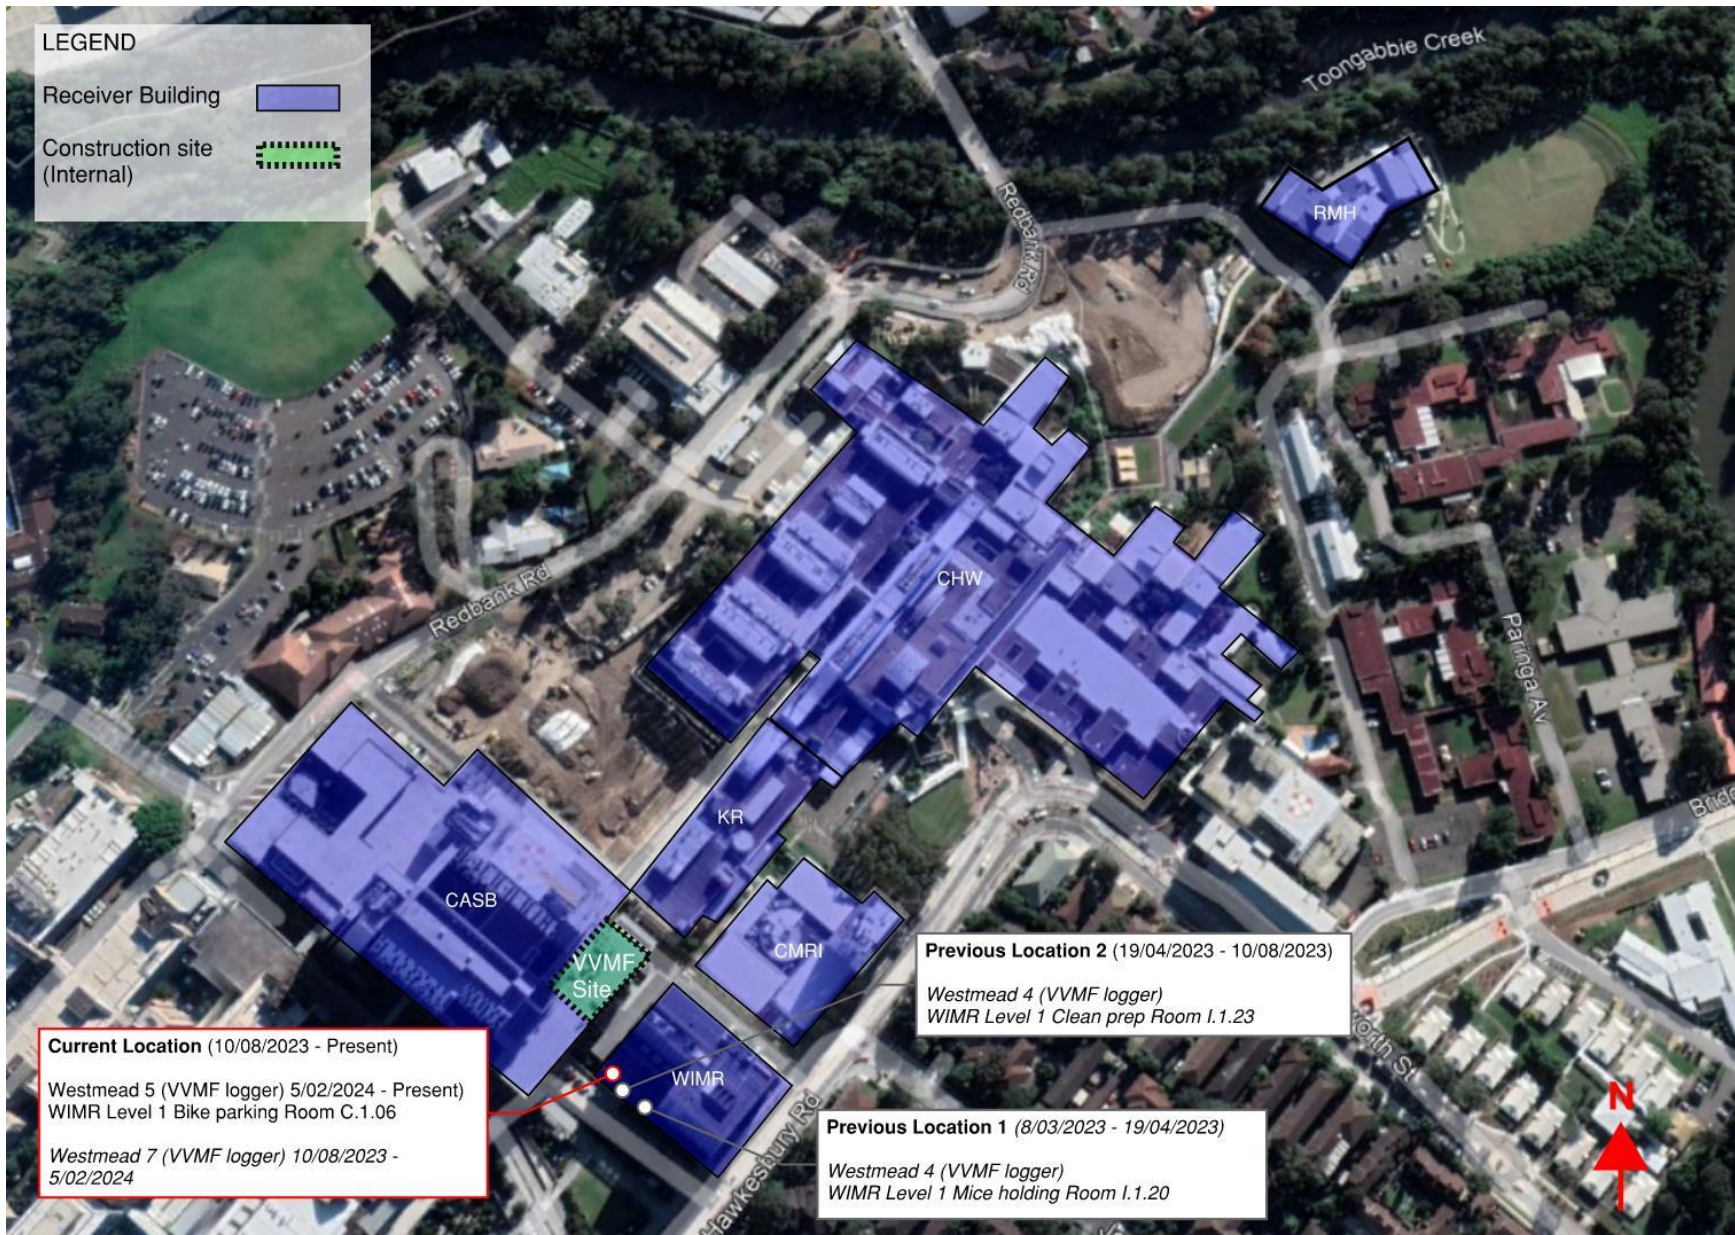

**Figure 1: VVMF noise monitoring locations**

## 2.1 Noise logger relocation

A summary of all logger relocations can be found in Table 1 below.

**Table 1: Logger relocation records**

Logger ID	Original Location	Location	
	Location	Date moved	Location
Westmead 4 <sup>1</sup>	WIMR Level 1 Mice holding room (I.1.20)	19/4/2023	WIMR Level 1 Clean Prep Room (I.1.23)
Westmead 4	WIMR Level 1 Clean Prep Room (I.1.23)	10/08/2023	<i>Removed from site</i>
Westmead 7	KR Level 3 Radiation Room (RF041)	10/08/2023	WIMR Level 1 Bike Parking room (C.1.06)
Westmead 7	WIMR Level 1 Bike Parking room (C.1.06)	5/02/2024	<i>Removed from site</i>
Westmead 5	<i>Supporting a different project</i>	5/02/2024 (Current)	WIMR Level 1 Bike Parking room (C.1.06)

Notes:

1. Greyed out text is included to summarize all logger swapping and relocations that have taken place throughout the duration of the project.



### 3. Noise Management Levels

The current Construction Noise Management Levels (NMLs) are set out in Table 2. The NMLs have been determined following a baseline noise study conducted in April 2023. (Refer to Arup’s *Westmead Hospital N&V Monitoring – Attended Noise Measurements – VVMF Construction Activity*<sup>1</sup> memo for details regarding how these NMLs were nominated.)

Measurement data taken from ‘standard’ construction work hours for the project only are assessed against the Noise Management Level criteria, being:

- 7am-6pm Mon-Fri
- 8am-1pm Sat
- No work on Sundays and Public Holidays.

The NMLs levels in Table 2 were determined following both the review of current noise levels within the mice holding room when no construction was conducted, and available information with regards to the sensitivity to noise of research animals. The NMLs below represent the level of construction noise if exceeded may result in a negative impact on research animals.

To safeguard the research animals, the previously established NMLs were retained despite relocating the logger. However, it is important to note that the results may be conservative due to the logger's closer proximity to the construction works.

**Table 2: Noise Management Levels**

Logger ID	Location	Noise Management Level, dB	Description
Westmead 4 (8/03/2023 – 19/04/2023)	WIMR Level 1 Mice holding room (I.1.20)	L <sub>Amax</sub> 85	For short duration high noise levels
		L <sub>Aeq(1minute)</sub> 69	For more continuous noise generation
Westmead 4 (19/04/2023 – 10/08/2023)	WIMR L1 Clean Prep Room (I.1.23)	L <sub>Amax</sub> 85	For short duration high noise levels
		L <sub>Aeq(1minute)</sub> 69	For more continuous noise generation
Westmead 7 (10/08/2023 – 5/02/2024)	WIMR L1 Bike Room (C.1.06)	L <sub>Amax</sub> 85	For short duration high noise levels
		L <sub>Aeq(1minute)</sub> 69	For more continuous noise generation
Westmead 5 (5/02/2024 – On Going)	WIMR L1 Bike Room (C.1.06)	L <sub>Amax</sub> 85	For short duration high noise levels
		L <sub>Aeq(1minute)</sub> 69	For more continuous noise generation

#### 3.1 Management Level updates

The following provides a progressive record of management level updates:

- None-to-date

<sup>1</sup> Arup report reference: 283812-16



## 4. Noise monitoring results

### 4.1 Outages

Noise monitoring outages are shown below. This excludes outages related to logger data collection and calibration.

**Table 3: Noise logger outages during monitoring period**

Logger ID	Noise logger location	Outages
Westmead 5	WIMR L1 Bike Room (C.1.06)	-

### 4.2 Exceedances

The number of Noise Management Level exceedances recorded during the assessment period are shown below.

**Table 4: Recorded NML exceedances**

Logger Id	Noise logger location	Noise Management Level exceedance instances	
		Short duration $L_{Amax}$ criteria	Continuous $L_{Aeq(1minute)}$ criteria
Westmead 5	WIMR L1 Bike Room (C.1.06)	20	13

It is noted that the exceedances of the NMLs may be the result of noise generated by either internal activities unrelated to construction, or by construction activities.


It is the responsibility of the Principal Contractor to respond to each NML exceedance when it occurs and record the outcome of the exceedance investigation (cause of NML exceedance, any noise mitigation measures implemented to address the exceedances, etc.).

# Appendix A

## Noise monitoring results

# A.1 WIMR L1 Bike Room (C.1.06)

Unattended monitoring: WIMR Level 1 Bike Parking room (C.1.06) (Internal)

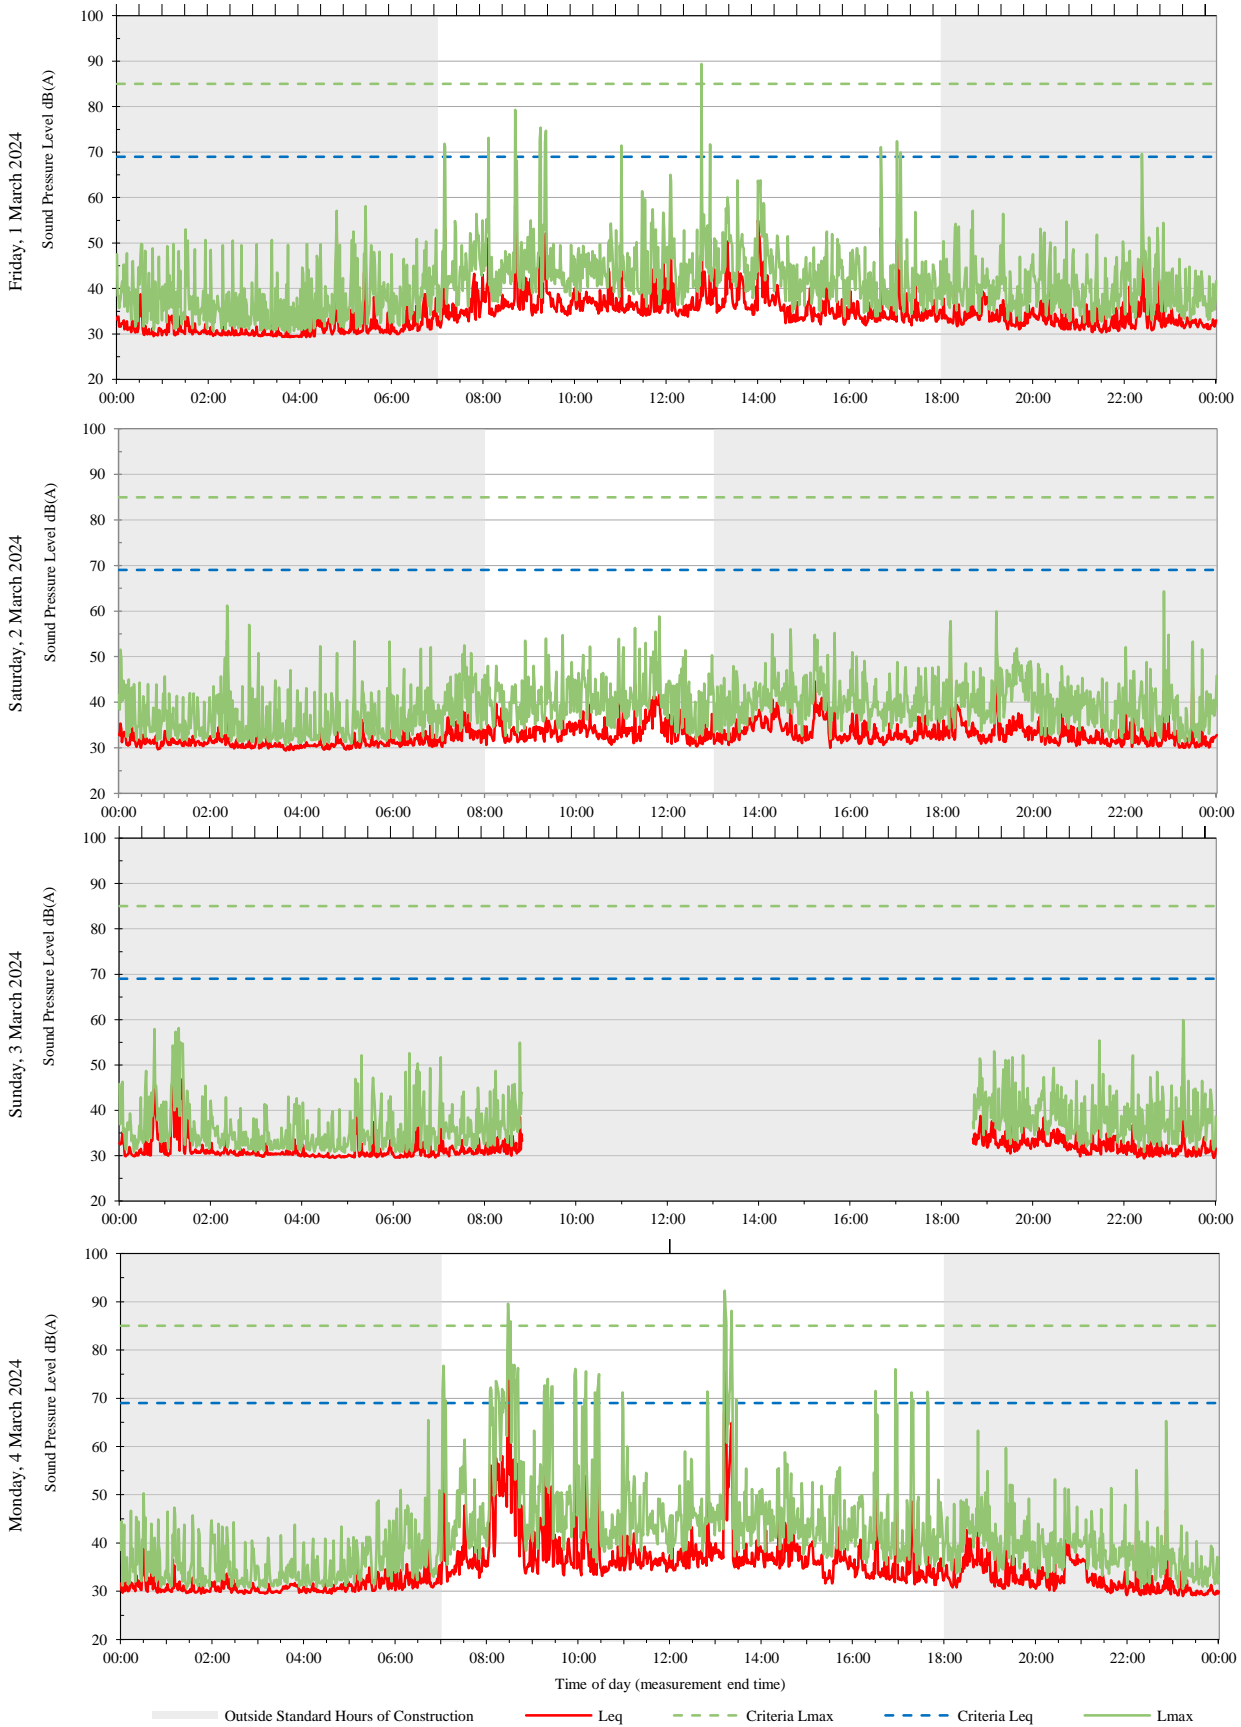


Unattended monitoring: WIMR Level 1 Bike Parking room (C.1.06) (Internal)




Unattended monitoring: WIMR Level 1 Bike Parking room (C.1.06) (Internal)


ARUP

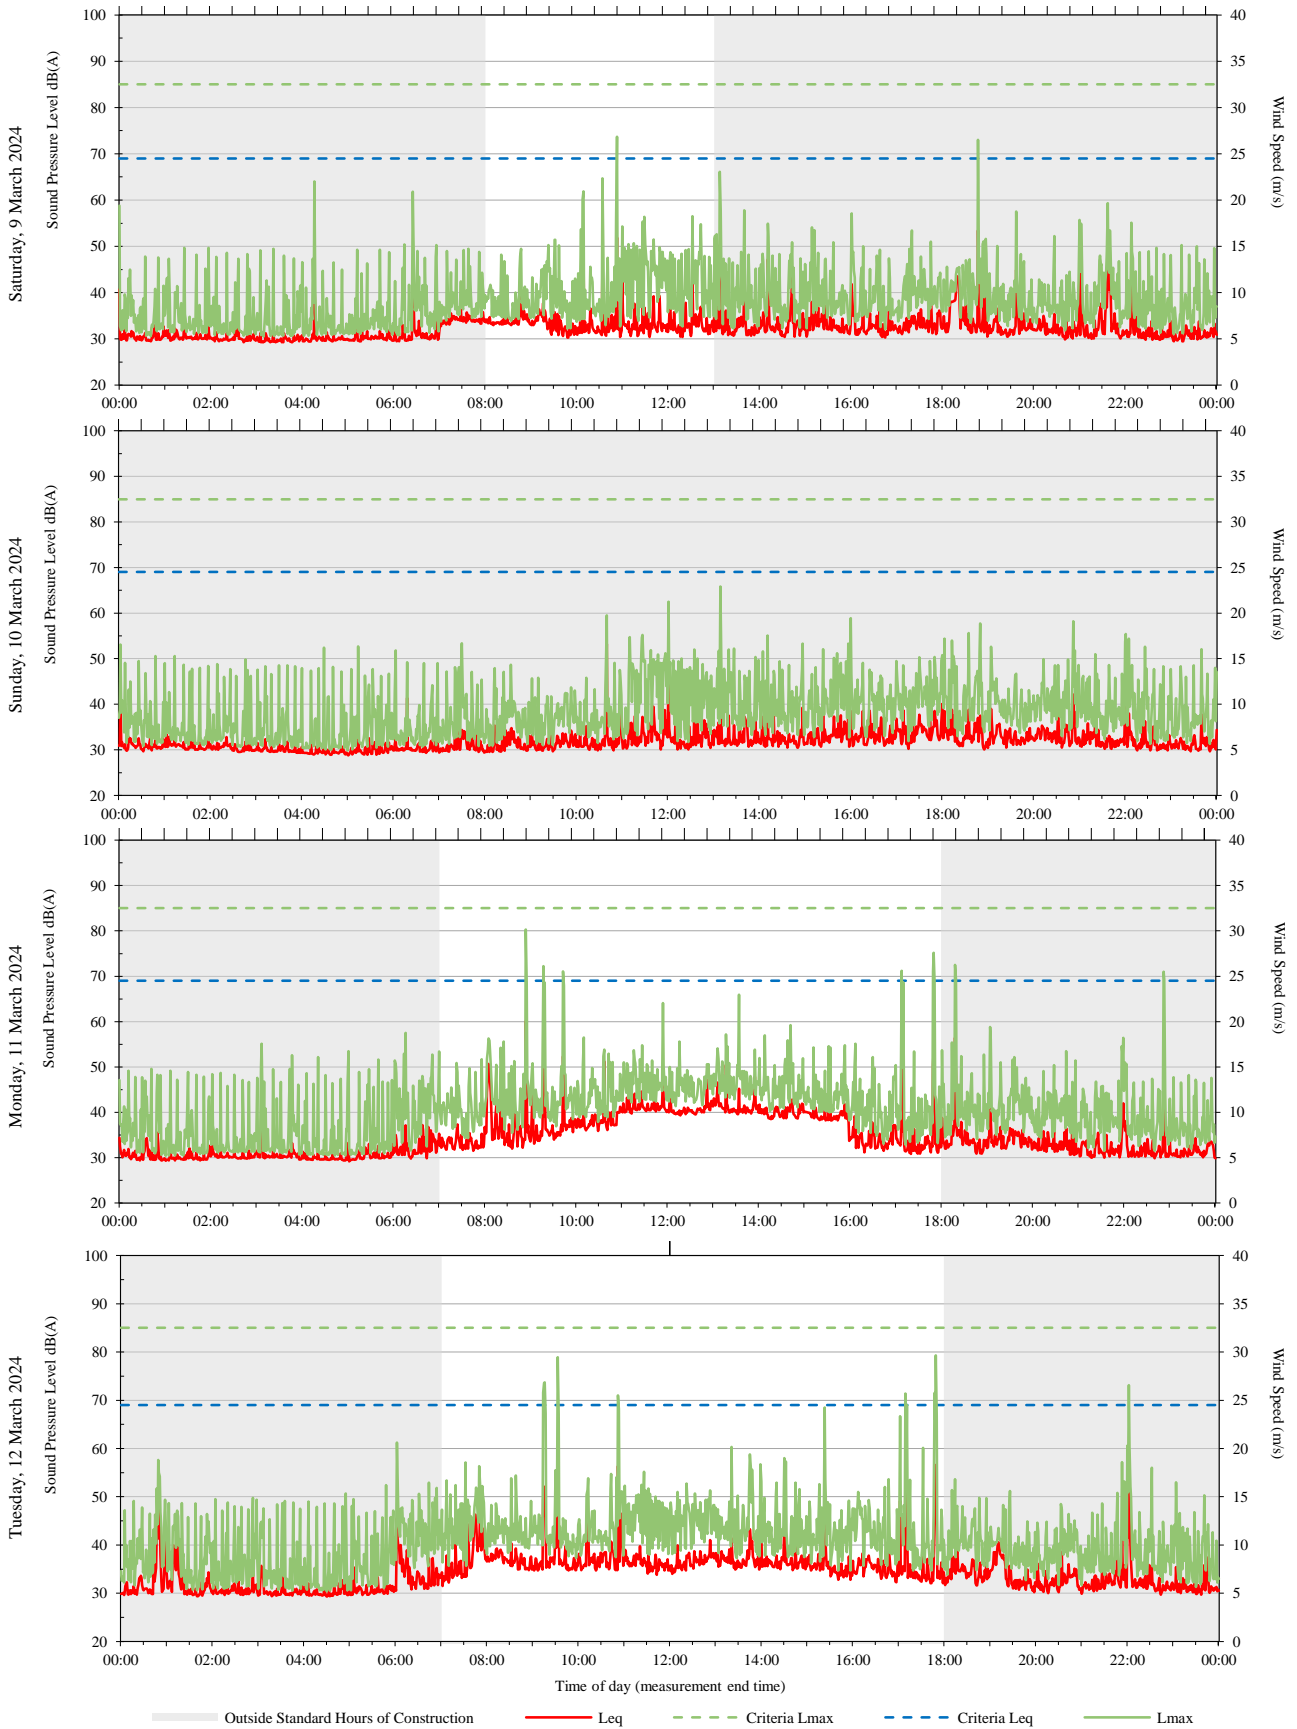

Unattended monitoring: WIMR Level 1 Bike Parking room (C.1.06) (Internal)

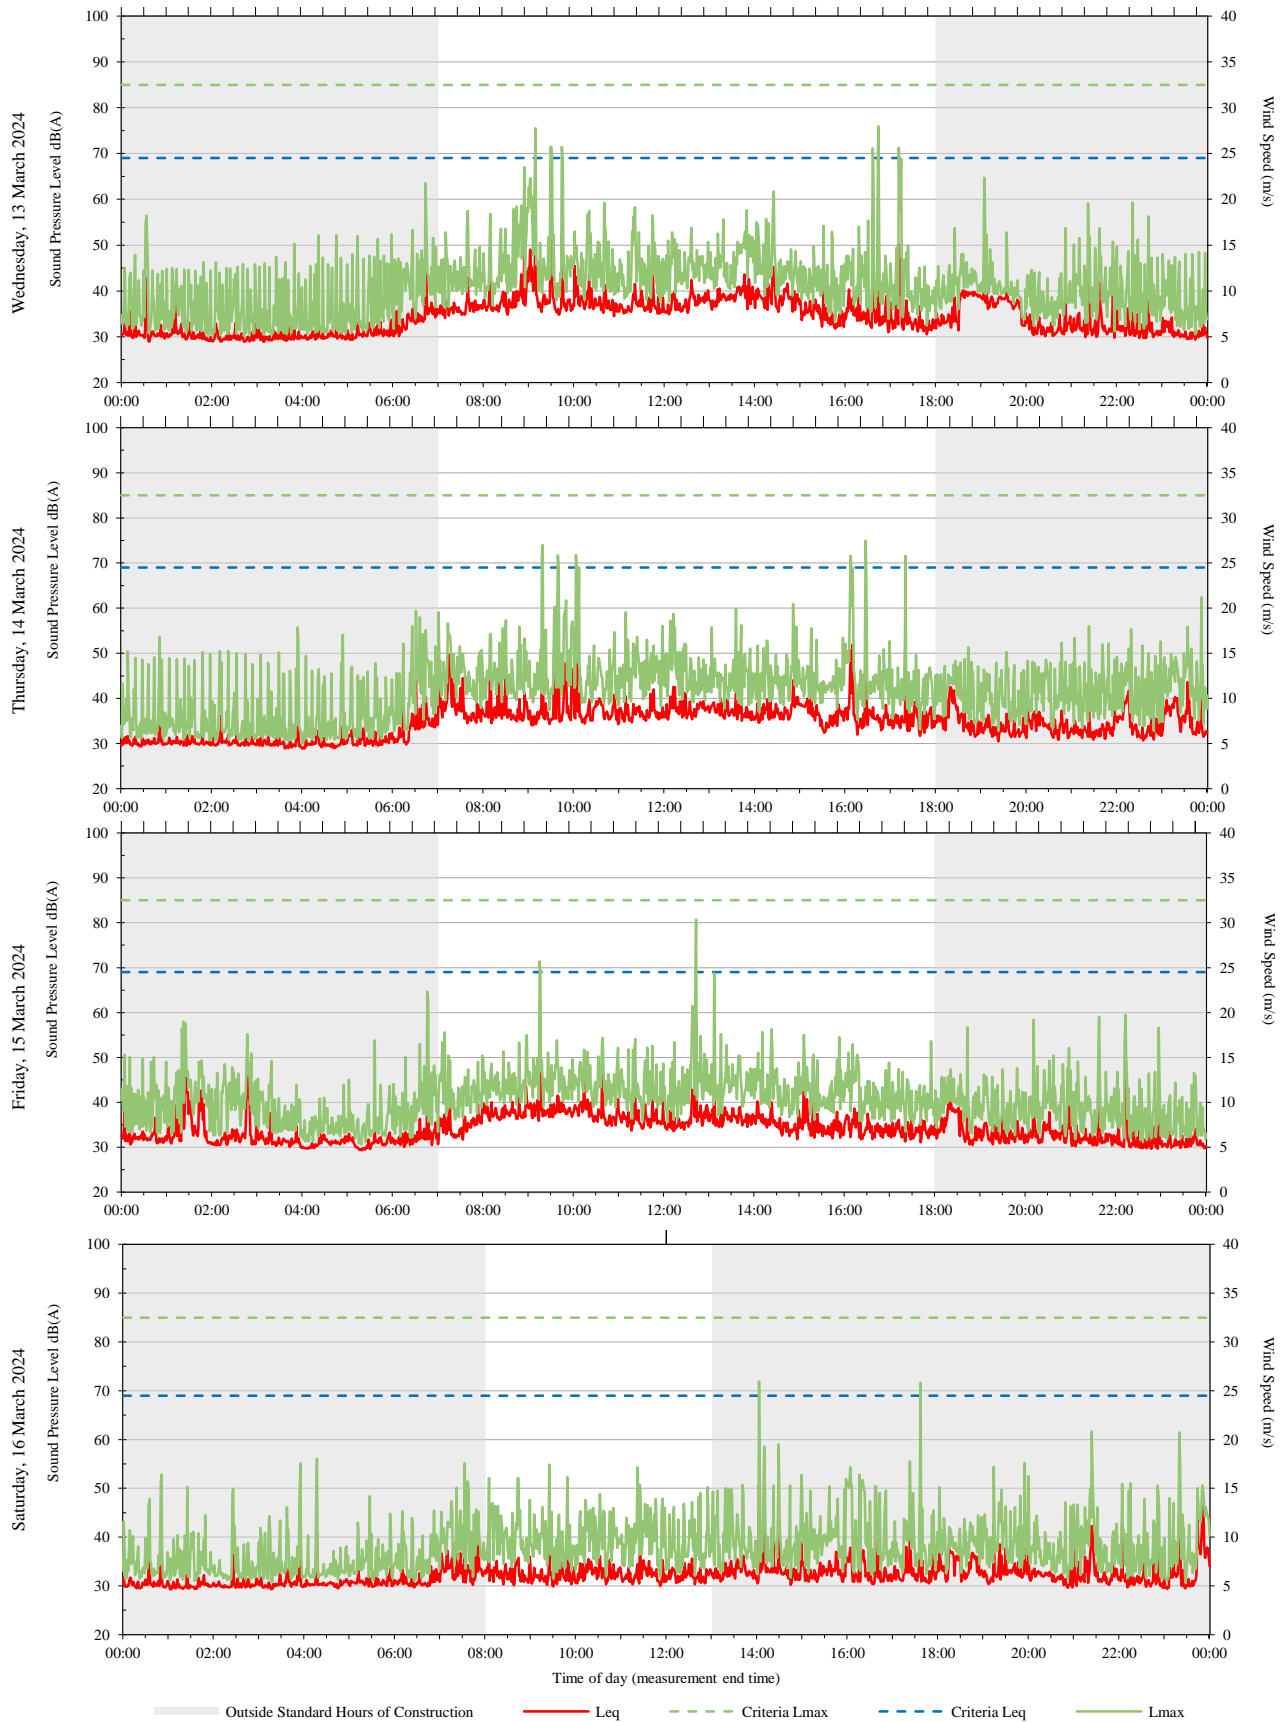


Unattended monitoring: WIMR Level 1 Bike Parking room (C.1.06) (Internal)

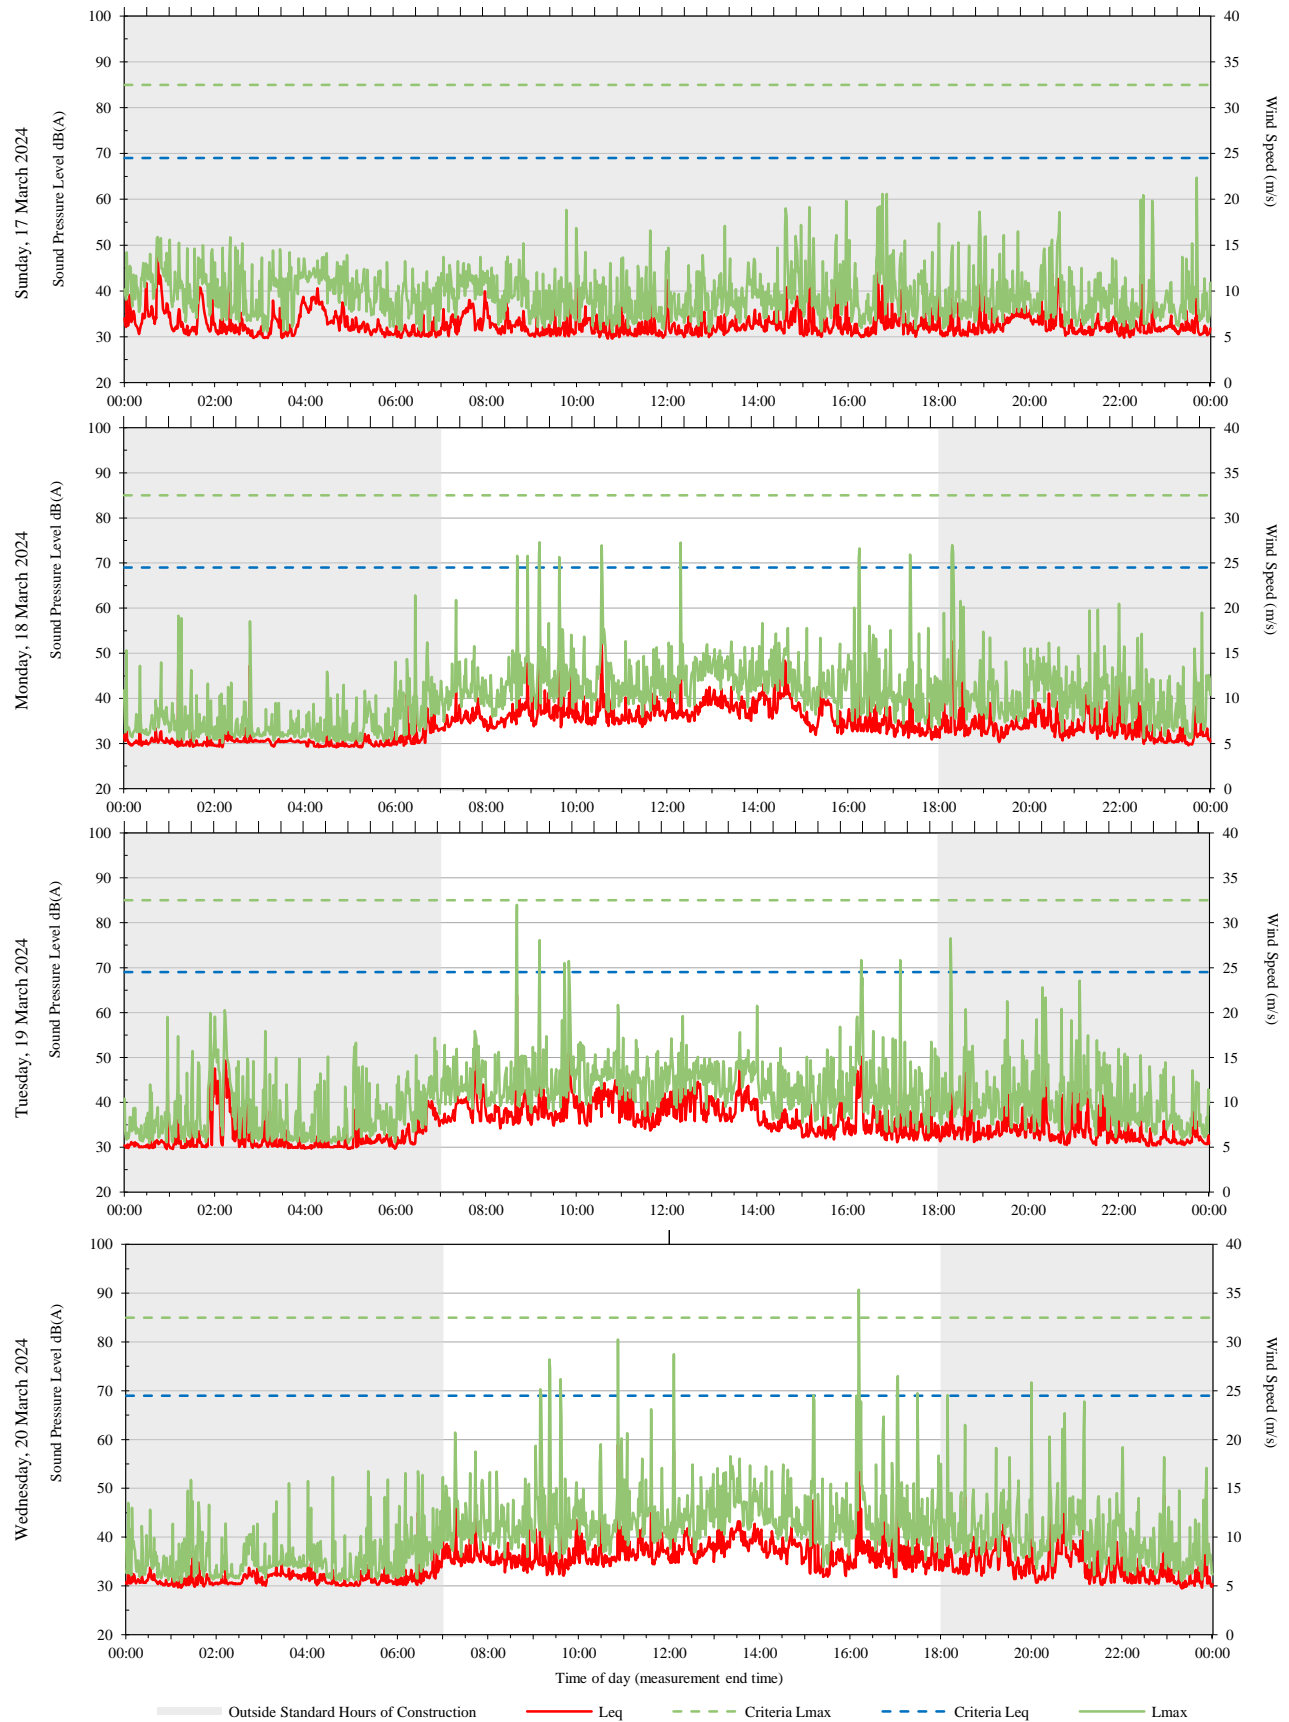





Unattended monitoring: WIMR Level 1 Bike Parking room (C.1.06) (Internal)

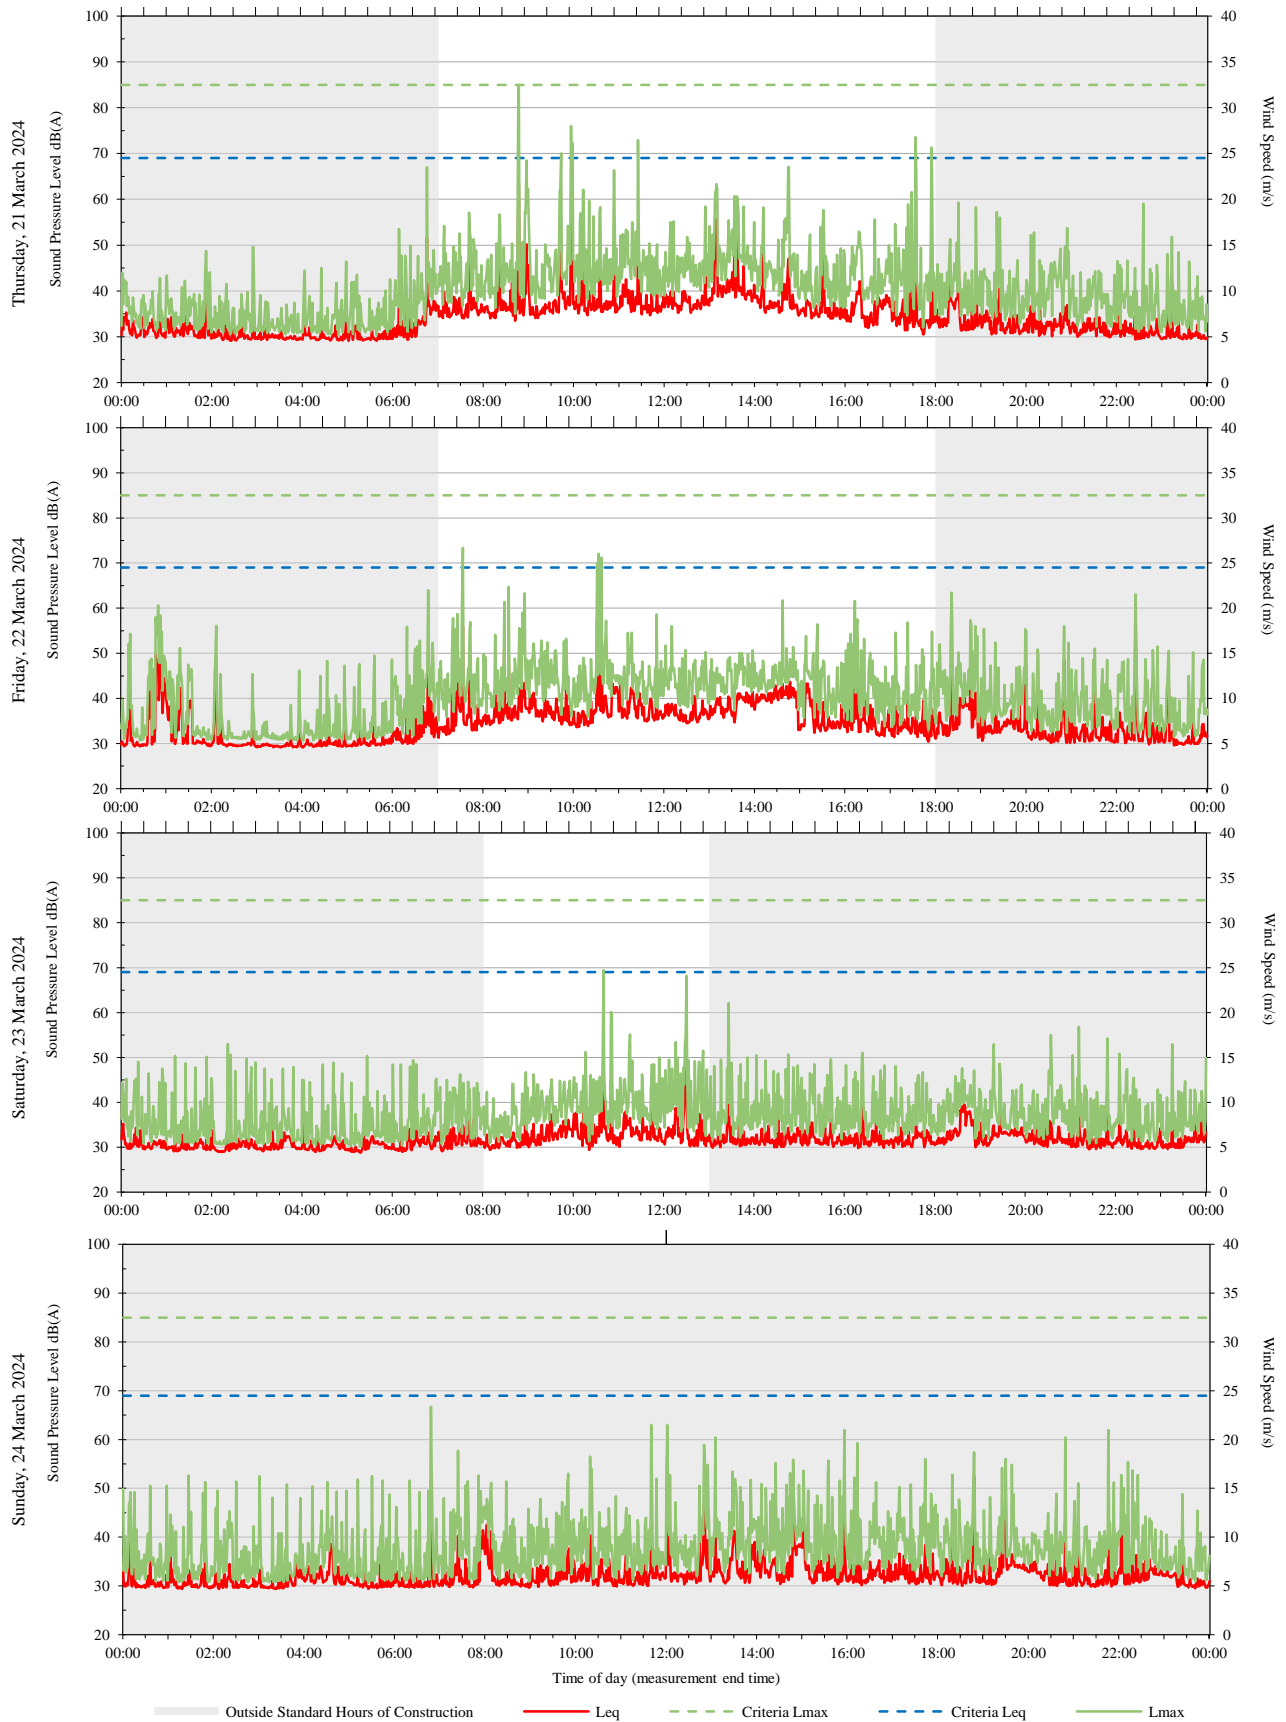

Unattended monitoring: WIMR Level 1 Bike Parking room (C.1.06) (Internal)

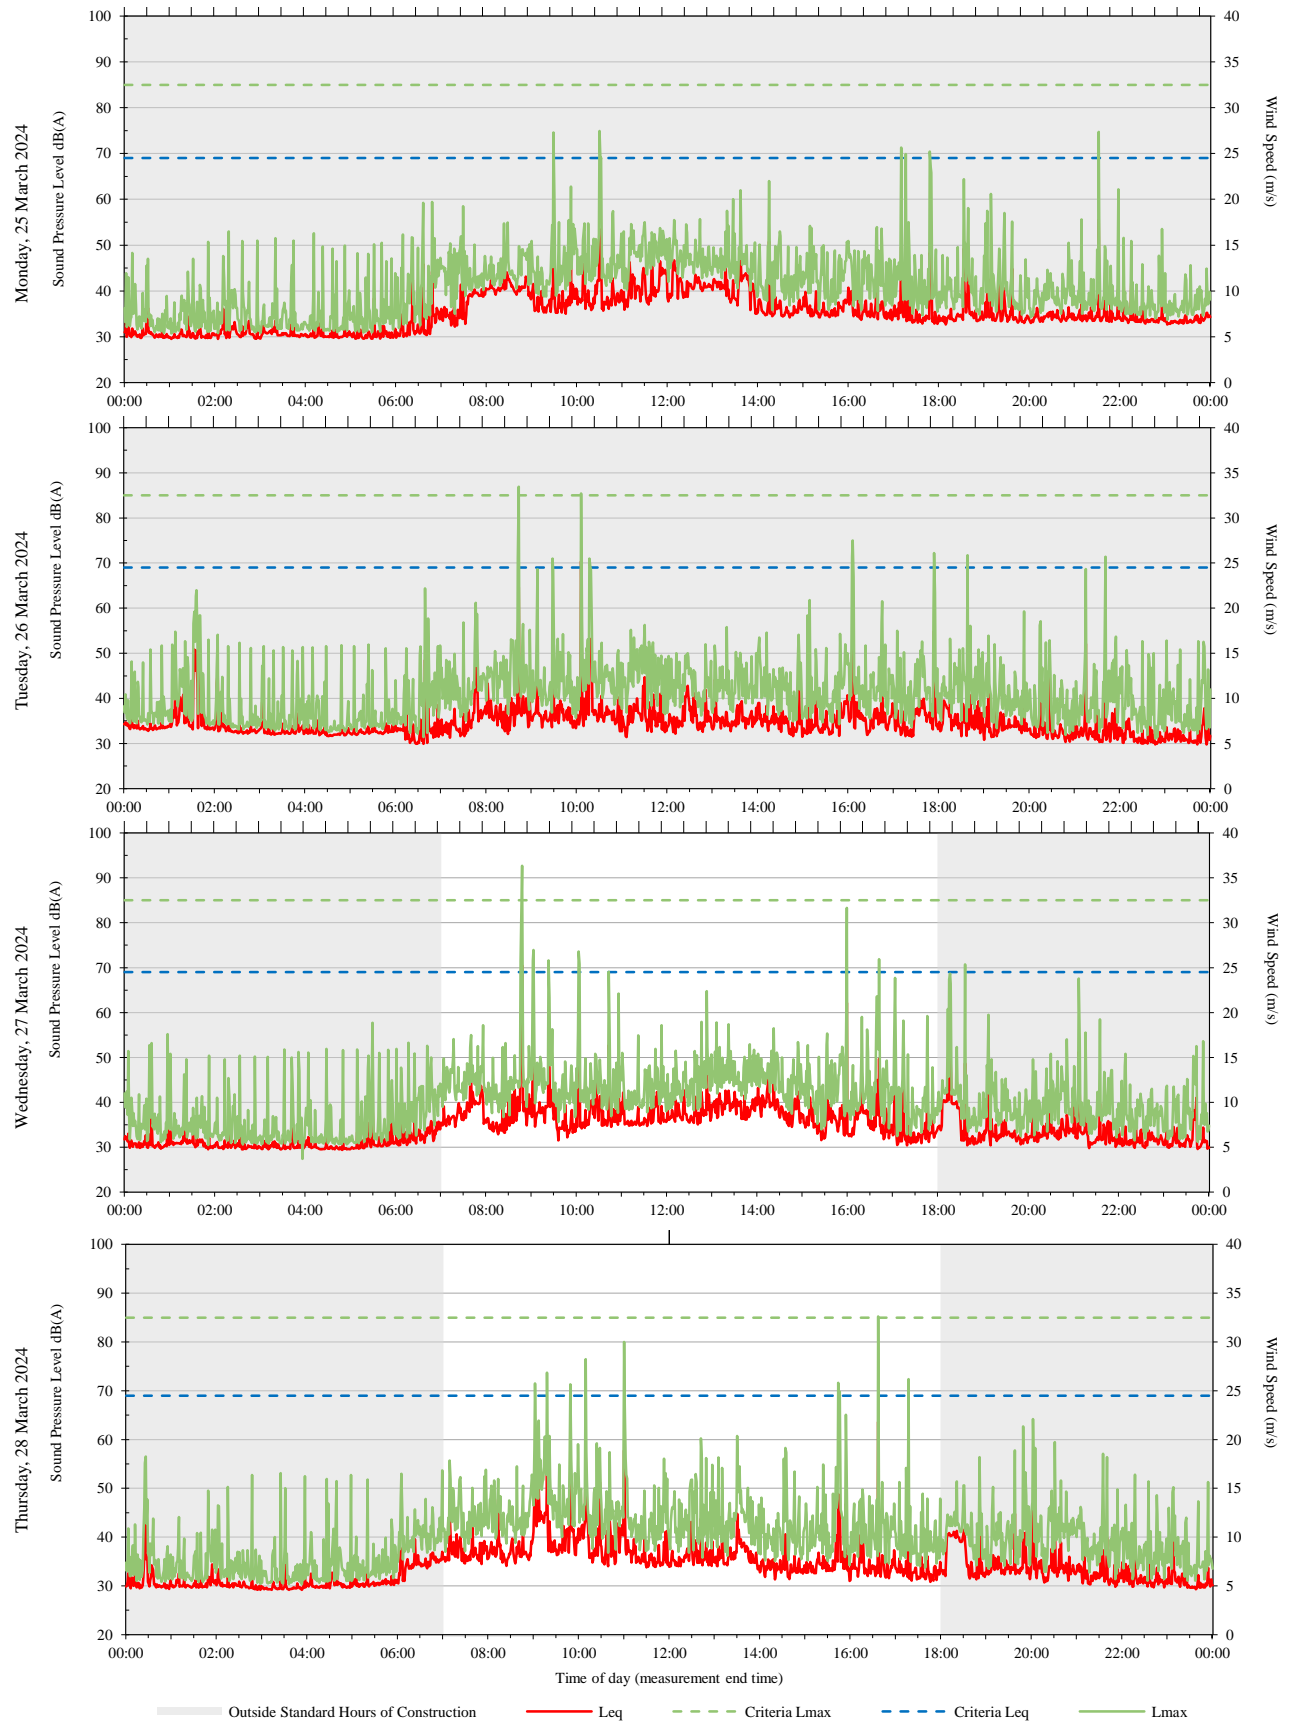

Unattended monitoring: WIMR Level 1 Bike Parking room (C.1.06) (Internal)

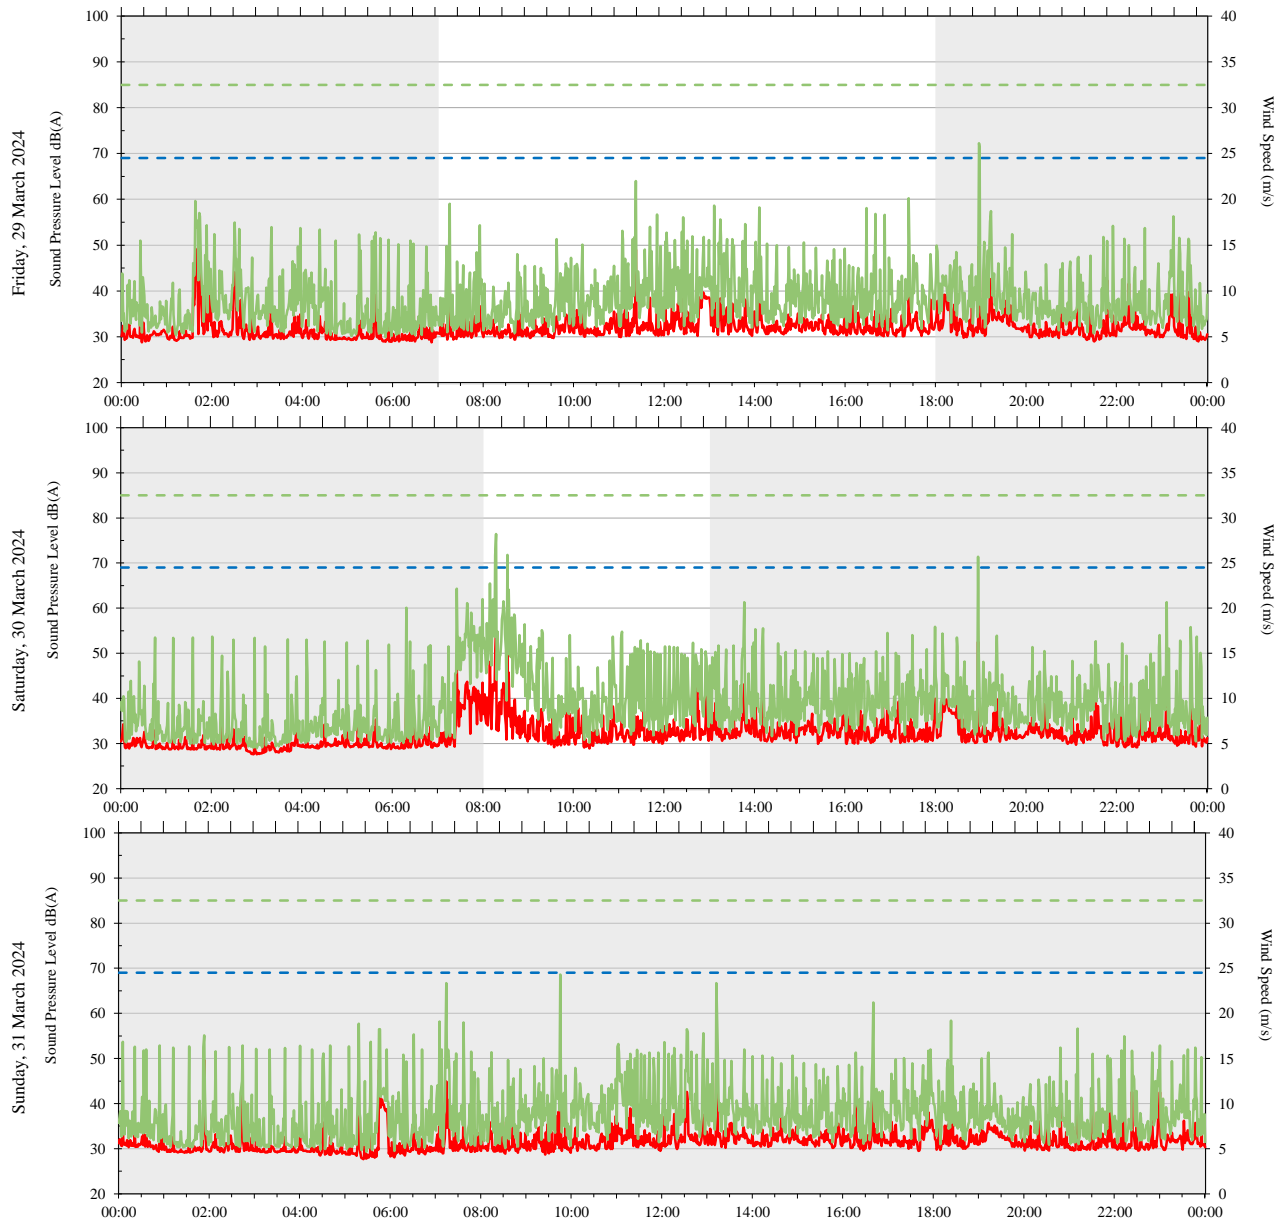



**Health Infrastructure**

# **Children's Hospital Westmead**

**Vibration Monitoring - KR L4 44-4873 -  
Mar 2024**

CVM/ KRL4/202403

Issue 1 | 15/04/2024

This report takes into account the particular instructions and requirements of our client.

It is not intended for and should not be relied upon by any third party and no responsibility is undertaken to any third party.

Job number 271985

Arup Pty Ltd ABN 18 000 966 165




**Arup Pty Ltd**  
Level 5  
151 Clarence Street  
Sydney NSW 2000  
Australia  
[www.arup.com](http://www.arup.com)



## Document Verification

**Project title** Children's Hospital Westmead  
**Document title** Monthly Vibration Monitoring Report  
**Job number** 271985  
**Document ref** CVM/KRL4/202403  
**File reference** -

Revision	Date	Filename	Description
		Westmead Hospital – SVAN958 KR – L4 Rm 44-4873 - Summary of Recent Vibration Measurements (01-03 to 31-03).docx	
Issue 1	15/04/2024		For issue

	Prepared by	Checked by	Approved by
<b>Name</b>	PR	MJW	MJW
<b>Signature</b>			

Filename	Description

	Prepared by	Checked by	Approved by
<b>Name</b>			
<b>Signature</b>			

Filename	Description

	Prepared by	Checked by	Approved by
<b>Name</b>			
<b>Signature</b>			

Issue Document Verification with Document

# Contents

---

Executive Summary.....	3
<b>1.</b> Introduction.....	4
<b>2.</b> Monitor Location .....	4
<b>3.</b> Recorded Data .....	5

# Executive Summary

This report summarises the vibration monitoring data recorded at KR Level 4 in Room 44-4873, over one month – from 01/03/2024 to 31/03/2024. Graphs in this report show the recorded data in blue, and exceedance trigger levels in red.

## RMS Acceleration Levels

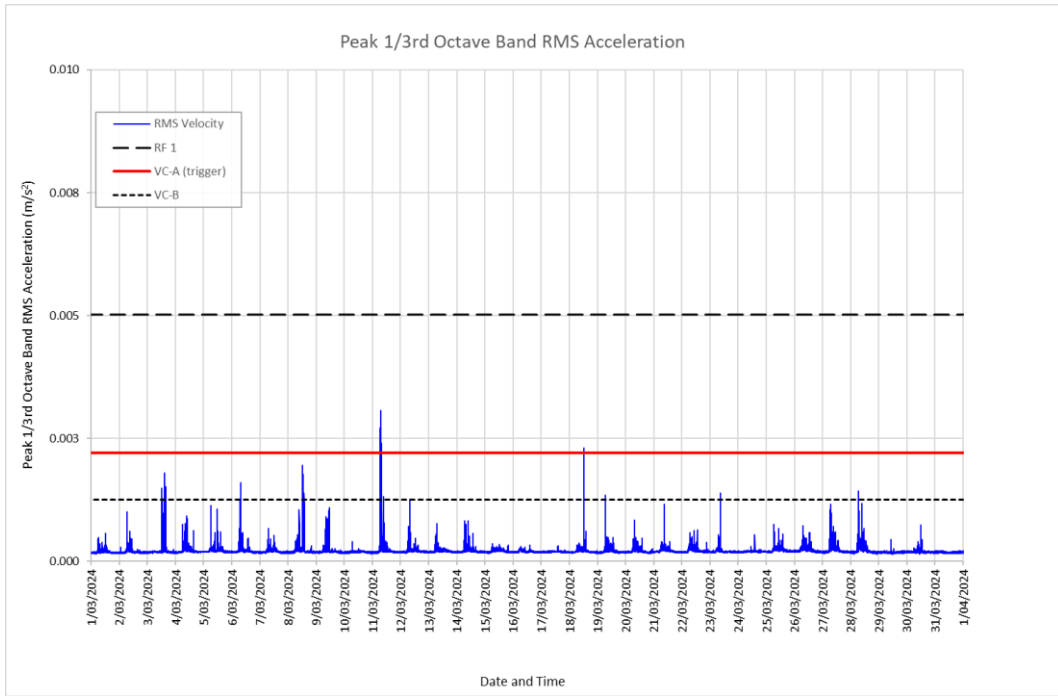


Figure 1: Measured RMS acceleration vibration levels at the KR L4.

The table below summarises the number of Root-Mean-Square Acceleration limit exceedances recorded during and outside of construction hours at KR L4 Lab.

During Construction Hours	Outside of Construction Hours
31	0

## 1. Introduction

---

Arup has been commissioned by PricewaterhouseCoopers (PwC) on behalf of NSW Health Infrastructure to monitor vibration levels in facilities adjacent to the Paediatric Services Building and Forecourt development sites to ensure facility operations are not excessively impacted by the construction works. This report summarises the vibration monitoring data recorded at KR – L4 Room 44-4873 during the period of the 01/03/2024 to 31/03/2024.

For the purposes of reporting, construction works are considered to be occurring at the following times:

Day	Construction Hours
Monday to Friday	7:00am to 6:00pm
Saturday	8:00am to 1:00pm
Sunday	No works
Public Holidays	No works

## 2. Monitor Location

---

The location of this monitor is shown below in Figure 2.



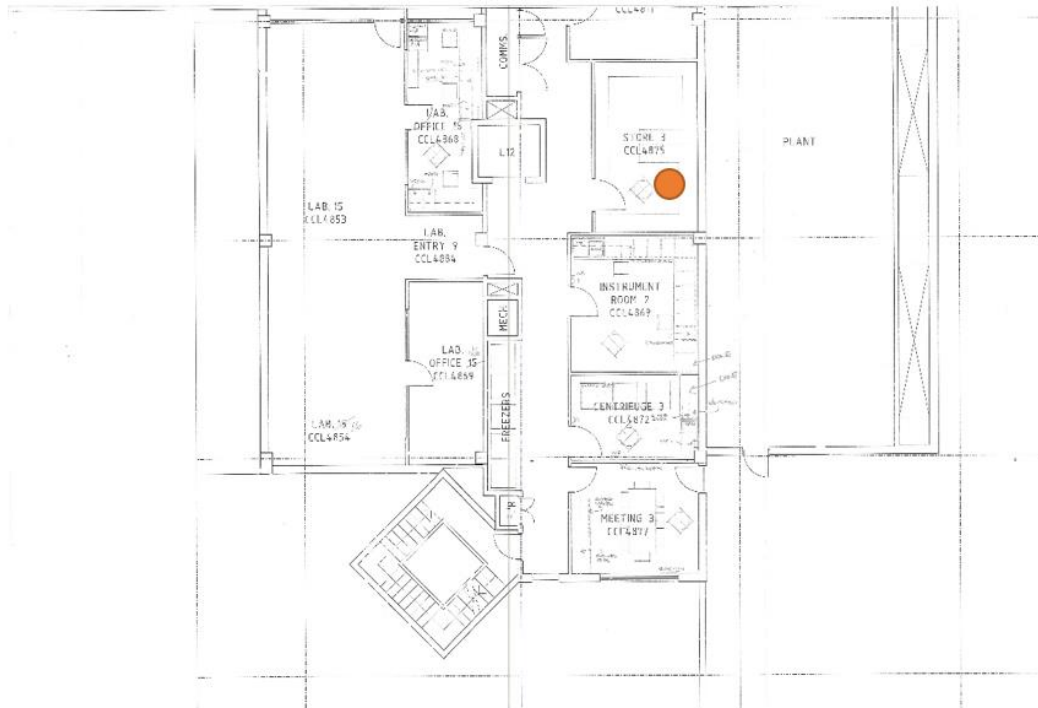


Figure 2: KR – L4 vibration monitor location

Monitoring at this location utilises a SVAN 958AG (SN 59827) with a triaxial accelerometer (SA207B).

### 3. Recorded Data

---

Figure 3 below shows the vibration levels (RMS acceleration) recorded between 01/03/2024 and 31/03/2024. The recorded data is shown in blue, while the limit of  $0.0025 \text{ m/s}^2$  (VC-A) is shown in red.

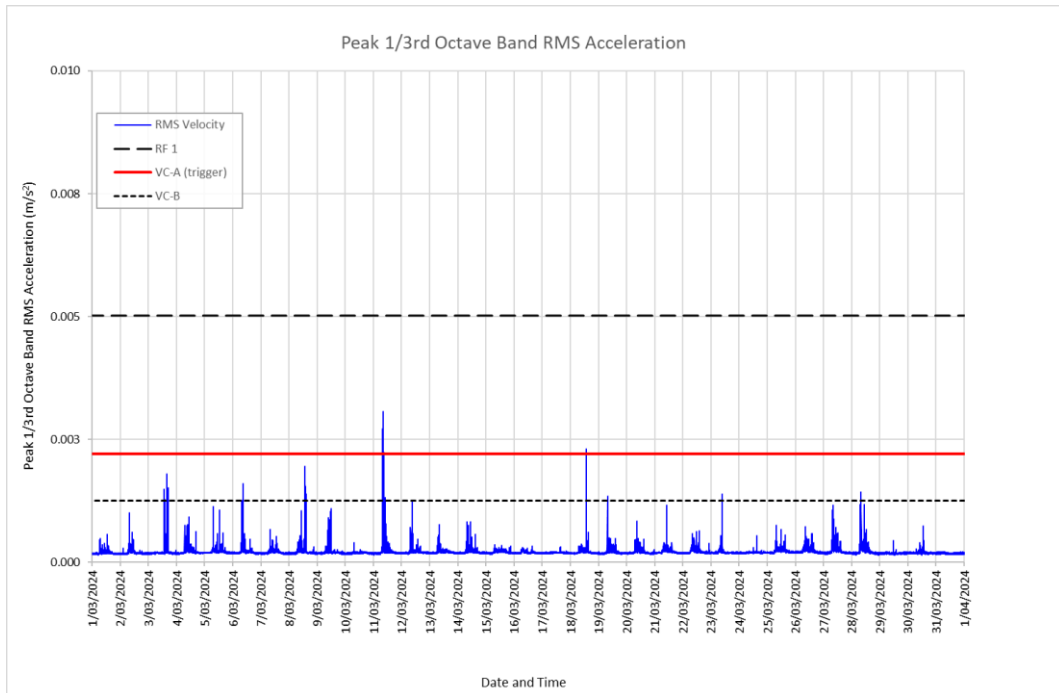


Figure 3: Measured RMS acceleration vibration levels for 01/03/2024 to 31/03/2024 at KR – L4.

The table below summarises the number of Root-Mean-Square Acceleration limit exceedances recorded during and outside of construction hours at KR L4 Lab.

During Construction Hours	Outside of Construction Hours
31	0



**Health Infrastructure**

# Children's Hospital Westmead

Vibration Monitoring - SCHN L1  
Endocrinology Lab - March 2024

CVM/ SCHN/202403

Issue 1 | 10/04/2024

This report takes into account the particular instructions and requirements of our client.

It is not intended for and should not be relied upon by any third party and no responsibility is undertaken to any third party.

Job number 271985

Arup Pty Ltd ABN 18 000 966 165

**Arup Pty Ltd**  
Level 5  
151 Clarence Street  
Sydney NSW 2000  
Australia  
[www.arup.com](http://www.arup.com)






## Document Verification

**Project title** Children's Hospital Westmead  
**Document title** Monthly Vibration Monitoring Report  
**Job number** 271985  
**Document ref** CVM/SCHN/202403  
**File reference** -

Revision	Date	Filename
		Westmead Hospital – 103157 SCHN L1 Endocrinology Lab - Summary of Recent Vibration Measurements (01-03 to 31-03).docx

Issue	Date	Description
Issue 1	10/04/2024	Issue

	Prepared by	Checked by	Approved by
<b>Name</b>	PR	MJW	MJW
<b>Signature</b>			

Filename

Description	Prepared by	Checked by	Approved by
<b>Name</b>			
<b>Signature</b>			

Filename

Description	Prepared by	Checked by	Approved by
<b>Name</b>			
<b>Signature</b>			

Issue Document Verification with Document



# Contents

---

Executive Summary.....	3
<b>1.</b> Introduction.....	4
<b>2.</b> Monitor Location .....	4
<b>3.</b> Recorded Data .....	5
Appendix A: Calibration Certificates.....	6

# Executive Summary

This report summarises the vibration monitoring data recorded at SCHN L1 Endocrinology Lab, over one month – from 01/03/2024 to 31/03/2024. Graphs in this report show the recorded data in blue, and exceedance trigger levels in red.

## RMSV Vibration Levels

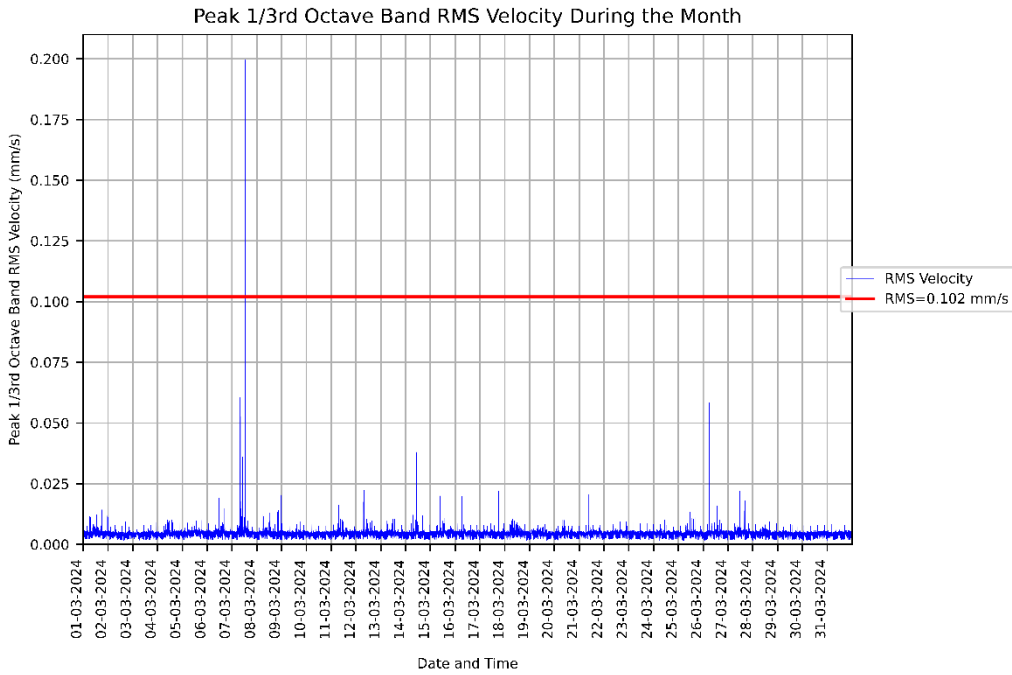


Figure 1: Measured RMSV vibration levels for 01/03/2024 to 31/03/2024 at the SCHN L1 Endocrinology Lab.

The table below summarises the number of Root-Mean-Square Velocity (RMSV) limit exceedances recorded during and outside of construction hours.

During Construction Hours	Outside of Construction Hours
3	0

# 1. Introduction

Arup has been commissioned by PricewaterhouseCoopers (PwC) on behalf of NSW Health Infrastructure to monitor vibration levels in facilities adjacent to the Paediatric Services Building and Multi-storey Car Park development sites to ensure facility operations are not excessively impacted by the construction works. This report summarises the vibration monitoring data recorded at SCHN L1 Endocrinology Lab during the period of the 01/03/2024 to 31/03/2024.

For the purposes of reporting, construction works are considered to be occurring at the following times:

Day	Construction Hours
Monday to Friday	7:00am to 6:00pm
Saturday	8:00am to 1:00pm
Sunday	No works
Public Holidays	No works

# 2. Monitor Location

The location of this monitor is shown below in Figure 3.



Figure 3: SCHN L1 Endocrinology Lab vibration monitor location shown in orange

Monitoring at this location utilises a GeoSIG GMSplus with a GeoSIG VE-11 geophone. The calibration certificate for the geophone is included in Appendix A.

### 3. Recorded Data

Figure 4 below shows the vibration levels (RMS velocity) recorded between 01/03/2024 and 31/03/2024. The recorded data is shown in blue, while the limit of 0.102mm/s ( $V_{RMS}$ ) is shown in red.

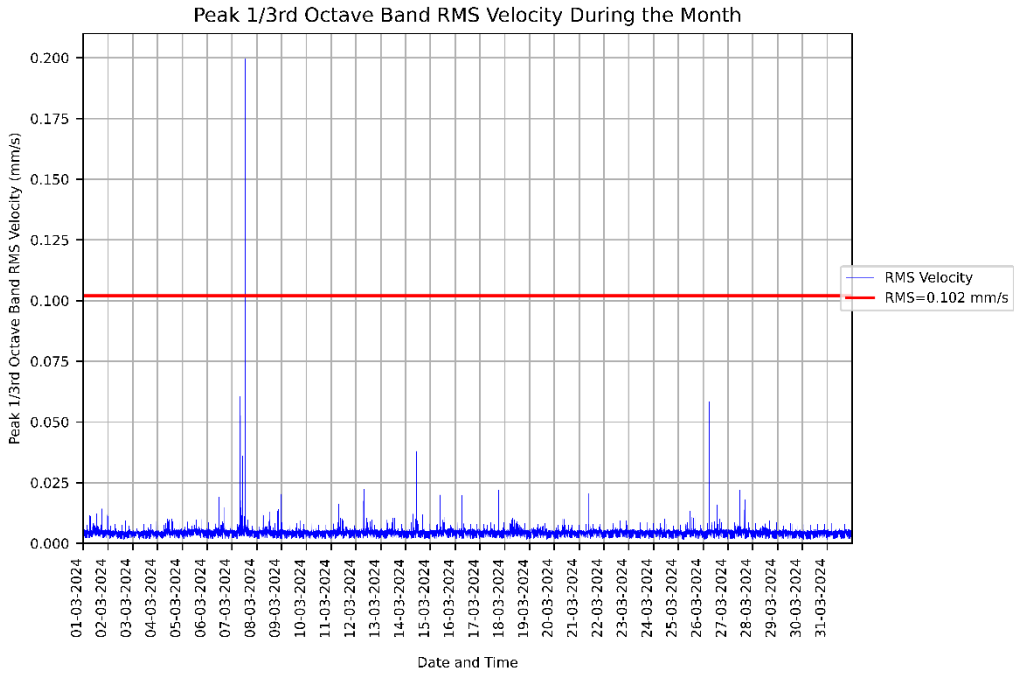


Figure 4: Measured RMSV vibration levels for 01/03/2024 to 31/03/2024 at the SCHN L1 Endocrinology Lab.

The table below summarises the number of RMS Velocity limit exceedances recorded during and outside of construction hours.

During Construction Hours	Outside of Construction Hours
3	0



# Appendix A: Calibration Certificates



## CERTIFICATE OF CALIBRATION

CERTIFICATE NO: G30985

EQUIPMENT TESTED : Geophone

Manufacturer: GeoSIG  
Geophone Type: VE-11

Serial No: 55910

Owner: Arup Services Pty Ltd  
Barrack Place, Level 5, 151 Clarence Street  
Sydney NSW 2000

Tests: Frequency Response, Linearity & Sensitivity at  
Performed: Selected Frequencies  
Comments: Detailed overleaf.

CONDITION OF TEST:

Temperature 23 °C ±1° C  
Relative Humidity 44 % ±5%

Date of Receipt : 25/10/2021  
Date of Calibration : 01/11/2021  
Date of Issue : 01/11/2021

Acu-Vib Test AVP15 (Low Frequency Transducer, Geophone) based on  
Procedure: AS2187.2 & DIN45669-1

CHECKED BY: *[Signature]*

AUTHORISED SIGNATURE: *[Signature]*

*Hein See*

Accredited for compliance with ISO/IEC 17025 - Calibration  
Results of the tests, calibration and/or measurements included in this document are traceable to SI units through reference equipment that has been calibrated by the Australian National Measurement Institute or other NATA accredited laboratories demonstrating traceability.  
This report applies only to the item identified in the report and may not be reproduced in part.  
The uncertainties quoted are calculated in accordance with the methods of the ISO Guide to the Uncertainty of Measurement and quoted at a coverage factor of 2 with a confidence interval of approximately 95%.



WORLD RECOGNISED  
ACCREDITATION  
Accredited Lab No. 9262  
Acoustic and Vibration  
Measurements



Head Office & Calibration Laboratory  
Unit 14, 22 Hudson Ave. Castle Hill NSW 2134  
(02) 9680 8133  
www.acu-vib.com.au

Page 1 of 2 Calibration Certificate  
AVCERT15 Rev.2.0 14.04.2021

Frequency response and linearity characteristics for  
GeoSIG Velocity Geophone **VE-11** Serial No. **55910**  
Constant velocity of 10 mm/sec Peak applied for response  
(Except at 200.0 Hz where applied level limited to 1.0 mm/s peak)  
For amplitude linearity applied level varied at 15.92 Hz

12VDC Power Supply

Geophone Orientation.: Vertical

Frequency		Velocity mm/sec Peak	Indicated Sensitivity $\text{mV}/\text{mms}^{-1}$	Expanded uncertainty
Hz	Radians/sec		Vertical Sensitivity	$U_{95}$ %
3.00	18.85	10.0	109.76	1.00%
4.00	25.13	10.0	111.50	0.90%
6.00	37.70	10.0	108.98	0.90%
10.00	62.83	10.0	103.80	0.90%
15.00	94.25	10.0	101.12	0.90%
15.92	94.25	1.0	N/A	0.90%
15.92	94.25	5.0	95.09	0.90%
<b>15.92</b>	<b>94.25</b>	<b>10.0</b>	<b>94.96</b>	<b>0.90%</b>
15.92	94.25	50.0	94.83	0.90%
15.92	94.25	100	N/A	0.50%
30.00	188.50	10.0	99.03	0.50%
60.00	376.99	10.0	100.56	0.50%
120.00	753.98	10.0	113.91	0.50%
150.00	942.48	10.0	119.09	0.50%
Hz	Radians/sec	Velocity mm/sec Peak	Vertical Sensitivity	$U_{95}$ %

**Note1:**

The laboratory has accreditation under ISO/IEC 17025 from NATA for calibration to ISO 16063-21 at frequencies from 0.5 Hz. Measurements at all frequencies and levels shown in the table above are made using reference equipment traceably calibrated to Australian National Standards.

**Note2:**

The uncertainties quoted are estimated at a confidence level of 95% and a coverage factor of  $k=2$  applies unless otherwise stated.



**Health Infrastructure**

# **Children's Hospital Westmead**

**Vibration Monitoring - WIMR - BSF  
Mice Holding Room - Floor - March 2024**

CVM/ WIMR/202403

Issue 1 | 10/04/2024

This report takes into account the particular instructions and requirements of our client.

It is not intended for and should not be relied upon by any third party and no responsibility is undertaken to any third party.

Job number 271985

Arup Pty Ltd ABN 18 000 966 165

**Arup Pty Ltd**

Level 5

151 Clarence Street

Sydney NSW 2000

Australia

[www.arup.com](http://www.arup.com)






## Document Verification

**Project title** Children's Hospital Westmead  
**Document title** Monthly Vibration Monitoring Report  
**Job number** 271985  
**Document ref** CVM/WIMR/202403  
**File reference** -

Revision	Date	Filename
		Westmead Hospital – 103158 WIMR - BSF Mice Holding Room - Floor - Summary of Recent Vibration Measurements (01-03 to 31-03).docx

Issue	Date	Description
Issue 1	10/04/2024	Issue

	Prepared by	Checked by	Approved by
<b>Name</b>	PR	MJW	MJW
<b>Signature</b>			

Filename	Description	Prepared by	Checked by	Approved by
<b>Name</b>				
<b>Signature</b>				

Filename	Description	Prepared by	Checked by	Approved by
<b>Name</b>				
<b>Signature</b>				

Issue Document Verification with Document

# Contents

---

Executive Summary.....	3
<b>1.</b> Introduction .....	5
<b>2.</b> Monitor Location .....	5
<b>3.</b> Recorded Data .....	6
Appendix A: Calibration Certificates.....	8

# Executive Summary

This report summarises the vibration monitoring data recorded at WIMR - BSF Mice Holding Room - Floor, over one month – from 01/03/2024 to 31/03/2024. Graphs in this report show the recorded data in blue, and exceedance trigger levels in red.

## RMSV Vibration Levels

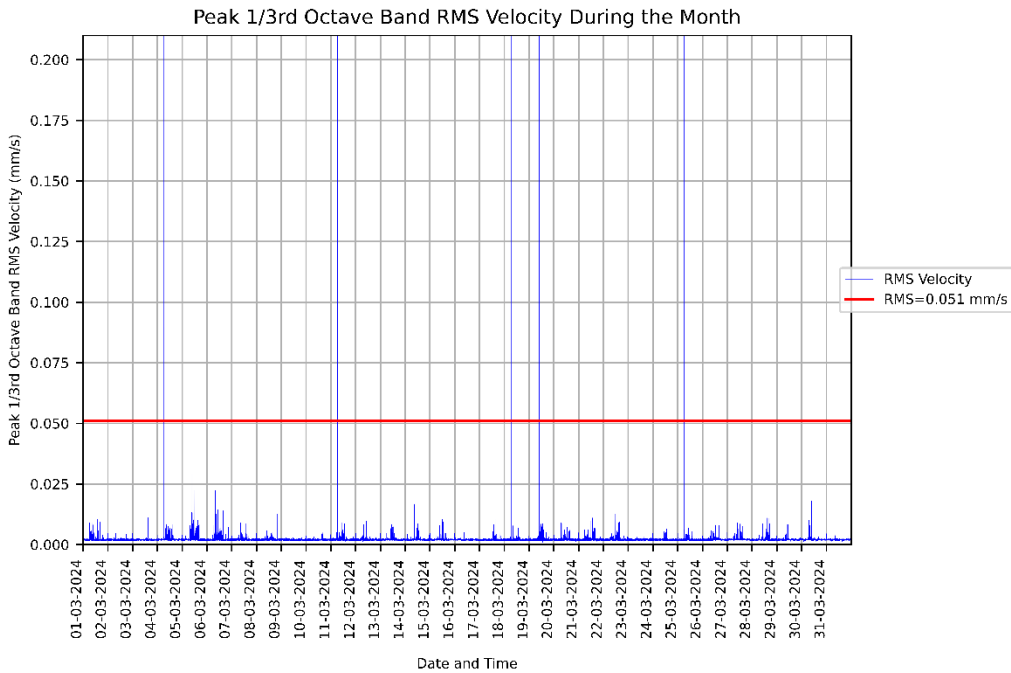


Figure 1: Measured RMSV vibration levels for 01/03/2024 to 31/03/2024 at the WIMR - BSF Mice Holding Room - Floor.

The table below summarises the number of Root-Mean-Square Velocity (RMSV) limit exceedances recorded during and outside of construction hours.

During Construction Hours	Outside of Construction Hours
2	4

## PPV Vibration Levels

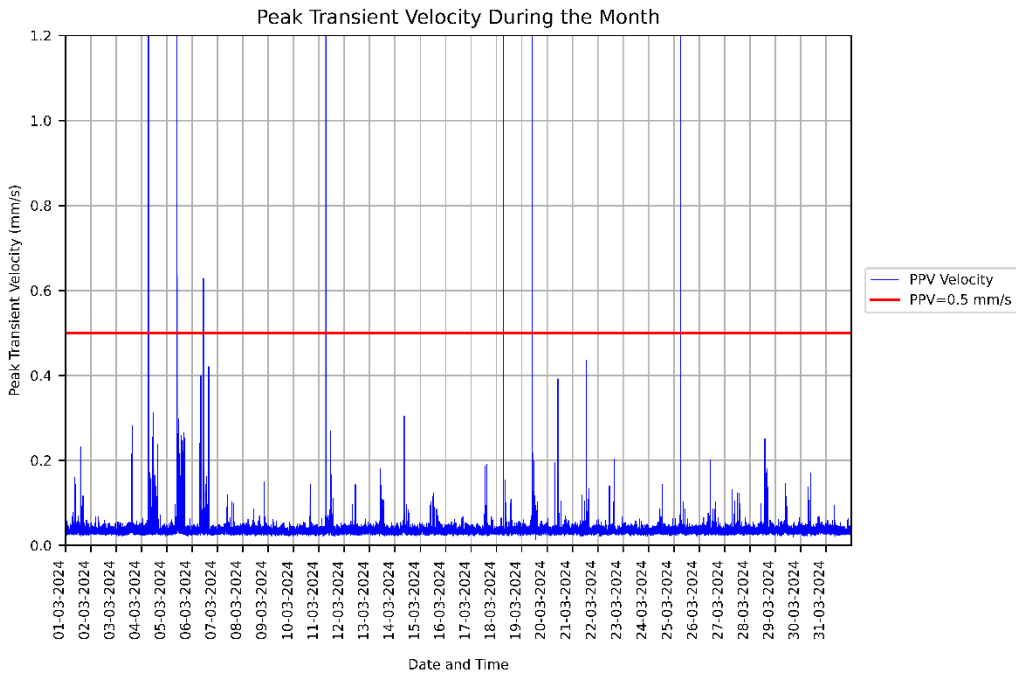


Figure 2: Measured vibration levels for 01/03/2024 to 31/03/2024 at the WIMR - BSF Mice Holding Room - Floor.

The table below summarises the number of Peak Particle Velocity (PPV) limit exceedances recorded during and outside of construction hours.

During Construction Hours	Outside of Construction Hours
4	4



# 1. Introduction

Arup has been commissioned by PricewaterhouseCoopers (PwC) on behalf of NSW Health Infrastructure to monitor vibration levels in facilities adjacent to the VVMF development sites to ensure facility operations are not excessively impacted by the construction works. This report summarises the vibration monitoring data recorded at WIMR - BSF Mice Holding Room - Floor during the period of the 01/03/2024 to 31/03/2024.

For the purposes of reporting, construction works are considered to be occurring at the following times:

Day	Construction Hours
Monday to Friday	7:00am to 6:00pm
Saturday	8:00am to 1:00pm
Sunday	No works
Public Holidays	No works

# 2. Monitor Location

The location of this monitor is shown below in Figure 3.

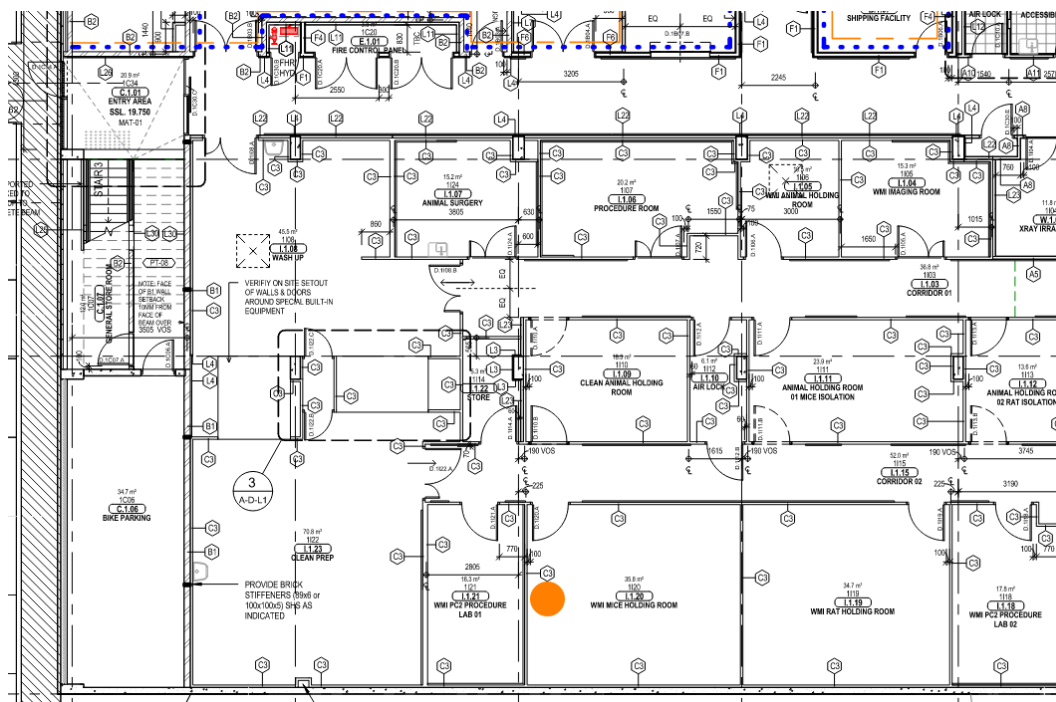


Figure 3: WIMR - BSF Mice Holding Room - Floor vibration monitor location

Monitoring at this location utilises a GeoSIG GMSplus with a GeoSIG VE-11 geophone. The calibration certificate for the geophone is included in Appendix A.



### 3. Recorded Data

Figure 4 below shows the vibration levels (RMS velocity) recorded between 01/03/2024 and 31/03/2024. The recorded data is shown in blue, while the limit of 0.051mm/s ( $V_{RMS}$ ) is shown in red.

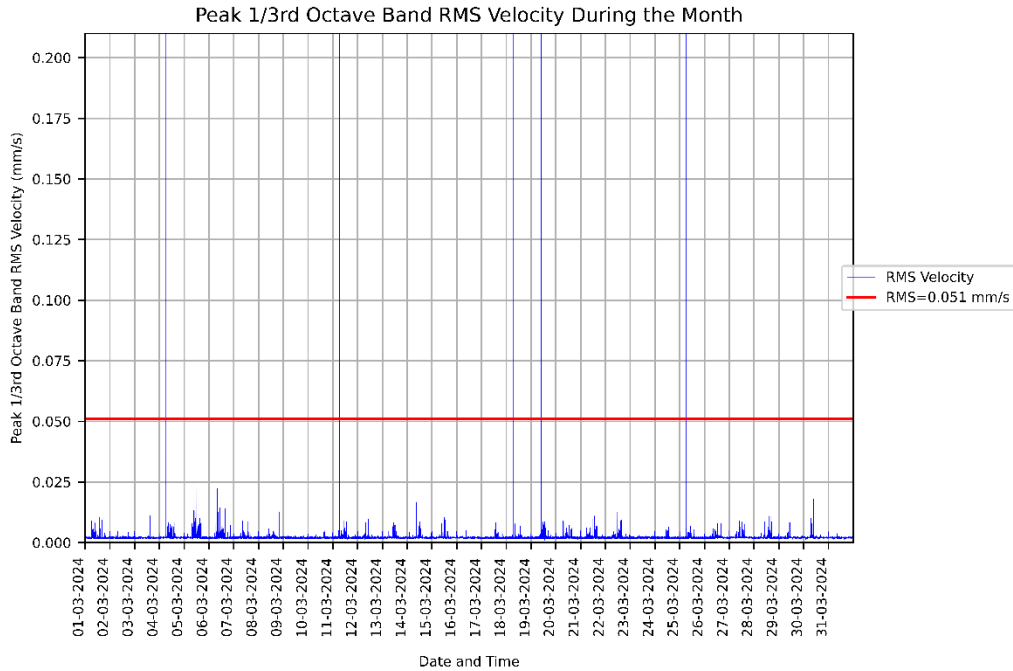


Figure 4: Measured RMSV vibration levels for 01/03/2024 to 31/03/2024 at the WIMR - BSF Mice Holding Room - Floor.

The table below summarises the number of RMS Velocity limit exceedances recorded during and outside of construction hours.

During Construction Hours	Outside of Construction Hours
2	4

Figure 5 below shows the peak particle vibration levels (PPV velocity) recorded between 01/03/2024 and 31/03/2024. The recorded data is shown in blue, while the limit of 0.5mm/s ( $V_{PPV}$ ) is shown in red.


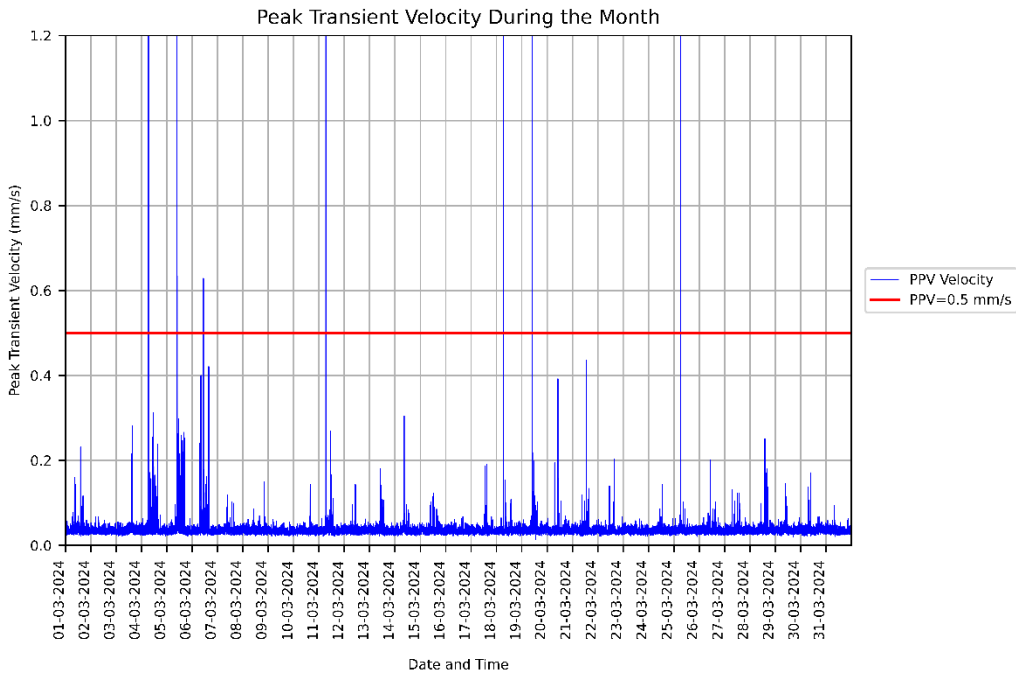


Figure 5: Measured PPV vibration levels for 01/03/2024 to 31/03/2024 at the WIMR - BSF Mice Holding Room - Floor.

The table below summarises the number of PPV limit exceedances recorded during and outside of construction hours.

During Construction Hours	Outside of Construction Hours
4	4

# Appendix A: Calibration Certificates

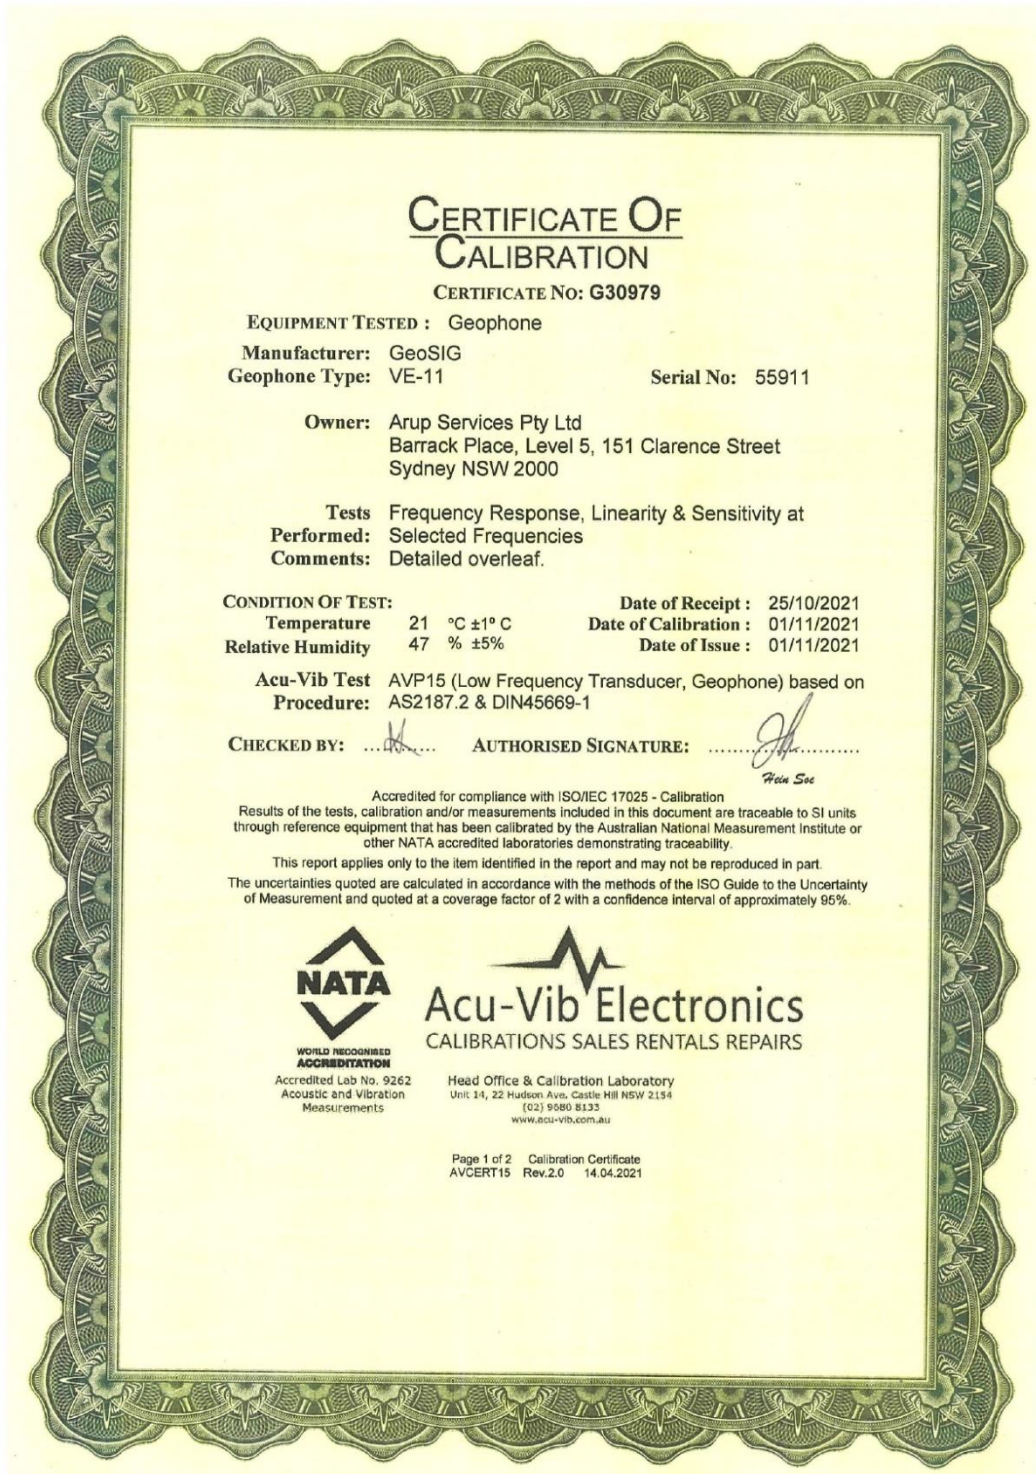

Frequency response and linearity characteristics for  
GeoSIG Velocity Geophone **VE-11** Serial No. **55911**  
Constant velocity of 10 mm/sec Peak applied for response  
(Except at 200.0 Hz where applied level limited to 1.0 mm/s peak)  
For amplitude linearity applied level varied at 15.92 Hz

12VDC Power Supply

Geophone Orientation.: Vertical

Frequency		Velocity mm/sec Peak	Indicated Sensitivity $\text{mV}/\text{mms}^{-1}$	Expanded uncertainty $U_{95}$ %
Hz	Radians/sec			
3.00	18.85	10.0	112.66	1.00%
4.00	25.13	10.0	112.97	0.90%
6.00	37.70	10.0	108.80	0.90%
10.00	62.83	10.0	101.91	0.90%
15.00	94.25	10.0	98.58	0.90%
15.92	94.25	1.0	N/A	0.90%
15.92	94.25	5.0	92.57	0.90%
<b>15.92</b>	<b>94.25</b>	<b>10.0</b>	<b>92.49</b>	<b>0.90%</b>
15.92	94.25	50.0	92.48	0.90%
15.92	94.25	100	N/A	0.50%
30.00	188.50	10.0	95.98	0.50%
60.00	376.99	10.0	96.13	0.50%
120.00	753.98	10.0	106.11	0.50%
150.00	942.48	10.0	116.46	0.50%
Hz	Radians/sec	Velocity mm/sec Peak	Vertical Sensitivity	$U_{95}$ %

**Note1:**

The laboratory has accreditation under ISO/IEC 17025 from NATA for calibration to ISO 16063-21 at frequencies from 0.5 Hz. Measurements at all frequencies and levels shown in the table above are made using reference equipment traceably calibrated to Australian National Standards.

**Note2:**

The uncertainties quoted are estimated at a confidence level of 95% and a coverage factor of  $k=2$  applies unless otherwise stated.



**Health Infrastructure**

# **Children's Hospital Westmead**

**Vibration Monitoring - CASB level 3  
Surgical Suite - March 2024**

CVM/ CASB/202403

Issue 1 | 10/04/2024

This report takes into account the particular instructions and requirements of our client.

It is not intended for and should not be relied upon by any third party and no responsibility is undertaken to any third party.

Job number 271985

Arup Pty Ltd ABN 18 000 966 165

**Arup Pty Ltd**  
Level 5  
151 Clarence Street  
Sydney NSW 2000  
Australia  
[www.arup.com](http://www.arup.com)






## Document Verification

**Project title** Children's Hospital Westmead  
**Document title** Monthly Vibration Monitoring Report  
**Job number** 271985  
**Document ref** CVM/CASB/202403  
**File reference** -

Revision	Date	Filename
		Westmead Hospital – 103160 CASB level 3 Surgical Suite - Summary of Recent Vibration Measurements (01-03 to 31-03).docx

Issue	Date	Description
Issue 1	10/04/2024	Issue

	Prepared by	Checked by	Approved by
<b>Name</b>	PR	MJW	MJW
<b>Signature</b>			

Filename

Description

	Prepared by	Checked by	Approved by
<b>Name</b>			
<b>Signature</b>			

Filename

Description

	Prepared by	Checked by	Approved by
<b>Name</b>			
<b>Signature</b>			

Issue Document Verification with Document

# Contents

---

Executive Summary.....	3
<b>1.</b> Introduction.....	4
<b>2.</b> Monitor Location .....	4
<b>3.</b> Recorded Data .....	5
Appendix A: Calibration Certificates.....	7

# Executive Summary

This report summarises the vibration monitoring data recorded at CASB level 3 Surgical Suite, over one month – from 01/03/2024 to 31/03/2024. Graphs in this report show the recorded data in blue, and exceedance trigger levels in red.

## RMSV Vibration Levels

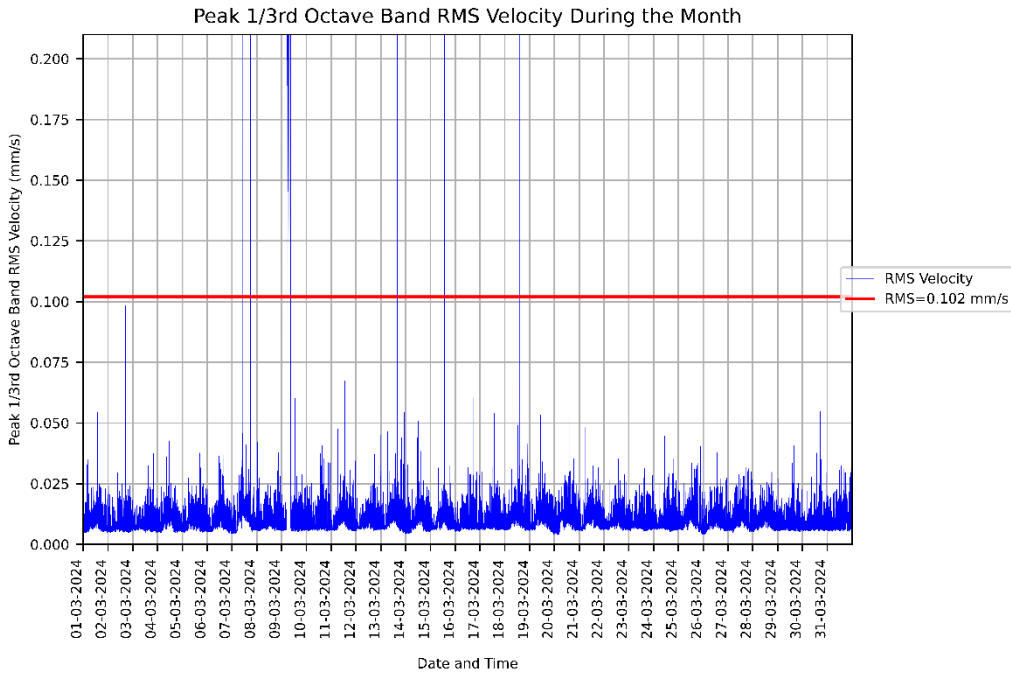


Figure 1: Measured RMSV vibration levels for 01/03/2024 to 31/03/2024 at the CASB level 3 Surgical Suite.

The table below summarises the number of Root-Mean-Square Velocity (RMSV) limit exceedances recorded during and outside of construction hours.

During Construction Hours	Outside of Construction Hours
40	88



## 1. Introduction

---

Arup has been commissioned by PricewaterhouseCoopers (PwC) on behalf of NSW Health Infrastructure to monitor vibration levels in facilities adjacent to the Paediatric Services Building and Multi-storey Car Park development sites to ensure facility operations are not excessively impacted by the construction works. This report summarises the vibration monitoring data recorded at CASB level 3 Surgical Suite during the period of the 01/03/2024 to 31/03/2024.

For the purposes of reporting, construction works are considered to be occurring at the following times:

Day	Construction Hours
Monday to Friday	7:00am to 6:00pm
Saturday	8:00am to 1:00pm
Sunday	No works
Public Holidays	No works

## 2. Monitor Location

---

The location of this monitor is shown below in Figure 3.

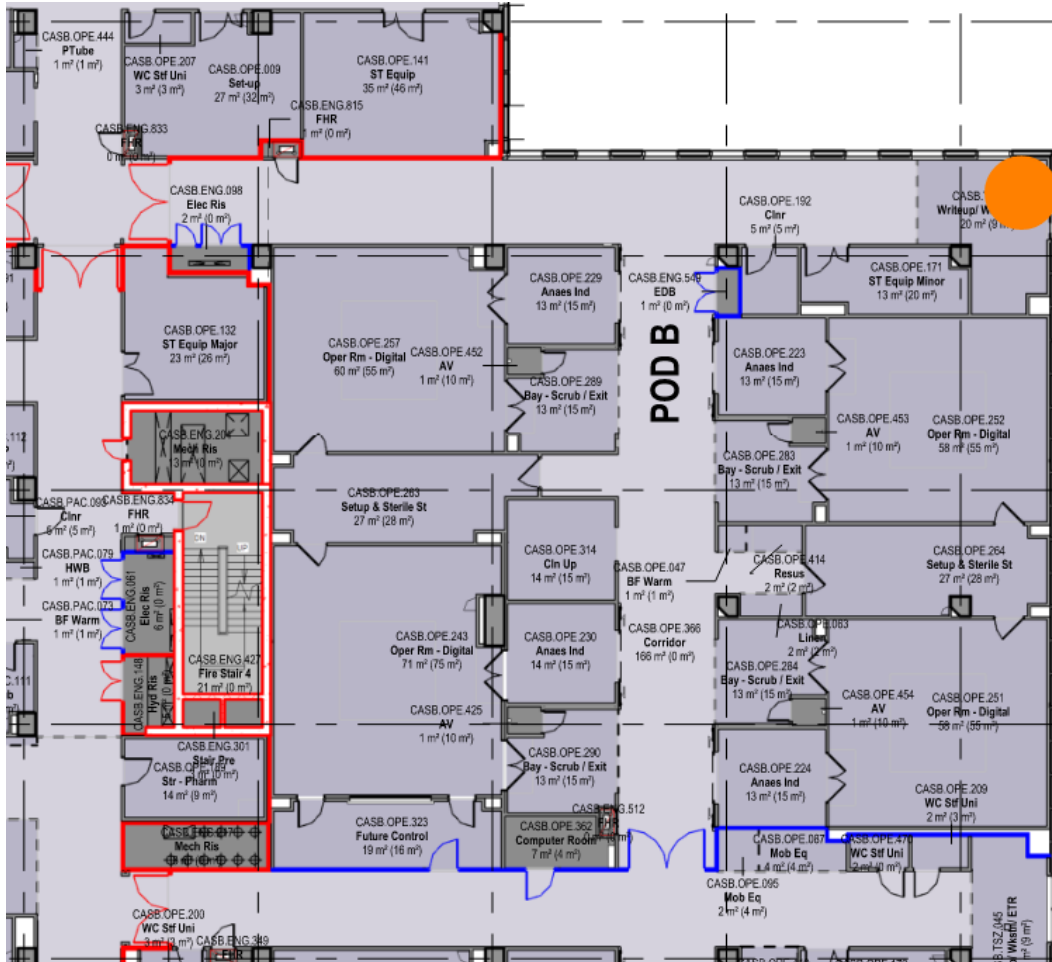


Figure 3: CASB level 3 Surgical Suite vibration monitor location

Monitoring at this location utilises a GeoSIG GMSplus with a GeoSIG VE-11 geophone. The calibration certificate for the geophone is included in Appendix A.

### 3. Recorded Data

Figure 4 below shows the vibration levels (RMS velocity) recorded between 01/03/2024 and 31/03/2024. The recorded data is shown in blue, while the limit of 0.102mm/s ( $V_{RMS}$ ) is shown in red.

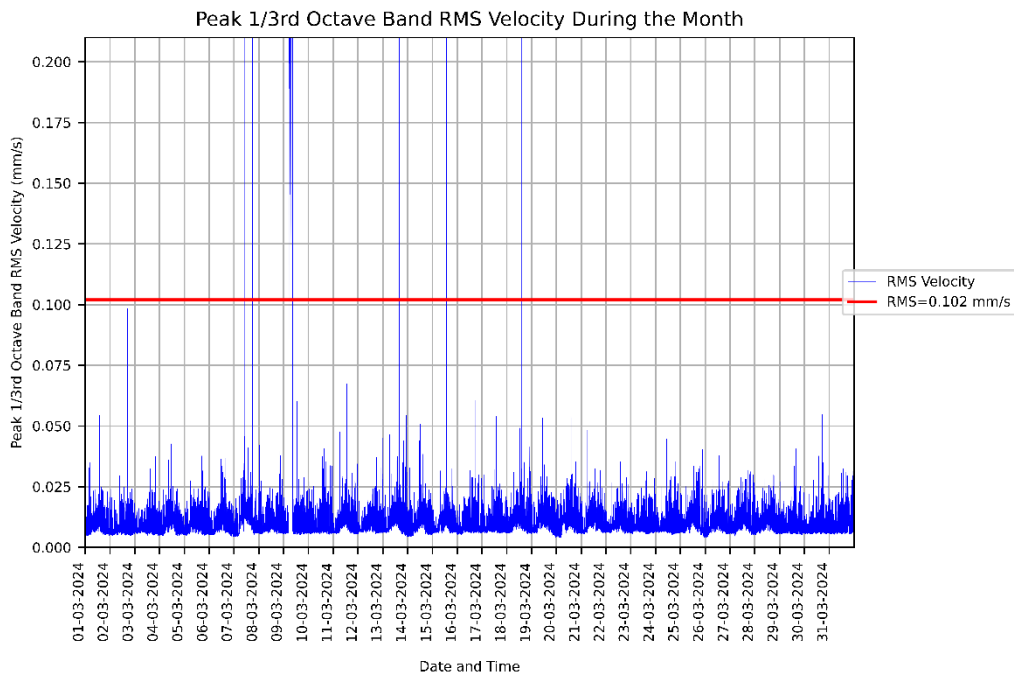


Figure 4: Measured RMSV vibration levels for 01/03/2024 to 31/03/2024 at the CASB level 3 Surgical Suite.

The table below summarises the number of RMS Velocity limit exceedances recorded during and outside of construction hours.

During Construction Hours	Outside of Construction Hours
40	88

## Appendix A: Calibration Certificates

---



Frequency response and linearity characteristics for  
GeoSIG Velocity Geophone **VE-11** Serial No. **55912**  
Constant velocity of 10 mm/sec Peak applied for response  
(Except at 200.0 Hz where applied level limited to 1.0 mm/s peak)  
For amplitude linearity applied level varied at 15.92 Hz

12VDC Power Supply

Geophone Orientation.: Vertical

Frequency		Velocity mm/sec Peak	Indicated Sensitivity mV/mms <sup>-1</sup>	Expanded uncertainty
Hz	Radians/sec		Vertical Sensitivity	U <sub>95</sub> %
3.00	18.85	10.0	112.74	1.00%
4.00	25.13	10.0	113.82	0.90%
6.00	37.70	10.0	109.59	0.90%
10.00	62.83	10.0	100.79	0.90%
15.00	94.25	10.0	96.12	0.90%
15.92	94.25	1.0	N/A	0.90%
15.92	94.25	5.0	90.09	0.90%
<b>15.92</b>	<b>94.25</b>	<b>10.0</b>	<b>89.99</b>	<b>0.90%</b>
15.92	94.25	50.0	89.89	0.90%
15.92	94.25	100	N/A	0.50%
30.00	188.50	10.0	92.45	0.50%
60.00	376.99	10.0	92.89	0.50%
120.00	753.98	10.0	100.92	0.50%
150.00	942.48	10.0	117.80	0.50%
Hz	Radians/sec	Velocity mm/sec Peak	Vertical Sensitivity	U <sub>95</sub> %

**Note1:**

The laboratory has accreditation under ISO/IEC 17025 from NATA for calibration to ISO 16063-21 at frequencies from 0.5 Hz. Measurements at all frequencies and levels shown in the table above are made using reference equipment traceably calibrated to Australian National Standards.

**Note2:**

The uncertainties quoted are estimated at a confidence level of 95% and a coverage factor of k=2 applies unless otherwise stated.



**Health Infrastructure**

# **Children's Hospital Westmead**

**Vibration Monitoring - WIMR - BSF  
Mice Holding Room - Rack - March 2024**

CVM/ WIMR/202403

Issue 1 | 10/04/2024

This report takes into account the particular instructions and requirements of our client.

It is not intended for and should not be relied upon by any third party and no responsibility is undertaken to any third party.

Job number 271985

Arup Pty Ltd ABN 18 000 966 165

**Arup Pty Ltd**

Level 5

151 Clarence Street

Sydney NSW 2000

Australia

[www.arup.com](http://www.arup.com)






## Document Verification

**Project title** Children's Hospital Westmead  
**Document title** Monthly Vibration Monitoring Report  
**Job number** 271985  
**Document ref** CVM/WIMR/202403  
**File reference** -

Revision	Date	Filename
		Westmead Hospital – 103678 WIMR - BSF Mice Holding Room - Rack - Summary of Recent Vibration Measurements (01-03 to 31-03).docx

Issue	Date	Description
Issue 1	10/04/2024	Issue

	Prepared by	Checked by	Approved by
<b>Name</b>	PR	MJW	MJW
<b>Signature</b>			

Filename		
Description		
Prepared by	Checked by	Approved by
Name		
Signature		

Filename		
Description		
Prepared by	Checked by	Approved by
Name		
Signature		

Issue Document Verification with Document



# Contents

---

Executive Summary.....	3
<b>1.</b> Introduction .....	5
<b>2.</b> Monitor Location .....	5
<b>3.</b> Recorded Data .....	6
Appendix A: Calibration Certificates.....	8

# Executive Summary

This report summarises the vibration monitoring data recorded at WIMR - BSF Mice Holding Room - Rack, over one month – from 01/03/2024 to 31/03/2024. Graphs in this report show the recorded data in blue, and exceedance trigger levels in red.

## RMSV Vibration Levels

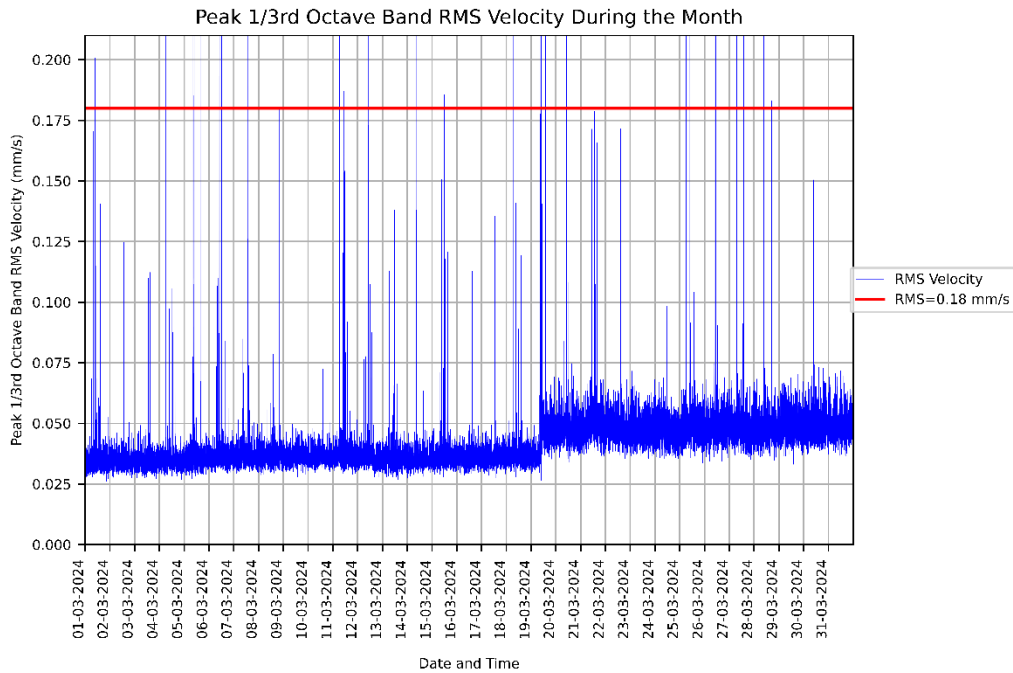


Figure 1: Measured RMSV vibration levels for 01/03/2024 to 31/03/2024 at the WIMR - BSF Mice Holding Room - Rack.

The table below summarises the number of Root-Mean-Square Velocity (RMSV) limit exceedances recorded during and outside of construction hours.

During Construction Hours	Outside of Construction Hours
32	5

## PPV Vibration Levels

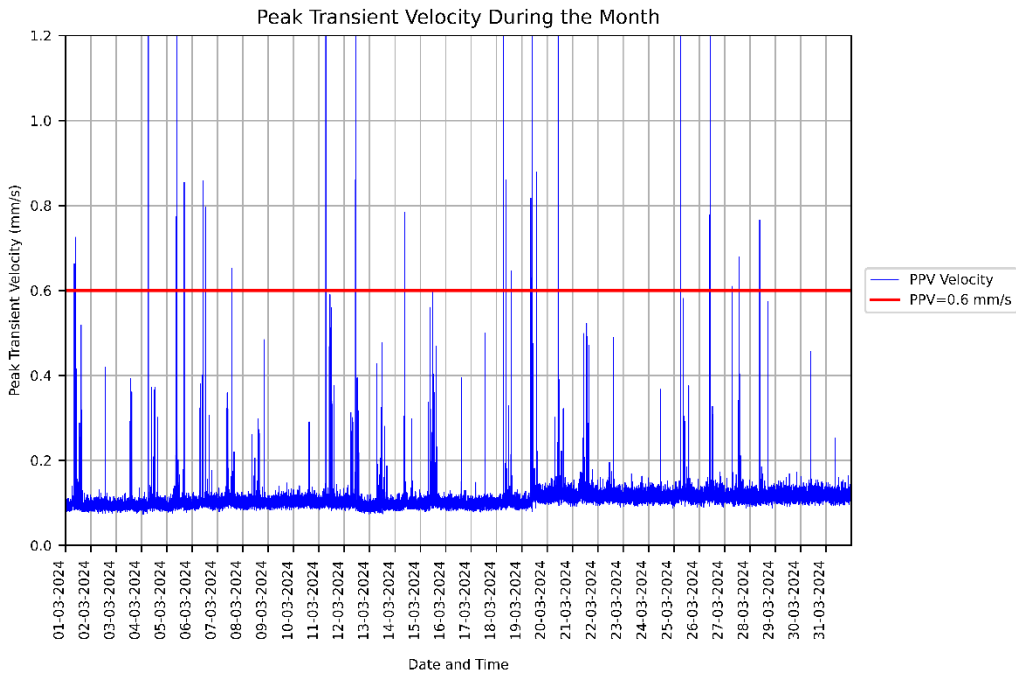


Figure 2: Measured vibration levels for 01/03/2024 to 31/03/2024 at the WIMR - BSF Mice Holding Room - Rack.

The table below summarises the number of Peak Particle Velocity (PPV) limit exceedances recorded during and outside of construction hours.

During Construction Hours	Outside of Construction Hours
27	10

# 1. Introduction

Arup has been commissioned by PricewaterhouseCoopers (PwC) on behalf of NSW Health Infrastructure to monitor vibration levels in facilities adjacent to the VVMF Innovation Centre development sites to ensure facility operations are not excessively impacted by the construction works. This report summarises the vibration monitoring data recorded at WIMR - BSF Mice Holding Room - Rack during the period of the 01/03/2024 to 31/03/2024.

For the purposes of reporting, construction works are considered to be occurring at the following times:

Day	Construction Hours
Monday to Friday	7:00am to 6:00pm
Saturday	8:00am to 1:00pm
Sunday	No works
Public Holidays	No works

# 2. Monitor Location

The location of this monitor is shown below in Figure 3.

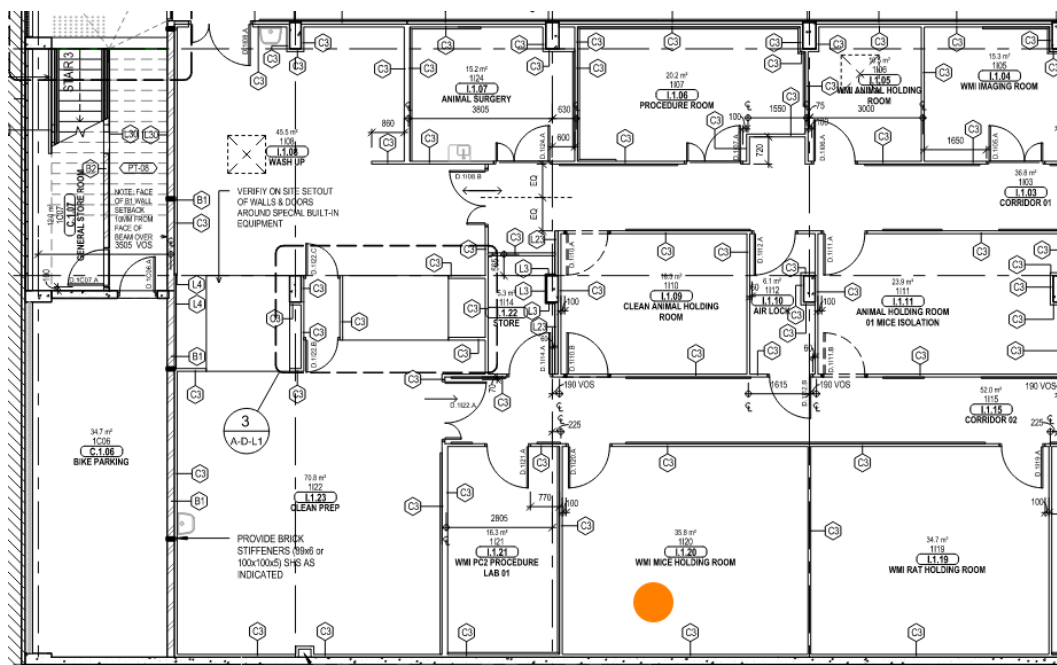


Figure 3: WIMR - BSF Mice Holding Room - Rack vibration monitor location

Monitoring at this location utilises a GeoSIG GMSplus with a GeoSIG VE-11 geophone. The calibration certificate for the geophone is included in Appendix A.

### 3. Recorded Data

Figure 4 below shows the vibration levels (RMS velocity) recorded between 01/03/2024 and 31/03/2024. The recorded data is shown in blue, while the limit of 0.18mm/s ( $V_{RMS}$ ) is shown in red.

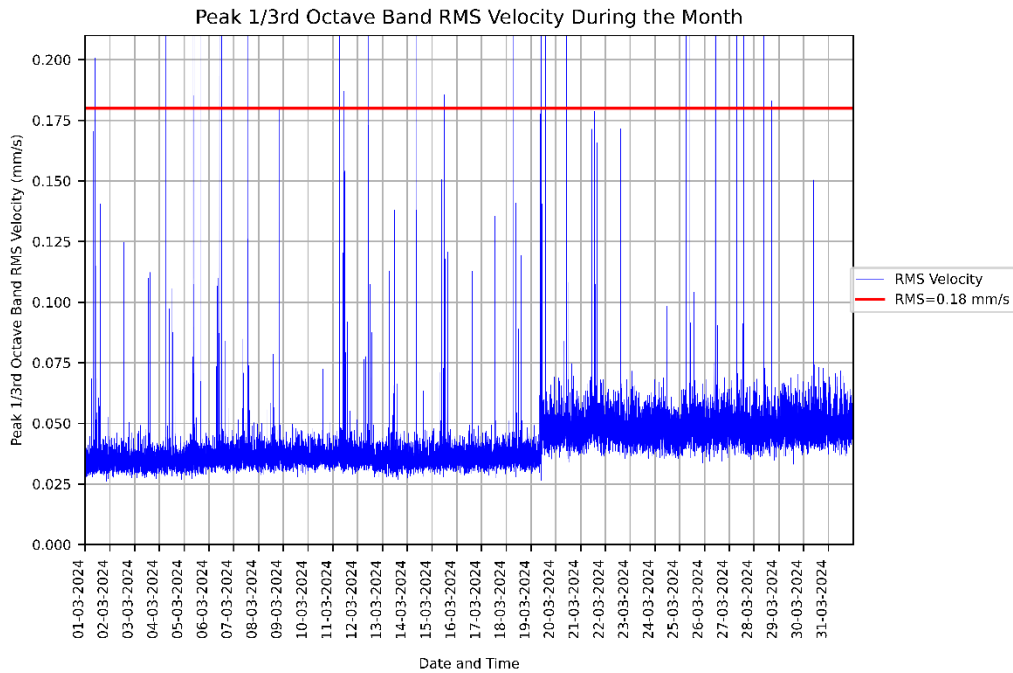


Figure 4: Measured RMSV vibration levels for 01/03/2024 to 31/03/2024 at the WIMR - BSF Mice Holding Room - Rack.

The table below summarises the number of RMS Velocity limit exceedances recorded during and outside of construction hours.

During Construction Hours	Outside of Construction Hours
32	5

Figure 5 below shows the peak particle vibration levels (PPV velocity) recorded between 01/03/2024 and 31/03/2024. The recorded data is shown in blue, while the limit of 0.6mm/s ( $V_{PPV}$ ) is shown in red.

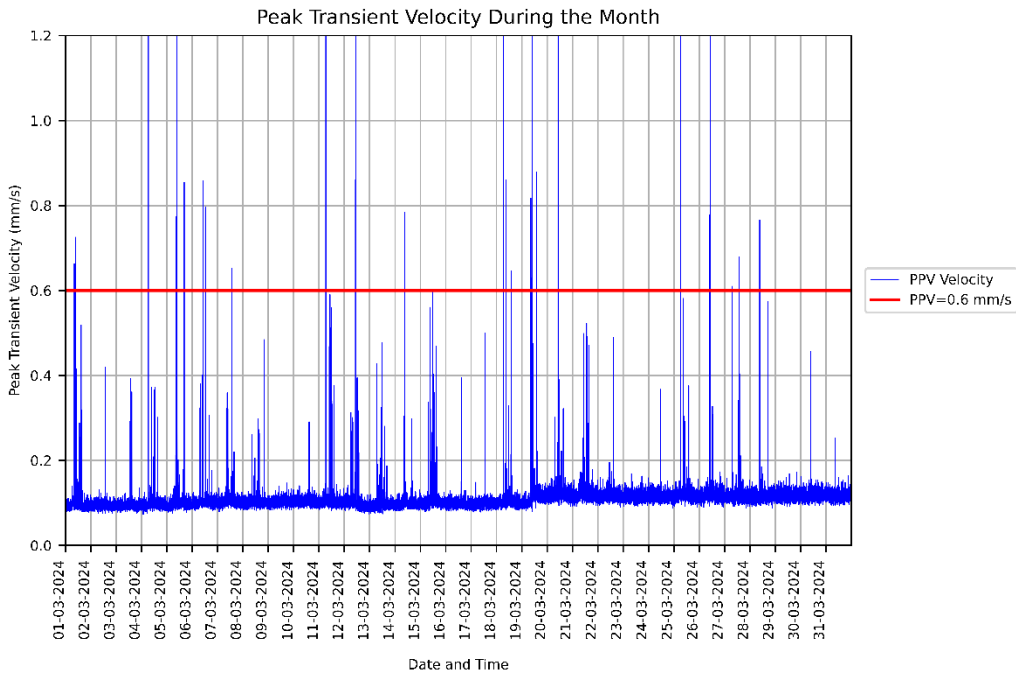


Figure 5: Measured PPV vibration levels for 01/03/2024 to 31/03/2024 at the WIMR - BSF Mice Holding Room - Rack.

The table below summarises the number of PPV limit exceedances recorded during and outside of construction hours.

During Construction Hours	Outside of Construction Hours
27	10

## Appendix A: Calibration Certificates

---

**Test Record GMSplus**

<b>Test Record</b>	1	<b>Job</b>	31057
<b>S/N</b>	103677	<b>Test Procedure</b>	GS_GMSplus_TestProcedure_V01

<b>Customer</b>	AU_ARUP_Riddet	<b>Date</b>	01.02.2018
		<b>Tested by</b>	Ross Baradoy

<b>Model</b>	GMSplus	103677	<b>Option 1</b>		
<b>Type</b>	3Ch		<b>Option 2</b>		
<b>Description</b>	Recorder		<b>Option 3</b>		
<b>Main board</b>	GS_IA18_S-MN.V06.H2	160281	<b>Option 4</b>		
<b>Conn. board</b>	GS_IA18_S-MN.V06.H2	160305	<b>Option 5</b>		
<b>Input range</b>	± 10 V DIFF		<b>Option 6</b>		
<b>Sensor 1</b>	VE-11	56865	<b>Ext. Option 1</b>	GXX-3GUE	17738
<b>Sensor 2</b>	0		<b>Ext. Option 2</b>		
<b>Power</b>	15 VDC		<b>Ext. Option 3</b>		
<b>Armdas/Predas</b>	21.12.16		<b>MAC</b>	8C:8E:76:00:C2:01	
<b>Linux</b>	gms-linux-firmware-r121_20170321.gsfw		<b>DSP</b>	51.03.05	
			<b>RTC</b>	80.02.03	

**Remarks:**

**1. Test Equipment**

1.1. Test equipment is as per list and ready	<input checked="" type="checkbox"/> Ok
--	--

**2. Visual Check**

2.1. No defects found during visual check	<input checked="" type="checkbox"/> Ok
---	--

**3. Configuration**

3.1. Description	GMSplus GeoSIG Ltd
3.2. Memory	8 GB
3.3. Station	GSGMS
3.4. Location	Australia
3.5. Sampling rate	200 SPS
3.6. Units	mm/s
3.7. LSB value	0.0000132500000mm/s /count
3.8. Pre event	5 s
3.9. Post event	10 s
3.10. Trigger level	2 and 3 mm/s
3.11. Alarms Trigger level	n/a

**4. Sensor input test**

4.1. AC input test	<input checked="" type="checkbox"/> Ok
4.2. DC input test	<input checked="" type="checkbox"/> Ok
4.3. Noise test	<input checked="" type="checkbox"/> Ok



**5. Real sensor test**

5.1. Test pulse	<input checked="" type="checkbox"/> Ok	<input type="checkbox"/> n/a
5.2. Event X-Y-Z	<input checked="" type="checkbox"/> Ok	<input type="checkbox"/> n/a
5.3. Tilt	<input checked="" type="checkbox"/> Ok	<input type="checkbox"/> n/a
5.4. Over range	<input checked="" type="checkbox"/> Ok	<input type="checkbox"/> n/a

**6. Options testing**

6.1. GMS-Wi-Fi	<input type="checkbox"/> Ok	<input checked="" type="checkbox"/> n/a
6.2. GMS-GPS	<input type="checkbox"/> Ok	<input checked="" type="checkbox"/> n/a
6.3. GXX-3GUM	<input checked="" type="checkbox"/> Ok	<input type="checkbox"/> n/a
6.4. ALC, Config:	<input type="checkbox"/> Ok	<input checked="" type="checkbox"/> n/a
6.5. GMS-Interconnection	<input type="checkbox"/> Ok	<input checked="" type="checkbox"/> n/a
6.6. Serial modem	<input type="checkbox"/> Ok	<input checked="" type="checkbox"/> n/a
6.7. Ethernet modem	<input type="checkbox"/> Ok	<input checked="" type="checkbox"/> n/a
6.8. Sensor junction box	<input type="checkbox"/> Ok	<input checked="" type="checkbox"/> n/a

**7. Physical inspection**

7.1. Housing	<input checked="" type="checkbox"/> Ok
7.2. Fixation and screws	<input checked="" type="checkbox"/> Ok
7.3. Cables and connectors	<input checked="" type="checkbox"/> Ok
7.4. Labels	<input checked="" type="checkbox"/> Ok
7.5. Cleanness	<input checked="" type="checkbox"/> Ok

**8. Configuration backup**

8.1. Instrument configuration (*.xml)	<input checked="" type="checkbox"/> Ok
8.2. Software configuration (*.gsc)	<input checked="" type="checkbox"/> Ok
8.3. Test files archived	<input checked="" type="checkbox"/> Ok

**Final Acceptance**

All tests were executed according to the test procedure and all results were checked and are according to the specifications.

Tested by                      Ross Baradoy                                            on                      26.02.2018

Approved by                      Tobias Liesching                                            on                      02.03.2018