

TEST REPORT

March 05, 2024

Australasian Technical Services (NSW) Pty Ltd
9 Phiney Place
INGLEBURN NSW 2565

Your Reference: Royal Prince Alfred Hospital – Redevelopment Works
Job Number: 70836

Attention: Sam Chea

Dear Sam,

In accordance with your instructions, Airsafe conducted air monitoring for airborne asbestos fibres at the above site.

The following samples were processed on the dates indicated.

Samples:	3 Filters
Date of Sampling:	04/03/24
Date of Analysis:	05/03/24
Date of Preliminary Report Sent:	Not Issued

The results are contained in the following pages of this report.

Should you have any queries regarding this report please contact the undersigned.

Yours faithfully
AIRSAFE LABORATORIES PTY LTD



Jonathon Stephens
Approved Counter and Signatory

PROJECT: Royal Prince Alfred Hospital – Redevelopment Works

JOB NO: 70836

Sample No	Location/Reference	Time		Total Time [min]	Air Flow Average [L/min]	Fields	Fibres	Concentration (Fibres/mL)
		On	Off					
70836 – 313	Metro – Redevelopment Works – Location 1	0725	1620	535	2.0	100	0	<0.01
70836 – 314	Stowe – Redevelopment Works – Location 3	0726	1621	535	2.0	100	1	<0.01
70836 – 315	Stowe – Redevelopment Works – Location 4	0728	1622	534	2.0	100	2	<0.01

Method: Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)] and in-house method AS101 – Membrane Filter Method for Estimating Airborne Asbestos Fibres.

Sampling: All samples have been taken by Airsafe personnel in accordance with the sampling plan detailed in method AS101.

Location of Laboratory Activities: Level 1, 488 Botany Road, Beaconsfield NSW 2015 Australia.

Quality Control: A field blank is taken and analysed for each batch of samples.

Environmental Conditions: Background air monitoring during removal works.

Comment: These calculated concentrations are less than the reporting limit of 0.01 fibres/mL for control and exposure monitoring as stated in the Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)].

Disclaimer: N/A

Sampled By: Pamela Mavroidis, Licensed Asbestos Assessor [SafeWork NSW Licence No LAA 002067].

Note: The measured results fall within a 95% confidence interval (calculated using a coverage factor of 2) in accordance with the NOHSC:3003(2005). The results relate only to the samples tested.


NATA is a signatory to the ILAC Mutual Recognition Arrangement for the mutual recognition of the equivalence of testing, medical testing, calibration, inspection, proficiency testing scheme providers and reference materials producers reports and certificates.

Airsafe shall not be liable for loss, cost, damages or expenses incurred by the client, or any other person or company, resulting from the use of any information or interpretation given in this report. In no case shall Airsafe be liable for consequential damages including, but not limited to, lost profits, damages for failure to meet deadlines and lost production arising from this report.

Any other holder of this document is advised that information contained hereon reflects Airsafe's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Airsafe's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents.

SITE MAP

Figure 1. Air Monitoring Locations

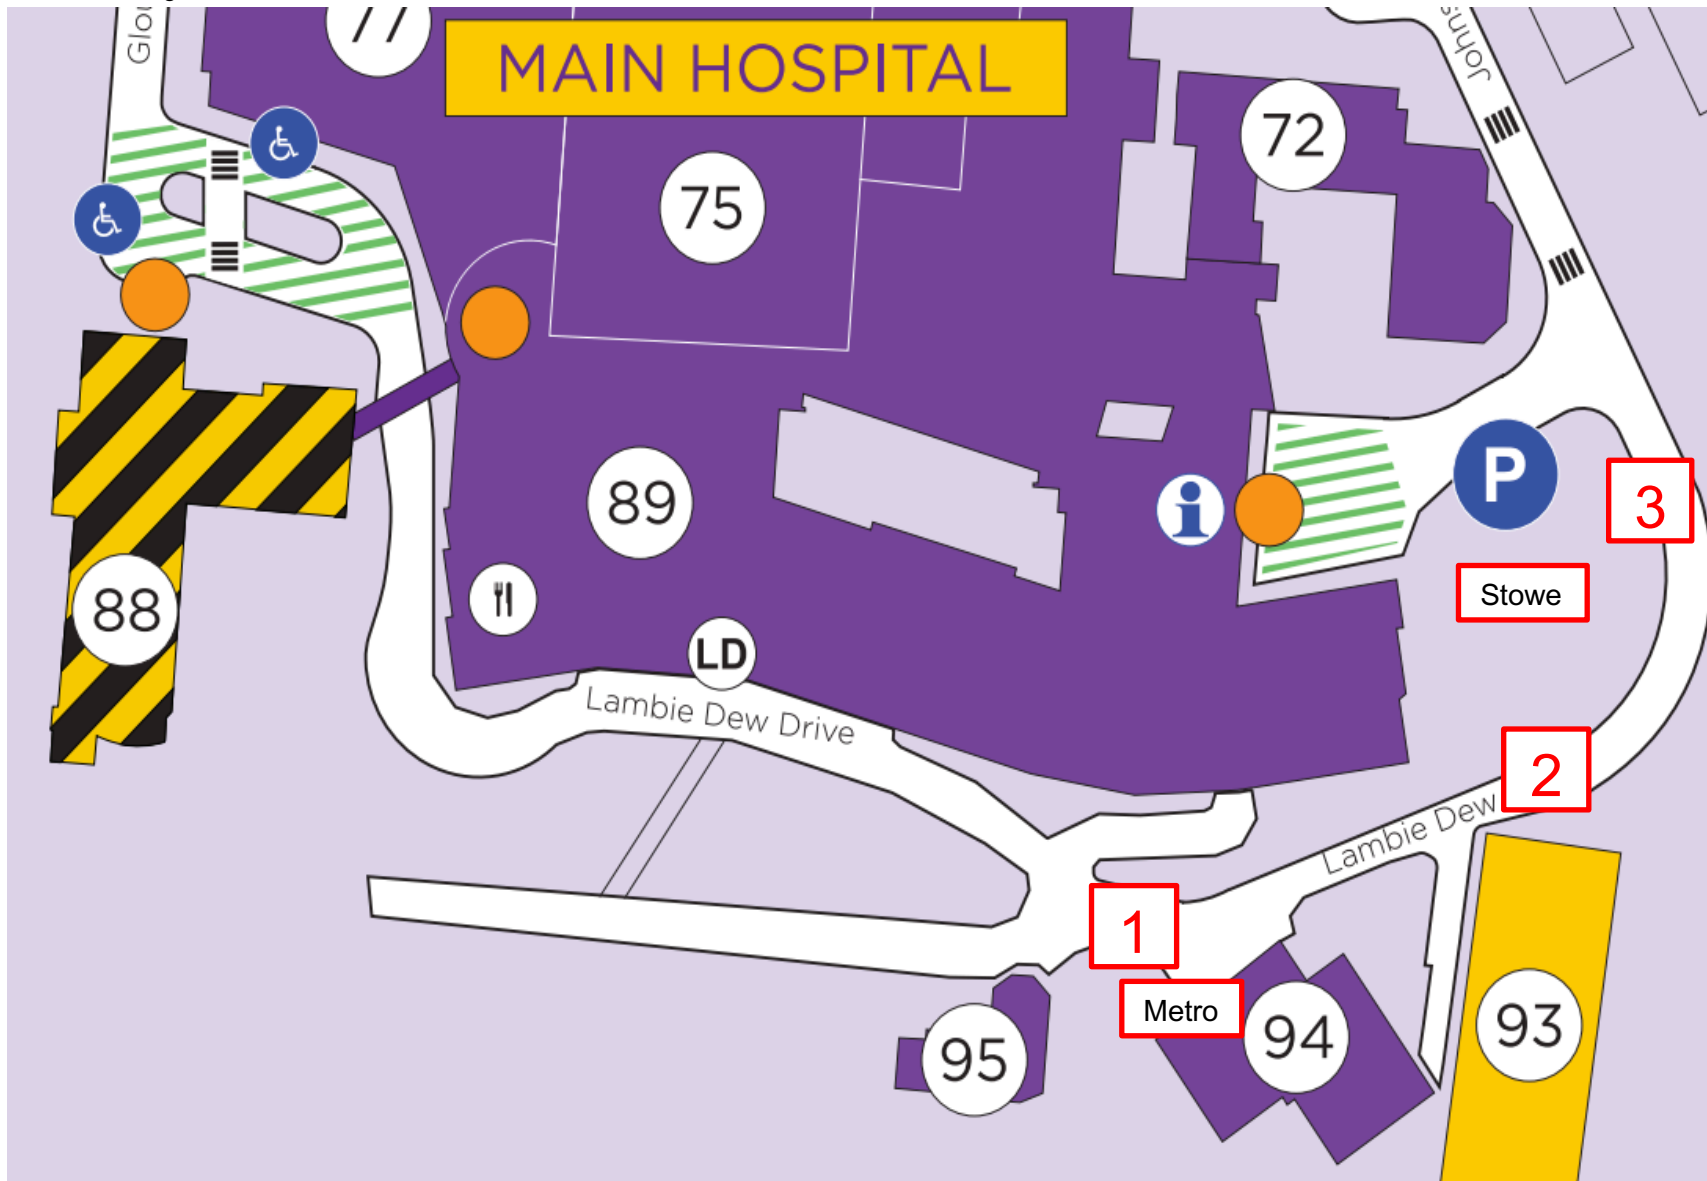

TEST REPORT

March 06, 2024

Australasian Technical Services (NSW) Pty Ltd
9 Phiney Place
INGLEBURN NSW 2565

Your Reference: Royal Prince Alfred Hospital – Redevelopment Works
Job Number: 70836

Attention: Sam Chea

Dear Sam,

In accordance with your instructions, Airsafe conducted air monitoring for airborne asbestos fibres at the above site.

The following samples were processed on the dates indicated.

Samples:	3 Filters
Date of Sampling:	05/03/24
Date of Analysis:	06/03/24
Date of Preliminary Report Sent:	Not Issued

The results are contained in the following pages of this report.

Should you have any queries regarding this report please contact the undersigned.

Yours faithfully
AIRSAFE LABORATORIES PTY LTD



Jonathon Stephens
Approved Counter and Signatory

PROJECT: Royal Prince Alfred Hospital – Redevelopment Works

JOB NO: 70836

Sample No	Location/Reference	Time		Total Time [min]	Air Flow Average [L/min]	Fields	Fibres	Concentration (Fibres/mL)
		On	Off					
70836 – 316	Metro – Redevelopment Works – Location 1	0734	1538	484	2.0	100	0	<0.01
70836 – 317	Stowe – Redevelopment Works – Location 3	0736	1539	483	2.0	100	0	<0.01
70836 – 318	Stowe – Redevelopment Works – Location 4	0738	1541	483	2.0	100	0	<0.01

Method: Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)] and in-house method AS101 – Membrane Filter Method for Estimating Airborne Asbestos Fibres.

Sampling: All samples have been taken by Airsafe personnel in accordance with the sampling plan detailed in method AS101.

Location of Laboratory Activities: Level 1, 488 Botany Road, Beaconsfield NSW 2015 Australia.

Quality Control: A field blank is taken and analysed for each batch of samples.

Environmental Conditions: Background air monitoring during removal works.

Comment: These calculated concentrations are less than the reporting limit of 0.01 fibres/mL for control and exposure monitoring as stated in the Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)].

Disclaimer: N/A

Sampled By: Pamela Mavroidis, Licensed Asbestos Assessor [SafeWork NSW Licence No LAA 002067].

Note: The measured results fall within a 95% confidence interval (calculated using a coverage factor of 2) in accordance with the NOHSC:3003(2005). The results relate only to the samples tested.


NATA is a signatory to the ILAC Mutual Recognition Arrangement for the mutual recognition of the equivalence of testing, medical testing, calibration, inspection, proficiency testing scheme providers and reference materials producers reports and certificates.

Airsafe shall not be liable for loss, cost, damages or expenses incurred by the client, or any other person or company, resulting from the use of any information or interpretation given in this report. In no case shall Airsafe be liable for consequential damages including, but not limited to, lost profits, damages for failure to meet deadlines and lost production arising from this report.

Any other holder of this document is advised that information contained hereon reflects Airsafe's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Airsafe's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents.

SITE MAP

Figure 1. Air Monitoring Locations

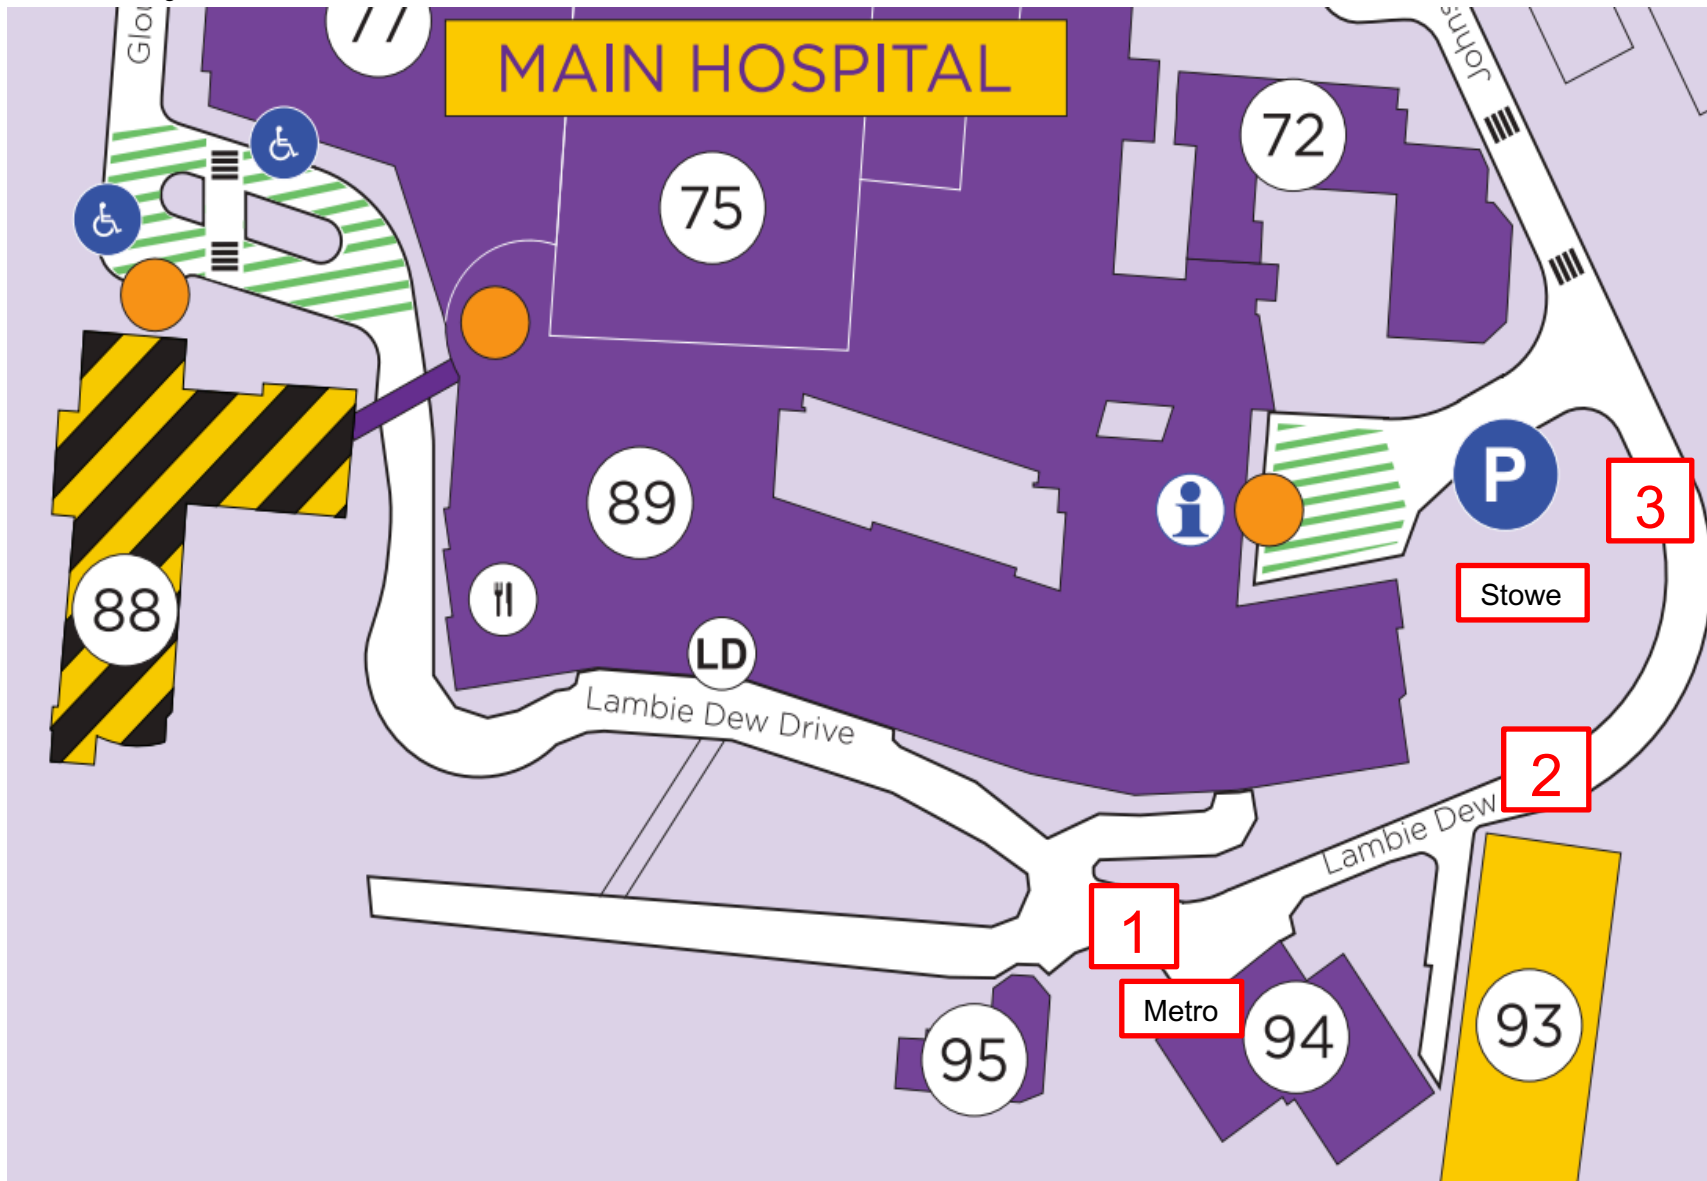

TEST REPORT

March 07, 2024

Australasian Technical Services (NSW) Pty Ltd
9 Phiney Place
INGLEBURN NSW 2565

Your Reference: Royal Prince Alfred Hospital – Redevelopment Works
Job Number: 70836

Attention: Sam Chea

Dear Sam,

In accordance with your instructions, Airsafe conducted air monitoring for airborne asbestos fibres at the above site.

The following samples were processed on the dates indicated.

Samples:	4 Filters
Date of Sampling:	06/03/24
Date of Analysis:	07/03/24
Date of Preliminary Report Sent:	Not Issued

The results are contained in the following pages of this report.

Should you have any queries regarding this report please contact the undersigned.

Yours faithfully
AIRSAFE LABORATORIES PTY LTD



Jonathon Stephens
Approved Counter and Signatory

PROJECT: Royal Prince Alfred Hospital – Redevelopment Works

JOB NO: 70836

Sample No	Location/Reference	Time		Total Time [min]	Air Flow Average [L/min]	Fields	Fibres	Concentration (Fibres/mL)
		On	Off					
70836 – 319	Metro – Redevelopment Works – Location 1	0705	1533	508	2.0	100	0	<0.01
70836 – 320	Metro – Redevelopment Works – Location 2	0706	1535	510	2.0	100	2	<0.01
70836 – 321	Stowe – Redevelopment Works – Location 3	0708	1539	511	2.0	100	0	<0.01
70836 – 322	Stowe – Redevelopment Works – Location 4	0710	1542	512	2.0	100	0	<0.01

Method: Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)] and in-house method AS101 – Membrane Filter Method for Estimating Airborne Asbestos Fibres.

Sampling: All samples have been taken by Airsafe personnel in accordance with the sampling plan detailed in method AS101.

Location of Laboratory Activities: Level 1, 488 Botany Road, Beaconsfield NSW 2015 Australia.

Quality Control: A field blank is taken and analysed for each batch of samples.

Environmental Conditions: Background air monitoring during removal works.

Comment: These calculated concentrations are less than the reporting limit of 0.01 fibres/mL for control and exposure monitoring as stated in the Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)].

Disclaimer: N/A

Sampled By: Pamela Mavroidis, Licensed Asbestos Assessor [SafeWork NSW Licence No LAA 002067].

Note: The measured results fall within a 95% confidence interval (calculated using a coverage factor of 2) in accordance with the NOHSC:3003(2005). The results relate only to the samples tested.

NATA is a signatory to the ILAC Mutual Recognition Arrangement for the mutual recognition of the equivalence of testing, medical testing, calibration, inspection, proficiency testing scheme providers and reference materials producers reports and certificates.


Airsafe shall not be liable for loss, cost, damages or expenses incurred by the client, or any other person or company, resulting from the use of any information or interpretation given in this report. In no case shall Airsafe be liable for consequential damages including, but not limited to, lost profits, damages for failure to meet deadlines and lost production arising from this report.

Any other holder of this document is advised that information contained hereon reflects Airsafe’s findings at the time of its intervention only and within the limits of Client’s instructions, if any. The Airsafe’s sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents.



SITE MAP

Figure 1. Air Monitoring Locations

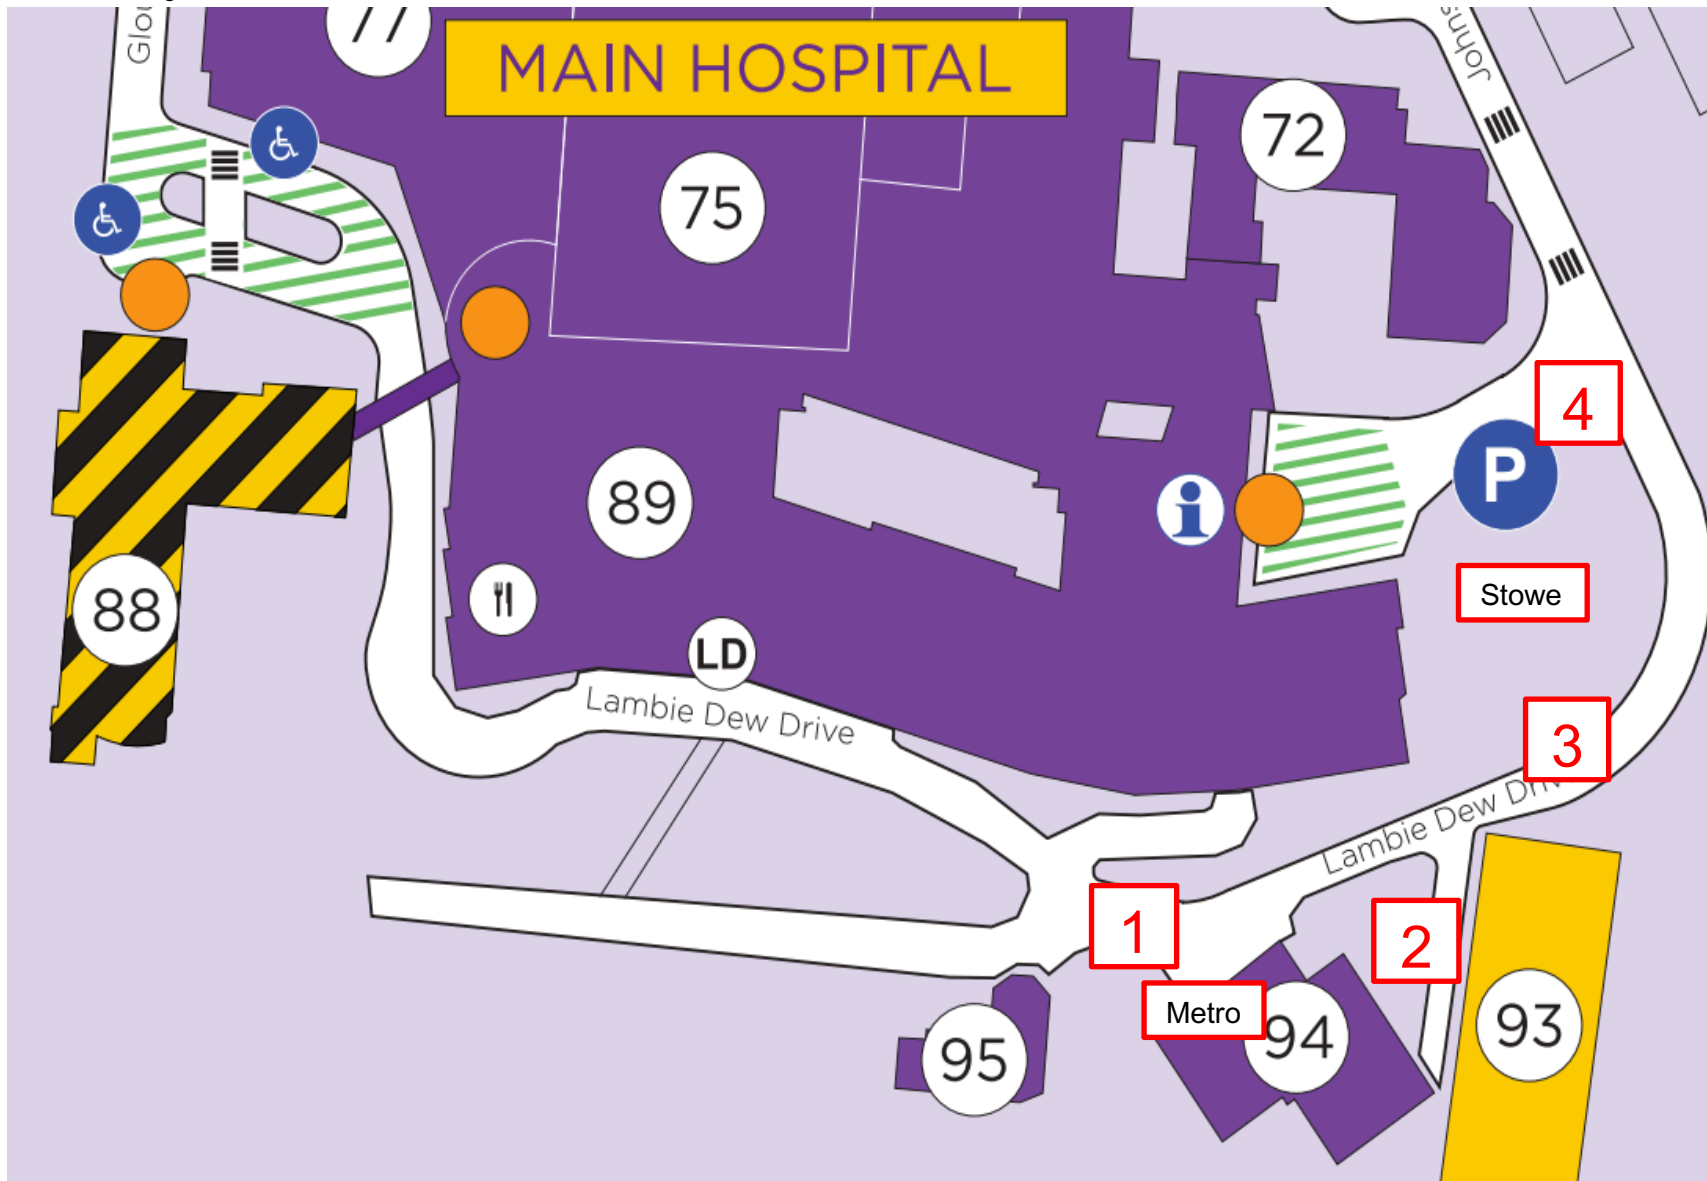

TEST REPORT

March 08, 2024

Australasian Technical Services (NSW) Pty Ltd
9 Phiney Place
INGLEBURN NSW 2565

Your Reference: Royal Prince Alfred Hospital – Redevelopment Works
Job Number: 70836

Attention: Sam Chea

Dear Sam,

In accordance with your instructions, Airsafe conducted air monitoring for airborne asbestos fibres at the above site.

The following samples were processed on the dates indicated.

Samples:	6 Filters
Date of Sampling:	07/03/24
Date of Analysis:	08/03/24
Date of Preliminary Report Sent:	Not Issued

The results are contained in the following pages of this report.

Should you have any queries regarding this report please contact the undersigned.

Yours faithfully
AIRSAFE LABORATORIES PTY LTD



Jonathon Stephens
Approved Counter and Signatory

PROJECT: Royal Prince Alfred Hospital – Redevelopment Works

JOB NO: 70836

Sample No	Location/Reference	Time		Total Time [min]	Air Flow Average [L/min]	Fields	Fibres	Concentration (Fibres/mL)
		On	Off					
70836 – 323	Metro – Redevelopment Works – Location 1	0708	1556	528	2.0	100	0	<0.01
70836 – 324	Metro – Redevelopment Works – Location 2	0710	1556	526	2.0	100	0	<0.01
70836 – 325	Metro – Redevelopment Works – Location 3	0712	1557	525	2.0	100	0	<0.01
70836 – 326	Metro – Redevelopment Works – Location 4	0713	1558	525	2.0	100	0	<0.01
70836 – 327	Stowe – Redevelopment Works – Location 5	0718	1559	521	2.0	100	0	<0.01
70836 – 328	Stowe – Redevelopment Works – Location 6	0719	1601	522	2.0	100	0	<0.01

Method: Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)] and in-house method AS101 – Membrane Filter Method for Estimating Airborne Asbestos Fibres.

Sampling: All samples have been taken by Airsafe personnel in accordance with the sampling plan detailed in method AS101.

Location of Laboratory Activities: Level 1, 488 Botany Road, Beaconsfield NSW 2015 Australia.

Quality Control: A field blank is taken and analysed for each batch of samples.

Environmental Conditions: Background air monitoring during removal works.

Comment: These calculated concentrations are less than the reporting limit of 0.01 fibres/mL for control and exposure monitoring as stated in the Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)].

Disclaimer: N/A

Sampled By: Pamela Mavroidis, Licensed Asbestos Assessor [SafeWork NSW Licence No LAA 002067].

Note: The measured results fall within a 95% confidence interval (calculated using a coverage factor of 2) in accordance with the NOHSC:3003(2005). The results relate only to the samples tested.


NATA is a signatory to the ILAC Mutual Recognition Arrangement for the mutual recognition of the equivalence of testing, medical testing, calibration, inspection, proficiency testing scheme providers and reference materials producers reports and certificates.

Airsafe shall not be liable for loss, cost, damages or expenses incurred by the client, or any other person or company, resulting from the use of any information or interpretation given in this report. In no case shall Airsafe be liable for consequential damages including, but not limited to, lost profits, damages for failure to meet deadlines and lost production arising from this report.

Any other holder of this document is advised that information contained hereon reflects Airsafe's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Airsafe's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents.

SITE MAP

Figure 1. Air Monitoring Locations

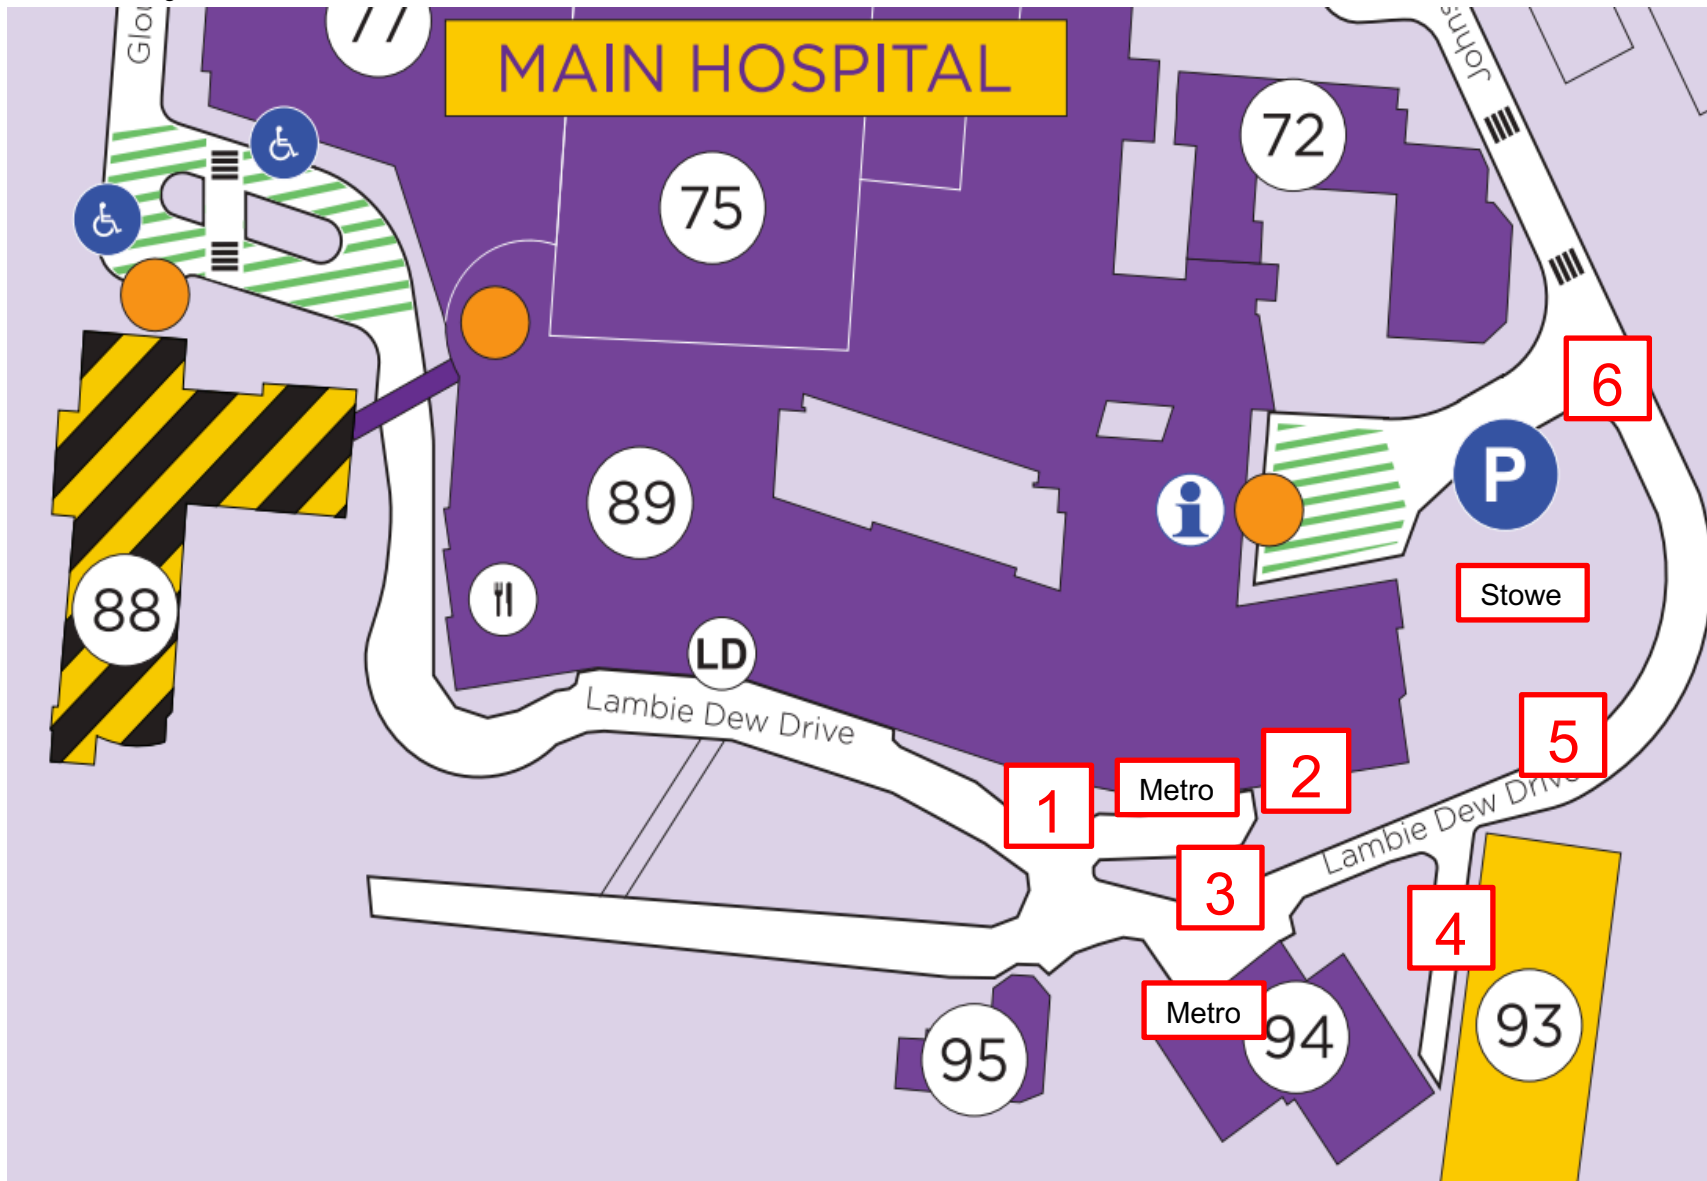

TEST REPORT

March 11, 2024

Australasian Technical Services (NSW) Pty Ltd
9 Phiney Place
INGLEBURN NSW 2565

Your Reference: Royal Prince Alfred Hospital – Redevelopment Works
Job Number: 70836

Attention: Sam Chea

Dear Sam,

In accordance with your instructions, Airsafe conducted air monitoring for airborne asbestos fibres at the above site.

The following samples were processed on the dates indicated.

Samples:	6 Filters
Date of Sampling:	08/03/24
Date of Analysis:	11/03/24
Date of Preliminary Report Sent:	Not Issued

The results are contained in the following pages of this report.

Should you have any queries regarding this report please contact the undersigned.

Yours faithfully
AIRSAFE LABORATORIES PTY LTD



Jonathon Stephens
Approved Counter and Signatory

PROJECT: Royal Prince Alfred Hospital – Redevelopment Works

JOB NO: 70836

Sample No	Location/Reference	Time		Total Time [min]	Air Flow Average [L/min]	Fields	Fibres	Concentration (Fibres/mL)
		On	Off					
70836 – 329	Metro – Redevelopment Works – Location 1	0657	1536	519	2.0	100	7	<0.01
70836 – 330	Metro – Redevelopment Works – Location 2	0658	1537	519	2.0	100	3	<0.01
70836 – 331	Metro – Redevelopment Works – Location 3	0659	1539	520	2.0	100	1	<0.01
70836 – 332	Metro – Redevelopment Works – Location 4	0700	1541	521	2.0	100	4	<0.01
70836 – 333	Stowe – Redevelopment Works – Location 5	0702	1542	520	2.0	100	0	<0.01
70836 – 334	Stowe – Redevelopment Works – Location 6	0703	1544	521	2.0	100	3	<0.01

Method: Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)] and in-house method AS101 – Membrane Filter Method for Estimating Airborne Asbestos Fibres.

Sampling: All samples have been taken by Airsafe personnel in accordance with the sampling plan detailed in method AS101.

Location of Laboratory Activities: Level 1, 488 Botany Road, Beaconsfield NSW 2015 Australia.

Quality Control: A field blank is taken and analysed for each batch of samples.

Environmental Conditions: Background air monitoring during removal works.

Comment: These calculated concentrations are less than the reporting limit of 0.01 fibres/mL for control and exposure monitoring as stated in the Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)].

Disclaimer: N/A

Sampled By: Pamela Mavroidis, Licensed Asbestos Assessor [SafeWork NSW Licence No LAA 002067].

Note: The measured results fall within a 95% confidence interval (calculated using a coverage factor of 2) in accordance with the NOHSC:3003(2005). The results relate only to the samples tested.


NATA is a signatory to the ILAC Mutual Recognition Arrangement for the mutual recognition of the equivalence of testing, medical testing, calibration, inspection, proficiency testing scheme providers and reference materials producers reports and certificates.

Airsafe shall not be liable for loss, cost, damages or expenses incurred by the client, or any other person or company, resulting from the use of any information or interpretation given in this report. In no case shall Airsafe be liable for consequential damages including, but not limited to, lost profits, damages for failure to meet deadlines and lost production arising from this report.

Any other holder of this document is advised that information contained hereon reflects Airsafe's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Airsafe's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents.

SITE MAP

Figure 1. Air Monitoring Locations

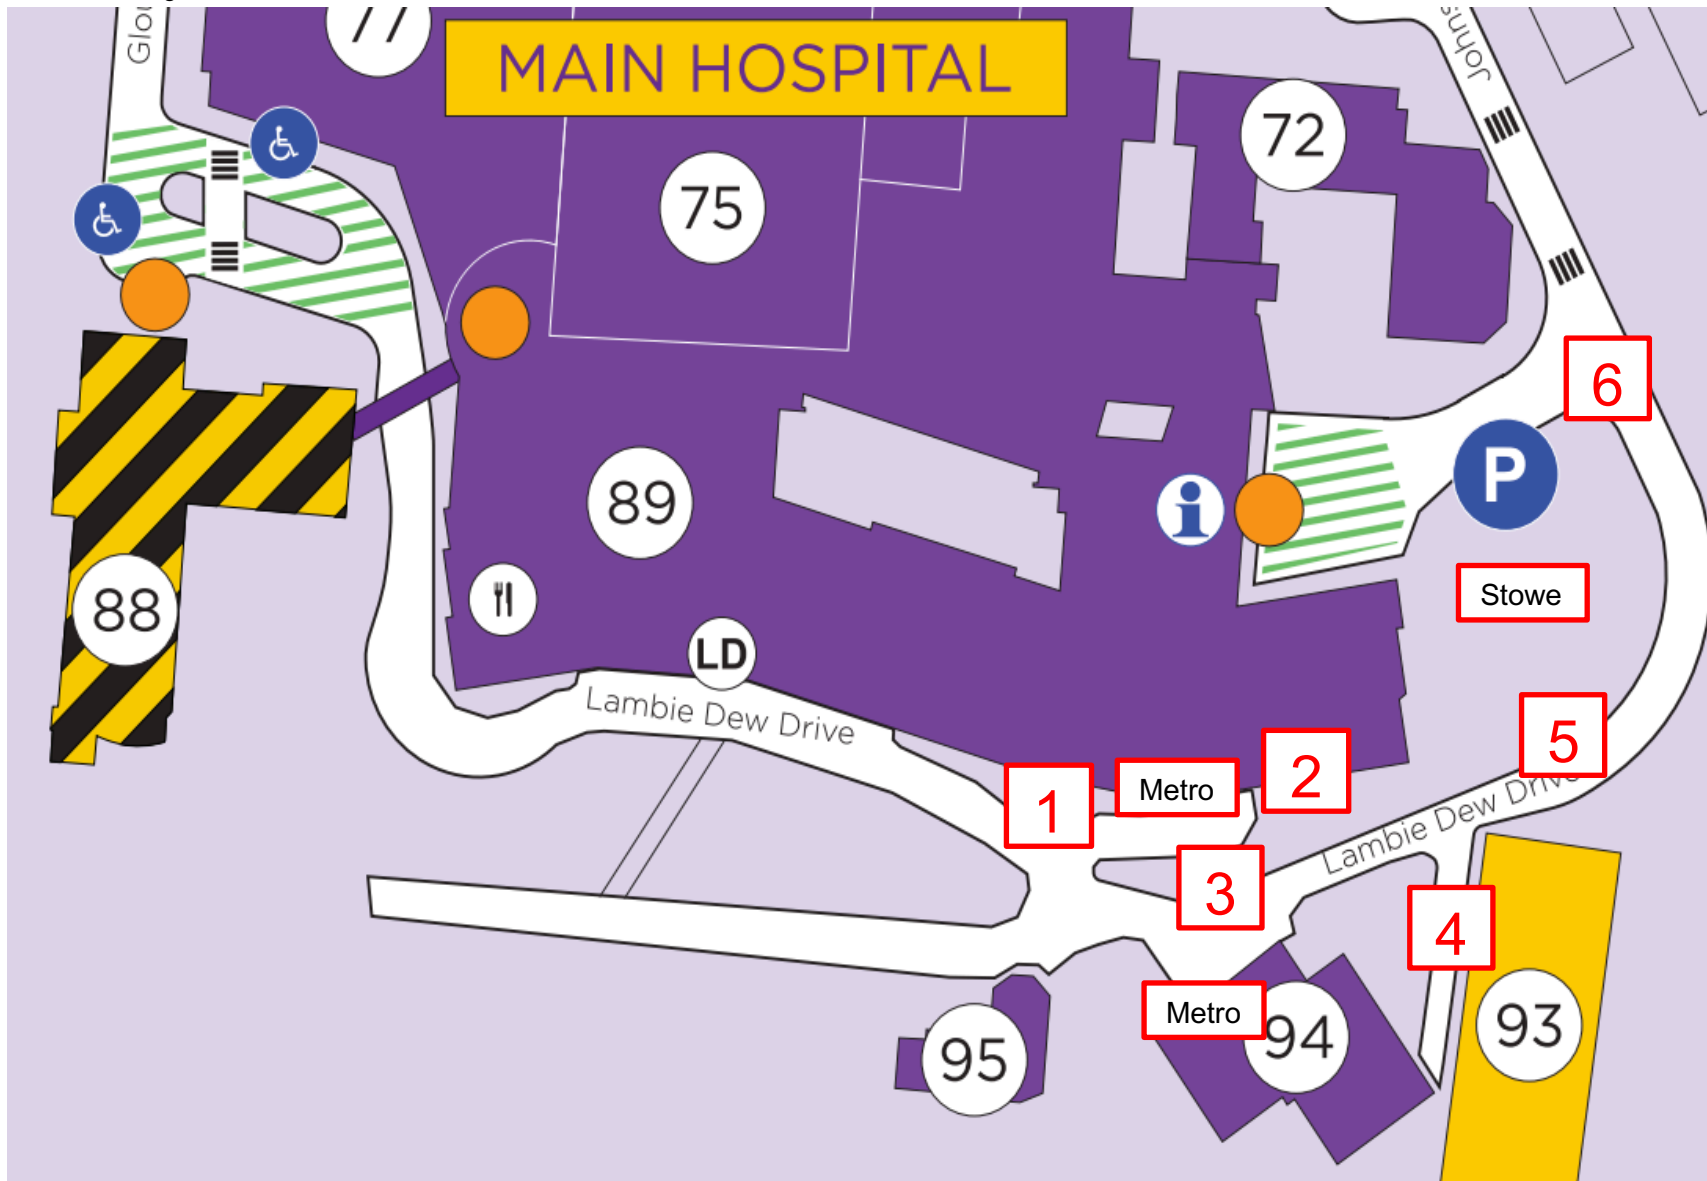

TEST REPORT

March 12, 2024

Australasian Technical Services (NSW) Pty Ltd
9 Phiney Place
INGLEBURN NSW 2565

Your Reference: Royal Prince Alfred Hospital – Redevelopment Works
Job Number: 70836

Attention: Sam Chea

Dear Sam,

In accordance with your instructions, Airsafe conducted air monitoring for airborne asbestos fibres at the above site.

The following samples were processed on the dates indicated.

Samples:	8 Filters
Date of Sampling:	11/03/24
Date of Analysis:	12/03/24
Date of Preliminary Report Sent:	Not Issued

The results are contained in the following pages of this report.

Should you have any queries regarding this report please contact the undersigned.

Yours faithfully
AIRSAFE LABORATORIES PTY LTD



Jonathon Stephens
Approved Counter and Signatory

PROJECT: Royal Prince Alfred Hospital – Redevelopment Works

JOB NO: 70836

Sample No	Location/Reference	Time		Total Time [min]	Air Flow Average [L/min]	Fields	Fibres	Concentration (Fibres/mL)
		On	Off					
70836 – 335	ATS – Asbestos Removal – Location 1	0715	1513	478	2.0	100	2	<0.01
70836 – 336	ATS – Asbestos Removal – Location 2	0716	1514	478	2.0	100	0	<0.01
70836 – 337	Metro – Redevelopment Works – Location 3	0710	1515	485	2.0	100	1	<0.01
70836 – 338	Metro – Redevelopment Works – Location 4	0712	1516	484	2.0	100	1	<0.01
70836 – 339	Metro – Redevelopment Works – Location 5	0719	1516	477	2.0	100	4	<0.01
70836 – 340	Metro – Redevelopment Works – Location 6	0720	1517	477	2.0	100	1	<0.01
70836 – 341	Stowe – Redevelopment Works – Location 7	0722	1519	477	2.0	100	1	<0.01
70836 – 342	Stowe – Redevelopment Works – Location 8	0723	1520	477	2.0	100	3	<0.01

Method: Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)] and in-house method AS101 – Membrane Filter Method for Estimating Airborne Asbestos Fibres.

Sampling: All samples have been taken by Airsafe personnel in accordance with the sampling plan detailed in method AS101.

Location of Laboratory Activities: Level 1, 488 Botany Road, Beaconsfield NSW 2015 Australia.

Quality Control: A field blank is taken and analysed for each batch of samples.

Environmental Conditions: Background air monitoring during removal works.

Comment: These calculated concentrations are less than the reporting limit of 0.01 fibres/mL for control and exposure monitoring as stated in the Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)].

Disclaimer: N/A

Sampled By: Pamela Mavroidis, Licensed Asbestos Assessor [SafeWork NSW Licence No LAA 002067].

Note: The measured results fall within a 95% confidence interval (calculated using a coverage factor of 2) in accordance with the NOHSC:3003(2005). The results relate only to the samples tested.

NATA is a signatory to the ILAC Mutual Recognition Arrangement for the mutual recognition of the equivalence of testing, medical testing, calibration, inspection, proficiency testing scheme providers and reference materials producers reports and certificates.

Airsafe shall not be liable for loss, cost, damages or expenses incurred by the client, or any other person or company, resulting from the use of any information or interpretation given in this report. In no case shall Airsafe be liable for consequential damages including, but not limited to, lost profits, damages for failure to meet deadlines and lost production arising from this report.


Any other holder of this document is advised that information contained hereon reflects Airsafe's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Airsafe's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents.



This document is issued in accordance with NATA's accreditation requirements. Accredited for compliance with ISO/IEC 17025 – Testing. NATA accredited laboratory 2959. This report must not be reproduced except in full

SITE MAP

Figure 1. Air Monitoring Locations

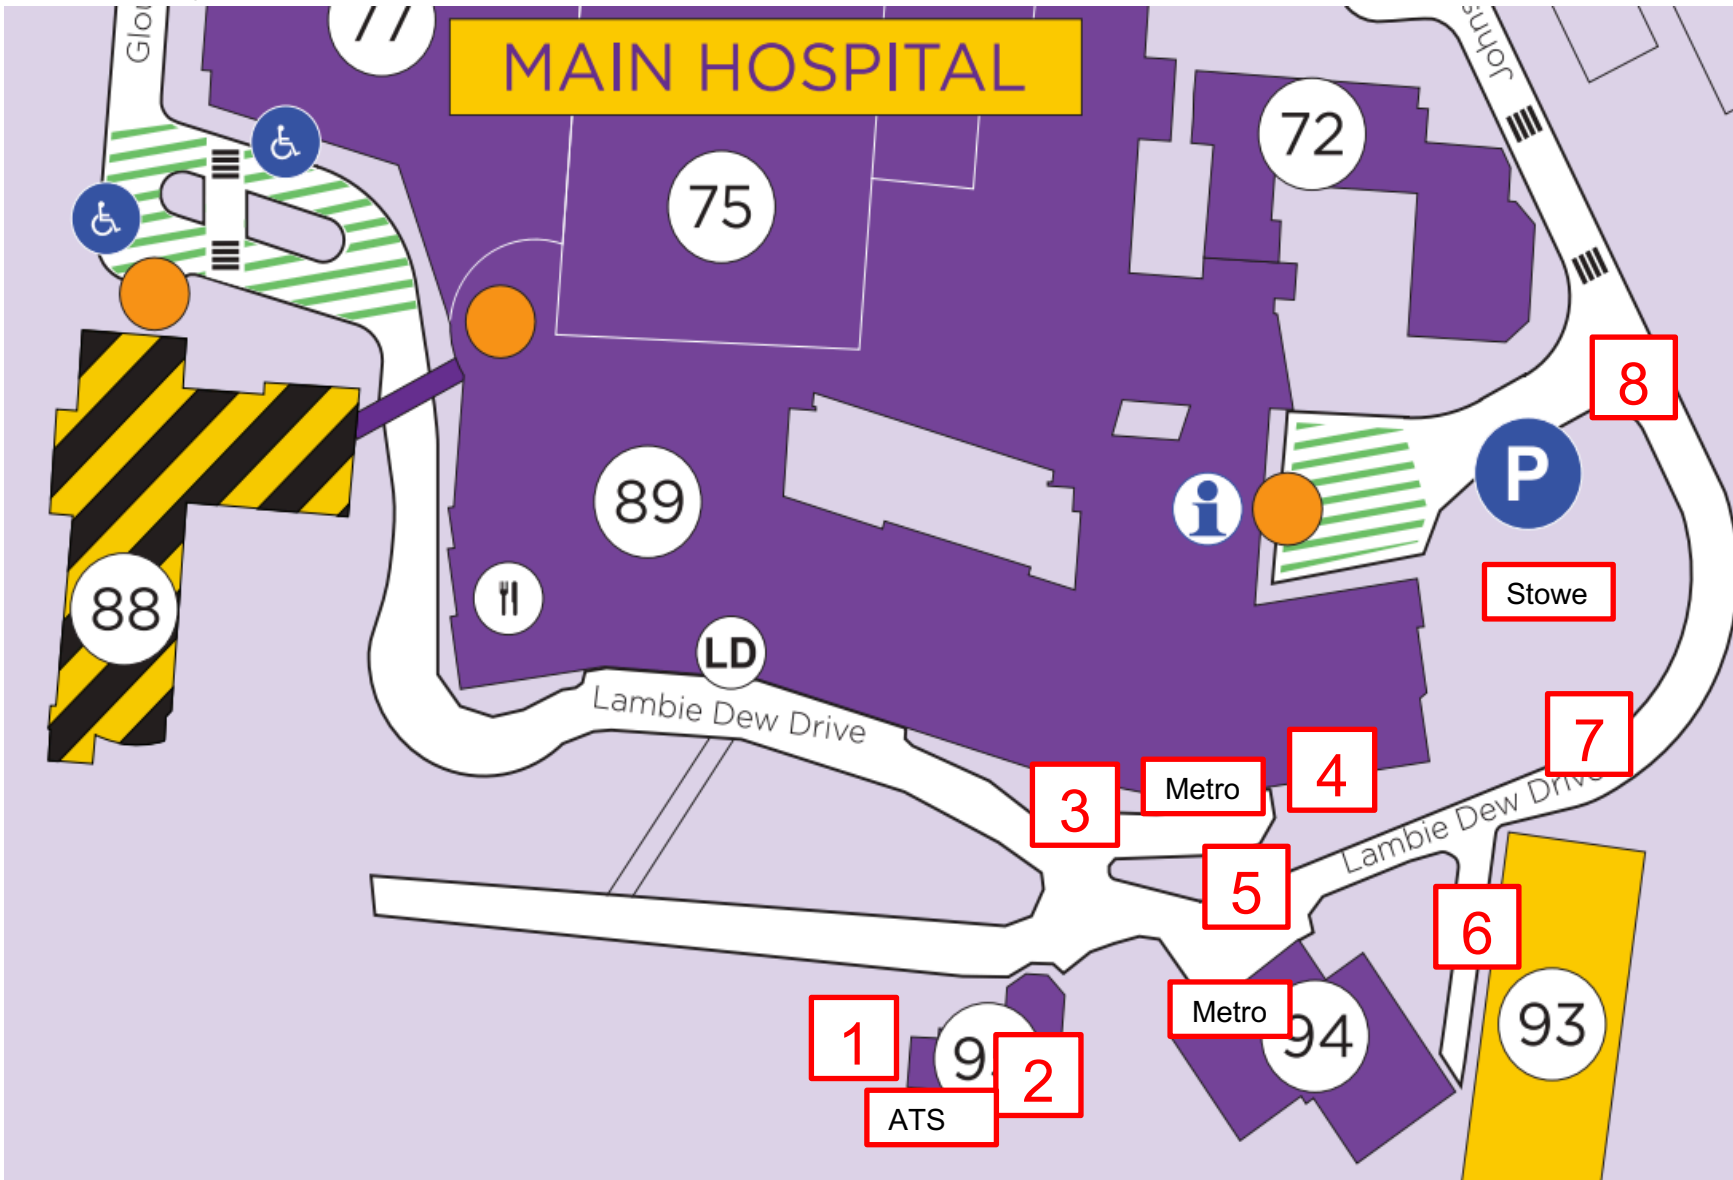

TEST REPORT

March 27, 2024

Australasian Technical Services (NSW) Pty Ltd
9 Phiney Place
INGLEBURN NSW 2565

Your Reference: Royal Prince Alfred Hospital – Redevelopment Works
Job Number: 70836

Attention: Sam Chea

Dear Sam,

In accordance with your instructions, Airsafe conducted air monitoring for airborne asbestos fibres at the above site.

The following samples were processed on the dates indicated.

Samples:	7 Filters
Date of Sampling:	26/03/24
Date of Analysis:	27/03/24
Date of Preliminary Report Sent:	Not Issued

The results are contained in the following pages of this report.

Should you have any queries regarding this report please contact the undersigned.

Yours faithfully
AIRSAFE LABORATORIES PTY LTD



Jonathon Stephens
Approved Counter and Signatory

PROJECT: Royal Prince Alfred Hospital – Redevelopment Works

JOB NO: 70836

Sample No	Location/Reference	Time		Total Time [min]	Air Flow Average [L/min]	Fields	Fibres	Concentration (Fibres/mL)
		On	Off					
70836 – 405	Metro – Redevelopment Works – Location 1	0711	1603	532	2.0	100	0	<0.01
70836 – 406	Metro – Redevelopment Works – Location 2	0713	1605	532	2.0	100	0	<0.01
70836 – 407	Metro – Redevelopment Works – Location 3	0716	1606	530	2.0	100	0	<0.01
70836 – 408	Stowe – Redevelopment Works – Location 4	0721	1607	526	2.0	100	1	<0.01
70836 – 409	Stowe – Redevelopment Works – Location 5	0722	1609	527	2.0	100	1	<0.01
70836 – 410	Stowe – Redevelopment Works – Location 6	0724	1610	526	2.0	100	1	<0.01
70836 – 411	Stowe – Redevelopment Works – Location 7	0726	1611	525	2.0	100	0	<0.01

Method: Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)] and in-house method AS101 – Membrane Filter Method for Estimating Airborne Asbestos Fibres.

Sampling: All samples have been taken by Airsafe personnel in accordance with the sampling plan detailed in method AS101.

Location of Laboratory Activities: Level 1, 488 Botany Road, Beaconsfield NSW 2015 Australia.

Quality Control: A field blank is taken and analysed for each batch of samples.

Environmental Conditions: Background air monitoring during removal works.

Comment: These calculated concentrations are less than the reporting limit of 0.01 fibres/mL for control and exposure monitoring as stated in the Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)].

Disclaimer: N/A

Sampled By: Pamela Mavroidis, Licensed Asbestos Assessor [SafeWork NSW Licence No LAA 002067].

Note: The measured results fall within a 95% confidence interval (calculated using a coverage factor of 2) in accordance with the NOHSC:3003(2005). The results relate only to the samples tested.

NATA is a signatory to the ILAC Mutual Recognition Arrangement for the mutual recognition of the equivalence of testing, medical testing, calibration, inspection, proficiency testing scheme providers and reference materials producers reports and certificates.

Airsafe shall not be liable for loss, cost, damages or expenses incurred by the client, or any other person or company, resulting from the use of any information or interpretation given in this report. In no case shall Airsafe be liable for consequential damages including, but not limited to, lost profits, damages for failure to meet deadlines and lost production arising from this report.


Any other holder of this document is advised that information contained hereon reflects Airsafe's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Airsafe's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents.



This document is issued in accordance with NATA's accreditation requirements. Accredited for compliance with ISO/IEC 17025 – Testing. NATA accredited laboratory 2959. This report must not be reproduced except in full

SITE MAP

Figure 1. Air Monitoring Locations

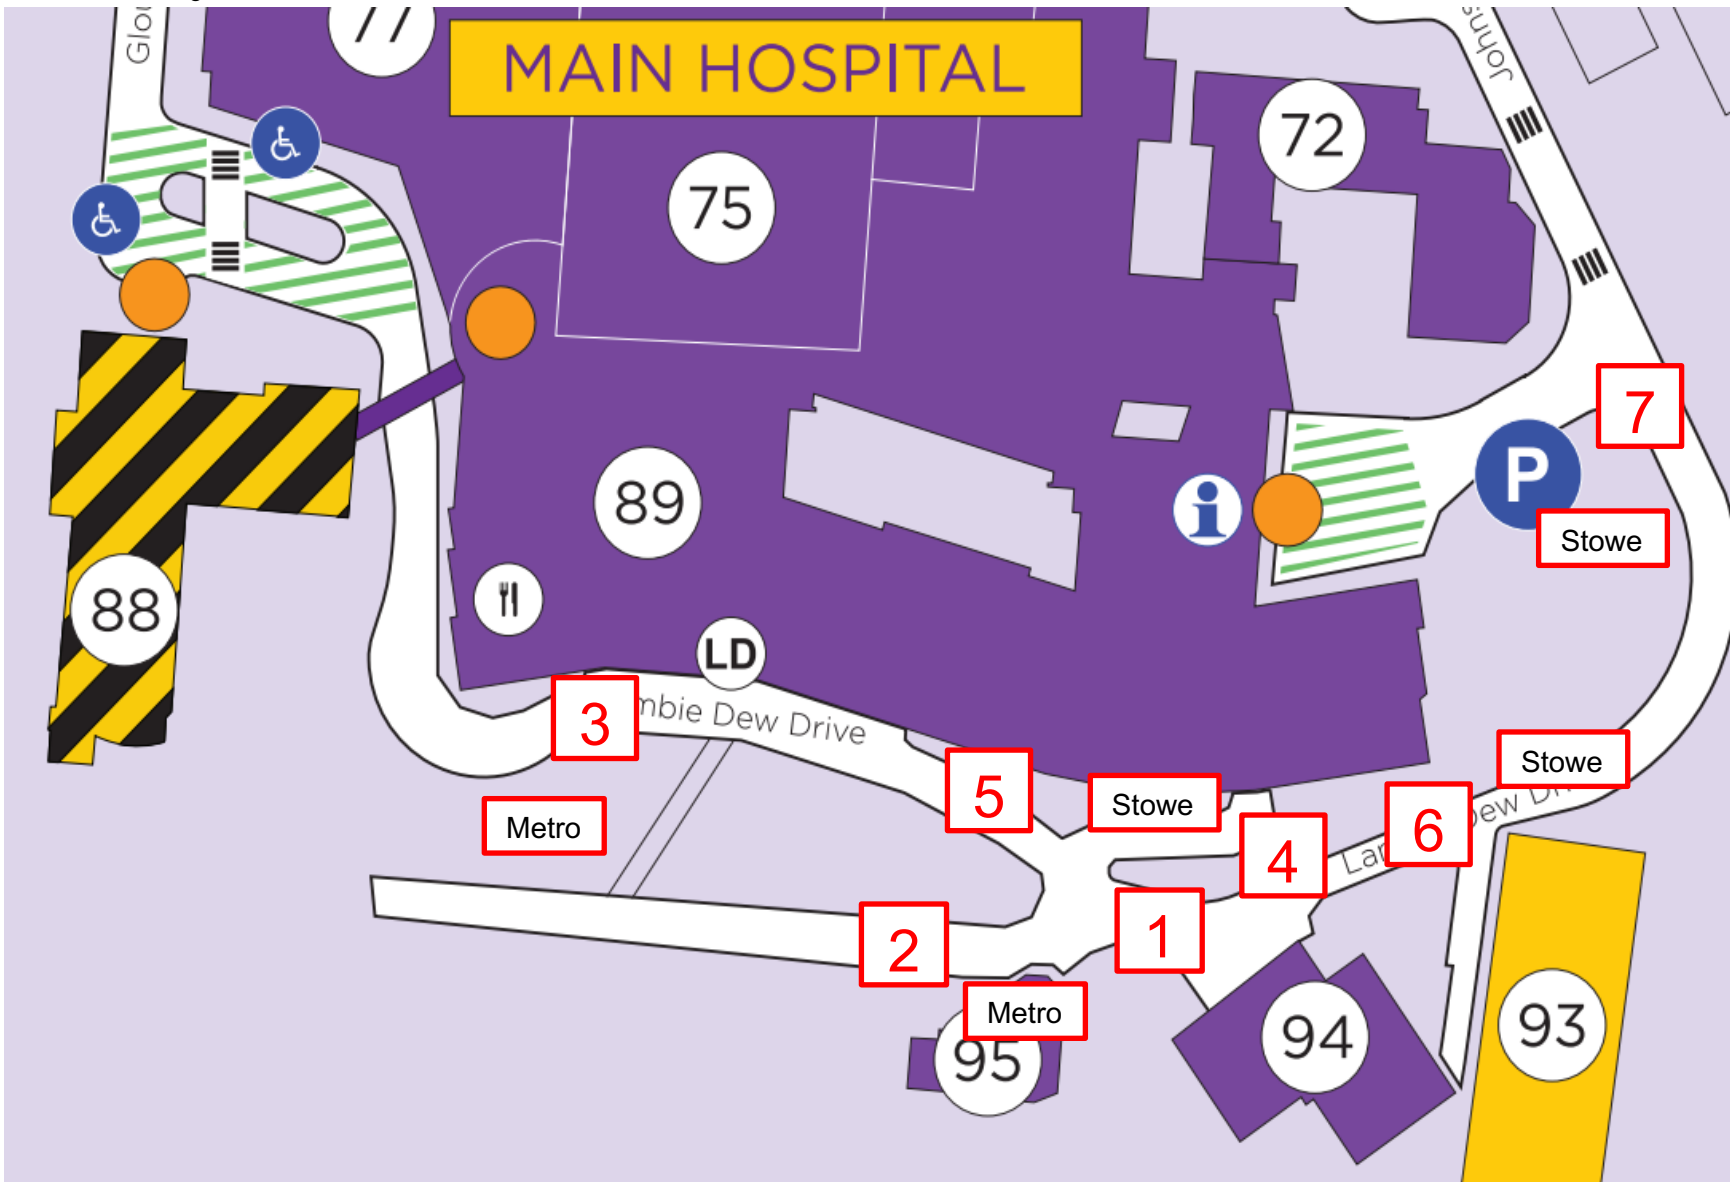

TEST REPORT

April 3, 2024

Australasian Technical Services (NSW) Pty Ltd
9 Phiney Place
INGLEBURN NSW 2565

Your Reference: Royal Prince Alfred Hospital – Redevelopment Works
Job Number: 70836

Attention: Sam Chea

Dear Sam,

In accordance with your instructions, Airsafe conducted air monitoring for airborne asbestos fibres at the above site.

The following samples were processed on the dates indicated.

Samples:	11 Filters
Date of Sampling:	28/03/24
Date of Analysis:	03/04/24
Date of Preliminary Report Sent:	Not Issued

The results are contained in the following pages of this report.

Should you have any queries regarding this report please contact the undersigned.

Yours faithfully
AIRSAFE LABORATORIES PTY LTD



Jonathon Stephens
Approved Counter and Signatory

PROJECT: Royal Prince Alfred Hospital – Redevelopment Works

JOB NO: 70836

Sample No	Location/Reference	Time		Total Time [min]	Air Flow Average [L/min]	Fields	Fibres	Concentration (Fibres/mL)
		On	Off					
70836 – 412	Metro – Redevelopment Works – Location 1	0658	1555	537	2.0	100	0	<0.01
70836 – 413	ATS – Asbestos Removal Works – Location 2	0701	1556	535	2.0	100	0	<0.01
70836 – 414	Metro – Redevelopment Works – Location 3	0705	1559	534	2.0	100	0	<0.01
70836 – 415	Metro – Redevelopment Works – Location 4	0706	1601	535	2.0	100	0	<0.01
70836 – 416	Stowe – Redevelopment Works – Location 5	0708	1602	534	2.0	100	0	<0.01
70836 – 417	Stowe – Redevelopment Works – Location 6	0710	1604	534	2.0	100	0	<0.01
70836 – 418	Stowe – Redevelopment Works – Location 7	0713	1605	532	2.0	100	0	<0.01
70836 – 419	Stowe – Redevelopment Works – Location 8	0714	1607	533	2.0	100	0	<0.01
70836 – 420	Redevelopment Works – Location 9	0726	1526	480	2.0	100	0	<0.01
70836 – 421	Redevelopment Works – Location 10	0728	1528	480	2.0	100	0	<0.01
70836 – 422	Redevelopment Works – Location 11	0729	1529	480	2.0	100	0	<0.01

Method: Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)] and in-house method AS101 – Membrane Filter Method for Estimating Airborne Asbestos Fibres.

Sampling: All samples have been taken by Airsafe personnel in accordance with the sampling plan detailed in method AS101.

Location of Laboratory Activities: Level 1, 488 Botany Road, Beaconsfield NSW 2015 Australia.

Quality Control: A field blank is taken and analysed for each batch of samples.

Environmental Conditions: Background air monitoring during removal works.

Comment: These calculated concentrations are less than the reporting limit of 0.01 fibres/mL for control and exposure monitoring as stated in the Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)].

Disclaimer: N/A

Sampled By: Pamela Mavroidis, Licensed Asbestos Assessor [SafeWork NSW Licence No LAA 002067].

Note: The measured results fall within a 95% confidence interval (calculated using a coverage factor of 2) in accordance with the NOHSC:3003(2005). The results relate only to the samples tested.

NATA is a signatory to the ILAC Mutual Recognition Arrangement for the mutual recognition of the equivalence of testing, medical testing, calibration, inspection, proficiency testing scheme providers and reference materials producers reports and certificates.

Airsafe shall not be liable for loss, cost, damages or expenses incurred by the client, or any other person or company, resulting from the use of any information or interpretation given in this report. In no case shall Airsafe be liable for consequential damages including, but not limited to, lost profits, damages for failure to meet deadlines and lost production arising from this report.




This document is issued in accordance with NATA's accreditation requirements. Accredited for compliance with ISO/IEC 17025 – Testing. NATA accredited laboratory 2959. This report must not be reproduced except in full

Any other holder of this document is advised that information contained hereon reflects Airsafe's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Airsafe's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents.

SITE MAP

Figure 1. Air Monitoring Locations

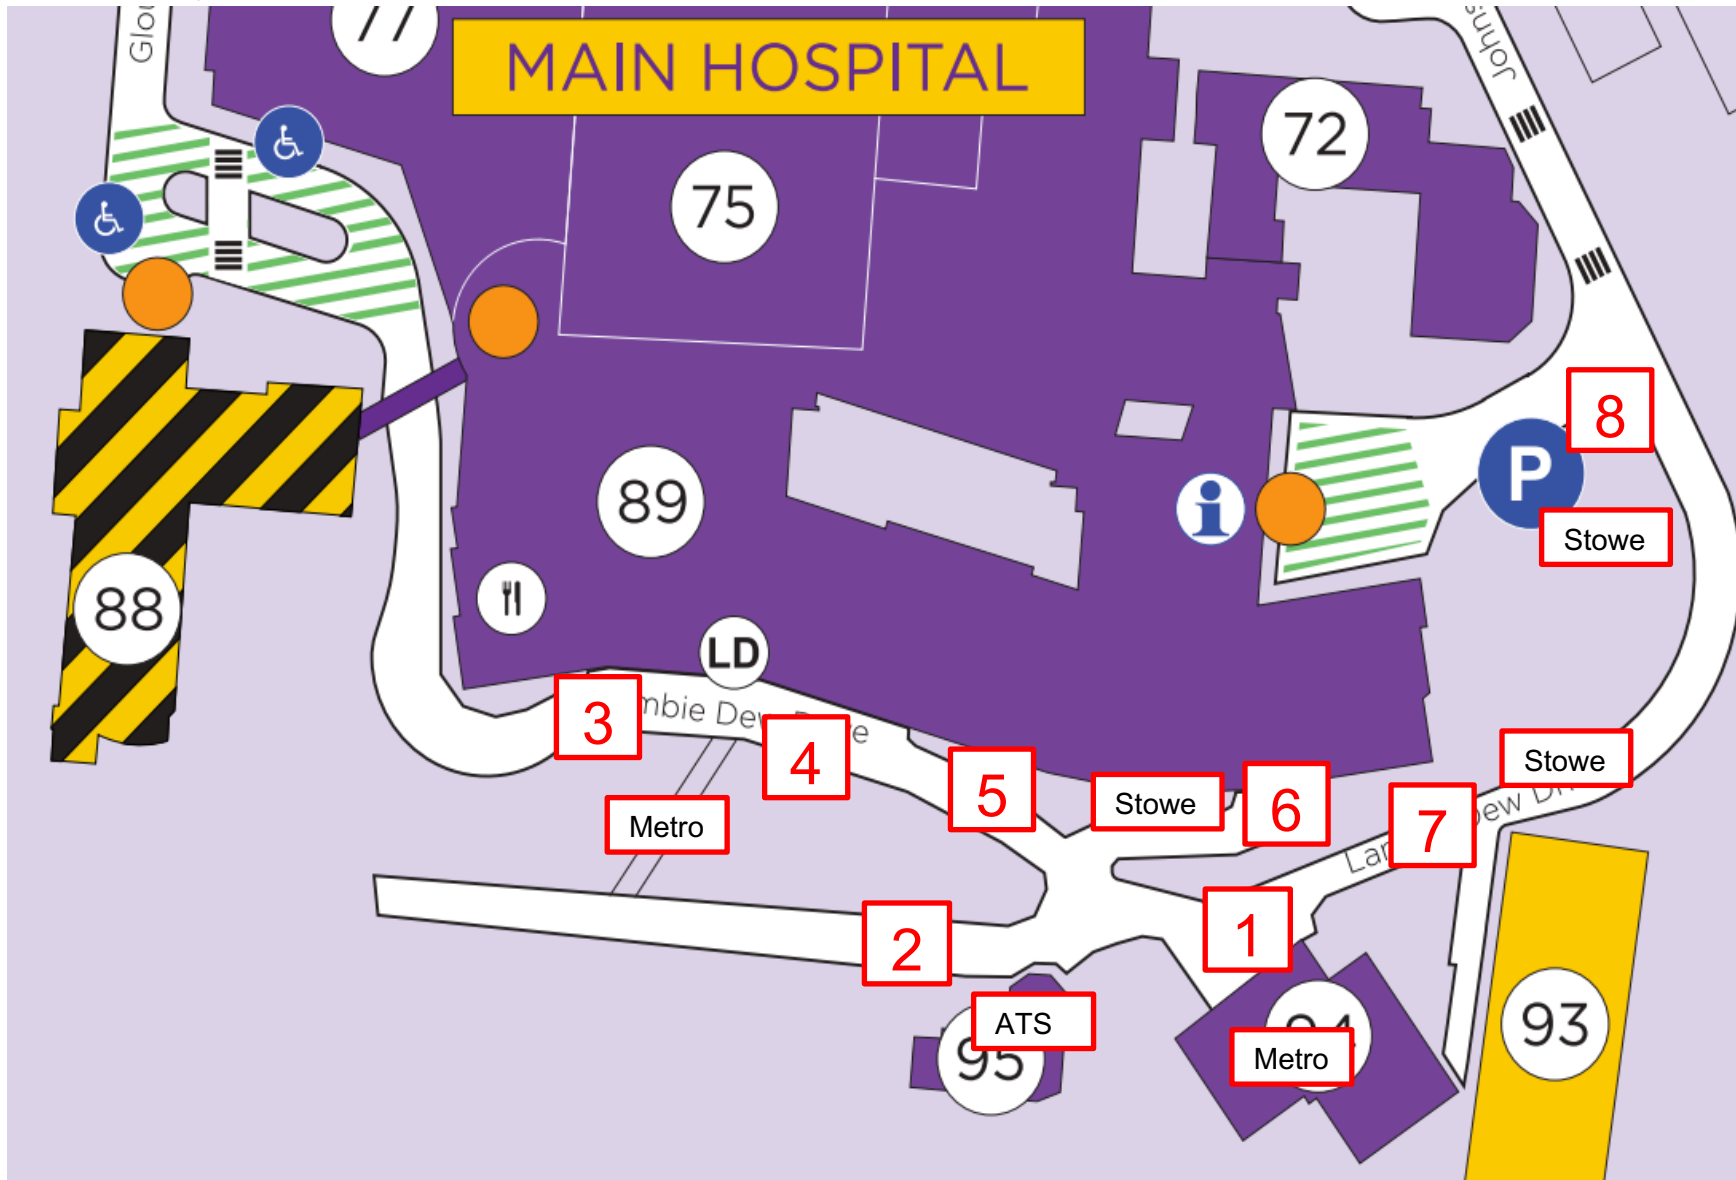

AIRSAFE



TEST REPORT

March 28, 2024

Australasian Technical Services (NSW) Pty Ltd
9 Phiney Place
INGLEBURN NSW 2565

Your Reference: Royal Prince Alfred Hospital – Redevelopment Works
Job Number: 70836

Attention: Sam Chea

Dear Sam,

In accordance with your instructions, Airsafe conducted air monitoring for airborne asbestos fibres at the above site.

The following samples were processed on the dates indicated.

Samples:	11 Filters
Date of Sampling:	27/03/24
Date of Analysis:	28/03/24
Date of Preliminary Report Sent:	Not Issued

The results are contained in the following pages of this report.

Should you have any queries regarding this report please contact the undersigned.

Yours faithfully
AIRSAFE LABORATORIES PTY LTD



Jonathon Stephens
Approved Counter and Signatory

PROJECT: Royal Prince Alfred Hospital – Redevelopment Works

JOB NO: 70836

Sample No	Location/Reference	Time		Total Time [min]	Air Flow Average [L/min]	Fields	Fibres	Concentration (Fibres/mL)
		On	Off					
70836 – 412	Metro – Redevelopment Works – Location 1	0707	1548	521	2.0	100	0	<0.01
70836 – 413	ATS – Redevelopment Works – Location 2	0709	1549	520	2.0	100	0	<0.01
70836 – 414	Metro – Redevelopment Works – Location 3	0709	1552	523	2.0	100	0	<0.01
70836 – 415	Metro – Redevelopment Works – Location 4	0710	1553	523	2.0	100	0	<0.01
70836 – 416	Stowe – Redevelopment Works – Location 5	0712	1554	522	2.0	100	0	<0.01
70836 – 417	Stowe – Redevelopment Works – Location 6	0713	1556	523	2.0	100	0	<0.01
70836 – 418	Stowe – Redevelopment Works – Location 7	0716	1558	522	2.0	100	0	<0.01
70836 – 419	Stowe – Redevelopment Works – Location 8	0717	1559	522	2.0	100	2	<0.01
70836 – 420	Redevelopment Works – Location 9	0830	1630	480	2.0	100	1	<0.01
70836 – 421	Redevelopment Works – Location 10	0831	1631	480	2.0	100	0	<0.01
70836 – 422	Redevelopment Works – Location 11	0832	1632	480	2.0	100	0	<0.01

Method: Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)] and in-house method AS101 – Membrane Filter Method for Estimating Airborne Asbestos Fibres.

Sampling: All samples have been taken by Airsafe personnel in accordance with the sampling plan detailed in method AS101.

Location of Laboratory Activities: Level 1, 488 Botany Road, Beaconsfield NSW 2015 Australia.

Quality Control: A field blank is taken and analysed for each batch of samples.

Environmental Conditions: Background air monitoring during removal works.

Comment: These calculated concentrations are less than the reporting limit of 0.01 fibres/mL for control and exposure monitoring as stated in the Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)].

Disclaimer: N/A

Sampled By: Pamela Mavroidis, Licensed Asbestos Assessor [SafeWork NSW Licence No LAA 002067].

Note: The measured results fall within a 95% confidence interval (calculated using a coverage factor of 2) in accordance with the NOHSC:3003(2005). The results relate only to the samples tested.

NATA is a signatory to the ILAC Mutual Recognition Arrangement for the mutual recognition of the equivalence of testing, medical testing, calibration, inspection, proficiency testing scheme providers and reference materials producers reports and certificates.

Airsafe shall not be liable for loss, cost, damages or expenses incurred by the client, or any other person or company, resulting from the use of any information or interpretation given in this report. In no case shall Airsafe be liable for consequential damages including, but not limited to, lost profits, damages for failure to meet deadlines and lost production arising from this report.




This document is issued in accordance with NATA's accreditation requirements. Accredited for compliance with ISO/IEC 17025 – Testing. NATA accredited laboratory 2959. This report must not be reproduced except in full

Any other holder of this document is advised that information contained hereon reflects Airsafe's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Airsafe's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents.

SITE MAP

Figure 1. Air Monitoring Locations

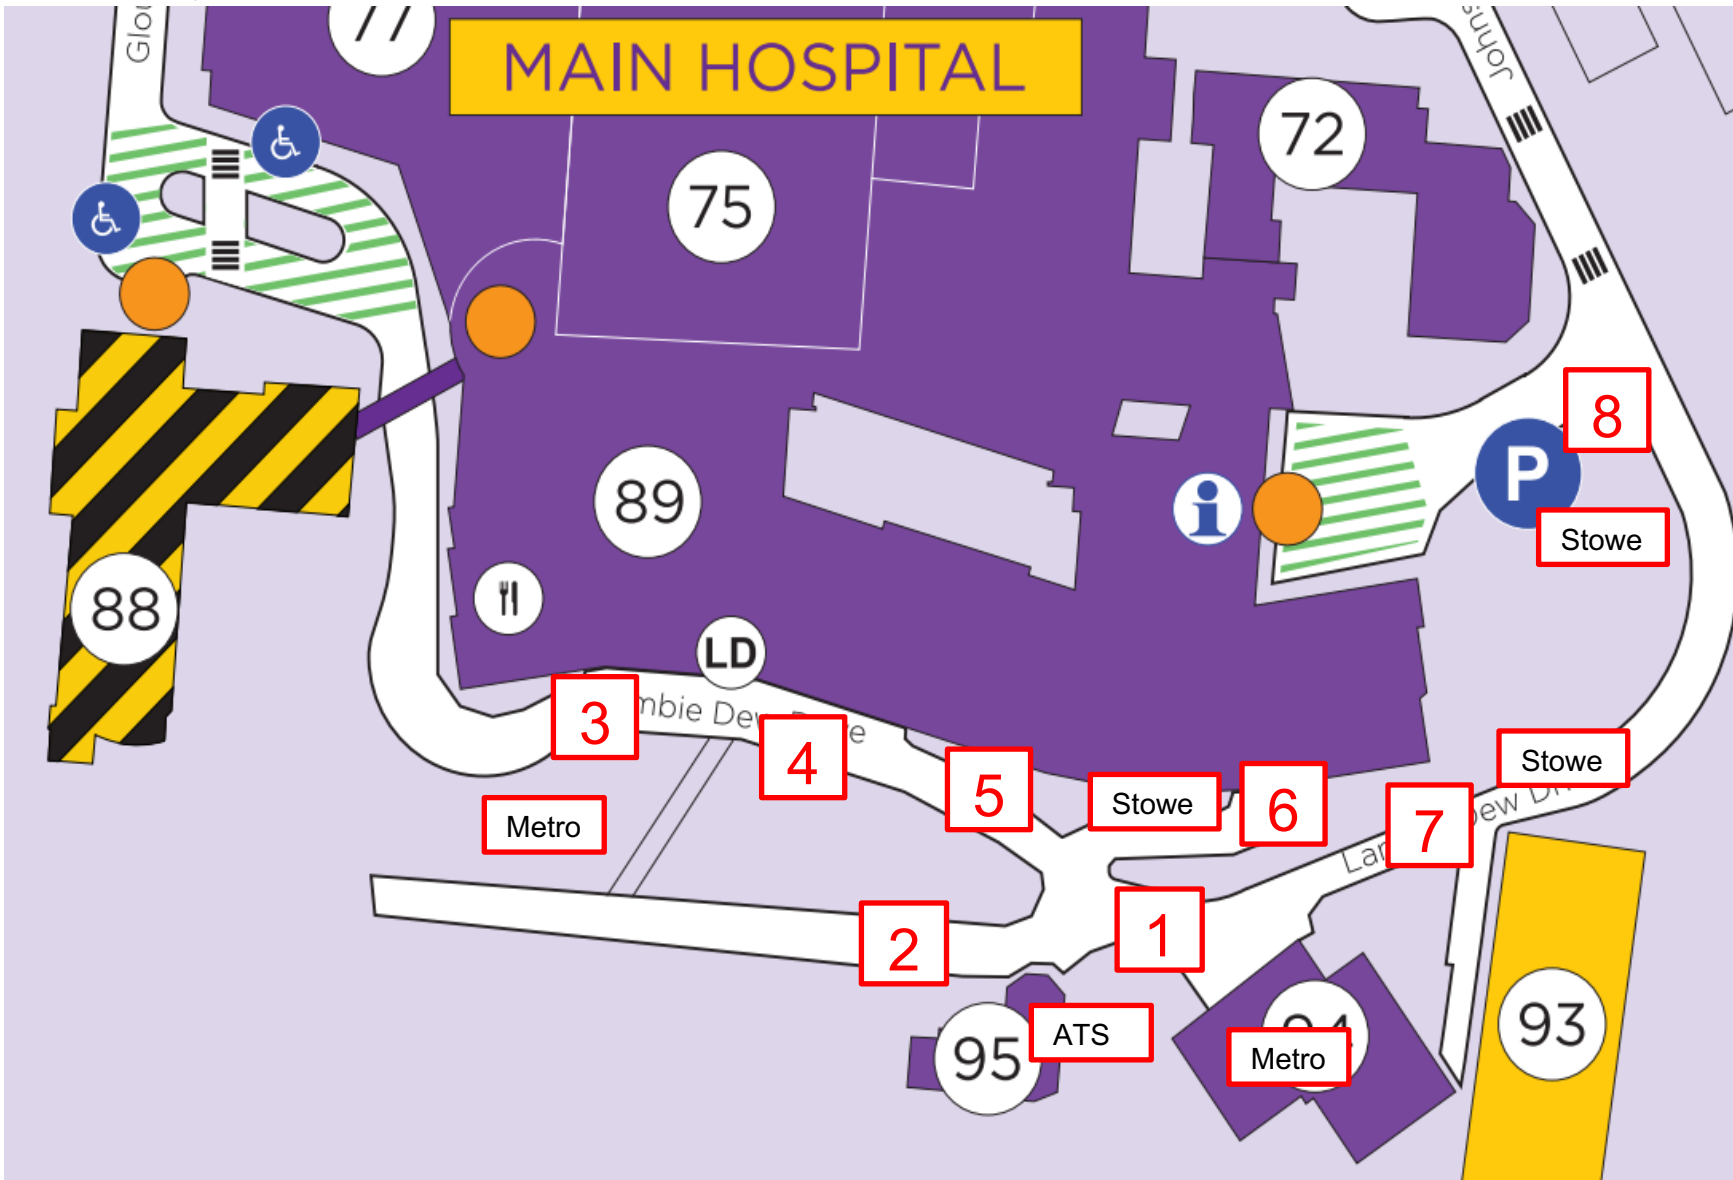

AIRSAFE

