

TEST REPORT

January 7, 2025

CPB Contractors

2 & 4/177 Pacific Hwy,
North Sydney NSW 2060

Your Reference: Royal Prince Alfred Hospital – Redevelopment Works
Job Number: 76105

Attention: David Nguyen

Dear David,

In accordance with your instructions, Airsafe conducted air monitoring for airborne asbestos fibres at the above site.

The following samples were processed on the dates indicated.

Samples:	8 Filters
Date of Sampling:	06/01/25
Date of Analysis:	07/01/25
Date of Preliminary Report Sent:	Not Issued

The results are contained in the following pages of this report.

Should you have any queries regarding this report please contact the undersigned.

Yours faithfully
AIRSAFE LABORATORIES PTY LTD



Pamela Mavroidis
Approved Counter and Signatory

PROJECT: Royal Prince Alfred Hospital – Redevelopment Works

JOB NO: 76105

Sample No	Location/Reference	Time		Total Time [min]	Air Flow Average [L/min]	Fields	Fibres	Concentration (Fibres/mL)
		On	Off					
76105–1	Redevelopment Works – Location 1	0703	1503	480	2.0	100	0	<0.01
76105–2	Redevelopment Works – Location 2	0703	1503	480	2.0	100	0	<0.01
76105–3	Redevelopment Works – Location 3	0702	1502	480	2.0	100	0	<0.01
76105–4	Redevelopment Works – Location 4	0701	1501	480	2.0	100	0	<0.01
76105–5	Redevelopment Works – Location 5	0707	1507	480	2.0	100	0	<0.01
76105–6	Redevelopment Works – Location 6	0711	1511	480	2.0	100	0	<0.01
76105–7	Redevelopment Works – Location 7	0712	1512	480	2.0	100	0	<0.01
76105–8	Redevelopment Works – Location 8	0713	1513	480	2.0	100	0	<0.01

Method: Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)] and in-house method AS101 – Membrane Filter Method for Estimating Airborne Asbestos Fibres.

Sampling: All samples have been taken by Airsafe personnel in accordance with the sampling plan detailed in method AS101.

Location of Laboratory Activities: Level 1, 488 Botany Road, Beaconsfield NSW 2015 Australia.

Quality Control: A field blank is taken and analysed for each batch of samples.

Environmental Conditions: Background air monitoring during removal works.

Comment: These calculated concentrations are less than the reporting limit of 0.01 fibres/mL for control and exposure monitoring as stated in the Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)].

Disclaimer: N/A

Sampled By: Nicholas Anastas, Consultant. Bachelor of Science [Biotechnology Science].

Note: The measured results fall within a 95% confidence interval (calculated using a coverage factor of 2) in accordance with the NOHSC:3003(2005). The results relate only to the samples tested.

NATA is a signatory to the ILAC Mutual Recognition Arrangement for the mutual recognition of the equivalence of testing, medical testing, calibration, inspection, proficiency testing scheme providers and reference materials producers reports and certificates.

Airsafe shall not be liable for loss, cost, damages or expenses incurred by the client, or any other person or company, resulting from the use of any information or interpretation given in this report. In no case shall Airsafe be liable for consequential damages including, but not limited to, lost profits, damages for failure to meet deadlines and lost production arising from this report.

Any other holder of this document is advised that information contained hereon reflects Airsafe's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Airsafe's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents.

SITE MAP

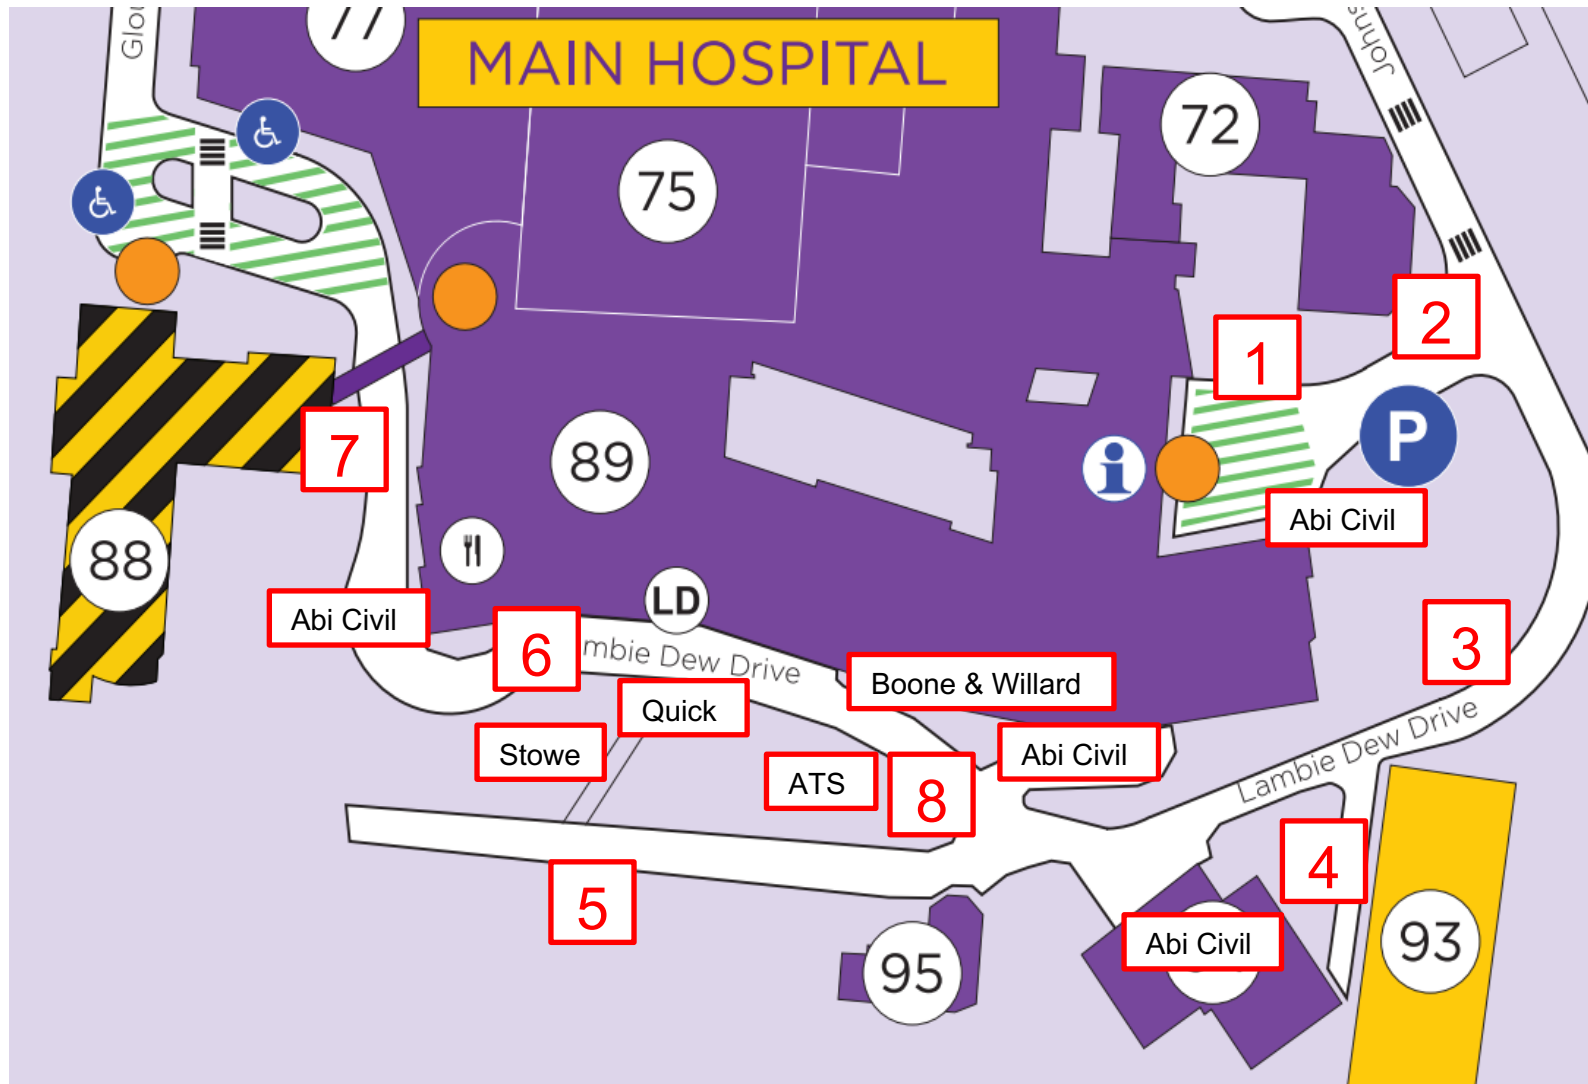


Figure 1. Air Monitoring Location.

TEST REPORT

January 8, 2025

CPB Contractors

2 & 4/177 Pacific Hwy,
North Sydney NSW 2060

Your Reference: Royal Prince Alfred Hospital – Redevelopment Works
Job Number: 76105

Attention: David Nguyen

Dear David,

In accordance with your instructions, Airsafe conducted air monitoring for airborne asbestos fibres at the above site.

The following samples were processed on the dates indicated.

Samples:	8 Filters
Date of Sampling:	07/01/25
Date of Analysis:	08/01/25
Date of Preliminary Report Sent:	Not Issued

The results are contained in the following pages of this report.

Should you have any queries regarding this report please contact the undersigned.

Yours faithfully
AIRSAFE LABORATORIES PTY LTD



Pamela Mavroidis
Approved Counter and Signatory

PROJECT: Royal Prince Alfred Hospital – Redevelopment Works

JOB NO: 76105

Sample No	Location/Reference	Time		Total Time [min]	Air Flow Average [L/min]	Fields	Fibres	Concentration (Fibres/mL)
		On	Off					
76105–9	Redevelopment Works – Location 1	0700	1500	480	2.0	100	0	<0.01
76105–10	Redevelopment Works – Location 2	0700	1500	480	2.0	100	0	<0.01
76105–11	Redevelopment Works – Location 3	0659	1459	480	2.0	100	0	<0.01
76105–12	Redevelopment Works – Location 4	0658	1458	480	2.0	100	0	<0.01
76105–13	Redevelopment Works – Location 5	0704	1504	480	2.0	100	0	<0.01
76105–14	Redevelopment Works – Location 6	0708	1508	480	2.0	100	0	<0.01
76105–15	Redevelopment Works – Location 7	0709	1509	480	2.0	100	0	<0.01
76105–16	Redevelopment Works – Location 8	0711	1511	480	2.0	100	0	<0.01

Method: Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)] and in-house method AS101 – Membrane Filter Method for Estimating Airborne Asbestos Fibres.

Sampling: All samples have been taken by Airsafe personnel in accordance with the sampling plan detailed in method AS101.

Location of Laboratory Activities: Level 1, 488 Botany Road, Beaconsfield NSW 2015 Australia.

Quality Control: A field blank is taken and analysed for each batch of samples.

Environmental Conditions: Background air monitoring during removal works.

Comment: These calculated concentrations are less than the reporting limit of 0.01 fibres/mL for control and exposure monitoring as stated in the Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)].

Disclaimer: N/A

Sampled By: Nicholas Anastas, Consultant. Bachelor of Science [Biotechnology Science].

Note: The measured results fall within a 95% confidence interval (calculated using a coverage factor of 2) in accordance with the NOHSC:3003(2005). The results relate only to the samples tested.

NATA is a signatory to the ILAC Mutual Recognition Arrangement for the mutual recognition of the equivalence of testing, medical testing, calibration, inspection, proficiency testing scheme providers and reference materials producers reports and certificates.

Airsafe shall not be liable for loss, cost, damages or expenses incurred by the client, or any other person or company, resulting from the use of any information or interpretation given in this report. In no case shall Airsafe be liable for consequential damages including, but not limited to, lost profits, damages for failure to meet deadlines and lost production arising from this report.

Any other holder of this document is advised that information contained hereon reflects Airsafe's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Airsafe's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents.

SITE MAP

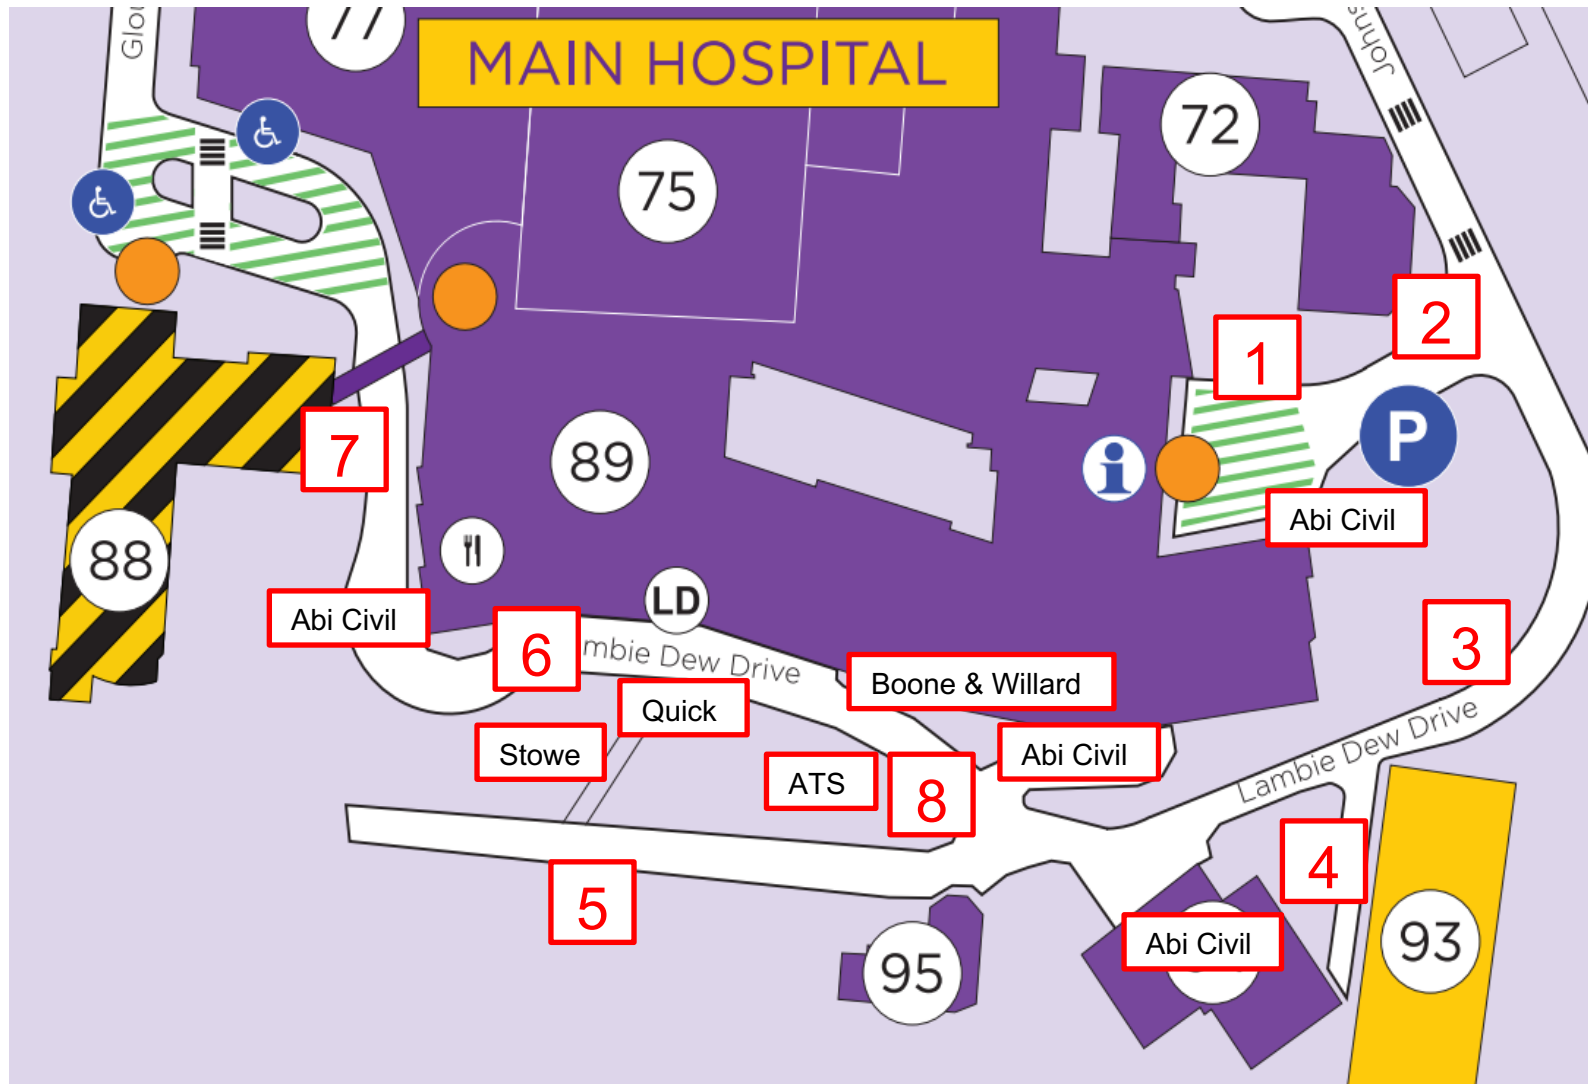


Figure 1. Air Monitoring Location.

TEST REPORT

January 09, 2025

CPB Contractors
2 & 4/177 Pacific Hwy,
North Sydney NSW 2060

Your Reference: Royal Prince Alfred Hospital – Redevelopment Works
Job Number: 76105

Attention: David Nguyen

Dear David,

In accordance with your instructions, Airsafe conducted air monitoring for airborne asbestos fibres at the above site.

The following samples were processed on the dates indicated.

Samples:	8 Filters
Date of Sampling:	08/01/25
Date of Analysis:	09/01/25
Date of Preliminary Report Sent:	Not Issued

The results are contained in the following pages of this report.

Should you have any queries regarding this report please contact the undersigned.

Yours faithfully
AIRSAFE LABORATORIES PTY LTD



Pamela Mavroidis
Approved Counter and Signatory

PROJECT: Royal Prince Alfred Hospital – Redevelopment Works

JOB NO: 76105

Sample No	Location/Reference	Time		Total Time [min]	Air Flow Average [L/min]	Fields	Fibres	Concentration (Fibres/mL)
		On	Off					
76105-17	Redevelopment Works – Location 1	0658	1458	480	2.0	100	0	<0.01
76105-18	Redevelopment Works – Location 2	0656	1456	480	2.0	100	0	<0.01
76105-19	Redevelopment Works – Location 3	0655	1455	480	2.0	100	0	<0.01
76105-20	Redevelopment Works – Location 4	0653	1453	480	2.0	100	0	<0.01
76105-21	Redevelopment Works – Location 5	0711	1511	480	2.0	100	0	<0.01
76105-22	Redevelopment Works – Location 6	0640	1440	480	2.0	100	0	<0.01
76105-23	Redevelopment Works – Location 7	0639	1439	480	2.0	100	0	<0.01
76105-24	Redevelopment Works – Location 8	0642	1442	480	2.0	100	0	<0.01

Method: Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)] and in-house method AS101 – Membrane Filter Method for Estimating Airborne Asbestos Fibres.

Sampling: All samples have been taken by Airsafe personnel in accordance with the sampling plan detailed in method AS101.

Location of Laboratory Activities: Level 1, 488 Botany Road, Beaconsfield NSW 2015 Australia.

Quality Control: A field blank is taken and analysed for each batch of samples.

Environmental Conditions: Background air monitoring during removal works.

Comment: These calculated concentrations are less than the reporting limit of 0.01 fibres/mL for control and exposure monitoring as stated in the Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)].

Disclaimer: N/A

Sampled By: Pamela Mavroidis, Licensed Asbestos Assessor [SafeWork NSW Licence No LAA 002067].

Note: The measured results fall within a 95% confidence interval (calculated using a coverage factor of 2) in accordance with the NOHSC:3003(2005). The results relate only to the samples tested.

NATA is a signatory to the ILAC Mutual Recognition Arrangement for the mutual recognition of the equivalence of testing, medical testing, calibration, inspection, proficiency testing scheme providers and reference materials producers reports and certificates.

Airsafe shall not be liable for loss, cost, damages or expenses incurred by the client, or any other person or company, resulting from the use of any information or interpretation given in this report. In no case shall Airsafe be liable for consequential damages including, but not limited to, lost profits, damages for failure to meet deadlines and lost production arising from this report.

Any other holder of this document is advised that information contained hereon reflects Airsafe's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Airsafe's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents.

SITE MAP

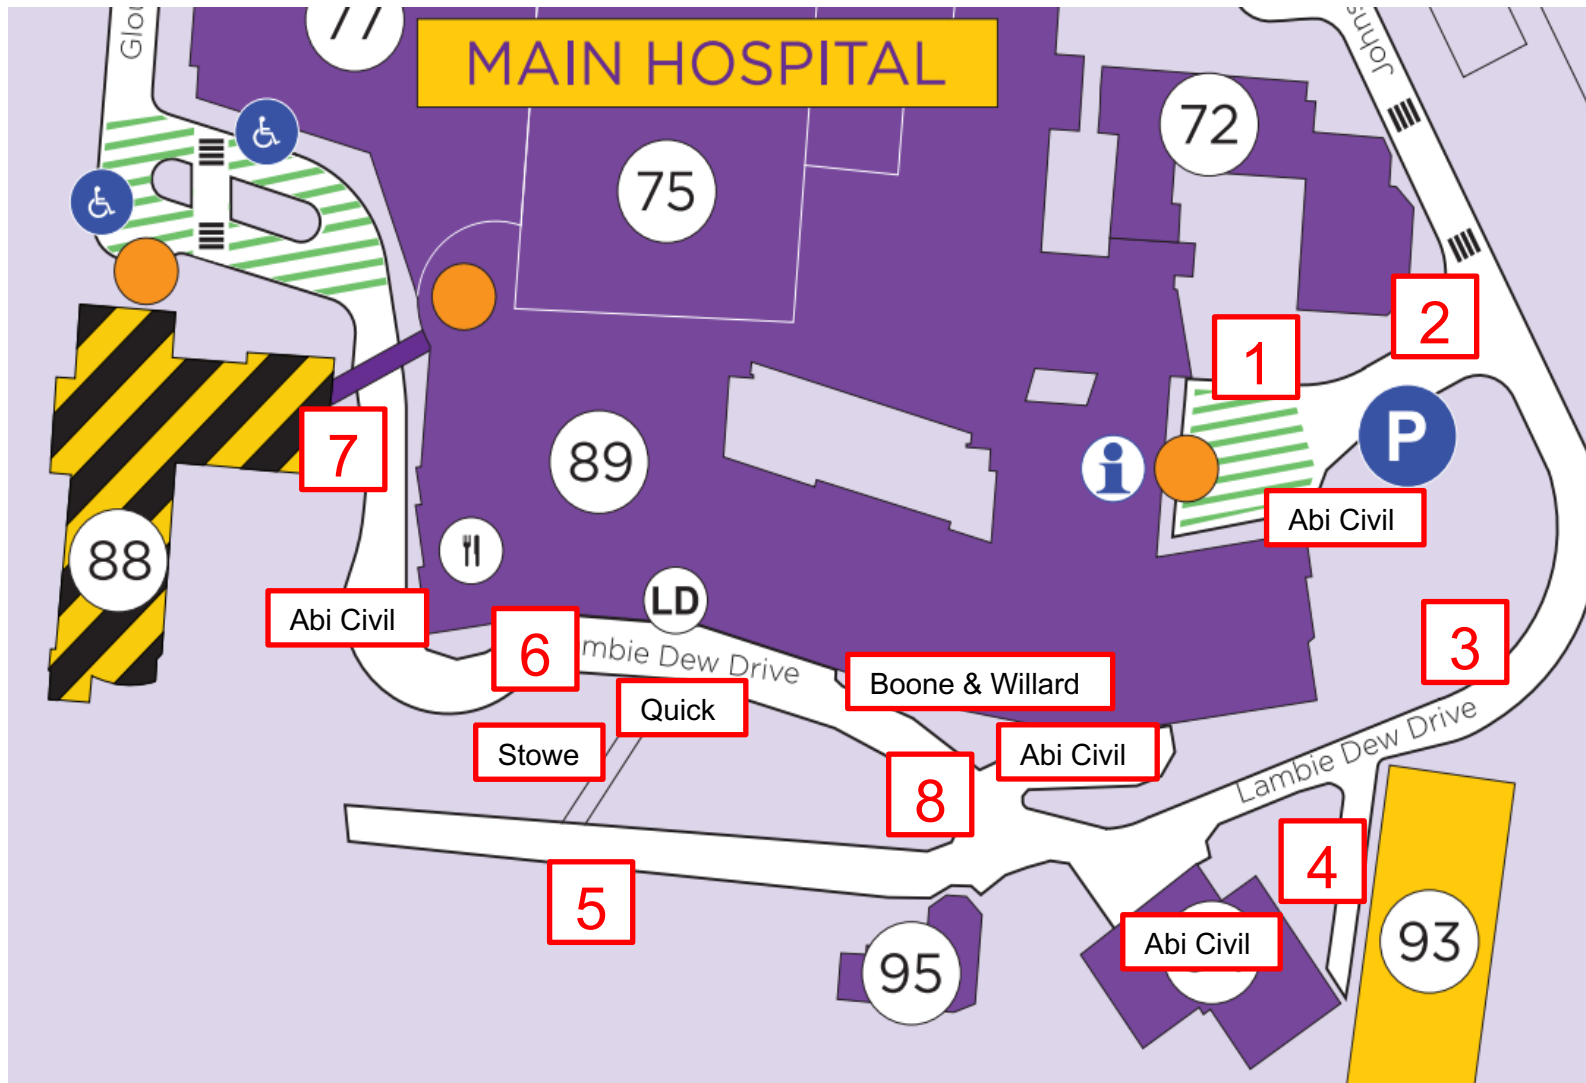


Figure 1. Air Monitoring Location.

TEST REPORT

January 10, 2025

CPB Contractors

2 & 4/177 Pacific Hwy,
North Sydney NSW 2060

Your Reference: Royal Prince Alfred Hospital – Redevelopment Works
Job Number: 76105

Attention: David Nguyen

Dear David,

In accordance with your instructions, Airsafe conducted air monitoring for airborne asbestos fibres at the above site.

The following samples were processed on the dates indicated.

Samples:	8 Filters
Date of Sampling:	09/01/25
Date of Analysis:	10/01/25
Date of Preliminary Report Sent:	Not Issued

The results are contained in the following pages of this report.

Should you have any queries regarding this report please contact the undersigned.

Yours faithfully
AIRSAFE LABORATORIES PTY LTD



Pamela Mavroidis
Approved Counter and Signatory

PROJECT: Royal Prince Alfred Hospital – Redevelopment Works

JOB NO: 76105

Sample No	Location/Reference	Time		Total Time [min]	Air Flow Average [L/min]	Fields	Fibres	Concentration (Fibres/mL)
		On	Off					
76105–25	Redevelopment Works – Location 1	0718	1518	480	2.0	100	0	<0.01
76105–26	Redevelopment Works – Location 2	0717	1517	480	2.0	100	0	<0.01
76105–27	Redevelopment Works – Location 3	0715	1515	480	2.0	100	0	<0.01
76105–28	Redevelopment Works – Location 4	0720	1520	480	2.0	100	0	<0.01
76105–29	Redevelopment Works – Location 5	0714	1514	480	2.0	100	0	<0.01
76105–30	Redevelopment Works – Location 6	0725	1525	480	2.0	100	0	<0.01
76105–31	Redevelopment Works – Location 7	0726	1526	480	2.0	100	0	<0.01
76105–32	Redevelopment Works – Location 8	0723	1523	480	2.0	100	0	<0.01

Method: Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)] and in-house method AS101 – Membrane Filter Method for Estimating Airborne Asbestos Fibres.

Sampling: All samples have been taken by Airsafe personnel in accordance with the sampling plan detailed in method AS101.

Location of Laboratory Activities: Level 1, 488 Botany Road, Beaconsfield NSW 2015 Australia.

Quality Control: A field blank is taken and analysed for each batch of samples.

Environmental Conditions: Background air monitoring during removal works.

Comment: These calculated concentrations are less than the reporting limit of 0.01 fibres/mL for control and exposure monitoring as stated in the Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)].

Disclaimer: N/A

Sampled By: Pamela Mavroidis, Licensed Asbestos Assessor [SafeWork NSW Licence No LAA 002067].

Note: The measured results fall within a 95% confidence interval (calculated using a coverage factor of 2) in accordance with the NOHSC:3003(2005). The results relate only to the samples tested.

NATA is a signatory to the ILAC Mutual Recognition Arrangement for the mutual recognition of the equivalence of testing, medical testing, calibration, inspection, proficiency testing scheme providers and reference materials producers reports and certificates.

Airsafe shall not be liable for loss, cost, damages or expenses incurred by the client, or any other person or company, resulting from the use of any information or interpretation given in this report. In no case shall Airsafe be liable for consequential damages including, but not limited to, lost profits, damages for failure to meet deadlines and lost production arising from this report.

Any other holder of this document is advised that information contained hereon reflects Airsafe's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Airsafe's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents.

SITE MAP

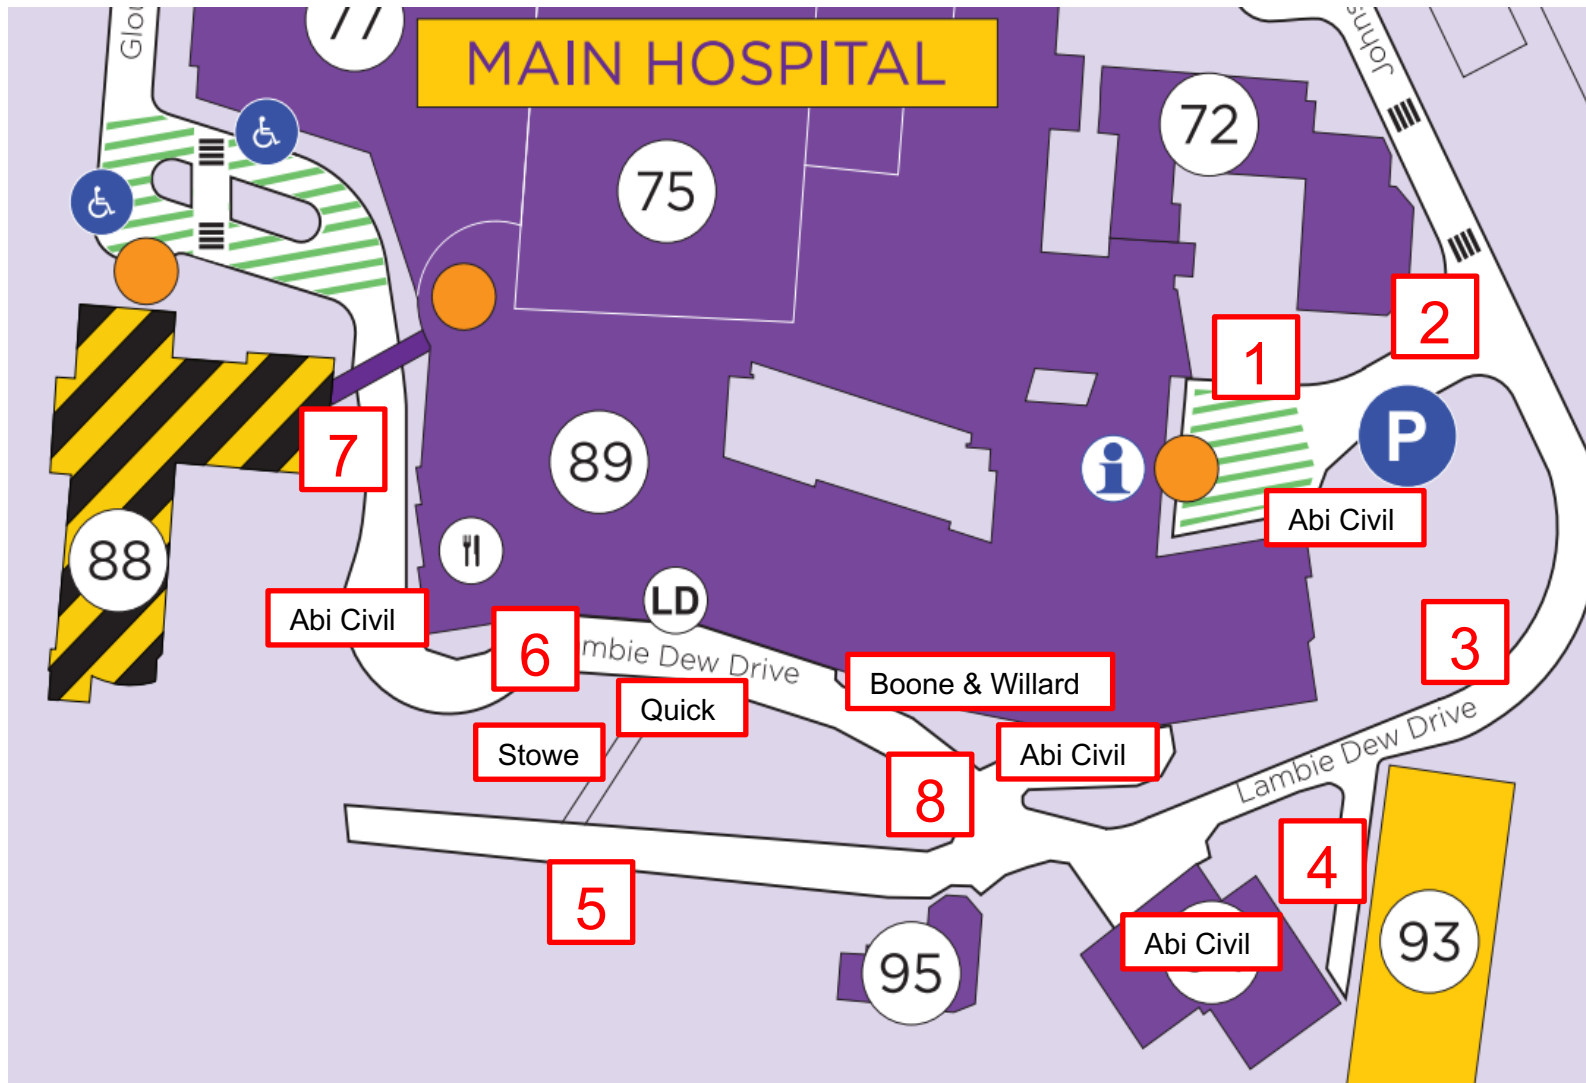


Figure 1. Air Monitoring Location.

TEST REPORT

January 13, 2025

CPB Contractors

2 & 4/177 Pacific Hwy,
North Sydney NSW 2060

Your Reference: Royal Prince Alfred Hospital – Redevelopment Works
Job Number: 76105

Attention: Zach Foster

Dear Zach,

In accordance with your instructions, Airsafe conducted air monitoring for airborne asbestos fibres at the above site.

The following samples were processed on the dates indicated.

Samples:	8 Filters
Date of Sampling:	10/01/25
Date of Analysis:	13/01/25
Date of Preliminary Report Sent:	Not Issued

The results are contained in the following pages of this report.

Should you have any queries regarding this report please contact the undersigned.

Yours faithfully
AIRSAFE LABORATORIES PTY LTD



Pamela Mavroidis
Approved Counter and Signatory

PROJECT: Royal Prince Alfred Hospital – Redevelopment Works

JOB NO: 76105

Sample No	Location/Reference	Time		Total Time [min]	Air Flow Average [L/min]	Fields	Fibres	Concentration (Fibres/mL)
		On	Off					
76105–33	Redevelopment Works – Location 1	0648	1448	480	2.0	100	0	<0.01
76105–34	Redevelopment Works – Location 2	0647	1447	480	2.0	100	0	<0.01
76105–35	Redevelopment Works – Location 3	0646	1446	480	2.0	100	0	<0.01
76105–36	Redevelopment Works – Location 4	0643	1443	480	2.0	100	0	<0.01
76105–37	Redevelopment Works – Location 5	0654	1454	480	2.0	100	0	<0.01
76105–38	Redevelopment Works – Location 6	0637	1437	480	2.0	100	0	<0.01
76105–39	Redevelopment Works – Location 7	0638	1438	480	2.0	100	0	<0.01
76105–40	Redevelopment Works – Location 8	0640	1440	480	2.0	100	0	<0.01

Method: Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)] and in-house method AS101 – Membrane Filter Method for Estimating Airborne Asbestos Fibres.

Sampling: All samples have been taken by Airsafe personnel in accordance with the sampling plan detailed in method AS101.

Location of Laboratory Activities: Level 1, 488 Botany Road, Beaconsfield NSW 2015 Australia.

Quality Control: A field blank is taken and analysed for each batch of samples.

Environmental Conditions: Background air monitoring during removal works.

Comment: These calculated concentrations are less than the reporting limit of 0.01 fibres/mL for control and exposure monitoring as stated in the Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)].

Disclaimer: N/A

Sampled By: Pamela Mavroidis, Licensed Asbestos Assessor [SafeWork NSW Licence No LAA 002067].

Note: The measured results fall within a 95% confidence interval (calculated using a coverage factor of 2) in accordance with the NOHSC:3003(2005). The results relate only to the samples tested.

NATA is a signatory to the ILAC Mutual Recognition Arrangement for the mutual recognition of the equivalence of testing, medical testing, calibration, inspection, proficiency testing scheme providers and reference materials producers reports and certificates.

Airsafe shall not be liable for loss, cost, damages or expenses incurred by the client, or any other person or company, resulting from the use of any information or interpretation given in this report. In no case shall Airsafe be liable for consequential damages including, but not limited to, lost profits, damages for failure to meet deadlines and lost production arising from this report.

Any other holder of this document is advised that information contained hereon reflects Airsafe's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Airsafe's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents.

SITE MAP

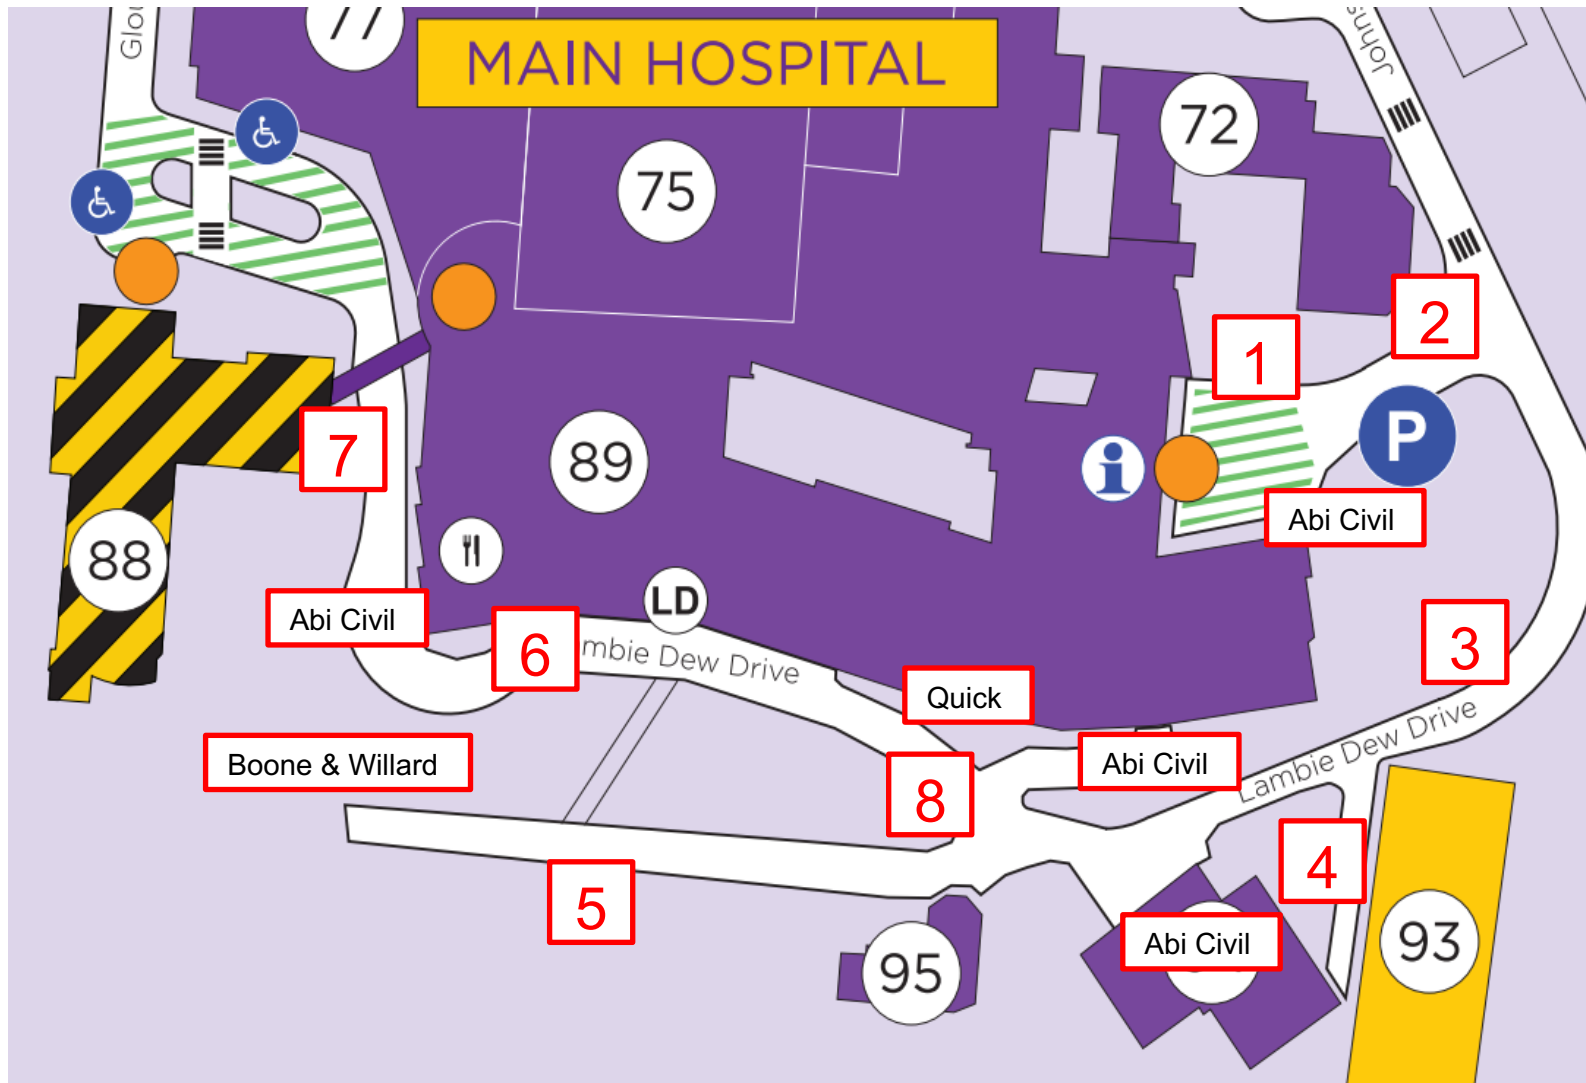


Figure 1. Air Monitoring Location.

TEST REPORT

January 14, 2025

CPB Contractors
2 & 4/177 Pacific Hwy,
North Sydney NSW 2060

Your Reference: Royal Prince Alfred Hospital – Redevelopment Works
Job Number: 76105

Attention: Zach Foster

Dear Zach,

In accordance with your instructions, Airsafe conducted air monitoring for airborne asbestos fibres at the above site.

The following samples were processed on the dates indicated.

Samples:	8 Filters
Date of Sampling:	13/01/25
Date of Analysis:	14/01/25
Date of Preliminary Report Sent:	Not Issued

The results are contained in the following pages of this report.

Should you have any queries regarding this report please contact the undersigned.

Yours faithfully
AIRSAFE LABORATORIES PTY LTD



Pamela Mavroidis
Approved Counter and Signatory

PROJECT: Royal Prince Alfred Hospital – Redevelopment Works

JOB NO: 76105

Sample No	Location/Reference	Time		Total Time [min]	Air Flow Average [L/min]	Fields	Fibres	Concentration (Fibres/mL)
		On	Off					
76105-41	Redevelopment Works – Location 1	0639	1439	480	2.0	100	0	<0.01
76105-42	Redevelopment Works – Location 2	0638	1438	480	2.0	100	0	<0.01
76105-43	Redevelopment Works – Location 3	0637	1437	480	2.0	100	0	<0.01
76105-44	Redevelopment Works – Location 4	0635	1435	480	2.0	100	0	<0.01
76105-45	Redevelopment Works – Location 5	0645	1445	480	2.0	100	0	<0.01
76105-46	Redevelopment Works – Location 6	0628	1428	480	2.0	100	0	<0.01
76105-47	Redevelopment Works – Location 7	0630	1430	480	2.0	100	0	<0.01
76105-48	Redevelopment Works – Location 8	0632	1432	480	2.0	100	0	<0.01

Method: Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)] and in-house method AS101 – Membrane Filter Method for Estimating Airborne Asbestos Fibres.

Sampling: All samples have been taken by Airsafe personnel in accordance with the sampling plan detailed in method AS101.

Location of Laboratory Activities: Level 1, 488 Botany Road, Beaconsfield NSW 2015 Australia.

Quality Control: A field blank is taken and analysed for each batch of samples.

Environmental Conditions: Background air monitoring during removal works.

Comment: These calculated concentrations are less than the reporting limit of 0.01 fibres/mL for control and exposure monitoring as stated in the Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)].

Disclaimer: N/A

Sampled By: Pamela Mavroidis, Licensed Asbestos Assessor [SafeWork NSW Licence No LAA 002067].

Note: The measured results fall within a 95% confidence interval (calculated using a coverage factor of 2) in accordance with the NOHSC:3003(2005). The results relate only to the samples tested.

NATA is a signatory to the ILAC Mutual Recognition Arrangement for the mutual recognition of the equivalence of testing, medical testing, calibration, inspection, proficiency testing scheme providers and reference materials producers reports and certificates.

Airsafe shall not be liable for loss, cost, damages or expenses incurred by the client, or any other person or company, resulting from the use of any information or interpretation given in this report. In no case shall Airsafe be liable for consequential damages including, but not limited to, lost profits, damages for failure to meet deadlines and lost production arising from this report.

Any other holder of this document is advised that information contained hereon reflects Airsafe's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Airsafe's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents.

SITE MAP

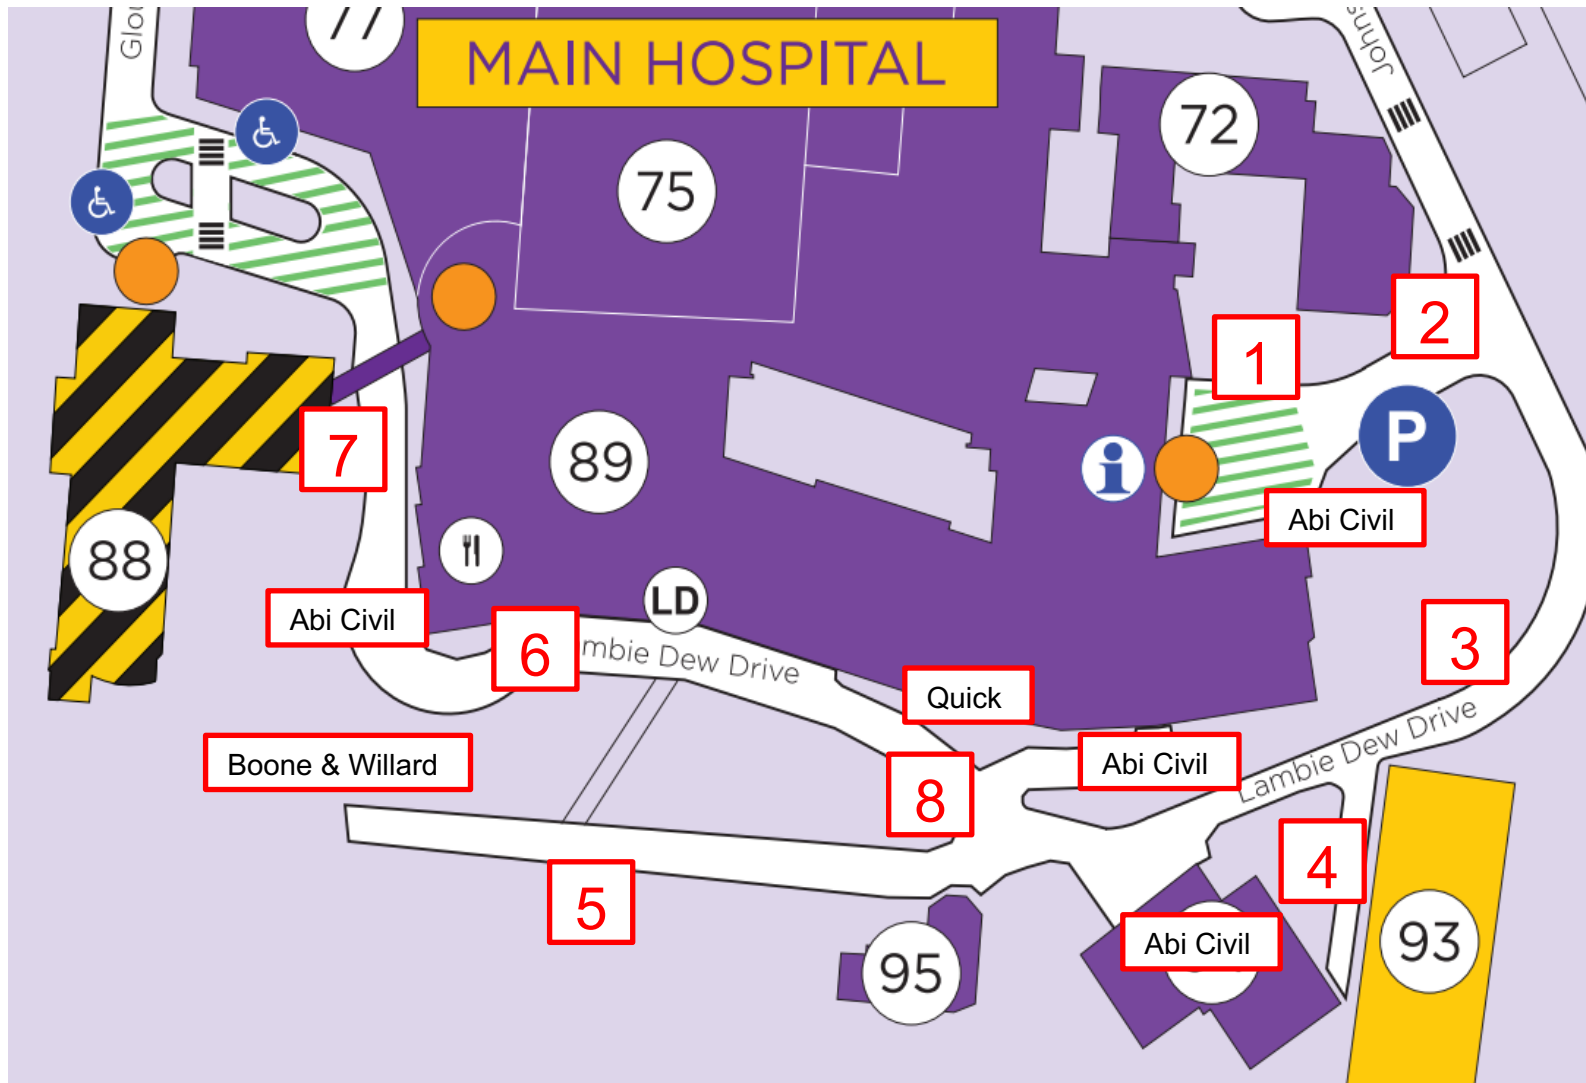


Figure 1. Air Monitoring Location.

TEST REPORT

January 15, 2025

CPB Contractors

2 & 4/177 Pacific Hwy,
North Sydney NSW 2060

Your Reference: Royal Prince Alfred Hospital – Redevelopment Works
Job Number: 76105

Attention: Zach Foster

Dear Zach,

In accordance with your instructions, Airsafe conducted air monitoring for airborne asbestos fibres at the above site.

The following samples were processed on the dates indicated.

Samples:	8 Filters
Date of Sampling:	14/01/25
Date of Analysis:	15/01/25
Date of Preliminary Report Sent:	Not Issued

The results are contained in the following pages of this report.

Should you have any queries regarding this report please contact the undersigned.

Yours faithfully
AIRSAFE LABORATORIES PTY LTD



Pamela Mavroidis
Approved Counter and Signatory

PROJECT: Royal Prince Alfred Hospital – Redevelopment Works

JOB NO: 76105

Sample No	Location/Reference	Time		Total Time [min]	Air Flow Average [L/min]	Fields	Fibres	Concentration (Fibres/mL)
		On	Off					
76105–49	Redevelopment Works – Location 1	0650	1450	480	2.0	100	0	<0.01
76105–50	Redevelopment Works – Location 2	0649	1449	480	2.0	100	0	<0.01
76105–51	Redevelopment Works – Location 3	0646	1446	480	2.0	100	0	<0.01
76105–52	Redevelopment Works – Location 4	0645	1445	480	2.0	100	0	<0.01
76105–53	Redevelopment Works – Location 5	0655	1455	480	2.0	100	0	<0.01
76105–54	Redevelopment Works – Location 6	0638	1438	480	2.0	100	0	<0.01
76105–55	Redevelopment Works – Location 7	0639	1439	480	2.0	100	0	<0.01
76105–56	Redevelopment Works – Location 8	0635	1435	480	2.0	100	0	<0.01

Method: Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)] and in-house method AS101 – Membrane Filter Method for Estimating Airborne Asbestos Fibres.

Sampling: All samples have been taken by Airsafe personnel in accordance with the sampling plan detailed in method AS101.

Location of Laboratory Activities: Level 1, 488 Botany Road, Beaconsfield NSW 2015 Australia.

Quality Control: A field blank is taken and analysed for each batch of samples.

Environmental Conditions: Background air monitoring during removal works.

Comment: These calculated concentrations are less than the reporting limit of 0.01 fibres/mL for control and exposure monitoring as stated in the Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)].

Disclaimer: N/A

Sampled By: Pamela Mavroidis, Licensed Asbestos Assessor [SafeWork NSW Licence No LAA 002067].

Note: The measured results fall within a 95% confidence interval (calculated using a coverage factor of 2) in accordance with the NOHSC:3003(2005). The results relate only to the samples tested.

NATA is a signatory to the ILAC Mutual Recognition Arrangement for the mutual recognition of the equivalence of testing, medical testing, calibration, inspection, proficiency testing scheme providers and reference materials producers reports and certificates.

Airsafe shall not be liable for loss, cost, damages or expenses incurred by the client, or any other person or company, resulting from the use of any information or interpretation given in this report. In no case shall Airsafe be liable for consequential damages including, but not limited to, lost profits, damages for failure to meet deadlines and lost production arising from this report.

Any other holder of this document is advised that information contained hereon reflects Airsafe's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Airsafe's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents.

SITE MAP

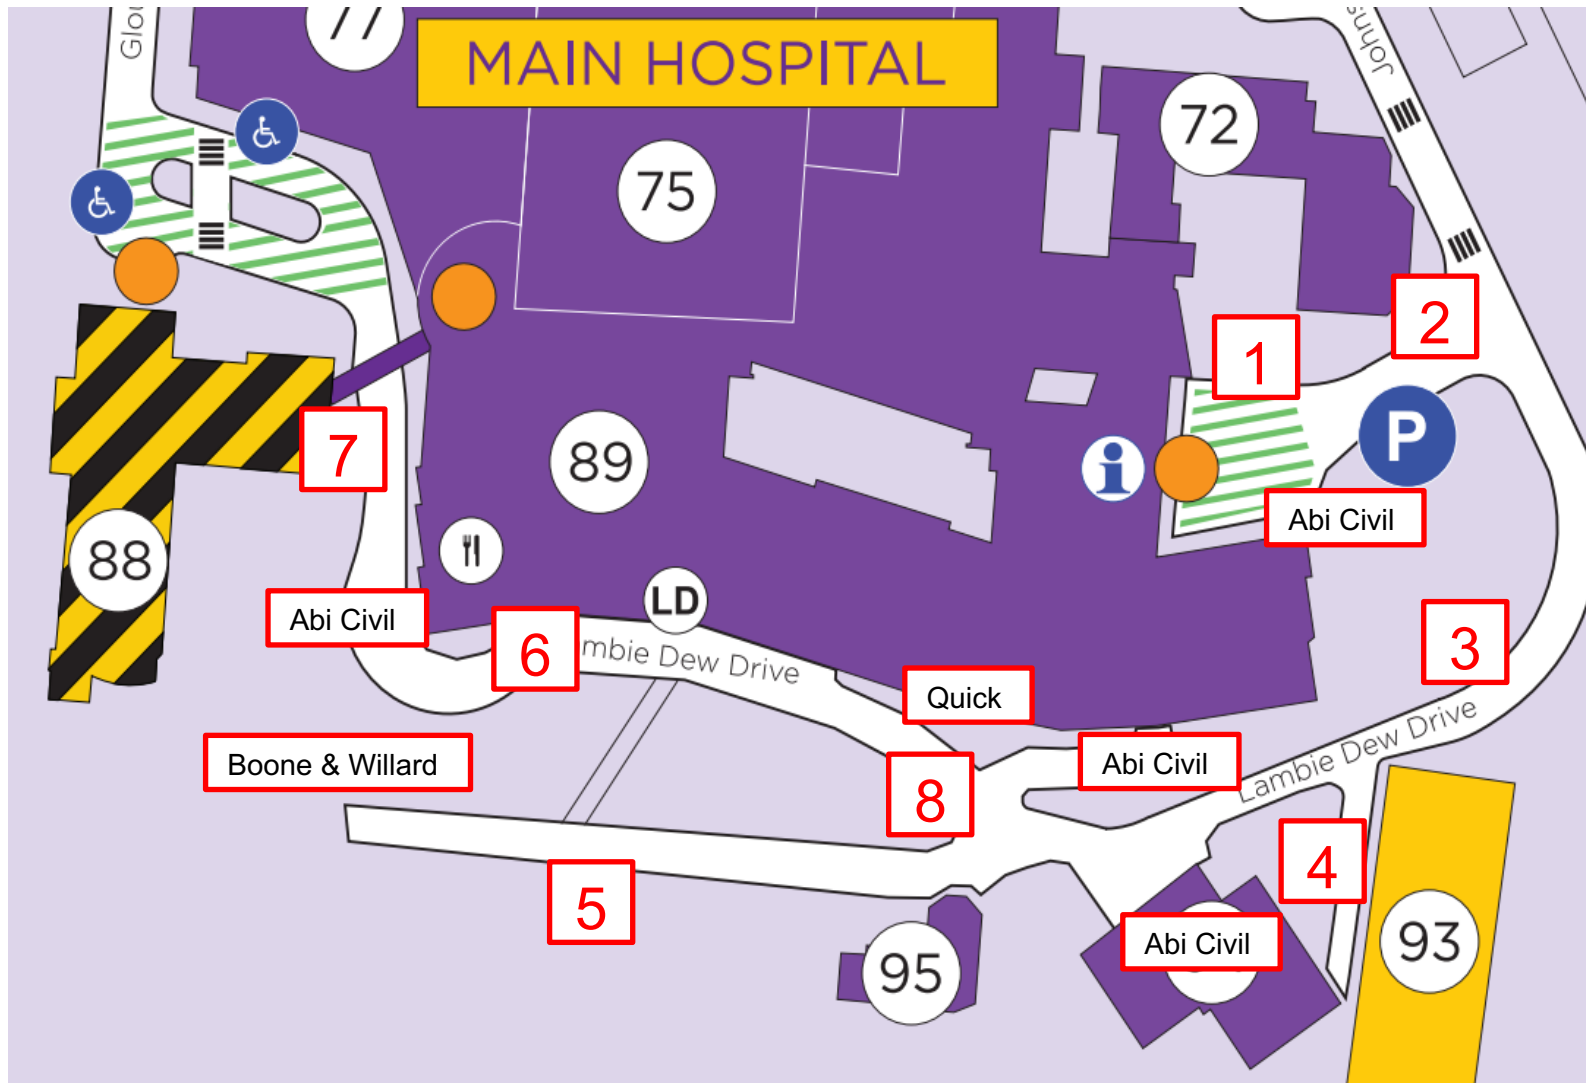


Figure 1. Air Monitoring Location.

TEST REPORT

January 16, 2025

CPB Contractors

2 & 4/177 Pacific Hwy,
North Sydney NSW 2060

Your Reference: Royal Prince Alfred Hospital – Redevelopment Works
Job Number: 76105

Attention: Zach Foster

Dear Zach,

In accordance with your instructions, Airsafe conducted air monitoring for airborne asbestos fibres at the above site.

The following samples were processed on the dates indicated.

Samples:	8 Filters
Date of Sampling:	15/01/25
Date of Analysis:	16/01/25
Date of Preliminary Report Sent:	Not Issued

The results are contained in the following pages of this report.

Should you have any queries regarding this report please contact the undersigned.

Yours faithfully
AIRSAFE LABORATORIES PTY LTD



Pamela Mavroidis
Approved Counter and Signatory

PROJECT: Royal Prince Alfred Hospital – Redevelopment Works

JOB NO: 76105

Sample No	Location/Reference	Time		Total Time [min]	Air Flow Average [L/min]	Fields	Fibres	Concentration (Fibres/mL)
		On	Off					
76105–57	Redevelopment Works – Location 1	0642	1442	480	2.0	100	0	<0.01
76105–58	Redevelopment Works – Location 2	0643	1443	480	2.0	100	0	<0.01
76105–59	Redevelopment Works – Location 3	0656	1456	480	2.0	100	0	<0.01
76105–60	Redevelopment Works – Location 4	0657	1457	480	2.0	100	0	<0.01
76105–61	Redevelopment Works – Location 5	0645	1445	480	2.0	100	0	<0.01
76105–62	Redevelopment Works – Location 6	0705	1505	480	2.0	100	0	<0.01
76105–63	Redevelopment Works – Location 7	0706	1506	480	2.0	100	0	<0.01
76105–64	Redevelopment Works – Location 8	0708	1508	480	2.0	100	0	<0.01

Method: Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)] and in-house method AS101 – Membrane Filter Method for Estimating Airborne Asbestos Fibres.

Sampling: All samples have been taken by Airsafe personnel in accordance with the sampling plan detailed in method AS101.

Location of Laboratory Activities: Level 1, 488 Botany Road, Beaconsfield NSW 2015 Australia.

Quality Control: A field blank is taken and analysed for each batch of samples.

Environmental Conditions: Background air monitoring during removal works.

Comment: These calculated concentrations are less than the reporting limit of 0.01 fibres/mL for control and exposure monitoring as stated in the Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)].

Disclaimer: N/A

Sampled By: Pamela Mavroidis, Licensed Asbestos Assessor [SafeWork NSW Licence No LAA 002067].

Note: The measured results fall within a 95% confidence interval (calculated using a coverage factor of 2) in accordance with the NOHSC:3003(2005). The results relate only to the samples tested.

NATA is a signatory to the ILAC Mutual Recognition Arrangement for the mutual recognition of the equivalence of testing, medical testing, calibration, inspection, proficiency testing scheme providers and reference materials producers reports and certificates.

Airsafe shall not be liable for loss, cost, damages or expenses incurred by the client, or any other person or company, resulting from the use of any information or interpretation given in this report. In no case shall Airsafe be liable for consequential damages including, but not limited to, lost profits, damages for failure to meet deadlines and lost production arising from this report.

Any other holder of this document is advised that information contained hereon reflects Airsafe's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Airsafe's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents.

SITE MAP

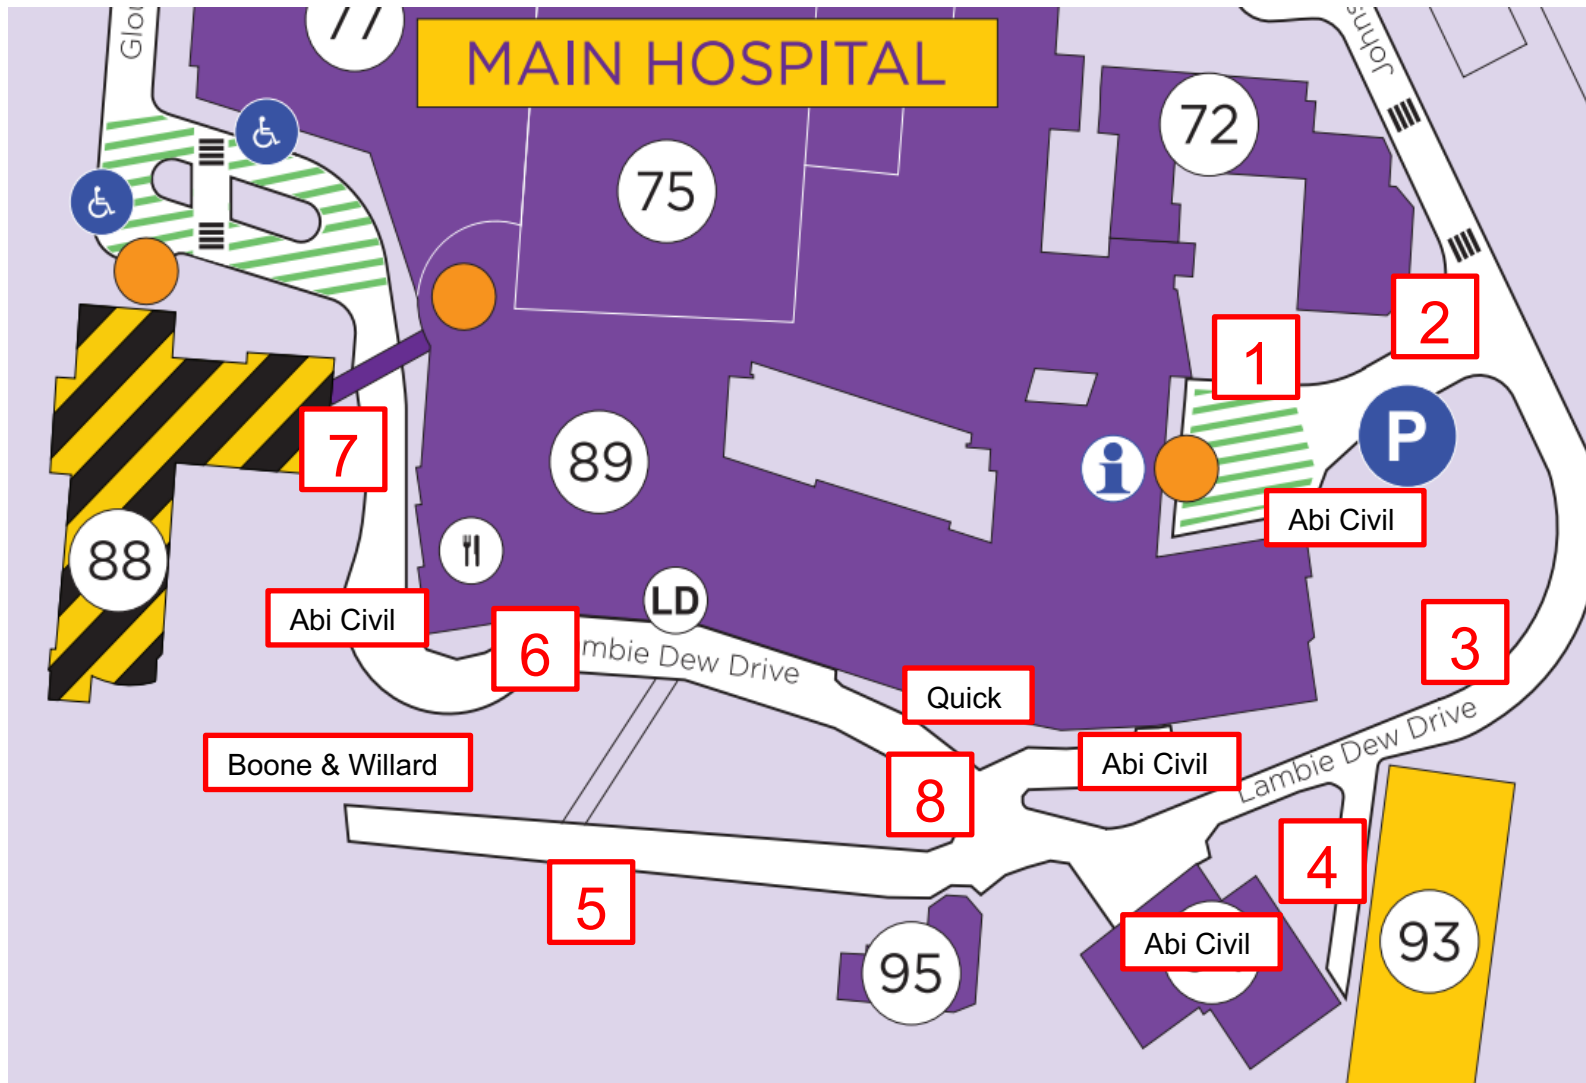


Figure 1. Air Monitoring Location.

TEST REPORT

January 17, 2025

CPB Contractors

2 & 4/177 Pacific Hwy,
North Sydney NSW 2060

Your Reference: Royal Prince Alfred Hospital – Redevelopment Works
Job Number: 76105

Attention: Zach Foster

Dear Zach,

In accordance with your instructions, Airsafe conducted air monitoring for airborne asbestos fibres at the above site.

The following samples were processed on the dates indicated.

Samples:	8 Filters
Date of Sampling:	16/01/25
Date of Analysis:	17/01/25
Date of Preliminary Report Sent:	Not Issued

The results are contained in the following pages of this report.

Should you have any queries regarding this report please contact the undersigned.

Yours faithfully
AIRSAFE LABORATORIES PTY LTD



Pamela Mavroidis
Approved Counter and Signatory

PROJECT: Royal Prince Alfred Hospital – Redevelopment Works

JOB NO: 76105

Sample No	Location/Reference	Time		Total Time [min]	Air Flow Average [L/min]	Fields	Fibres	Concentration (Fibres/mL)
		On	Off					
76105–65	Redevelopment Works – Location 1	0645	1445	480	2.0	100	0	<0.01
76105–66	Redevelopment Works – Location 2	0641	1441	480	2.0	100	0	<0.01
76105–67	Redevelopment Works – Location 3	0638	1438	480	2.0	100	0	<0.01
76105–68	Redevelopment Works – Location 4	0635	1435	480	2.0	100	0	<0.01
76105–69	Redevelopment Works – Location 5	0650	1450	480	2.0	100	0	<0.01
76105–70	Redevelopment Works – Location 6	0631	1431	480	2.0	100	0	<0.01
76105–71	Redevelopment Works – Location 7	0632	1431	480	2.0	100	0	<0.01
76105–72	Redevelopment Works – Location 8	0628	1428	480	2.0	100	0	<0.01

Method: Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)] and in-house method AS101 – Membrane Filter Method for Estimating Airborne Asbestos Fibres.

Sampling: All samples have been taken by Airsafe personnel in accordance with the sampling plan detailed in method AS101.

Location of Laboratory Activities: Level 1, 488 Botany Road, Beaconsfield NSW 2015 Australia.

Quality Control: A field blank is taken and analysed for each batch of samples.

Environmental Conditions: Background air monitoring during removal works.

Comment: These calculated concentrations are less than the reporting limit of 0.01 fibres/mL for control and exposure monitoring as stated in the Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)].

Disclaimer: N/A

Sampled By: Pamela Mavroidis, Licensed Asbestos Assessor [SafeWork NSW Licence No LAA 002067].

Note: The measured results fall within a 95% confidence interval (calculated using a coverage factor of 2) in accordance with the NOHSC:3003(2005). The results relate only to the samples tested.

NATA is a signatory to the ILAC Mutual Recognition Arrangement for the mutual recognition of the equivalence of testing, medical testing, calibration, inspection, proficiency testing scheme providers and reference materials producers reports and certificates.

Airsafe shall not be liable for loss, cost, damages or expenses incurred by the client, or any other person or company, resulting from the use of any information or interpretation given in this report. In no case shall Airsafe be liable for consequential damages including, but not limited to, lost profits, damages for failure to meet deadlines and lost production arising from this report.

Any other holder of this document is advised that information contained hereon reflects Airsafe's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Airsafe's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents.

SITE MAP

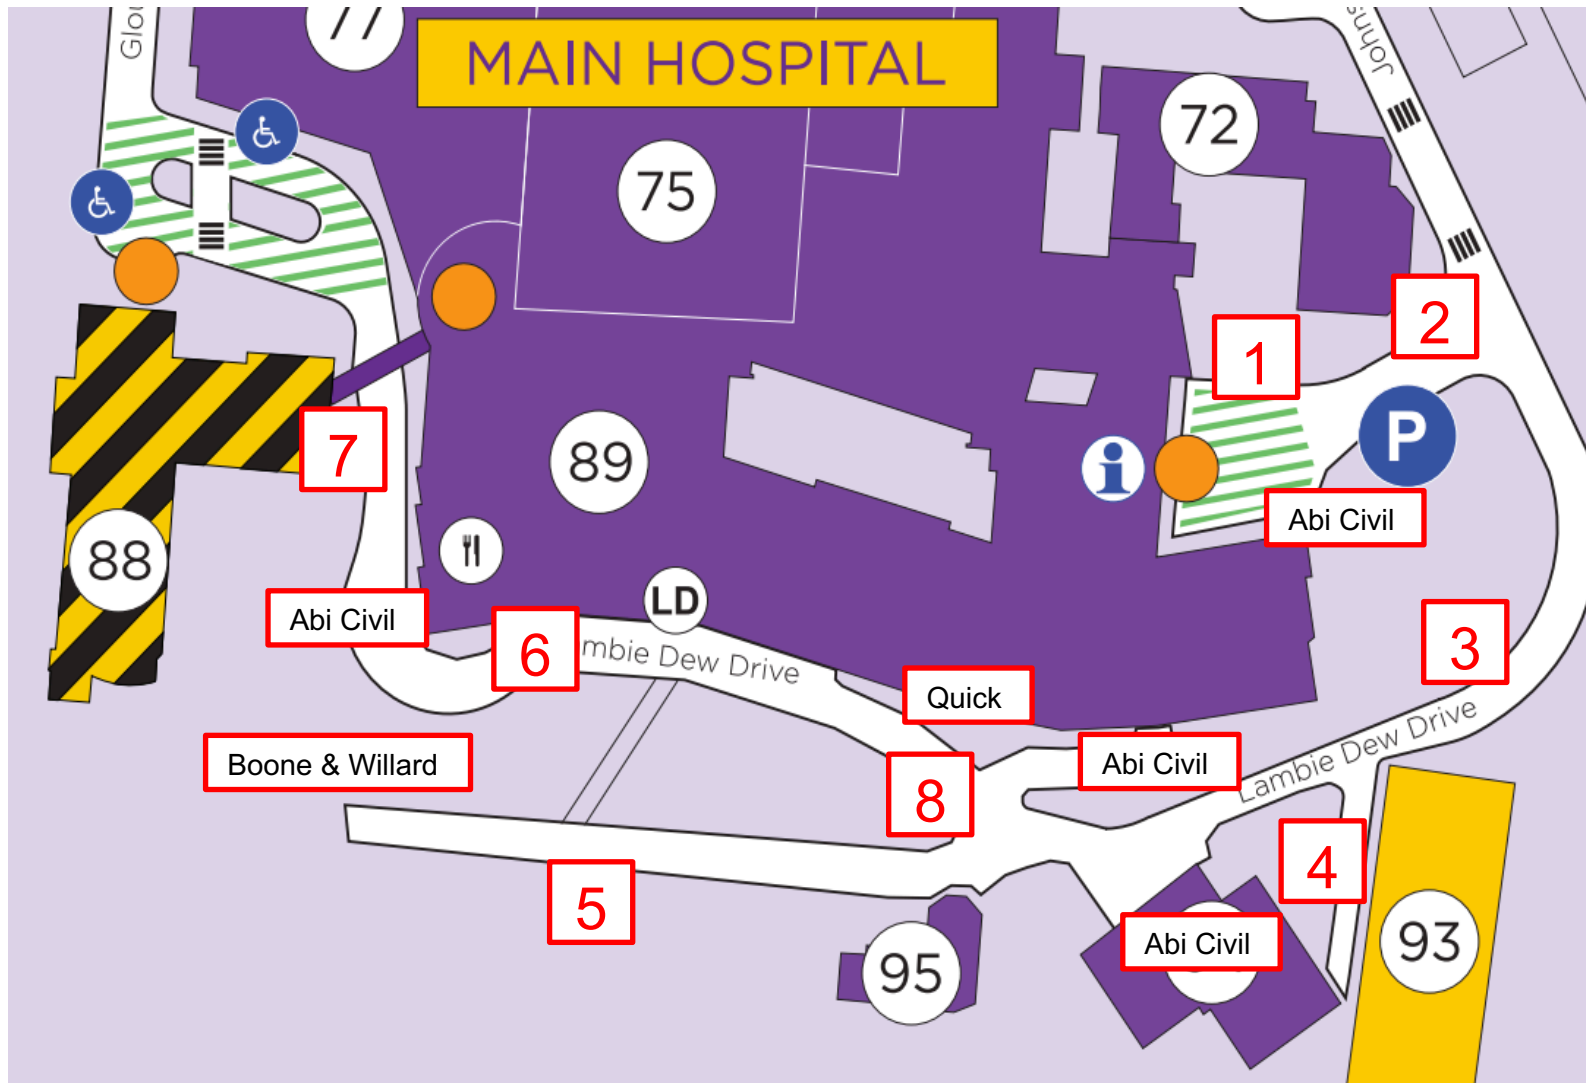


Figure 1. Air Monitoring Location.

TEST REPORT

January 20, 2025

CPB Contractors

2 & 4/177 Pacific Hwy,
North Sydney NSW 2060

Your Reference: Royal Prince Alfred Hospital – Redevelopment Works
Job Number: 76105

Attention: Zach Foster

Dear Zach,

In accordance with your instructions, Airsafe conducted air monitoring for airborne asbestos fibres at the above site.

The following samples were processed on the dates indicated.

Samples:	8 Filters
Date of Sampling:	17/01/25
Date of Analysis:	20/01/25
Date of Preliminary Report Sent:	Not Issued

The results are contained in the following pages of this report.

Should you have any queries regarding this report please contact the undersigned.

Yours faithfully
AIRSAFE LABORATORIES PTY LTD



Pamela Mavroidis
Approved Counter and Signatory

PROJECT: Royal Prince Alfred Hospital – Redevelopment Works

JOB NO: 76105

Sample No	Location/Reference	Time		Total Time [min]	Air Flow Average [L/min]	Fields	Fibres	Concentration (Fibres/mL)
		On	Off					
76105–73	Redevelopment Works – Location 1	0645	1445	480	2.0	100	0	<0.01
76105–74	Redevelopment Works – Location 2	0643	1443	480	2.0	100	0	<0.01
76105–75	Redevelopment Works – Location 3	0641	1441	480	2.0	100	0	<0.01
76105–76	Redevelopment Works – Location 4	0640	1440	480	2.0	100	0	<0.01
76105–77	Redevelopment Works – Location 5	0649	1449	480	2.0	100	0	<0.01
76105–78	Redevelopment Works – Location 6	0635	1435	480	2.0	100	0	<0.01
76105–79	Redevelopment Works – Location 7	0633	1433	480	2.0	100	0	<0.01
76105–80	Redevelopment Works – Location 8	0736	1436	480	2.0	100	0	<0.01

Method: Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)] and in-house method AS101 – Membrane Filter Method for Estimating Airborne Asbestos Fibres.

Sampling: All samples have been taken by Airsafe personnel in accordance with the sampling plan detailed in method AS101.

Location of Laboratory Activities: Level 1, 488 Botany Road, Beaconsfield NSW 2015 Australia.

Quality Control: A field blank is taken and analysed for each batch of samples.

Environmental Conditions: Background air monitoring during removal works.

Comment: These calculated concentrations are less than the reporting limit of 0.01 fibres/mL for control and exposure monitoring as stated in the Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)].

Disclaimer: N/A

Sampled By: Pamela Mavroidis, Licensed Asbestos Assessor [SafeWork NSW Licence No LAA 002067].

Note: The measured results fall within a 95% confidence interval (calculated using a coverage factor of 2) in accordance with the NOHSC:3003(2005). The results relate only to the samples tested.

NATA is a signatory to the ILAC Mutual Recognition Arrangement for the mutual recognition of the equivalence of testing, medical testing, calibration, inspection, proficiency testing scheme providers and reference materials producers reports and certificates.

Airsafe shall not be liable for loss, cost, damages or expenses incurred by the client, or any other person or company, resulting from the use of any information or interpretation given in this report. In no case shall Airsafe be liable for consequential damages including, but not limited to, lost profits, damages for failure to meet deadlines and lost production arising from this report.

Any other holder of this document is advised that information contained hereon reflects Airsafe's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Airsafe's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents.

SITE MAP

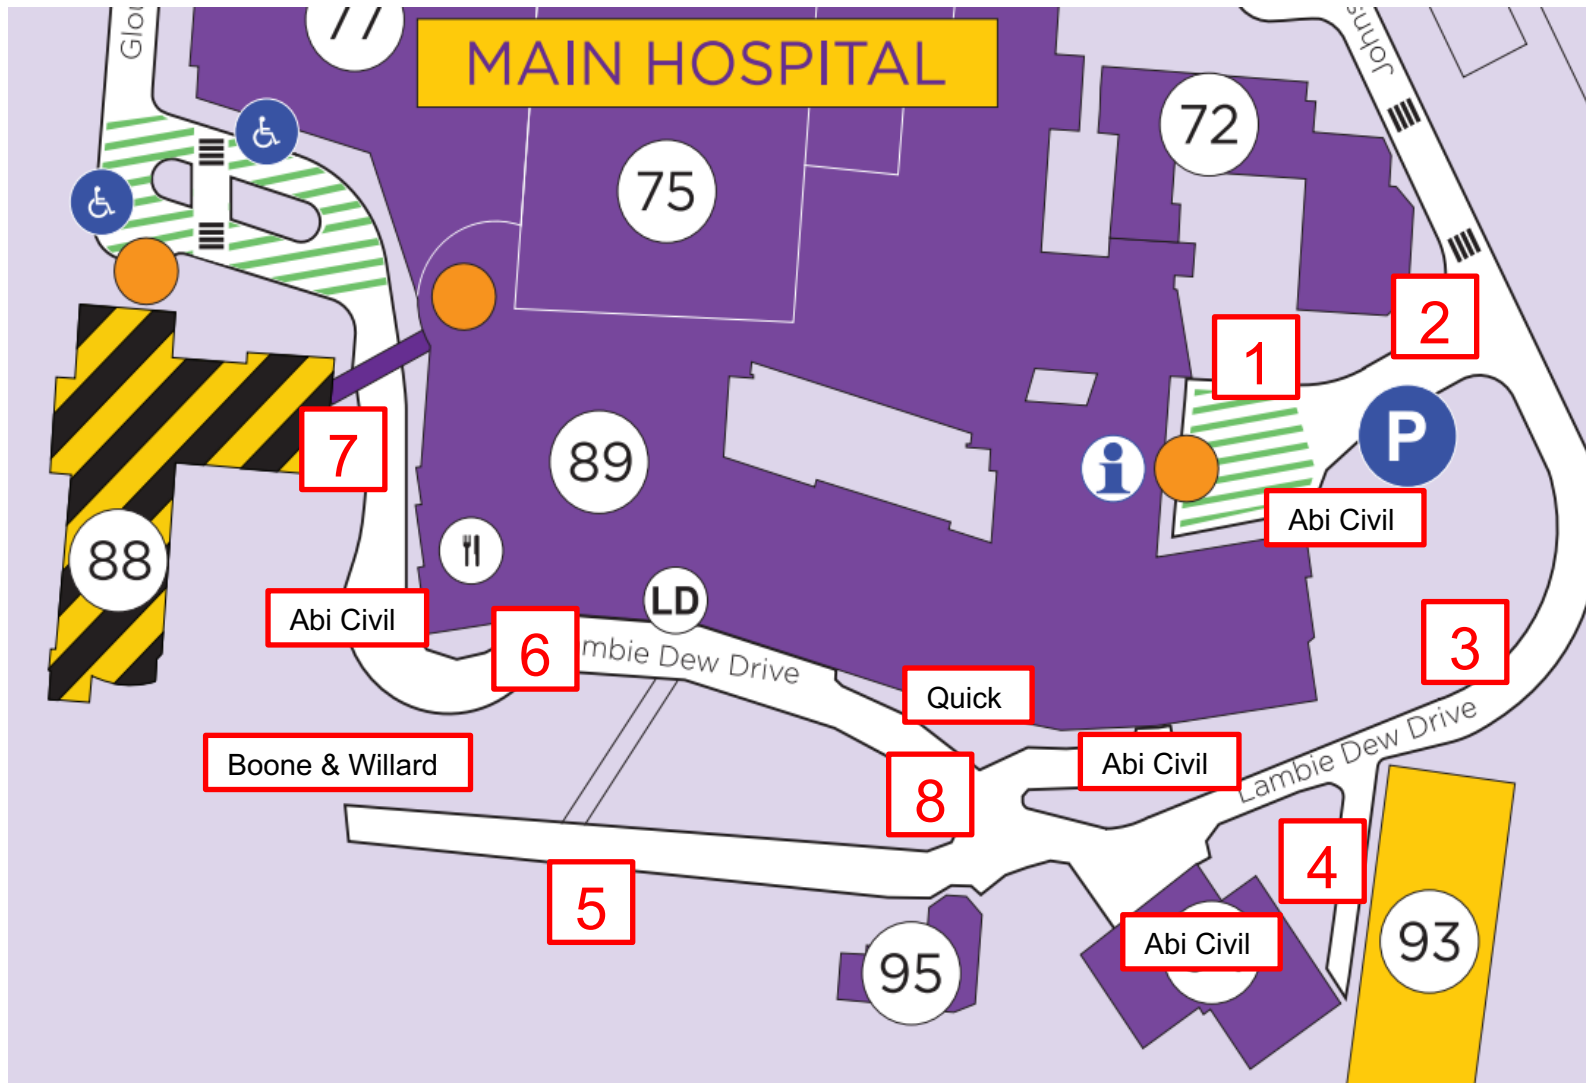


Figure 1. Air Monitoring Location.

TEST REPORT

January 21, 2025

CPB Contractors
2 & 4/177 Pacific Hwy,
North Sydney NSW 2060

Your Reference: Royal Prince Alfred Hospital – Redevelopment Works
Job Number: 76105

Attention: Zach Foster

Dear Zach,

In accordance with your instructions, Airsafe conducted air monitoring for airborne asbestos fibres at the above site.

The following samples were processed on the dates indicated.

Samples:	8 Filters
Date of Sampling:	20/01/25
Date of Analysis:	21/01/25
Date of Preliminary Report Sent:	Not Issued

The results are contained in the following pages of this report.

Should you have any queries regarding this report please contact the undersigned.

Yours faithfully
AIRSAFE LABORATORIES PTY LTD



Pamela Mavroidis
Approved Counter and Signatory

PROJECT: Royal Prince Alfred Hospital – Redevelopment Works

JOB NO: 76105

Sample No	Location/Reference	Time		Total Time [min]	Air Flow Average [L/min]	Fields	Fibres	Concentration (Fibres/mL)
		On	Off					
76105–81	Redevelopment Works – Location 1	0701	1501	480	2.0	100	0	<0.01
76105–82	Redevelopment Works – Location 2	0702	1502	480	2.0	100	0	<0.01
76105–83	Redevelopment Works – Location 3	0710	1510	480	2.0	100	0	<0.01
76105–84	Redevelopment Works – Location 4	0712	1512	480	2.0	100	0	<0.01
76105–85	Redevelopment Works – Location 5	0705	1505	480	2.0	100	0	<0.01
76105–86	Redevelopment Works – Location 6	0715	1515	480	2.0	100	0	<0.01
76105–87	Redevelopment Works – Location 7	0718	1518	480	2.0	100	0	<0.01
76105–88	Redevelopment Works – Location 8	0719	1519	480	2.0	100	0	<0.01

Method: Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)] and in-house method AS101 – Membrane Filter Method for Estimating Airborne Asbestos Fibres.

Sampling: All samples have been taken by Airsafe personnel in accordance with the sampling plan detailed in method AS101.

Location of Laboratory Activities: Level 1, 488 Botany Road, Beaconsfield NSW 2015 Australia.

Quality Control: A field blank is taken and analysed for each batch of samples.

Environmental Conditions: Background air monitoring during removal works.

Comment: These calculated concentrations are less than the reporting limit of 0.01 fibres/mL for control and exposure monitoring as stated in the Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)].

Disclaimer: N/A

Sampled By: Pamela Mavroidis, Licensed Asbestos Assessor [SafeWork NSW Licence No LAA 002067].

Note: The measured results fall within a 95% confidence interval (calculated using a coverage factor of 2) in accordance with the NOHSC:3003(2005). The results relate only to the samples tested.

NATA is a signatory to the ILAC Mutual Recognition Arrangement for the mutual recognition of the equivalence of testing, medical testing, calibration, inspection, proficiency testing scheme providers and reference materials producers reports and certificates.

Airsafe shall not be liable for loss, cost, damages or expenses incurred by the client, or any other person or company, resulting from the use of any information or interpretation given in this report. In no case shall Airsafe be liable for consequential damages including, but not limited to, lost profits, damages for failure to meet deadlines and lost production arising from this report.

Any other holder of this document is advised that information contained hereon reflects Airsafe's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Airsafe's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents.

SITE MAP

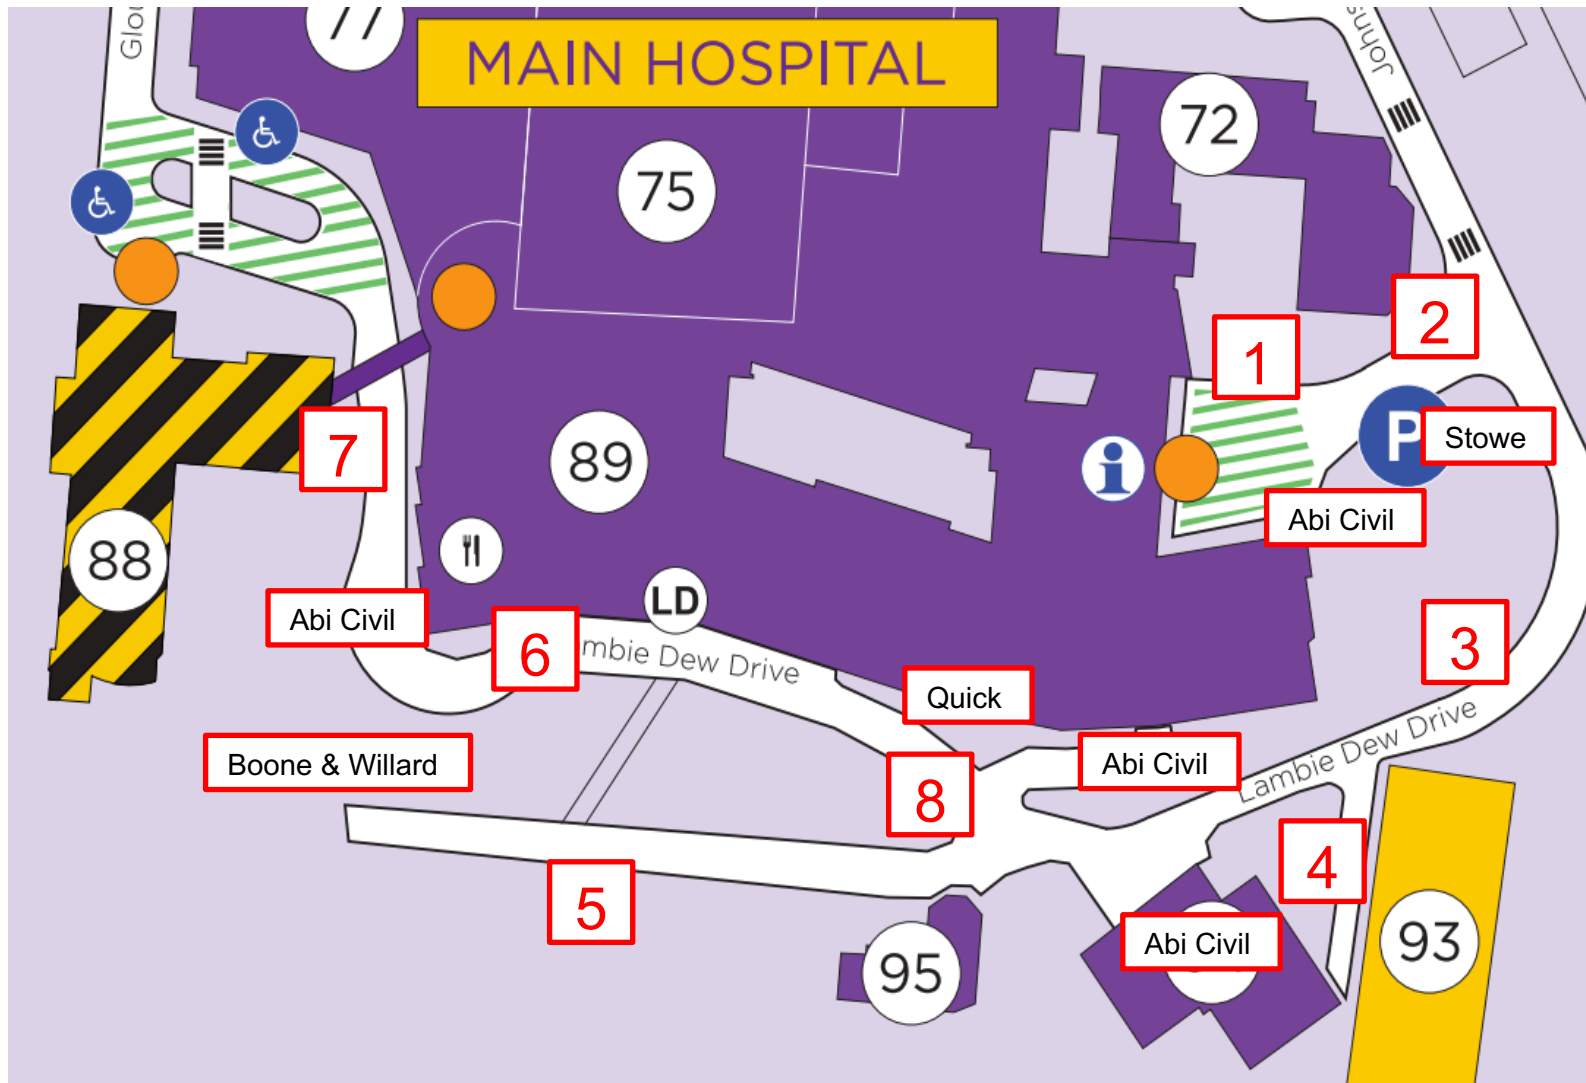


Figure 1. Air Monitoring Location.

TEST REPORT

January 22, 2025

CPB Contractors
2 & 4/177 Pacific Hwy,
North Sydney NSW 2060

Your Reference: Royal Prince Alfred Hospital – Redevelopment Works
Job Number: 76105

Attention: Zach Foster

Dear Zach,

In accordance with your instructions, Airsafe conducted air monitoring for airborne asbestos fibres at the above site.

The following samples were processed on the dates indicated.

Samples:	8 Filters
Date of Sampling:	21/01/25
Date of Analysis:	22/01/25
Date of Preliminary Report Sent:	Not Issued

The results are contained in the following pages of this report.

Should you have any queries regarding this report please contact the undersigned.

Yours faithfully
AIRSAFE LABORATORIES PTY LTD



Pamela Mavroidis
Approved Counter and Signatory

PROJECT: Royal Prince Alfred Hospital – Redevelopment Works

JOB NO: 76105

Sample No	Location/Reference	Time		Total Time [min]	Air Flow Average [L/min]	Fields	Fibres	Concentration (Fibres/mL)
		On	Off					
76105–89	Redevelopment Works – Location 1	0648	1448	480	2.0	100	0	<0.01
76105–90	Redevelopment Works – Location 2	0644	1444	480	2.0	100	0	<0.01
76105–91	Redevelopment Works – Location 3	0640	1440	480	2.0	100	0	<0.01
76105–92	Redevelopment Works – Location 4	0638	1438	480	2.0	100	0	<0.01
76105–93	Redevelopment Works – Location 5	0655	1455	480	2.0	100	0	<0.01
76105–94	Redevelopment Works – Location 6	0632	1432	480	2.0	100	0	<0.01
76105–95	Redevelopment Works – Location 7	0633	1433	480	2.0	100	0	<0.01
76105–96	Redevelopment Works – Location 8	0630	1430	480	2.0	100	0	<0.01

Method: Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)] and in-house method AS101 – Membrane Filter Method for Estimating Airborne Asbestos Fibres.

Sampling: All samples have been taken by Airsafe personnel in accordance with the sampling plan detailed in method AS101.

Location of Laboratory Activities: Level 1, 488 Botany Road, Beaconsfield NSW 2015 Australia.

Quality Control: A field blank is taken and analysed for each batch of samples.

Environmental Conditions: Background air monitoring during removal works.

Comment: These calculated concentrations are less than the reporting limit of 0.01 fibres/mL for control and exposure monitoring as stated in the Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)].

Disclaimer: N/A

Sampled By: Pamela Mavroidis, Licensed Asbestos Assessor [SafeWork NSW Licence No LAA 002067].

Note: The measured results fall within a 95% confidence interval (calculated using a coverage factor of 2) in accordance with the NOHSC:3003(2005). The results relate only to the samples tested.

NATA is a signatory to the ILAC Mutual Recognition Arrangement for the mutual recognition of the equivalence of testing, medical testing, calibration, inspection, proficiency testing scheme providers and reference materials producers reports and certificates.

Airsafe shall not be liable for loss, cost, damages or expenses incurred by the client, or any other person or company, resulting from the use of any information or interpretation given in this report. In no case shall Airsafe be liable for consequential damages including, but not limited to, lost profits, damages for failure to meet deadlines and lost production arising from this report.

Any other holder of this document is advised that information contained hereon reflects Airsafe's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Airsafe's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents.

SITE MAP

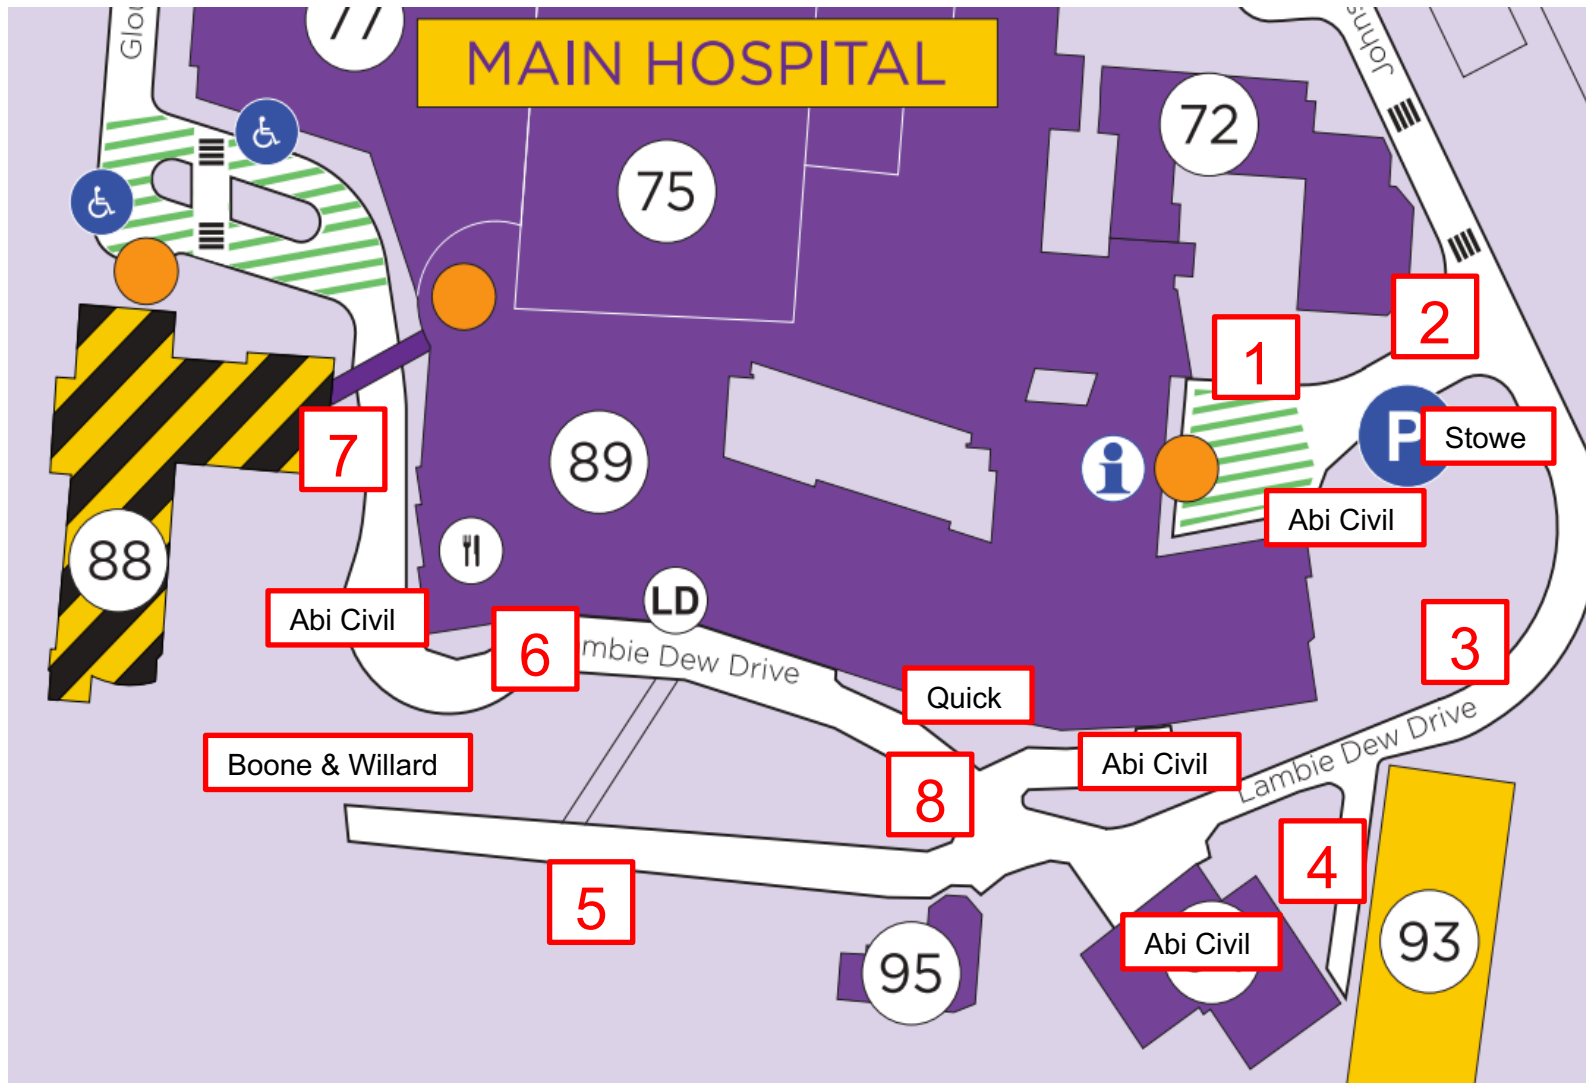


Figure 1. Air Monitoring Location.

TEST REPORT

January 23, 2025

CPB Contractors
2 & 4/177 Pacific Hwy,
North Sydney NSW 2060

Your Reference: Royal Prince Alfred Hospital – Redevelopment Works
Job Number: 76105

Attention: Zach Foster

Dear Zach,

In accordance with your instructions, Airsafe conducted air monitoring for airborne asbestos fibres at the above site.

The following samples were processed on the dates indicated.

Samples:	8 Filters
Date of Sampling:	22/01/25
Date of Analysis:	23/01/25
Date of Preliminary Report Sent:	Not Issued

The results are contained in the following pages of this report.

Should you have any queries regarding this report please contact the undersigned.

Yours faithfully
AIRSAFE LABORATORIES PTY LTD



Pamela Mavroidis
Approved Counter and Signatory

PROJECT: Royal Prince Alfred Hospital – Redevelopment Works

JOB NO: 76105

Sample No	Location/Reference	Time		Total Time [min]	Air Flow Average [L/min]	Fields	Fibres	Concentration (Fibres/mL)
		On	Off					
76105–97	Redevelopment Works – Location 1	0650	1450	480	2.0	100	0	<0.01
76105–98	Redevelopment Works – Location 2	0648	1448	480	2.0	100	0	<0.01
76105–99	Redevelopment Works – Location 3	0646	1446	480	2.0	100	0	<0.01
76105–100	Redevelopment Works – Location 4	0645	1445	480	2.0	100	0	<0.01
76105–101	Redevelopment Works – Location 5	0654	1454	480	2.0	100	0	<0.01
76105–102	Redevelopment Works – Location 6	0641	1441	480	2.0	100	0	<0.01
76105–103	Redevelopment Works – Location 7	0642	1442	480	2.0	100	0	<0.01
76105–104	Redevelopment Works – Location 8	0640	1440	480	2.0	100	0	<0.01

Method: Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)] and in-house method AS101 – Membrane Filter Method for Estimating Airborne Asbestos Fibres.

Sampling: All samples have been taken by Airsafe personnel in accordance with the sampling plan detailed in method AS101.

Location of Laboratory Activities: Level 1, 488 Botany Road, Beaconsfield NSW 2015 Australia.

Quality Control: A field blank is taken and analysed for each batch of samples.

Environmental Conditions: Background air monitoring during removal works.

Comment: These calculated concentrations are less than the reporting limit of 0.01 fibres/mL for control and exposure monitoring as stated in the Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)].

Disclaimer: N/A

Sampled By: Pamela Mavroidis, Licensed Asbestos Assessor [SafeWork NSW Licence No LAA 002067].

Note: The measured results fall within a 95% confidence interval (calculated using a coverage factor of 2) in accordance with the NOHSC:3003(2005). The results relate only to the samples tested.

NATA is a signatory to the ILAC Mutual Recognition Arrangement for the mutual recognition of the equivalence of testing, medical testing, calibration, inspection, proficiency testing scheme providers and reference materials producers reports and certificates.

Airsafe shall not be liable for loss, cost, damages or expenses incurred by the client, or any other person or company, resulting from the use of any information or interpretation given in this report. In no case shall Airsafe be liable for consequential damages including, but not limited to, lost profits, damages for failure to meet deadlines and lost production arising from this report.

Any other holder of this document is advised that information contained hereon reflects Airsafe's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Airsafe's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents.

SITE MAP

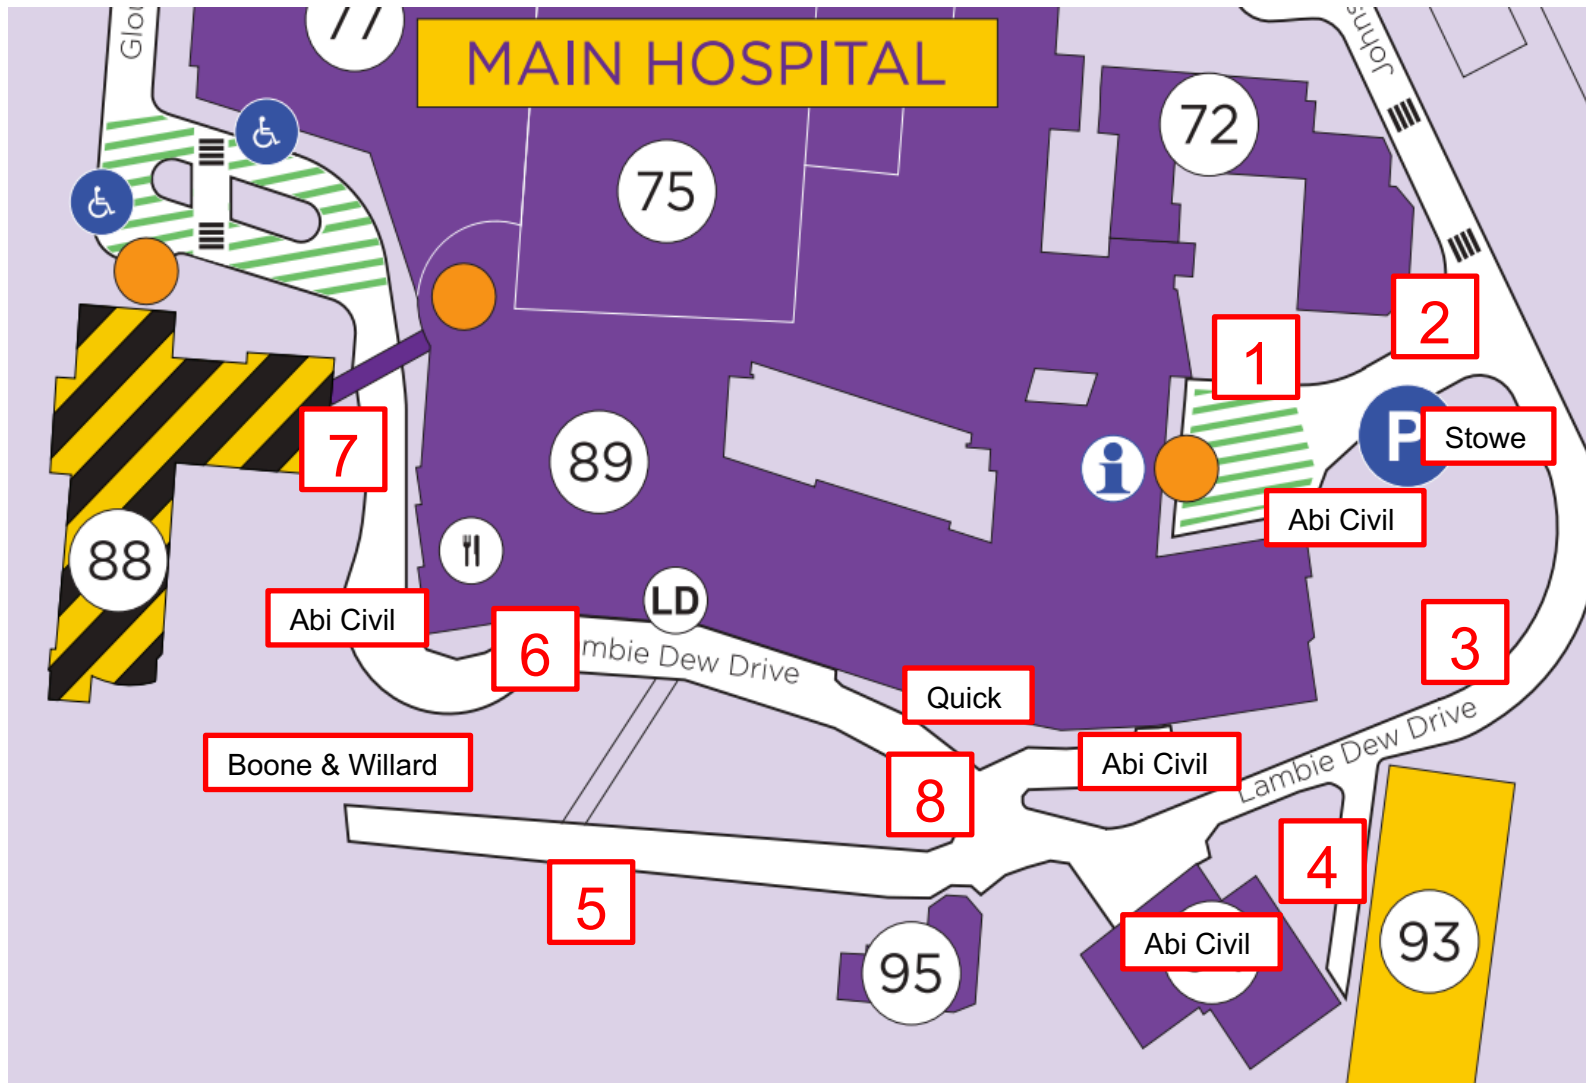


Figure 1. Air Monitoring Location.

TEST REPORT

January 24, 2025

CPB Contractors
2 & 4/177 Pacific Hwy,
North Sydney NSW 2060

Your Reference: Royal Prince Alfred Hospital – Redevelopment Works
Job Number: 76105

Attention: Zach Foster

Dear Zach,

In accordance with your instructions, Airsafe conducted air monitoring for airborne asbestos fibres at the above site.

The following samples were processed on the dates indicated.

Samples:	8 Filters
Date of Sampling:	23/01/25
Date of Analysis:	24/01/25
Date of Preliminary Report Sent:	Not Issued

The results are contained in the following pages of this report.

Should you have any queries regarding this report please contact the undersigned.

Yours faithfully
AIRSAFE LABORATORIES PTY LTD

A handwritten signature in black ink, appearing to be "Pm", with a stylized loop and a horizontal stroke.

Pamela Mavroidis
Approved Counter and Signatory

PROJECT: Royal Prince Alfred Hospital – Redevelopment Works

JOB NO: 76105

Sample No	Location/Reference	Time		Total Time [min]	Air Flow Average [L/min]	Fields	Fibres	Concentration (Fibres/mL)
		On	Off					
76105–105	Redevelopment Works – Location 1	0648	1448	480	2.0	100	0	<0.01
76105–106	Redevelopment Works – Location 2	0645	1445	480	2.0	100	0	<0.01
76105–107	Redevelopment Works – Location 3	0642	1442	480	2.0	100	0	<0.01
76105–108	Redevelopment Works – Location 4	0640	1440	480	2.0	100	0	<0.01
76105–109	Redevelopment Works – Location 5	0635	1435	480	2.0	100	0	<0.01
76105–110	Redevelopment Works – Location 6	0659	1459	480	2.0	100	0	<0.01
76105–111	Redevelopment Works – Location 7	0657	1457	480	2.0	100	0	<0.01
76105–112	Redevelopment Works – Location 8	0655	1455	480	2.0	100	0	<0.01

Method: Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)] and in-house method AS101 – Membrane Filter Method for Estimating Airborne Asbestos Fibres.

Sampling: All samples have been taken by Airsafe personnel in accordance with the sampling plan detailed in method AS101.

Location of Laboratory Activities: Level 1, 488 Botany Road, Beaconsfield NSW 2015 Australia.

Quality Control: A field blank is taken and analysed for each batch of samples.

Environmental Conditions: Background air monitoring during removal works.

Comment: These calculated concentrations are less than the reporting limit of 0.01 fibres/mL for control and exposure monitoring as stated in the Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)].

Disclaimer: N/A

Sampled By: Pamela Mavroidis, Licensed Asbestos Assessor [SafeWork NSW Licence No LAA 002067].

Note: The measured results fall within a 95% confidence interval (calculated using a coverage factor of 2) in accordance with the NOHSC:3003(2005). The results relate only to the samples tested.

NATA is a signatory to the ILAC Mutual Recognition Arrangement for the mutual recognition of the equivalence of testing, medical testing, calibration, inspection, proficiency testing scheme providers and reference materials producers reports and certificates.

Airsafe shall not be liable for loss, cost, damages or expenses incurred by the client, or any other person or company, resulting from the use of any information or interpretation given in this report. In no case shall Airsafe be liable for consequential damages including, but not limited to, lost profits, damages for failure to meet deadlines and lost production arising from this report.

Any other holder of this document is advised that information contained hereon reflects Airsafe's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Airsafe's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents.

SITE MAP

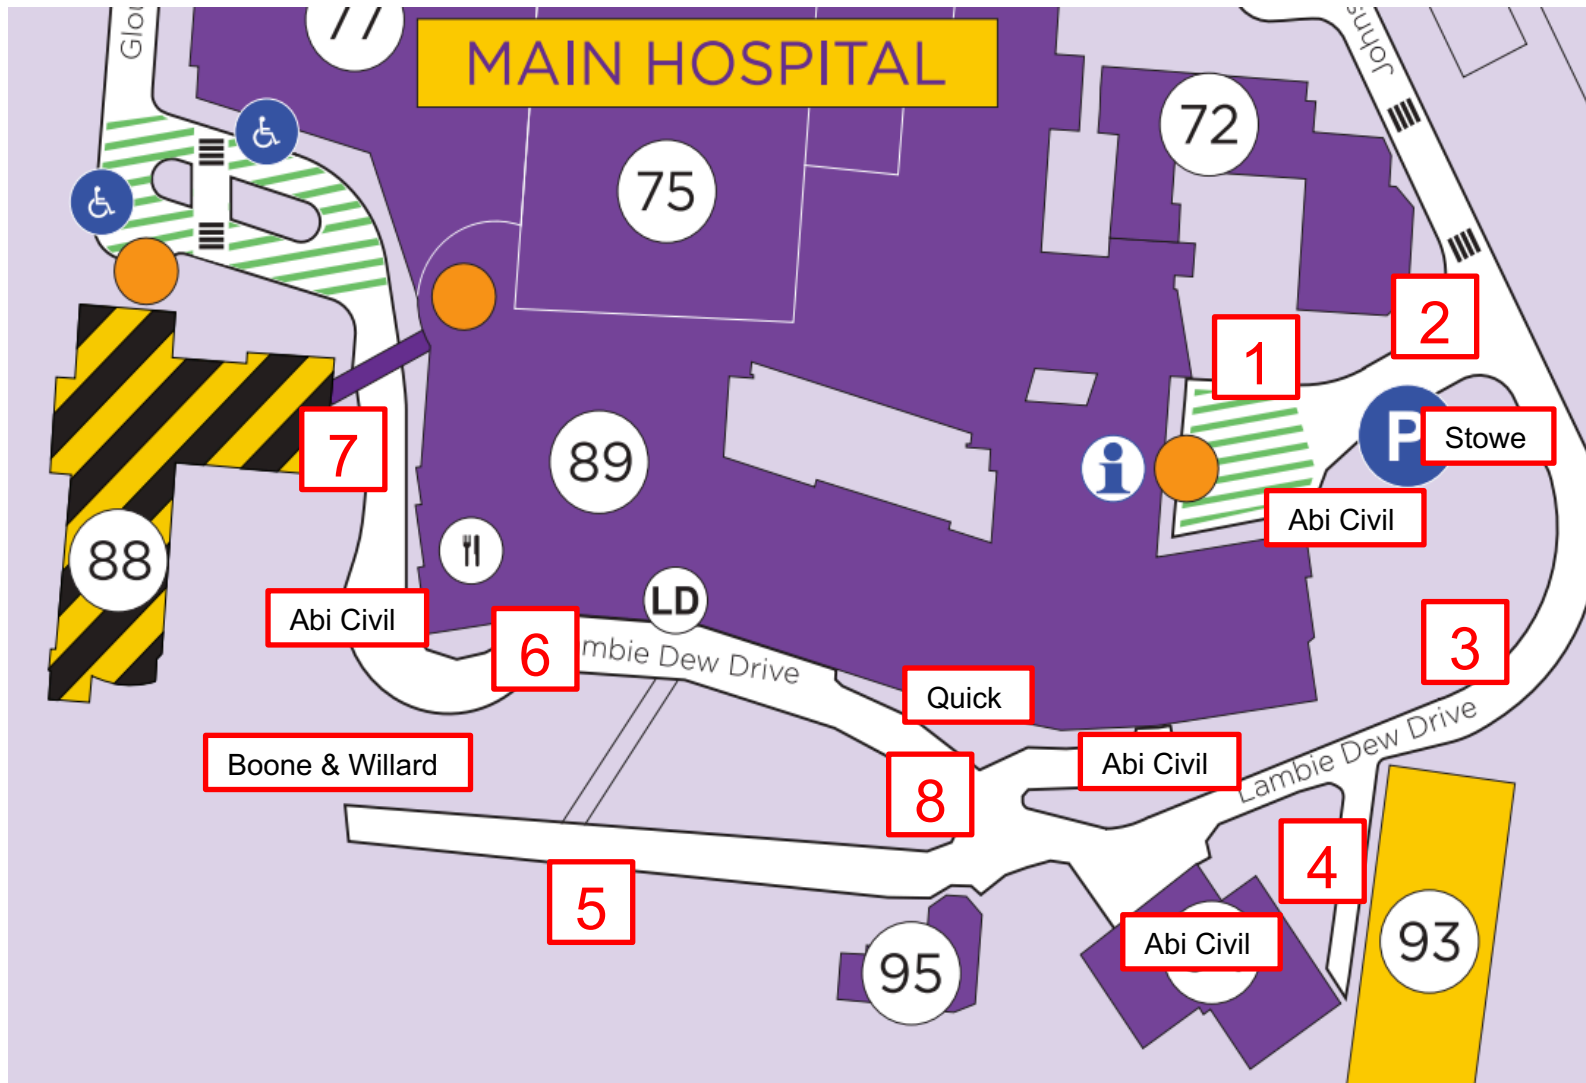


Figure 1. Air Monitoring Location.

TEST REPORT

January 29, 2025

CPB Contractors
2 & 4/177 Pacific Hwy,
North Sydney NSW 2060

Your Reference: Royal Prince Alfred Hospital – Redevelopment Works
Job Number: 76105

Attention: Zach Foster

Dear Zach,

In accordance with your instructions, Airsafe conducted air monitoring for airborne asbestos fibres at the above site.

The following samples were processed on the dates indicated.

Samples:	8 Filters
Date of Sampling:	24/01/25
Date of Analysis:	29/01/25
Date of Preliminary Report Sent:	Not Issued

The results are contained in the following pages of this report.

Should you have any queries regarding this report please contact the undersigned.

Yours faithfully
AIRSAFE LABORATORIES PTY LTD



Pamela Mavroidis
Approved Counter and Signatory

PROJECT: Royal Prince Alfred Hospital – Redevelopment Works

JOB NO: 76105

Sample No	Location/Reference	Time		Total Time [min]	Air Flow Average [L/min]	Fields	Fibres	Concentration (Fibres/mL)
		On	Off					
76105–113	Redevelopment Works – Location 1	0709	1509	480	2.0	100	0	<0.01
76105–114	Redevelopment Works – Location 2	0705	1505	480	2.0	100	0	<0.01
76105–115	Redevelopment Works – Location 3	0703	1503	480	2.0	100	0	<0.01
76105–116	Redevelopment Works – Location 4	0701	1501	480	2.0	100	0	<0.01
76105–117	Redevelopment Works – Location 5	0655	1455	480	2.0	100	0	<0.01
76105–118	Redevelopment Works – Location 6	0717	1517	480	2.0	100	0	<0.01
76105–119	Redevelopment Works – Location 7	0718	1518	480	2.0	100	0	<0.01
76105–120	Redevelopment Works – Location 8	0716	1516	480	2.0	100	0	<0.01

Method: Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)] and in-house method AS101 – Membrane Filter Method for Estimating Airborne Asbestos Fibres.

Sampling: All samples have been taken by Airsafe personnel in accordance with the sampling plan detailed in method AS101.

Location of Laboratory Activities: Level 1, 488 Botany Road, Beaconsfield NSW 2015 Australia.

Quality Control: A field blank is taken and analysed for each batch of samples.

Environmental Conditions: Background air monitoring during removal works.

Comment: These calculated concentrations are less than the reporting limit of 0.01 fibres/mL for control and exposure monitoring as stated in the Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)].

Disclaimer: N/A

Sampled By: Pamela Mavroidis, Licensed Asbestos Assessor [SafeWork NSW Licence No LAA 002067].

Note: The measured results fall within a 95% confidence interval (calculated using a coverage factor of 2) in accordance with the NOHSC:3003(2005). The results relate only to the samples tested.

NATA is a signatory to the ILAC Mutual Recognition Arrangement for the mutual recognition of the equivalence of testing, medical testing, calibration, inspection, proficiency testing scheme providers and reference materials producers reports and certificates.

Airsafe shall not be liable for loss, cost, damages or expenses incurred by the client, or any other person or company, resulting from the use of any information or interpretation given in this report. In no case shall Airsafe be liable for consequential damages including, but not limited to, lost profits, damages for failure to meet deadlines and lost production arising from this report.

Any other holder of this document is advised that information contained hereon reflects Airsafe's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Airsafe's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents.

SITE MAP

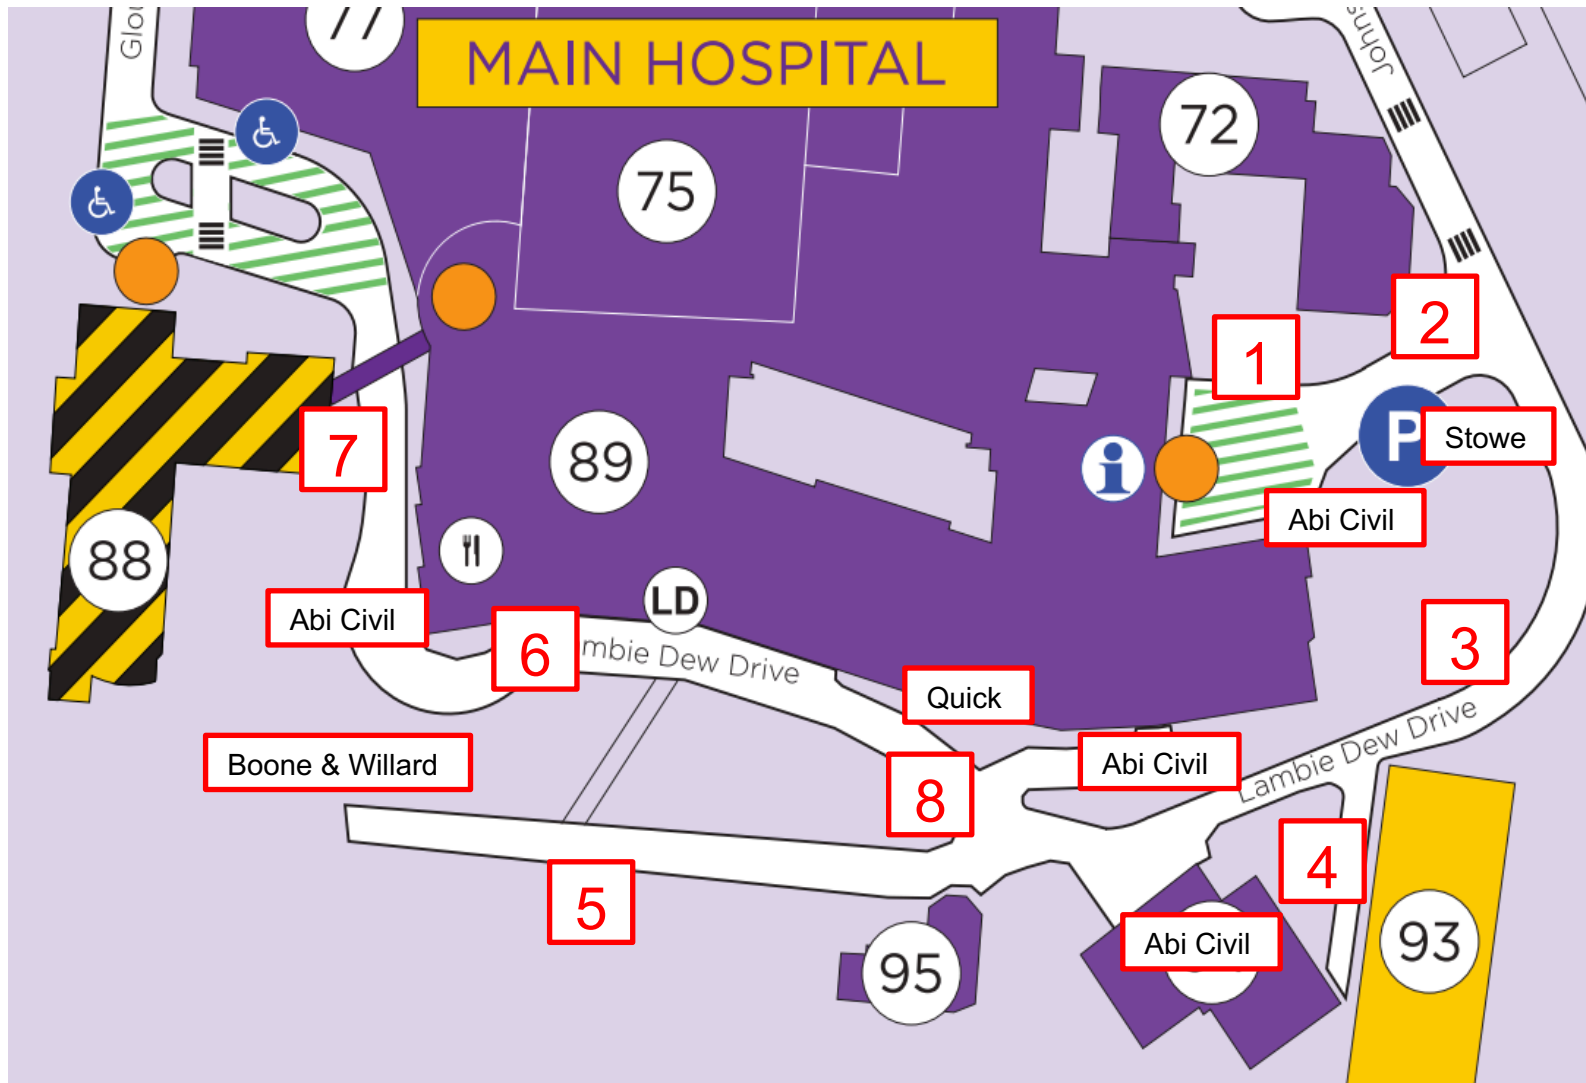


Figure 1. Air Monitoring Location.

TEST REPORT

January 30, 2025

CPB Contractors
2 & 4/177 Pacific Hwy,
North Sydney NSW 2060

Your Reference: Royal Prince Alfred Hospital – Redevelopment Works
Job Number: 76105

Attention: Zach Foster

Dear Zach,

In accordance with your instructions, Airsafe conducted air monitoring for airborne asbestos fibres at the above site.

The following samples were processed on the dates indicated.

Samples:	8 Filters
Date of Sampling:	29/01/25
Date of Analysis:	30/01/25
Date of Preliminary Report Sent:	Not Issued

The results are contained in the following pages of this report.

Should you have any queries regarding this report please contact the undersigned.

Yours faithfully
AIRSAFE LABORATORIES PTY LTD



Pamela Mavroidis
Approved Counter and Signatory

PROJECT: Royal Prince Alfred Hospital – Redevelopment Works

JOB NO: 76105

Sample No	Location/Reference	Time		Total Time [min]	Air Flow Average [L/min]	Fields	Fibres	Concentration (Fibres/mL)
		On	Off					
76105–121	Redevelopment Works – Location 1	0648	1448	480	2.0	100	0	<0.01
76105–122	Redevelopment Works – Location 2	0652	1452	480	2.0	100	0	<0.01
76105–123	Redevelopment Works – Location 3	0700	1500	480	2.0	100	0	<0.01
76105–124	Redevelopment Works – Location 4	0701	1501	480	2.0	100	0	<0.01
76105–125	Redevelopment Works – Location 5	0656	1556	480	2.0	100	0	<0.01
76105–126	Redevelopment Works – Location 6	0706	1506	480	2.0	100	0	<0.01
76105–127	Redevelopment Works – Location 7	0708	1508	480	2.0	100	0	<0.01
76105–128	Redevelopment Works – Location 8	0704	1504	480	2.0	100	0	<0.01

Method: Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)] and in-house method AS101 – Membrane Filter Method for Estimating Airborne Asbestos Fibres.

Sampling: All samples have been taken by Airsafe personnel in accordance with the sampling plan detailed in method AS101.

Location of Laboratory Activities: Level 1, 488 Botany Road, Beaconsfield NSW 2015 Australia.

Quality Control: A field blank is taken and analysed for each batch of samples.

Environmental Conditions: Background air monitoring during removal works.

Comment: These calculated concentrations are less than the reporting limit of 0.01 fibres/mL for control and exposure monitoring as stated in the Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)].

Disclaimer: N/A

Sampled By: Pamela Mavroidis, Licensed Asbestos Assessor [SafeWork NSW Licence No LAA 002067].

Note: The measured results fall within a 95% confidence interval (calculated using a coverage factor of 2) in accordance with the NOHSC:3003(2005). The results relate only to the samples tested.

NATA is a signatory to the ILAC Mutual Recognition Arrangement for the mutual recognition of the equivalence of testing, medical testing, calibration, inspection, proficiency testing scheme providers and reference materials producers reports and certificates.

Airsafe shall not be liable for loss, cost, damages or expenses incurred by the client, or any other person or company, resulting from the use of any information or interpretation given in this report. In no case shall Airsafe be liable for consequential damages including, but not limited to, lost profits, damages for failure to meet deadlines and lost production arising from this report.

Any other holder of this document is advised that information contained hereon reflects Airsafe's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Airsafe's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents.

SITE MAP

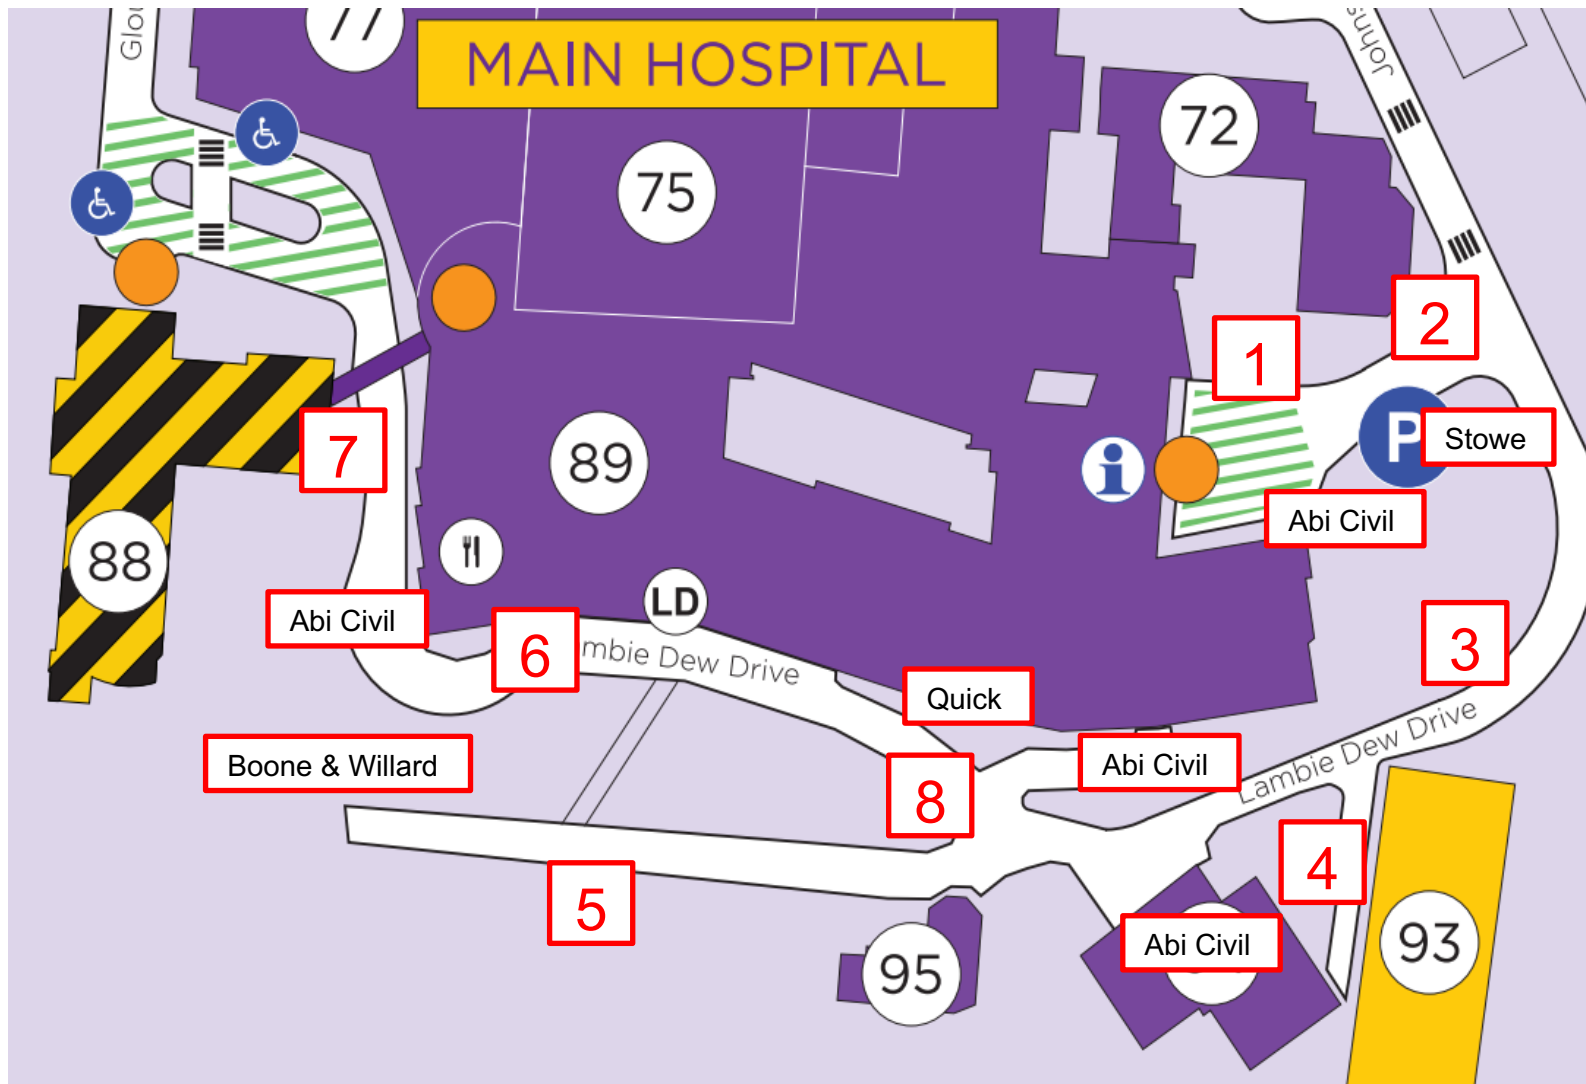


Figure 1. Air Monitoring Location.

TEST REPORT

January 31, 2025

CPB Contractors
2 & 4/177 Pacific Hwy,
North Sydney NSW 2060

Your Reference: Royal Prince Alfred Hospital – Redevelopment Works
Job Number: 76105

Attention: Zach Foster

Dear Zach,

In accordance with your instructions, Airsafe conducted air monitoring for airborne asbestos fibres at the above site.

The following samples were processed on the dates indicated.

Samples:	8 Filters
Date of Sampling:	30/01/25
Date of Analysis:	31/01/25
Date of Preliminary Report Sent:	Not Issued

The results are contained in the following pages of this report.

Should you have any queries regarding this report please contact the undersigned.

Yours faithfully
AIRSAFE LABORATORIES PTY LTD

A handwritten signature in black ink, appearing to be "Pm", with a stylized loop and a horizontal stroke.

Pamela Mavroidis
Approved Counter and Signatory

PROJECT: Royal Prince Alfred Hospital – Redevelopment Works

JOB NO: 76105

Sample No	Location/Reference	Time		Total Time [min]	Air Flow Average [L/min]	Fields	Fibres	Concentration (Fibres/mL)
		On	Off					
76105–129	Redevelopment Works – Location 1	0644	1444	480	2.0	100	0	<0.01
76105–130	Redevelopment Works – Location 2	0648	1448	480	2.0	100	0	<0.01
76105–131	Redevelopment Works – Location 3	0651	1451	480	2.0	100	0	<0.01
76105–132	Redevelopment Works – Location 4	0654	1454	480	2.0	100	0	<0.01
76105–133	Redevelopment Works – Location 5	0640	1440	480	2.0	100	0	<0.01
76105–134	Redevelopment Works – Location 6	0656	1456	480	2.0	100	0	<0.01
76105–135	Redevelopment Works – Location 7	0657	1457	480	2.0	100	0	<0.01
76105–136	Redevelopment Works – Location 8	0659	1459	480	2.0	100	0	<0.01

Method: Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)] and in-house method AS101 – Membrane Filter Method for Estimating Airborne Asbestos Fibres.

Sampling: All samples have been taken by Airsafe personnel in accordance with the sampling plan detailed in method AS101.

Location of Laboratory Activities: Level 1, 488 Botany Road, Beaconsfield NSW 2015 Australia.

Quality Control: A field blank is taken and analysed for each batch of samples.

Environmental Conditions: Background air monitoring during removal works.

Comment: These calculated concentrations are less than the reporting limit of 0.01 fibres/mL for control and exposure monitoring as stated in the Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)].

Disclaimer: N/A

Sampled By: Pamela Mavroidis, Licensed Asbestos Assessor [SafeWork NSW Licence No LAA 002067].

Note: The measured results fall within a 95% confidence interval (calculated using a coverage factor of 2) in accordance with the NOHSC:3003(2005). The results relate only to the samples tested.

NATA is a signatory to the ILAC Mutual Recognition Arrangement for the mutual recognition of the equivalence of testing, medical testing, calibration, inspection, proficiency testing scheme providers and reference materials producers reports and certificates.

Airsafe shall not be liable for loss, cost, damages or expenses incurred by the client, or any other person or company, resulting from the use of any information or interpretation given in this report. In no case shall Airsafe be liable for consequential damages including, but not limited to, lost profits, damages for failure to meet deadlines and lost production arising from this report.

Any other holder of this document is advised that information contained hereon reflects Airsafe's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Airsafe's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents.

SITE MAP

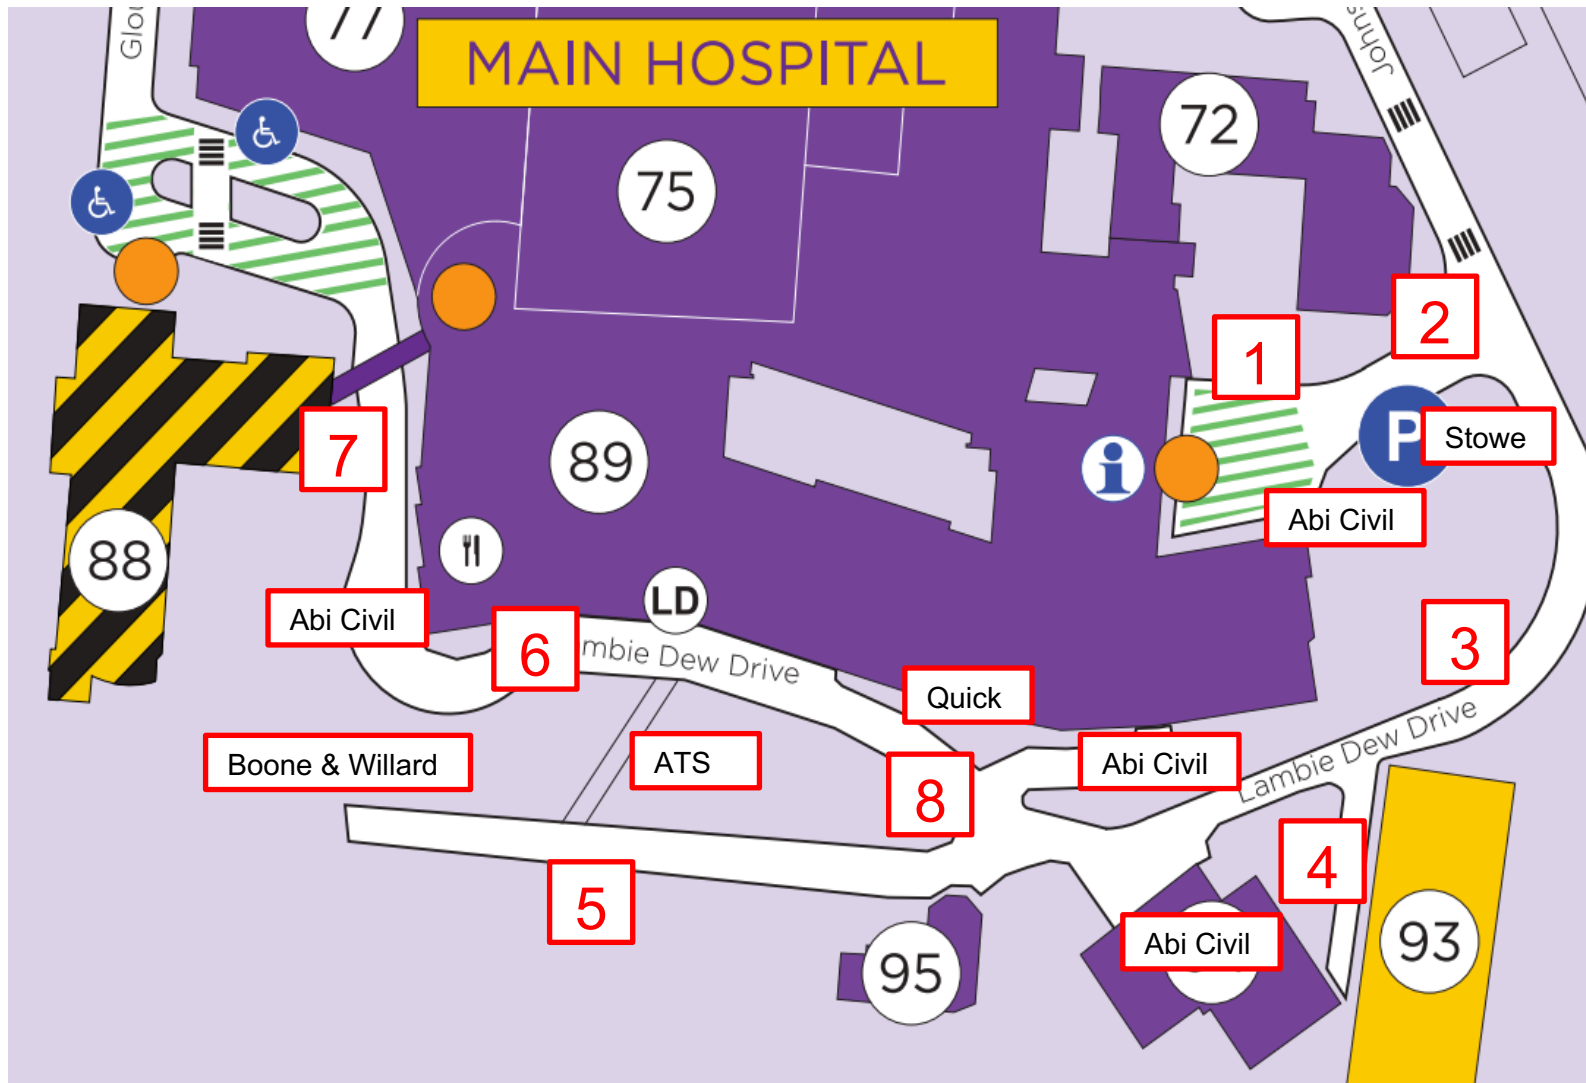


Figure 1. Air Monitoring Location.

TEST REPORT

February 03, 2025

CPB Contractors

2 & 4/177 Pacific Hwy,
North Sydney NSW 2060

Your Reference: Royal Prince Alfred Hospital – Redevelopment Works
Job Number: 76105

Attention: Zach Foster

Dear Zach,

In accordance with your instructions, Airsafe conducted air monitoring for airborne asbestos fibres at the above site.

The following samples were processed on the dates indicated.

Samples:	8 Filters
Date of Sampling:	31/01/25
Date of Analysis:	03/02/25
Date of Preliminary Report Sent:	Not Issued

The results are contained in the following pages of this report.

Should you have any queries regarding this report please contact the undersigned.

Yours faithfully
AIRSAFE LABORATORIES PTY LTD



Pamela Mavroidis
Approved Counter and Signatory

PROJECT: Royal Prince Alfred Hospital – Redevelopment Works
JOB NO: 76105

Sample No	Location/Reference	Time		Total Time [min]	Air Flow Average [L/min]	Fields	Fibres	Concentration (Fibres/mL)
		On	Off					
76105–137	Redevelopment Works – Location 1	0707	1507	480	2.0	100	0	<0.01
76105–138	Redevelopment Works – Location 2	0706	1506	480	2.0	100	0	<0.01
76105–139	Redevelopment Works – Location 3	0705	1505	480	2.0	100	0	<0.01
76105–140	Redevelopment Works – Location 4	0704	1504	480	2.0	100	0	<0.01
76105–141	Redevelopment Works – Location 5	0658	1458	480	2.0	100	0	<0.01
76105–142	Redevelopment Works – Location 6	0711	1511	480	2.0	100	0	<0.01
76105–143	Redevelopment Works – Location 7	0713	1513	480	2.0	100	0	<0.01
76105–144	Redevelopment Works – Location 8	0710	1510	480	2.0	100	0	<0.01

Method: Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)] and in-house method AS101 – Membrane Filter Method for Estimating Airborne Asbestos Fibres.

Sampling: All samples have been taken by Airsafe personnel in accordance with the sampling plan detailed in method AS101.

Location of Laboratory Activities: Level 1, 488 Botany Road, Beaconsfield NSW 2015 Australia.

Quality Control: A field blank is taken and analysed for each batch of samples.

Environmental Conditions: Background air monitoring during removal works.

Comment: These calculated concentrations are less than the reporting limit of 0.01 fibres/mL for control and exposure monitoring as stated in the Guidance Note on the Membrane Filter Method for Estimating Airborne Asbestos Fibres [NOHSC: 3003 (2005)].

Disclaimer: N/A

Sampled By: Pamela Mavroidis, Licensed Asbestos Assessor [SafeWork NSW Licence No LAA 002067].

Note: The measured results fall within a 95% confidence interval (calculated using a coverage factor of 2) in accordance with the NOHSC:3003(2005). The results relate only to the samples tested.

NATA is a signatory to the ILAC Mutual Recognition Arrangement for the mutual recognition of the equivalence of testing, medical testing, calibration, inspection, proficiency testing scheme providers and reference materials producers reports and certificates.

Airsafe shall not be liable for loss, cost, damages or expenses incurred by the client, or any other person or company, resulting from the use of any information or interpretation given in this report. In no case shall Airsafe be liable for consequential damages including, but not limited to, lost profits, damages for failure to meet deadlines and lost production arising from this report.

Any other holder of this document is advised that information contained hereon reflects Airsafe's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Airsafe's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents.

SITE MAP

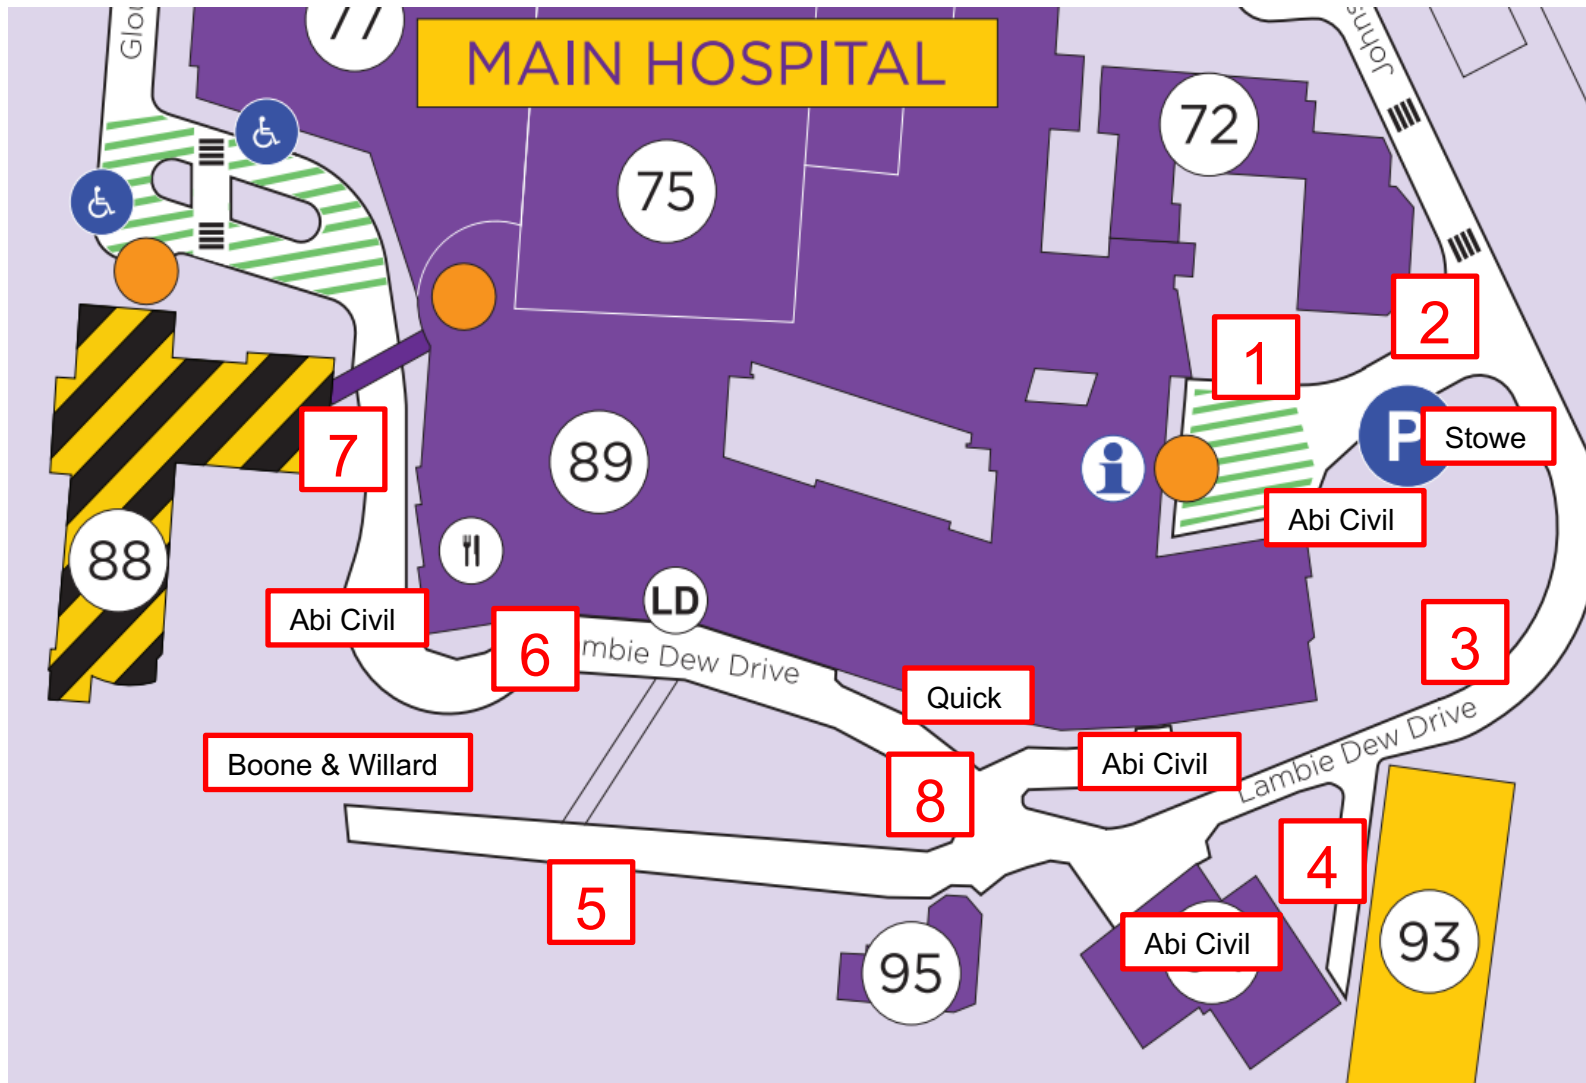


Figure 1. Air Monitoring Location.