

BCA Crown Certificate

Pursuant to Section 6.28 of the Environmental Planning & Assessment Act 1979

| | | |
|------------------------------|--|---|
| Certificate No. | CRO-24042 | |
| Date of Certificate | 23 May 2024 | |
| + Subject Land | | |
| Lot + DP | Lot 373 | DP 755952 |
| | Lot 1 | DP 1043088 |
| | Lot 1031 | DP 1208730 |
| | Lot 1302 | DP 1208730 |
| | Lot 102 | DP 1165533 |
| | Lot 104 | DP 1165533 |
| | Lot 7034 | DP 1031852 |
| Address | Shoalhaven Hospital, Scenic Drive, Nowra | |
| Local Government Area | Shoalhaven City Council | |
| + Applicant | | |
| Name | Rhys Collum | |
| Company | John Holland Group | |
| Address | Level 3, 63-65 Pirrama Rd, Pyrmont, NSW, 2009 | |
| Phone | Phone (02) 9552 4288 | Mobile 0472 573 672 |
| Email | rhys.collum@jhg.com.au | |
| + Owner | | |
| Name | Health Administration Corporation | |
| Address | 1 Reserve Road St Leonards, NSW 2065 | |
| Mobile | 0433 282 031 | |
| + Description of Development | | |
| Description | <p>CC#7: Landscaping and External Works, Excluding Public Domain Works, associated with the construction of a seven-storey hospital building with rooftop plant, helipad, ambulance entry from Shoalhaven Street, loading dock and mortuary parking, including demolition works, earthworks, tree removal, landscaping, and utility works.</p> <p><i>1. This staged BCA Crown Certificate has been issued for the building works described above only. Separate BCA Crown Certificate/s will be required prior to commencement of any subsequent works.</i></p> <p><i>2. This BCA Crown Certificate excludes any external ancillary services, structures or civil works required by relevant authorities.</i></p> | |
| BCA Classification | Class 9a (Health Care) Class 7b (Loading Dock) Class 4 (Sole dwelling within a building of non-residential nature) | |
| Applicable BCA | NCC Volume 1 2019 <u>Note:</u> NCC 2022 (to the exclusion of Part G5) has been adopted through a Performance Solution. | |
| Development Consent | Consent Number: SSD-35999468 MOD 1 MOD 2 MOD 3 MOD 4 | Date: 5 April 2023 Date: 8 June 2023 Date: 30 August 2023 Date: 07 March 2024 Date: 22 March 2024 |
| Statutory Certification | Pursuant to the provisions of Section 6.28 of the Environmental Planning and Assessment Act 1979, Blackett Maguire + Goldsmith Pty Ltd hereby certifies that the building works have been designed in accordance with the Building Code of Australia 2022, subject to the attached Conditions. | |
| Referenced Documentation | Refer to Schedule 1 | |
| Conditions and Exclusions | Refer to Schedule 2 | |

Fire Safety Schedule


Refer to Schedule 3

+ Details of Crown Certifier

Crown Certifier Blackett Maguire + Goldsmith Pty Ltd

Registration Number RBC00004

Signature

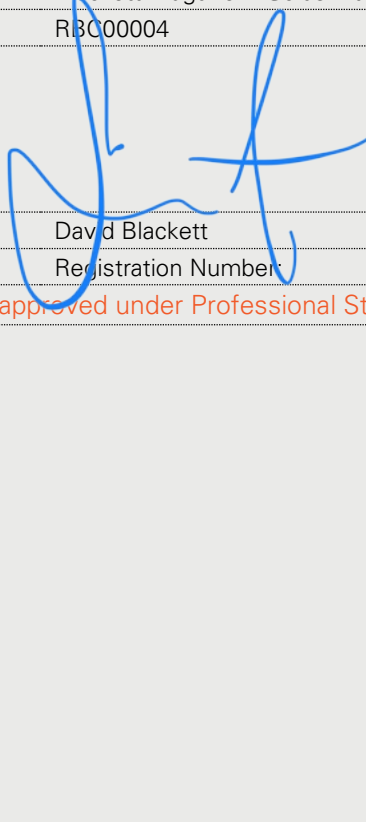

Signed on Behalf of BM+G

David Blackett

Registration Number

BDC 0032

Liability limited by a scheme approved under Professional Standards Legislation

Schedule 1 – Schedule of Documentation

Referenced Plans

+ Architectural Plans prepared by Conrad Gargett

| + Drawing Number | + Rev | + Date | + Drawing Number | + Rev | + Date |
|----------------------------|-------|----------|----------------------------|-------|----------|
| SHR-CGA-STW-DRG-ARC-06X000 | 04 | 18.04.24 | SHR-CGA-STW-DRG-ARC-06X001 | 03 | 18.04.24 |
| SHR-CGA-STW-DRG-ARC-06X002 | 03 | 24.04.24 | SHR-CGA-STW-DRG-ARC-06X003 | 04 | 09.05.24 |

Documentation Relied Upon

In conjunction with the approved plans and specifications the following documentation was relied upon in issuing the BCA Crown Certificate:

+ Documentation:

| + Item | + Documentation | + Prepared by | + Date |
|--------|---|---------------------------------------|------------------|
| 1. | Crown Certificate Application | John Holland Group | 02 May 2024 |
| 2. | Long Service Levy Receipt No. L0000117256 | Long Service Corporation | 18 April 2024 |
| 3. | Design Certificate | Site Image (NSW) Pty Ltd | 05 May 2024 |
| 4. | Civil Design Certificate | Meinhardt Bonacci Group (NSW) Pty Ltd | 23 February 2024 |
| 5. | Siteworks And Stormwater Drainage Plans | Architectus Conrad Gargett Pty Ltd | 24 April 2024 |
| 6. | Detention Plan | Architectus Conrad Gargett Pty Ltd | 24 April 2024 |
| 7. | Infiltration Swales and Basins Plans | Architectus Conrad Gargett Pty Ltd | 19 April 2024 |
| 8. | Geotechnical Interpretive Report | Cardno Pty Ltd | 29 June 2022 |
| 9. | Environmental Site Assessment | Cardno Pty Ltd | 28 February 2022 |
| 10. | Civil Design Certificate | Meinhardt Bonacci Group (NSW) Pty Ltd | 02 May 2024 |
| 11. | Civil Siteworks Plan | Architectus Conrad Gargett Pty Ltd | 21 February 2024 |
| 12. | Landscape Desing Statement | Site Image (NSW) Pty Ltd | 05 March 2024 |
| 13. | Hydraulic Design Certificate | OSKA Hydraulic Consultants Pty Ltd | 30 April 2024 |
| 14. | Electrical Services – Lighting Design Certificate | Heyday Group Pty Ltd | 09 May 2024 |
| 15. | Landscape Plan | Architectus Conrad Gargett Pty Ltd | 19 April 2024 |
| 16. | Architectural Design Statement | Architectus Conrad Gargett Pty Ltd | 01 May 2024 |
| 17. | Notice of Commencement | NSW Government | 20 May 2024 |

+ Schedule 2 – Conditions and Exclusions

This Crown Certificate has been issued subject to the following conditions:

1. This Crown Certificate does not certify compliance with the Conditions of the Development Consent SSD-35999468 dated 5 April 2023. The building works should not commence until the Crown is satisfied that the relevant conditions of the Development Consent that are a pre-requisite to commencement have been appropriately addressed where relevant.
2. No approval is given nor implied for the construction of works beyond the scope specifically approved by this Stage 7 Crown Certificate.
3. There is to be no impact, disruption, impediment or modification to existing active or passive fire safety systems or egress arrangements within the existing hospital building as a direct or indirect result of the proposed works without prior consultation and approval by the LHD (as applicable) and the crown certifier (BM+G).
4. Demolition works are to be undertaken in accordance with the documentation listed in Schedule 1 & AS 2601-2001.
5. Where the proposed demolition works necessitate the isolation and/or decommissioning of any existing fire services, particularly the fire hydrant system or the sprinkler system, then Fire & Rescue NSW and any relevant insurance providers should be notified prior to de-commissioning and/or isolation of the system.
6. All building works associated with the subject development are to be carried out in accordance with the approved documentation listed above in Schedule 1.

Any departure from the documentation cannot be undertaken without the review and approval by Blackett Maguire + Goldsmith.
7. Where there is any conflict between the Design Documentation and the advice provided by Blackett Maguire + Goldsmith, the advice issued takes precedence unless approved by Blackett Maguire + Goldsmith.
8. Any changes to the Architectural Documentation that may affect compliance with the Building Code of Australia or the referenced Australian Standards are to be appropriately disclosed to Blackett Maguire + Goldsmith for review.
9. Blackett Maguire + Goldsmith are to be contacted throughout the project for routine site inspections to ensure that the works are being carried out in accordance with the approved documentation.

+ Schedule 3 – Fire Safety Schedule

Part 10 of the Environmental Planning and Assessment Act (Development Certification and Fire Safety) Regulation 2021.

Please note:

- + A fire safety Schedule must deal with the whole of the building not just part of the building.
- + Please complete all sections in full using CAPITAL LETTERS

Section 1: Location of building

Address (Street No., Street Name, Suburb and Postcode)

SHOALHAVEN HOSPITAL, SCENIC DRIVE, NOWRA

| Lot No. (if known) | CP/DP/SP No. (if known) | Building name (if applicable) |
|--------------------|-------------------------|-------------------------------|
| LOT 373 | DP 755952 | SHOALHAVEN HOSPITAL |
| LOT 1 | DP 1043088 | |
| LOT 1031 | DP 1208730 | |
| LOT 1302 | DP 1208730 | |
| LOT 102 | DP 1165533 | |
| LOT 104 | DP 1165533 | |
| LOT 7034 | DP 1031852 | |

Section 2: Reissue of Fire Safety Schedule (Section 80A of the Regulation)

- ☒ Not applicable – Fire Safety Schedule is not being re-issued.
- ☐ Reissued Fire Safety Schedule (please state reason below)

Reason for Reissue of Schedule

- ☐ Original Schedule Lost or Destroyed ☐ Correction of errors or omissions.

Section 3: Reference Details (Section 78 of the Regulation)

| Reference Type | Reference Number (if known) |
|--------------------------|-----------------------------|
| CONSTRUCTION CERTIFICATE | CRO-24042 |

Section 4: Fire Safety Measures for the building – excluding Critical Fire Safety Measures (Section 79 of the Regulation)

| + Item No. | + Fire safety measure | + Minimum standard of performance |
|--|---|---|
| Proposed (New or Modified including section 84(6) of the Regulation) | | |
| 1. | ACCESS PANELS, DOORS & HOPPERS | BCA CLAUSE C4D14 AS 1530.4 – 2014 AND MANUFACTURER'S SPECIFICATIONS FIRE SAFETY ENGINEERING REPORT PREPARED BY ARUP REPORT NO. ARUP-RPT-296844-FER-ASB, REVISION D DATED 20 MARCH 2024. |
| 2. | ALARM SIGNALLING EQUIPMENT | AS 1670.3 – 2018 |
| 3. | AUTOMATIC FAIL SAFE DEVICES | BCA CLAUSE D3D26 |
| 4. | AUTOMATIC FIRE DETECTION & ALARM SYSTEM | BCA SPEC. 20 AS 1670.1 – 2018 |

| + Item No. | + Fire safety measure | + Minimum standard of performance |
|------------|--|---|
| | | FIRE SAFETY ENGINEERING REPORT PREPARED BY ARUP REPORT NO. ARUP-RPT-296844-FER-ASB, REVISION D DATED 20 MARCH 2024. |
| 5. | AUTOMATIC FIRE SUPPRESSION SYSTEMS | BCA SPEC. 17 AS 2118.1 – 2017, AS 2118.6 – 2012 FIRE SAFETY ENGINEERING REPORT PREPARED BY ARUP REPORT NO. ARUP-RPT-296844-FER-ASB, REVISION D DATED 20 MARCH 2024. |
| 6. | EMERGENCY LIFTS | BCA CLAUSE E3D5 AS 1735.2 – 2001 |
| 7. | EMERGENCY LIGHTING | BCA CLAUSE E4D2 & E4D4 AS 2293.1 – 2018 |
| 8. | EMERGENCY EVACUATION PLAN | AS 3745 – 2010 FIRE SAFETY ENGINEERING REPORT PREPARED BY ARUP REPORT NO. ARUP-RPT-296844-FER-ASB, REVISION D DATED 20 MARCH 2024. |
| 9. | EMERGENCY WARNING INTERCOM SYSTEM (EWIS) | BCA E4D9 AS1670.4 – 2018 FIRE SAFETY ENGINEERING REPORT PREPARED BY ARUP REPORT NO. ARUP-RPT-296844-FER-ASB, REVISION D DATED 20 MARCH 2024. |
| 10. | EXIT SIGNS | BCA CLAUSES E4D5, NSW E4D6 & E4D8 AS 2293.1 – 2018 |
| 11. | FIRE CONTROL ROOM | BCA SPEC 19 FIRE SAFETY ENGINEERING REPORT PREPARED BY ARUP REPORT NO. ARUP-RPT-296844-FER-ASB, REVISION D DATED 20 MARCH 2024. |
| 12. | FIRE BLANKETS | AS 3504 – 1995 & AS2444 – 2001 |
| 13. | FIRE DAMPERS | BCA CLAUSE C4D15 AS 1668.1 – 2015 & AS 1682.1 & 2 – 2015 AND MANUFACTURER'S SPECIFICATION FIRE SAFETY ENGINEERING REPORT PREPARED BY ARUP REPORT NO. ARUP-RPT-296844-FER-ASB, REVISION D DATED 20 MARCH 2024. |
| 14. | FIRE DOORS | BCA CLAUSE C3D13, C3D14, C4D3, C4D5, C4D6, C4D8, C4D9 & C4D12 AS 1905.1 – 2015 AND MANUFACTURER'S SPECIFICATION FIRE SAFETY ENGINEERING REPORT PREPARED BY ARUP REPORT NO. ARUP-RPT-296844-FER-ASB, REVISION D DATED 20 MARCH 2024. |
| 15. | FIRE HOSE REELS | BCA CLAUSE E1D3 AS 2441 – 2005 FIRE SAFETY ENGINEERING REPORT PREPARED BY ARUP REPORT NO. ARUP-RPT-296844-FER-ASB, REVISION D DATED 20 MARCH 2024. |
| 16. | FIRE HYDRANT SYSTEMS | BCA CLAUSE E1D2 AS 2419.1 – 2021 FIRE SAFETY ENGINEERING REPORT PREPARED BY ARUP REPORT NO. ARUP-RPT-280524-FER-ASB REVISION A DATED 17 FEBRUARY 2023. |

| + Item No. | + Fire safety measure | + Minimum standard of performance |
|------------|--|---|
| 17. | FIRE SEALS | BCA CLAUSE C4D15, AS 1530.4 – 2014 & AS 4072.1 – 2014 AND MANUFACTURER'S SPECIFICATION FIRE SAFETY ENGINEERING REPORT PREPARED BY ARUP REPORT NO. ARUP-RPT-296844-FER- ASB, REVISION D DATED 20 MARCH 2024. |
| 18. | LIGHTWEIGHT CONSTRUCTION | BCA CLAUSE C2D9 AS 1530.4 – 2014 AND MANUFACTURER'S SPECIFICATION FIRE SAFETY ENGINEERING REPORT PREPARED BY ARUP REPORT NO. ARUP-RPT-296844-FER- ASB, REVISION D DATED 20 MARCH 2024. |
| 19. | MECHANICAL AIR HANDLING SYSTEMS (AUTOMATIC SHUTDOWN) | BCA CLAUSE E2D3 AS/NZS 1668.1 – 2015 & AS 1668.2 – 2012 |
| 20. | PORTABLE FIRE EXTINGUISHERS | BCA CLAUSE E1D14 AS 2444 – 2001 FIRE SAFETY ENGINEERING REPORT PREPARED BY ARUP REPORT NO. ARUP-RPT-296844-FER- ASB, REVISION D DATED 20 MARCH 2024. |
| 21. | REQUIRED EXIT DOORS (POWER OPERATED) | BCA CLAUSE D3D24(2) |
| 22. | SMOKE HAZARD MANAGEMENT SYSTEMS + STAIR PRESSURISATION + ZONE SMOKE CONTROL | BCA PART E2 AS/NZS 1668.1 –2015 FIRE SAFETY ENGINEERING REPORT PREPARED BY ARUP REPORT NO. ARUP-RPT-296844-FER- ASB, REVISION D DATED 20 MARCH 2024. |
| 23. | SMOKE DAMPERS | BCA SPEC 11 AS/NZS 1668.1 – 2015 FIRE SAFETY ENGINEERING REPORT PREPARED BY ARUP REPORT NO. ARUP-RPT-296844-FER- ASB, REVISION D DATED 20 MARCH 2024. |
| 24. | SMOKE DOORS | BCA SPEC 11 & 12 FIRE SAFETY ENGINEERING REPORT PREPARED BY ARUP REPORT NO. ARUP-RPT-296844-FER- ASB, REVISION D DATED 20 MARCH 2024. |
| 25. | WALL-WETTING SPRINKLERS | BCA CLAUSE C4D5 AS 2118.2 – 2010 FIRE SAFETY ENGINEERING REPORT PREPARED BY ARUP REPORT NO. ARUP-RPT-296844-FER- ASB, REVISION D DATED 20 MARCH 2024. |
| 26. | WARNING & OPERATIONAL SIGNS | BCA CLAUSE D3D28, D4D7, E3D4. AS 1905.1 – 2015 & SECTION 108 OF THE EP&A (DCFS) REGULATION 2021 FIRE SAFETY ENGINEERING REPORT PREPARED BY ARUP REPORT NO. ARUP-RPT-296844-FER- ASB, REVISION D DATED 20 MARCH 2024. |

Details of Fire Safety Building Code of Australia (BCA) Performance Solutions Report(s)

| + (Ref No./Title of report/Author/Date) | + BCA Performance Requirement(s) | + BCA DtS Provision(s) and details of non-compliance |
|---|----------------------------------|---|
| FIRE SAFETY ENGINEERING REPORT PREPARED BY ARUP REPORT NO. ARUP-RPT-296844-FER-ASB, REVISION D DATED 20 MARCH 2024. | C1P2, C1P3 | C3D6 <ul style="list-style-type: none"> + TO ALLOW FIRE COMPARTMENTS IN PATIENT CARE AREAS TO BE A MAXIMUM OF 2100M2 IN LIEU OF 2000M2 + TO ALLOW FIRE COMPARTMENTS IN WARD AREAS TO BE A MAXIMUM OF 1100M2 IN LIEU OF 1000M2. + TO ALLOW SMOKE COMPARTMENTS IN WARD AREAS TO BE A MAXIMUM OF 600M2 IN LIEU OF 500M2. + TO ALLOW SMOKE COMPARTMENTS IN TREATMENT AREAS TO BE A MAXIMUM OF 1200M2 IN LIEU OF 1000M2. |
| | C1P2, C1P3 | C2D2 / SPEC 5 TO ALLOW WALL WETTING SPRINKLERS FOR NON-FIRE RESISTING GLAZING IN COMPARTMENT WALLS |
| | C1P2, C1P3 | D2D17 TO ALLOW A NON-REQUIRE NON-FIRE-ISOLATED STAIRWAY TO CONNECT LEVELS 2-6 OF THE ASB PATIENT-CARE AREAS. |
| | C1P2, C1P3, C1P4 | C2D2/SPEC5, C3D15, C4D12 TO ALLOW CLASS 4 ROOMS TO BE CONSTRUCTED IN ACCORDANCE WITH THE REQUIREMENTS FOR CLASS 9A. <ul style="list-style-type: none"> + LOADBEARING WALLS OF THE SUBJECT CORRIDORS TO ACHIEVE 120/-/ IN LIEU OF 90/90/90. + NON-LOADBEARING WALLS OF THE SUBJECT CORRIDORS SHALL NOT ACHIEVE AN FRL, IN LIEU OF -/90/90; + DOORWAYS THAT PROVIDE ACCESS TO THE SUBJECT CORRIDORS FROM A ROOM NOT WITHIN A SOLE-OCCUPANCY UNIT (I.E. OVERNIGHT ROOM) SHALL NOT BE PROTECTED; + WALLS OF THE SUBJECT CORRIDORS SHALL NOT BE SMOKE PROOF. |
| | C1P2 | C4D4 TO PROVIDE THE REQUIRED LEEL OF PROTECTION ONLY BY FIRE PROTECTING ONE WALL (INCLUDING OPENINGS) WITH 120/120/120 FRL IN IEU OF BOTH WALLS AND PROTETION OF WINDOW OPENINGS WITH DTS WALL WETTING SPRINKLERS PROVIDED INTERNALLY AND EXTERNALLY. |
| | C1P2, C1P3, C1P8, E2P2 | C4D15, SPECC 11, E2D3(2) OMISSION OF SMOKE DAMPERS FROM DUCTS THAT ARE REQUIRED TO CONTINUE TO OPERATE IN FIRE MODE, WHERE A SMOKE DAMPER WOULD IMPEDE THE OPERATIONAL FUNCTION OF THE DUCT. |

| | |
|-------------------|--|
| D1P4, D1P5, E2P2 | D2D12, D2D14, E2D4 TO ALLOW DISCONTINUOUS STAIRWAYS: <ul style="list-style-type: none"> + Stair 7 and 8 to only connect level 6-8. + The open stair from the helipad to connect level 7-8. |
| D1p4, e2p2 | D2D5, D2D6 TO ALLOW EXTENDED TRAVEL DISTANCES: PATIENT CARE AREAS <ul style="list-style-type: none"> + UP TO 18M TO A POINT OF CHOICE IN LIEU OF 12M. + UP TO 42M TO AN EXIT IN LIEU OF 30M. + UP TO 57M BETWEEN ALTERNATIVE EXITS, IN LIEU OF 45M. NON-PATIENT CARE AREAS <ul style="list-style-type: none"> + UP TO 30M TO A POINT OF CHOICE IN LIEU OF 20M. + UP TO 52M TO AN EXIT IN LIEU OF 40M. + UP TO 72M BETWEEN ALTERNATIVE EXITS IN LIEU OF 60M. |
| C1P2, C1P3 | C4D6 TO ALLOW FIRE DOORS TO COMPRISE AN EXCESSIVE AMOUNT OF THE LEVEL 1 FIRE-ISOLATED CORRIDOR CONNECTING TO STAIR 3. |
| D1P4, E2P2 | D2D16 TO NOT PROVIDE A VERTICAL EXIT TO ALL COMPARTMENTS. |
| D1P2 | D3D22 TO ALLOW THE HANDRAIL ON THE LEVEL 8 HELIPAD TO NOT EXTEND AT THE TOP OF THE STAIRS. |
| D1P2 | D3D24 TO ALLOW SLIDING DOORS TO BE PROVIDED TO PATIENT ROOMS AND ENTRANCE AIRLOCKS. |
| D1P2(b) | SPEC 11, SPEC 12, D3D25 TO ALLOW DOORS IN REQUIRED EXITS TO SWING AGAINST THE DIRECTION OF EGRESS. |
| D1P2 | D3d26 TO ALLOW ANTI-LIGATURE DOOR HARDWARE TO BE INSTALLED THROUGHOUT THE MENTAL HEALD DEPARTMENT (NON-SINGLE ACTION). |
| E1P4 | E1D4, SPEC 17 TO ALLOW CONCEALED SPRINKLERS IN OPERATING THEATRES AND ASSOCIATED STERILE ROOMS. |
| E1P1 | E1D3 TO PERMIT FIRE HOSE REEL COVERAGE SHORTFALLS. |
| E1P4 | E1D4, SPEC 17 TO OMIT SPRINKLERS FROM ELECTRICAL ROOMS AND CUPBOARDS CONTAINING ELECTRICAL DISTRIBUTION BOARDS. |
| E1P1, E1P2, E1P3, | E1D2, E1D3, E1D14, SPEC 20, E4D9 |

| | |
|-------------|--|
| E2P2, EP4.3 | TO RATIONALISE SECURE FIRE SAFETY SYSTEMS TO PREVENT UNAUTHORISED ACCESS IN THE MENTAL HEALTH FACILITY. |
| E2P1 | E2D7, SPEC 20 TO ALLOW SMOKE DETECTION WITHIN THE ILING VOID TO BE SPACED ON A 15M GRID IN LIEU OF 10M GRID SPACING. |
| E4P3 | E4D9 OMISSION OF EWIS SPEAKERS FROM PATIENT CARE ROOMS. |
| C1P2, C1P3 | C2D2/SPEC 5, C3D32, C3D6, C3D8 + TO ALLOW THE FIRE RESISTING SLAB AND FIRE WALLS TO TERMINATE AT THE BACKPAN OF THE EXTERNAL WALL. + TO ALLOW COMPARTMENTS FLOOR AREA LIMITATIONS TO BE EXCEEDED. |
| C1P1, C1P2 | C2D2, SPEC 5, C4D3 TO RATIONALISE THE EXPOSURE REQUIREMENTS OF THE ASB TO BUILDING B. |
| E1P1, E1P3 | E1D2 AS 2419.1:2021 E1D3 TO ALLOW FIRE HYDRANT AND HOSE REELS TO BE LOCATED ON THE MID LANDING OF THE OPEN STAIR TO THE HELIPAD. |
| E1P3, E1P4 | E1D2 E1D4 AS 2118.1 AS 2419.1:2021 TO ALLOW THE BOOSTER ASSEMBLY TO NOT BE LOCATED AT THE BOUNDARY OF THE SITE. |
| E1P2 | E1D14, AS 2444 TO ALLOW A SPECIALIST FIRE EXTINGUISHER NOT COMPLYING WITH THE REQUIREMENTS OF AS 1841 TO BE INSTALLED TO THE MRI ROOMS. |
| E1P3, E1P4 | E1D2 E1D4, SPEC 17 AS 2419.1:2021, AS 2118.1:2017, AS 2941:2013 TO ALLOW AN ENCLOSURE THAT DOES NOT ONLY CONTAIN FIREFIGHTING PUMPSETS AND ASSOCIATED EQUIPMENT FOR ASB LEVEL 00 PLANTROOM. |
| E2P2 | E2D7 OMISSION OF ZONE PRESSURISATION TO HELIPAD LOBBY. |
| C1P2 | C2D2/SPEC 5 C4D3 TO OMIT THE REQUIREMENT FOR SEPARATION OF ALLOTMENT BOUNDARIES FOR THE ASB AND BUILDING B. |
| E1P3 | E1D2 AS 2419.1:2021 TO ALLOW FIRE HYDRANTS TO BE LOCATED MORE THAN 4M OF A REQUIRED EXIT. |
| C1P1 | C2D2/SPEC 5 TO OMIT AN FRL OF 120/- FROM THE LINK BRIDGE. |
| C1P4 | SPECIFICATION 7, S7C5 OMISSION OF FIRE HAZARD PROPERTIES TO CHEMICAL FLUES. |

| | | |
|--|------------|---|
| | C1P2 | C4D13, SPECIFICATION 5 – CLAUSE S5C8 OMISSION OF FIRE RESISTING SHAFT WALLS FOR LEVEL 7 PLANT ROOM. |
| | E2P2 | E2D7, SPECIFICALLY CL 2.5.2 OF AS 1682.1 (2015) TO ALLOW A SMOKE EXHAUST DUCT TO SERVE MULTIPLE FIRE COMPARTMENTS. |
| | E2P2 | E2D3, E2D7, AS1668.1:2015 TO OMIT ZONE PRESSURISATION FROM THE LINK BRIDGE. |
| | C1P2, E1P4 | E1D4 TO OMIT SPRINKLERS FROM UNDERCROFT AREAS. |
| | C1P2, C1P8 | C2D2, C4D15 TO ALLOW MEDICAL GAS PIPE PENETRATIONS TO ACHIEVE AN FRL OF -/180/180 IN LIEU OF -/240/240. |

Section 5: Critical Fire Safety Measures – where applicable to the building (Section 79 of the Regulation)

Note: A critical fire safety measure is one where the performance is verified at intervals of less than 12 months through the submission of a supplementary fire safety statement.

| + Item No. | + Fire safety measure | + Minimum standard of performance |
|--------------------|-----------------------|-----------------------------------|
| Current (Existing) | | |
| 1. | N/A | |

| | | |
|----------------------------|-----|--|
| Proposed (New or Modified) | | |
| 1. | N/A | |

Section 6: Details of approved exemptions from compliance with BCA standards for a relevant fire safety system (Section 74 of the Regulation)

| + Item No. | + Relevant fire safety measures | + Description of exemption |
|------------|---------------------------------|----------------------------|
| 1. | N/A | |

Section 7: Name of authority or registered certifier issuing this schedule

| | |
|---|--------------------------------------|
| Name | Organisation (Business name) |
| DAVID BLACKETT | BLACKETT MAGUIRE + GOLDSMITH PTY LTD |
| Business Address (Street No., Street Name, Suburb and Postcode) | |
| SUITE 2.01, 22-36 MOUNTAIN ST, ULTIMO NSW 2007 | |
| Registration Number (Where Applicable) | |
| RBC00004 (BDC0032) | |
| Date of Issue | |
| 23/05/2024 | |